

**BEFORE THE GUJARATELECTRICITYREGULATORYCOMMISSION
GANDHINAGAR**

Petition No. _____ of 2023

IN THE MATTER OF:

Petition under Section 63 read with 86(1)(b) and other applicable provisions of the Electricity Act 2003 seeking for adoption of tariff discovered under tariff based competitive bidding process conducted by UGVCL vide RfS No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104 Dtd.15,16 & 17.03.2023 for 36 Nos of solar plants of total 104.5MW,through RESCO model, for solarization of various 11 KV feeders in UGVCL for implantation of FLS (Feeder Level Solarization) under PM KUSUM-C scheme of Government of India.

PETITIONER

Uttar Gujarat Vij Company Limited, Mehsana

PETITIONER MOST RESPECTFULLY SUBMITS THAT

1. Preamble

- 1) The Government of Gujarat (hereinafter referred to as "GoG") has notified the Gujarat Electricity Industry (Reorganization and Regulation) Act 2003 (herein after called as "Act") in May 2003 for the reorganization of the entire power sector in the State of Gujarat.
- 2) Pursuant to the Gujarat Electricity Industry Reorganization and Comprehensive Transfer Scheme, 2003 notified under the Gujarat Electricity Industry (Reorganization and Regulation) Act 2003, erstwhile Gujarat Electricity Board has been reorganized and its functions have been vested in different entities.
- 3) The activities of Generation, Transmission, Distribution, Bulk power purchase and supply undertaken by erstwhile Gujarat Electricity Board has been entrusted to separate seven functional entities. The generation activity is assigned to Gujarat State Electricity Corporation Ltd. (GSECL), the transmission activity is assigned to Gujarat Energy Transmission Corporation Ltd. (GETCO) and the distribution activity is assigned to four Distribution companies viz. Uttar Gujarat Vij Company Ltd. (UGVCL), Madhya Gujarat Vij Company Ltd. (MGVCL), Dakshin Gujarat Vij Company Ltd. (DGVCL) and Paschim Gujarat Vij Company Ltd. (UGVCL) -



Petitioner. The function of Bulk purchase and Bulk sale of power is assigned to Gujarat UrjaVikas Nigam Ltd. (GUVNL) as per the re-organization scheme.

It is submitted that the present petition is filed **under Section 63 read with 86(1) (b) and other applicable provisions of the Electricity Act 2003 seeking** approval of adoption of the tariff discovered under tariff based competitive bidding process for the PM KUSUM component - C FLS (Feeder Level Solarization) scheme conducted by the petitioner through RfS (Request for Solarization) No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104 Dtd.15,16 & 17.03.2023.

2. SUBMISSION: -

2.1 The Ministry of Power, Government of India, vide notification OM 32/645/2017-SPV Division dated 22/07/2019 has published "Guidelines for Implementation of Pradhan Mantri Kisan Urja Suraksha evam Utthan Mahabhiyan (PM KUSUM) Scheme for installation of solar pumps and grid connected solar power plants, covering three components, viz.

- Component A: Decentralized Ground Mounted Grid Connected Renewable Energy (RE) based Power Plants of individual plant size up to 2.0 MW.
- Component B: Installation of standalone Solar Powered Agriculture Pumpsets
- Component C: Solarization of Grid-connected Agriculture Pumps which

Subsequently, Government of Gujarat vide notification dated 11/12/2020, 19/06/2020 and 6/11/2020 has issued GR for implementation of PM-KUSUM schemes under component A, B & C, which is attached herewith as **Annexure-A (colly.)**

Accordingly, the petitioner has been implementing the PM KUSUM schemes in the UGVCL area.

Subsequently, the Ministry of New and Renewable Energy (MNRE), Government of India, vide Office Memorandum No. 32/645/2017- SPV Division, dated 4th December, 2020 has issued guidelines for implementation of **Feeder Level Solarization under component-C of PM-KUSUM Scheme.**

Brief highlights of the guidelines dated 4th December 2020 are as under:

- (a) Under the scheme, agriculture feeders already segregated or feeders having major agriculture load, may be solarized using installation of grid connected solar power plant to cater the annual power requirement of feeder(s).
- (b) The requirements of total annual power for an agriculture feeder will be assessed and a solar power plant of capacity that can cater to the requirement of annual power



for that agriculture feeder can be installed either through CAPEX mode / RESCO mode, which will supply solar power to those feeders.

- (c) Feeder level solar power plant may be installed to cater to the requirement of power for a single feeder or multiple agriculture feeders emanating from a Distribution Sub-Station (DSS) to feed power at 11 KV or at the higher voltage level side of the DSS depending upon the factors like availability of land, technical feasibility etc. and there is no cap of the capacity of solar power plant for feeder level solarization.
- (d) As per the guidelines, the cost of solar plant is benchmarked at Rs. 3.5 Crore/MW for the purpose of providing Capital Financial Assistance(CFA) of Rs. 1.05 Crore/MW. Under the scheme, solarization of agricultural pumpsets of any capacity is allowed, however in case of pumps capacity above 7.5 HP, the CFA will be limited to solar capacity for 7.5 HP Pumps.
- (e) Guaranteed CUF: The solar capacity requirement for catering agricultural pump-sets load (with ceiling limit of 7.5 HP pump-sets) on the feeder for feeder level solarization shall be worked out considering fixed CUF (Capacity Utilization Factor) of 19% i.e., no deration permitted. The annual CUF will be calculated every year from 1st April of the year (COD for first year) to 31st March next year.

Under the scheme, initially the MNRE, Government of India, vide letter 32/54/2018-SPV Division dated 18 May, 2022 has sanctioned the 39,332 nos. of quantity as well as vide letter 32/54/2018-SPV Division dated 05 August, 2022 has sanctioned the 2,60,668 nos. of quantity of existing agriculture pump-sets for state owned DISOCMs of GUVNL (Gujarat UrjaVikas Nigam Limited) to be solarized. Subsequent to this, GUVNL, vide letter dated 21st June, 2022 has conveyed UGVCL to invite tariff based competitive bid for various solar power plants under 66 KV sub-stations by 0.5 MW and above, covering multiple agriculture feeders, catered from the sub-stations and having at least 90% agriculture connections up to 7.5 HP firstly. In case of 90% criteria not met, DISCOMs may select feeders in downgrade manner gradually as per the scheme's guideline. The scheme guideline and its amendments are enclosed herewith as **Annexure- B (Colly.)**

- 2.2 On the basis of above guideline, the petitioner has invited RFS (Request for Selection) for setting up of solar power projects under RESCO model.

Brief of the RFS is as under:

- (a) Petitioner conducted the tendering process and invited bids vide RfS No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104 Dtd. 15, 16 & 17.03.2023 through public notice in One Gujarati + One English All India edition + One Financial daily All India edition newspapers for design, survey, supply, installation, testing,



commissioning, operation & maintenance for 25 years (unless extended beyond 25 years by both the parties on mutual agreement) from COD of grid connected feeder level solar power plants, its associated 11KV line to connect the plant with concerned sub-station and RMS (Remote Monitoring System) of solar power plant through RESCO model for solarization of various 11KV feeders of 66 KV substation in UGVCL area as per MNRE guideline under PM-KUSUM scheme Component-C (Feeder Level Solarization) dated 10/02/2022 and its amendments received time to time. Copies of the RFS and public notices of the tender are attached herewith at **Annexure-C (Colly.)** and MNRE guidelines at **Annexure –D(Colly.)**

List of solar power plants with detail of name of sub-station, nos of Ag. feeders, plant capacity in MW is published in RFS as per MNRE guidelines. Summary of plants published under TN-42 to TN-104 RFS is as under:

Sr No.	No. of Solar plants (66 KV Substations) against which bids invited	No. of 11 KV Ag. Dom Feeders covered	No. of grid connected Ag. Consumers covered having contracted load up to 7.5 HP	Aggregate Notified Solar Capacity of all plants (MW) after round off
1	63	357	60,524	208.5


(Detailed breakup of plants is mentioned in **Annexure-3** of **TN-42 to TN- 104**
Tender placed at Annexure-G of the petition)

(b) Salient feature:

1	Solar PV Plant technology	All components used for installation of solar power plants shall conform to applicable BIS / MNRE specifications and follow quality control guidelines issued by MNRE. It will be mandatory to use domestically manufactured modules only. As per recent amendment by MNRE vide Office Memorandum No: 283/16/2023- GRID SOLAR, Dtd.10.03.2023 (Requirements for Compulsory Registration) Order, 2019 it is to consider that ALMM order is held in abeyance for one financial year, i.e. FY 2023-24. Thus Projects commissioned by 31.03.2024 will be exempted from the requirement of procuring Solar PV modules from ALMM. However, Order/clarifications issued by MNRE in this regard from time to time will be applicable.
2	Project location & land arrangement	Project location: The location of the Solar Power project will be preferably within Five KM radius of the selected sub-stations in order to avoid high cost of evacuation line and losses. Project land: It shall be the responsibility of SPG to identify and arrange for required project land on ownership / lease basis. In case of lease land, the minimum period of lease agreement shall be such that it shall cover the 25 years of PPA and UGVCL and/or Govt. assumes no responsibility in procuring



		/ arranging for project land.
3	Delivery point	11 KV Bus of associated 66Kv/11kvs substation.
4	Notified Solar Capacity	The notified solar capacity against each sub-station is as per Annexure 3 of RFS .
5	Bid capacity to participating in the bid	There shall be single bid for each selected sub-station. The bidder is allowed to bid for a minimum capacity of 0.5 MWp and maximum upto notified capacity for the respective Sub-station in multiple of 0.5 MWp.
6	Location wise project capacity	Irrespective of capacity bided for a given sub-station Sub-station, the solar project capacity at single location shall be minimum 0.5 MWp & maximum upto 4 MWp. The bidder shall have discretion to install solar power project at multiple location for bided capacity under the given bid considering the availability of land. It is to clarify that in case of bided capacity is more than 4 MW, the bidder is allowed to set up solar project for more than 4MWp at single location subject to establishment of multiple 11 KV evacuation line & separate metering arrangement for each line considering limit of 4 MWp for 11 KV line.
7	Evacuation of Power & metering arrangement	The bidder shall be responsible to deliver the power upto 11 KV bus of selected 66/11 KV sub-station. The 11 KV evacuation line shall be constructed and maintained by the bidder during the tenure of PPA. The use of common 11 KV evacuation line for multiple projects and amongst multiple bidders shall be encouraged to optimize the resources. The summation of power from all line (upto 4 MW) will be feed to a single 11 KV Panel and the cost of the panel and related infrastructure at receiving sub-station end shall be borne by and among the generators through proportionate sharing basis. For metering purpose, the individual receiving end ABT Meters should be put up by the generator by erecting the CTPT Unit at SS Wall. In no case, evacuation at 66 KV voltage level shall be permitted.
8	Guaranteed CUF / min CUF	19%(fixed i.e. no deration permitted) CUF in a Year shall mean the ratio of the net output energy injected at delivery point of the SPV Power Plant in a Financial Year versus installed Project capacity x 365 x 24 (i.e. CUF = Cumulative Project output in kWh / (installed Project capacity in kWp x 24 x 365)) The annual CUF will be calculated every year from 1st April of the year (COD for first year) to 31st March next year. However, SPG can add additional DC capacity to maintain 19% CUF in a year, for the entire period of PPA subject to CEA approval, if required
9	Eligible CFA by MNRE	Successful bidder shall be eligible to get CFA@ Rs.1.05CrperMW considering capital cost of solar project at Rs. 3.50 Crores per MW (subject to installation & commissioning of project in line with MNRE requirement).



		CFA up to 100% of the total eligible CFA will be released to the project entity through UGVCL on successful operation and performance of solar plant for two months after the commissioning subject to achieving guaranteed CUF agreed in PPA at least for one month CUF as per minimum CUF agreed in PPA, subject to further sanction and release of CFA by MNRE-Gol. SPG shall give an undertaking that he shall not sell power to any other party / buyer except the UGVCL during the tenure of PPA. At any point of time during the tenure of PPA, if it is found that the SPG has sold power produced from the solar plant to other party / buyer, strict legal action will be initiated against such SPG, including stop deal or black list from Participation in future tender of MNRE in Gujarat and the SPG shall require to refund the proportionate CFA granted for the project by MNRE to UGVCL. For the recovery of Proportionate CFA in case of default, the disbursed CFA will be divided by 25 years to arrive at CFA per year and the CFA shall be recovered for the balance period of PPA upon noticing the default. The recovery of the proportionate CFA will be made through the payments of invoices or through remedies taken in accordance with applicable laws. In case of any liquidation of assets of the solar power plants prior to completion of PPA period the first charge shall be towards recovery of the proportionate CFA granted to the project.
10	Mode of submission	All required documents are to be submitted in online mode only except documents required against payment of tender fee & earnest money deposit (EMD) etc. as specified in tender shall be required to submit in physical mode also.
11	Selection criteria	The bidder(s) shall be selected in ascending order of quoted tariff upto notified project capacity of the sub-station under bucket filling mode through reverse auction e-bidding. Say, a bidder who has quoted lowest tariff shall be awarded solar capacity for which bid is submitted and thereafter subsequent lowest bidder, and so on, till the notified capacity of given 66 KV Sub-station is exhausted.
12	Bid Validity	120days from the date of opening of online Technical bid.
13	Performance Bank Guarantee(PBG) against commissioning	Performance Bank Guarantee (PBG) of Rs. 5 Lakh / MW basis is required to be submitted to UGVCL by the successful bidder upon issuance of Letter of Award by UGVCL towards payment security mechanism for recovery of liquidated damages for delay in commissioning of solar power project beyond scheduled commercial operation date. The PBG will be returned to the SPG after successful commissioning of solar power plant within scheduled commercial operation date. The PBG shall be valid from the date of issue until 2months (i.e. sixty (60) days) beyond scheduled commercial operation date. It shall be responsibility of selected bidder to get the PBG extended, if required, such that it is valid till 2months after



		date of commissioning of project.
14	Power Purchase Agreement (PPA)	PPA for a period of 25 years (unless extended by both the parties on mutual agreement) from the date of commercial operation of the project at a fixed quoted tariff shall be executed with successful bidder within 15 days from adoption of tariff by Hon'ble GERC.
15	Scheduled Commercial Operation Date	Within 9months from date of signing of PPA
16	Terms of PPA	25years(unless extended by both the parties on mutual agreement) of O&M from the date of commercial operation date of the project
17	Metering and RMS	The solar power generator shall install Metering infrastructure and Remote Monitoring System (RMS) as per the philosophy explained in the Annexure-1 of RMS
18	The bidding criteria for each sub-station	There shall be single bid for selected sub-station by a bidder. Accordingly, bidder has to quote single fixed tariff for a given sub-station with minimum bid capacity of 0.5 MWp and maximum upto notified solar capacity for respective for the sub-station. The bidder can quote for a project capacity in multiple of 0.5 MW.
19	Computation of notified Solar capacity for selected sub-station:	As per the MNRE guideline for feeder level solarization, the Agricultural connection upto 7.5 HP is to be considered for computation of solar project capacity for availing CFA. In compliance to the same, the solar capacity mentioned against each selected Sub-station in the Annexure-3 covers all the AG feeders emanating from the substation covering AG consumers' load upto 7.5 HP. Thus, the notified solar capacity for the Sub-station is decided as aggregate of AG load upto 7.5 HP and AG consumer's load in excess of 7.5 HP is not considered while computing solar capacity against each Sub-station. Further, the aggregate capacity so arrived as per (a) above, is round off at lower side in multiple of 0.5 MW (say if the total capacity is worked out to 3.8 MW, the notified plant capacity is considered at 3.5 MW) so as to avoid extra cost of redundant capacity of transformer and inverter for the bidders.



Project milestones and timeline

S. No.	Milestone	Timeline
1	Issuance of Letter of Intent (LoI) to the successful bidders -SPG	T1
2	Unconditional acceptance of LoI by successful Bidder	T1+ 7 days
<i>Petition will be filed by UGVCL before GERC for adoption of tariff discovered under e-reverse bidding process</i>		
3	Issuance of Letter of Award (LOA) to the successful bidder after adoption of tariff by GERC	T2
4	Unconditional acceptance of Letter of Award (LOA) by successful Bidder and submission of Performance Bank Guarantee	T2 +7days

5	Signing of PPA between selected bidder (SPG) and UGVCL	T3 = T2 + 15 Days
6	Completion of design, supply, installation, testing and commissioning of the SPV power plant and associated 11kV line for connecting solar power plant with concerned substation along with Submission of the final land documents for the entire required land duly registered by appropriate revenue authority	T3+9 months
7	Operation and maintenance of power plant and associated 11kV line	25 years from COD (unless extended by both the parties on mutual agreement)

(c) The basis of evaluation of the bids shall be the fixed tariff for 25 years in Rs. Per kWh quoted in the Price Schedule. It is further to clarify that all the costs, distribution losses up to the delivery point including applicable taxes (incl. GST and cess as applicable), duties, etc. pertaining to design, survey, supply, installation, testing, commissioning, operation & maintenance of grid connected solar power plant, its associated 11kV line to connect the plant with concerned substation and RMS of solar power plant, shall be borne by the successful bidder. Bidders are required to quote the tariff on firm price End cost and no price variation shall be considered during the tenure of Power Purchase Agreement except Change in Law conditions provided in the Power Purchase Agreement



(d) The tender documents (RFS and PPA) of above mentioned tender were published on the website of the petitioner for downloading the copy of the tender documents for participation in e-bidding procedure including e-reverse auction. Further, a pre-bid meeting was held at UGVCL, Corporate office, Mehsana, on dated 28/03/2023 wherein, key bid parameters, provisions of RFS documents & timelines were discussed. All the tender documents of UGVCL including addendums are annexed herewith as **Annexure-E (Colly)**.

(e) The last date of submission of bid in the tendering process was 05/04/2023 for 21 nos. of tenders, 06/04/2023 for 08 nos. of Tenders & 10/04/2023 for 34 nos. of Tenders and the same were extended 1 time to 8 time with a view to receive good participation. The petitioner has received online and 103 Nos of bidders have participated in 52 nos. of tenders and bid of 52 plants with aggregate offered capacity of 186.5 MW against aggregated 208.5 MW notified capacities, which were processed online. 08 nos. of tenders against aggregated 20 MW notified capacities are scrap as no online bids received after 14 time extended the time limits up to 17.07.2023.

(f) After completion of bid evaluation process for tender TN-42 to TN-104, petitioner has

submitted the proposal to GUVNL seeking permission to proceed for filing tariff petition vide UGVCL proposal for 44 nos. Tenders : CORMHSUG/0439/05/2023 Dtd.01.06.2023, UGVCL proposal for 07 nos. Tenders : UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/ 983 Dtd.26.07.2023 & UGVCL proposal for 01 nos. Tenders : UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/ 1019 Dtd.01.08.2023 in view of the final price received against different plants under TN-42 to TN-104 tender, including price bids which were already received earlier under previous tenders viz TN-03, TN-04, TN-05, TN-06 to TN-41.

GUVNL,vide GUVNL/Tech/Solar Cell/PM KUSUM-C/FLS/1114 dated 22.6.23has informed that proposal of UGVCL was placed before the GUVNL Board in the Board meeting dated 6.6.2023 and Board discussed and decided that (1) UGVCL shall issue Lol (Letter of Intent) for tariff received up to Rs.3.00 per unit (2) UGVCL shall seek consent of all the bidders who have qualified under bucket filling mechanism as per the bis documents and quoted tariff in excess of Rs. 3.00 per unit to agree for tariff of Rs. 3.00 per unit. Based on consents, UGVCL may issue Lol to those bidders and seek acknowledgement for the same. (3) UGVCL shall immediately take above actions and inform the same to GUVNL along with quantum of power for which Lol are issued.

(g) Accordingly, in the matter of tender RFS TN-42 to TN-104, the petitioner has taken following steps:

(1) Lol/Consent letter issued to the bidders of 06 plants, where L-1 bidders have already offered last tariff rate up to Rs. 3.00 per unit (From Rs. 2.75 to Rs. 2.98 per unit). Lol/Consent letter were issued at the rate of plant wise lowest (L-1) bidder rate considering full offered bucket MW capacity, with matching of L-1 rate incase of bucket capacity pending to L-2. Among these 04 Lol were accepted with respective bidders's bid MW capacity.

As per above, for these 06 plants, against 11.0 MW notified capacity as per tender & 11 MW offered capacity, Out of these 06 Lol/Consent letter, 04 Lol is accepted by the bidders for 5.5 MW solar plant capacity while 02 bidders have not accepted Lol/Consent for 5.5 MW.

Sr No	L-1 bidder Rate slab	Tender No.	Plants where L-1 bidder rate Lol is accepted	Total MW capacity of bids of accepted Lol
Unit	(Rs. per unit)		(Nos of Plant)	MW
1	2.75	TN-100	02	1.5



2	2.95	TN-52	01	3.0
3	2.98	TN-51	01	1.0
Total			04	5.5

(2) Lol/Consent letter issued to the 53 bidders, where L-1 bidders have offered last tariff above Rs. 3.00 per unit. Lol/Consent letter were issued with UGVCL offered rate of Rs. 3.00 per unit against bidder's last tariff which was above Rs. 3.00 per unit.

Lol/Consent letter were issued to the bidders of respective plants at the rate of Rs. 3.00 per unit considering full offered bucket MW capacity as per their bid. Subsequently, where bucket capacity still remained available, Lol/Consent letter were issued to the next higher bidder at the rate of Rs. 3.00 per unit. These Lol were issued as per the eligible bucket capacity (based on minimum of remaining MW bucket capacity or bidder's original bid MW capacity) till the total capacity i.e. notified capacity for respective plant is exhausted.

As per above, for these 53 bidders, against 177.5 MW notified capacity as per tender & 175.5 MW offered capacity by bidders, total 53 Lol/Consent letter were issued to the eligible bidders. Out of these 53 Lol/Consent, 32 Lol is accepted by the bidders for 99.0 MW solar plant capacity while 21 bidders have not accepted Lol/Consent letter at the UGVCL offered rate of Rs. 3.00 per unit.



Sr No	Rate offered by UGVCL to bidder	Tender No.	Plants where Lol is accepted for Rs.3.00 per unit	Total MW capacity of bids of accepted Lol under bucket
Unit	(Rs. per unit)	TN-	(Nos of Plant)	MW
1	3.00	42, 44, 46, 48, 50, 54, 59, 60, 62, 64, 66, 67, 68, 73, 74, 75, 76, 77, 78, 81, 84, 89, 90, 94, 95, 98, 99, 101, 103, 104	32	99.0
TOTAL			32	99.0

(3) Considering above para-1 and para-2, final position of rate wise Lol acceptance of bidders of the plants are as under. As per the table, at the tariff rate below Rs. 3.00 (i.e., between Rs. 2.75 to Rs. 2.98), for 04 plants of 5.5 MW solar capacity, Lol from bidders are accepted.

Likewise, at the tariff rate of Rs. 3.00 per unit, for 32 plants of 99 MW solar capacity, Lol from bidders are accepted.

Overall, in reference to petitioner's tender RFS TN-42 to TN-104 , for 33 tenders of 104.5 MW solar capacity, 36 Lol from bidders are accepted.

Sr No	Rate offered by UGVCL to bidder	Description	Tenders where L-1 bidder rate Lol is accepted	Total nos of bids having accepted Lol under bucket for plants	Total MW capacity of bids of accepted Lol under bucket
Unit	(Rs. per unit)		(Nos of Tenders)	(Nos of Bids)	MW
1	Rs. 2.75 to Rs. 2.98	As per list of plants as mentioned in para (1), as per total Total below 3.00 per unit	03	04	5.5
2	Rs. 3.00	As per list of plants as mentioned in para (2) above	30	32	99.0
Grand Total			33	36	104.5



- (h) The plant wise position of quoted tariff, tariff rate after e-reverse auction and final tariff rate accepted as above by the respective bidder for the plant as per accepted Lol by respective bidder are as under:

Sr. No.	Tender No (TN-)	Notified Capacity of SS in MW	Bidder Rank	Offered capacity in MW	Quoted tariff rate by bidder (Rs./KWH)	E-reverse Auction offered rate (Rs./KWH)	Lol Accepted against counter offer	
							MW	Rate (Rs./KWH)
A	B	C	D	E	F	G	H	I
1	TN-42	10.5	L-1	10.5	3.19	-	10.5	3.00
2	TN-44	8	L-1	4.0	3.96	3.18	4.0	3.00
	TN-44		L-2	4.0	3.96	3.19	4.0	3.00
3	TN-46	7.5	L-1	7.5	3.20	-	7.5	3.00
4	TN-48	7	L-1	7.0	3.19	-	7.0	3.00
5	TN-50	6	L-1	6.0	3.25	Single Bid	6.0	3.00
Sr. No.	Tender No	Notified Capacity of SS in MW	Bidder Rank	Offered capacity in MW	Quoted tariff rate by bidder (Rs./KWH)	E-reverse Auction offered rate (Rs./KWH)	Lol Accepted against counter offer	
							MW	Rate (Rs./KWH)
A	B	C	D	E	F	G	H	I
6	TN-51	5	L-1	1.0	3.69	2.98	1.0	2.98
7	TN-52	4.5	L-1	3.0	3.97	2.95	3.0	2.95

8	TN-54	4	L-1	4.0	3.20	Single Bid	4.0	3.00
9	TN-59	4	L-1	4.0	3.25	-	4.0	3.00
10	TN-60	4	L-1	4.0	3.25	Single Bid	4.0	3.00
11	TN-62	3.5	L-1	3.5	3.40	Single Bid	3.5	3.00
12	TN-64	3.5	L-1	3.5	3.30	Single Bid	3.5	3.00
13	TN-66	3.5	L-1	3.5	3.40	3.34	3.5	3.00
14	TN-67	3.5	L-1	3.5	3.50	-	3.5	3.00
15	TN-68	3	L-1	3.0	3.70	3.39	3.0	3.00
16	TN-73	3	L-1	2.0	3.96	3.39	2.0	3.00
17	TN-74	3	L-1	3.0	3.40	Single Bid	3.0	3.00
18	TN-75	2.5	L-1	2.5	3.80	-	2.5	3.00
19	TN-76	2.5	L-1	1.0	4.02	4	1.0	3.00
	TN-76		L-2	1.0	4.19	4.01	1.0	3.00
20	TN-78	2.5	L-1	2.5	4.55	Single Bid	2.5	3.00
21	TN-77	2.5	L-1	2.5	3.80	3.44	2.5	3.00
22	TN-81	2	L-1	2.0	3.83	Single Bid	2.0	3.00
23	TN-84	2	L-1	1.0	3.86	3.85	1.0	3.00
24	TN-89	1.5	L-1	1.5	3.95	3.63	1.5	3.00
25	TN-90	1.5	L-1	1.5	4.37	Single Bid	1.5	3.00
26	TN-94	1.5	L-1	1.5	3.75	Single Bid	1.5	3.00
27	TN-95	1.5	L-1	1.5	3.50	Single Bid	1.5	3.00
28	TN-98	1.5	L-1	1.5	4.50	Single Bid	1.5	3.00
29	TN-99	1.5	L-1	1.5	3.83	Single Bid	1.5	3.00
30	TN-100	1.5	L-1	1.0	3.00	2.75	1.0	2.75
	TN-100	1.5	L-2	1.5	4.30	..	0.5	2.75
31	TN-101	1.5	L-1	1.5	3.83	Single Bid	1.5	3.00
32	TN-103	1.5	L-1	1.5	3.50	Single Bid	1.5	3.00
33	TN-104	1.5	L-1	1.5	3.50	Single Bid	1.5	3.00

- (i) The present petition is filed by the petitioner seeking for adoption by Hon'ble Commission, the tariff rate as per column I in the above table through discovered tariff under tariff based competitive bidding process held by the petitioner.
- (j) Upon adoption of discovered tariff, as per RFS, the milestones and timeline will be followed and LOA will be issued. Subsequently, PPA (Power Purchase Agreement) will be signed with above successful bidders. Draft copy of the PPA is attached herewith.

2.3 It is respectfully submitted that distribution companies are mandated to procure power from renewable energy sources as per the provisions of section 86(1)(e) of the Electricity Act, 2003 and in terms of GERC (Procurement of Energy from Renewable Energy Sources) Regulations as amended from time to time, petitioner is required to procure power from renewable energy sources for meeting RPO obligation.



2.4 It is respectfully submitted that as per provisions of section 63 of the Electricity Act 2003 provides that appropriate commission shall adopt the tariff if such tariff has been determined through transparent process of bidding in accordance with the guidelines issued by the central government.

2.5 As per provisions of section 86(1) of the Electricity Act 2003 provides that the State Commission shall discharge following functions namely –

Clause (b) – “regulate electricity purchase and procurement process of distribution licensees including the price at which electricity shall be procured from the generating companies or licensees or from other sources through agreements for purchase of power for distribution and supply within the State.”

2.6 In the above background and in accordance with section 63 read with 86 (1) (b) of the Electricity Act 2003, the petitioner has filed present petition for adoption of tariffs discovered under tariff competitive bidding process for 36 no. of solar power plants of total capacity of 104.5 MW for the period of 25 years, under PM KUSUM-C Feeder Level Solarization scheme of 11 KV Agricultural feeders, through RESCO model.

2.7 Draft PPA is attached herewith in **Annexure-F**.

2.8 The detailed list of plant wise bidders with Lol issuance/ response (where price bids received) is attached here with in **Annexure-G**



PRAYER

The Petitioner most respectfully prays to the Hon'ble Commission that:

- a) Hon'ble Commission may please to admit the present petition.
- (b) To adopt the tariff discovered under tariff based competitive bidding process under PM KUSUM-C Feeder Level Solarization scheme of MNRE, Government of India, conducted by the petitioner through tender RFS No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104 Dtd.15,16 & 17.03.2023.
- (c) To approve the draft Power Purchase Agreement to be executed with the following successful bidder as per tender RFS No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104 Dtd.15,16 & 17.03.2023 for the respective plant capacities at the accepted Lol rate as under:

Sr No	Tender No.	Plant No	Name of Bidder	Solar Plant capacity (in MW)	Accepted tariff rate by bidder (Rs./KWH)
1	TN-42	UG-FLS-SS-1	M/s MKC Infrastructure Ltd.	10.5	3.00
2	TN-44	UG-FLS-SS-3	M/s TIRUPATI COTTON INDUSTRIES	4.0	3.00
3	TN-44	UG-FLS-SS-3	M/s VENKATESH COTTON COMPANY	4.0	3.00
4	TN-46	UG-FLS-SS-5	M/s MKC Infrastructure Ltd.	7.5	3.00
5	TN-48	UG-FLS-SS-7	M/s MKC Infrastructure Ltd.	7.0	3.00
6	TN-50	UG-FLS-SS-9	M/s MKC Infrastructure Ltd.	6.0	3.00
7	TN-51	UG-FLS-SS-10	M/s MECHATRONIK TECHNOLOGIES PRIVATE LIMITED	1.0	2.98
8	TN-52	UG-FLS-SS-11	M/s S.K.Buildcon	3.0	2.95
9	TN-54	UG-FLS-SS-13	M/s MKC Infrastructure Ltd.	4.0	3.00
10	TN-59	UG-FLS-SS-18	M/s MKC Infrastructure Ltd.	4.0	3.00
11	TN-60	UG-FLS-SS-19	M/s MKC Infrastructure Ltd.	4.0	3.00
12	TN-62	UG-FLS-SS-21	M/s HEXATRON INDUSTRIES LIMITED	3.5	3.00
13	TN-64	UG-FLS-SS-23	M/s MKC Infrastructure Ltd.	3.5	3.00
14	TN-66	UG-FLS-SS-25	M/s MKC Infrastructure Ltd.	3.5	3.00
15	TN-67	UG-FLS-SS-26	M/s MKC Infrastructure Ltd.	3.5	3.00
16	TN-68	UG-FLS-SS-27	Manisha Sunil Shah	3.0	3.00
17	TN-73	UG-FLS-SS-32	M/s SKP Bearing Industries Limited.	2.0	3.00
18	TN-74	UG-FLS-SS-33	M/s MKC Infrastructure Ltd.	3.0	3.00
19	TN-75	UG-FLS-SS-34	M/s CEPCO Industries Pvt. Ltd.	2.5	3.00
20	TN-76	UG-FLS-SS-35	Sharadkumar Keshubhai Desai	1.0	3.00
21	TN-76	UG-FLS-SS-35	Desai Ramilaben Sharadkumar	1.0	3.00
22	TN-77	UG-FLS-SS-36	M/s CEPCO Industries Pvt. Ltd.	2.5	3.00
23	TN-78	UG-FLS-SS-37	M/s Platinum Agro Industries	2.5	3.00
24	TN-81	UG-FLS-SS-40	M/s Zodiac Energy Limited	2.0	3.00
25	TN-84	UG-FLS-SS-43	M/s Goldensol Producer company Limited	1.0	3.00
26	TN-89	UG-FLS-SS-48	M/s Avatar Solar Private Limited	1.5	3.00
27	TN-90	UG-FLS-SS-49	M/s NUGLADE PRIVATE LIMITED	1.5	3.00
28	TN-94	UG-FLS-SS-53	M/s VIJAPURA IMPEX LLP, JV Partner : M/s Photonics Watertech Pvt Ltd.	1.5	3.00
29	TN-95	UG-FLS-SS-54	M/s R K CORP	1.5	3.00
30	TN-98	UG-FLS-SS-57	M/s JSR Renewable Consultants	1.5	3.00
31	TN-99	UG-FLS-SS-58	M/s Zodiac Energy Limited	1.5	3.00
32	TN-100	UG-FLS-SS-59	M/s Deesha Civil Engineering Design	1.0	2.75
33	TN-100	UG-FLS-SS-59	M/s Gurukrupa Granite	0.5	2.75
34	TN-101	UG-FLS-SS-60	M/s Zodiac Energy Limited	1.5	3.00
35	TN-103	UG-FLS-SS-62	Kamleshkumar Babulal Shah	1.5	3.00
36	TN-104	UG-FLS-SS-63	M/s R K CORP	1.5	3.00




- (d) The petitioner craves relief of the Hon'ble Commission to allow further submissions, prayers, additions and alterations to this petition as may be necessary from time to time.
- (e) Pass any other order as the Hon'ble Commission may deem fit and appropriate under the circumstances of the case, to avoid further delay and in the interest of justice.

DECLARATION

It is to declare that subject matter of the Petition has not been raised by the Petitioner before any other competent forum and that no other competent forum is currently seized of the matter or has passed any order in relation thereto.


Uttar Gujarat Vij Company Limited
-PETITIONER




SERIAL NO.	2441
BOOK NO.	02
PAGE NO.	61
DATE	13-09-2023

AFFIDAVIT:

I, Mr Bhagubhai Pranami, son of Ganeshbhai Pranami, aged 53, residing at Gandhinagar, do solemnly affirm and state as under:-

1. I am I/c Chief Engineer (P), Uttar Gujarat Vij Company Limited, in the Petitioner Company and am duly authorized by the said Petitioner to make this affidavit.
2. I say that the contents of the accompanying Petition are based on the records of the Petitioner Company maintained in normal course of business and believed by the Deponent to be true.
3. I say that the annexure is a true copy.



[Signature]
DEPONENT

VERIFICATION:

I, the deponent above named do hereby verify that the contents of my above affidavit are true to my knowledge, no part of it is false and nothing material has been concealed there from.

Verified at Mehsana on 13 -September-2023.

[Signature]
DEPONENT



Solely Affirmed & Signed
BEFORE ME

[Signature]
Jayeshkumar M. Chaudhary
NOTARY
(GOVT. OF INDIA) MEHSANA
13-09-2023

Annexure-A

PM-KUSUM યોજનાના કોમ્પોનન્ટ-17
હેઠળ ગ્રીડ કનેક્ટેડ કૃષિ પંપને
સોલરાઈઝેશન કરવા અંગેની યોજનામાં
સુધારો કરવા બાબત.

ગુજરાત સરકાર
ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગ
ઠરાવ ક્રમાંક : EPCD/SLR/20/2022/0485/B1
સચિવાલય, ગાંધીનગર
તા. ૨૬/૦૭/૨૦૨૩

વંચાણે લીધા:

- 1) ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગનો તા-૦૬.૧૧.૨૦૨૦ નો ઠરાવ ક્રમાંક : SLR/૧૧/૨૦૨૦/૮૫૧/બી૧.
- 2) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય (MNRE), ભારત સરકારની તા- ૦૪.૧૧.૨૦૨૦ની કચેરી યાદી ક્રમાંક: ૩૨/૬૪૫/૨૦૧૭- SPV ડીવીઝન
- 3) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય (MNRE), ભારત સરકારની તા- ૦૪.૧૨.૨૦૨૦ની કચેરી યાદી ક્રમાંક: ૩૨/૬૪૫/૨૦૧૭- SPV ડીવીઝન.

પ્રસ્તાવના:

કેન્દ્ર સરકારના નવી અને નવીનીકરણીય ઉર્જા મંત્રાલય(MNRE) દ્વારા ખેડૂતો માટે વંચાણે લીધેલ ક્રમાંક(૨) પરની તા. ૦૪.૧૧.૨૦૨૦ની કચેરી યાદીથી પ્રધાન મંત્રી કિસાન ઉર્જા સુરક્ષા એવમ ઉત્થાન મહાભિયાન(PM-KUSUM) યોજનાનું વિસ્તરણ કરીને ફીડર લેવલ સોલરાઈઝેશનનો સદર યોજનામાં સમાવેશ કરેલ છે. કેન્દ્ર સરકારના નવી અને નવીનીકરણીય ઉર્જા મંત્રાલય(MNRE) દ્વારા ખેડૂતો માટે વંચાણે લીધેલ (૩) પરની તા. ૦૪.૧૨.૨૦૨૦ની કચેરી યાદીથી પ્રધાન મંત્રી કિસાન ઉર્જા સુરક્ષા એવમ ઉત્થાન મહાભિયાન(PM-KUSUM) યોજનાના કોમ્પોનન્ટ-C હેઠળ ફીડર લેવલ સોલરાઈઝેશનના અમલીકરણ માટેની ગાઈડલાઈન્સને મંજૂરી આપવામાં આવેલ છે. કેન્દ્ર સરકારની સદરફૂ ફીડર લેવલ સોલરાઈઝેશનની યોજનાનો રાજ્યમાં અમલ કરવાની બાબત રાજ્ય સરકારની વિચારણા હેઠળ હતી.

સુધારા ઠરાવ:

સરકારશ્રીની પુખ્ત વિચારણાને અંતે, રાજ્યનાં ખેડૂતોના લાભાર્થે કેન્દ્ર સરકારની ફીડર લેવલ સોલરાઈઝેશન યોજનાનો રાજ્યમાં અમલ કરવા સારું ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગના વંચાણે લીધેલ ક્રમાંક (૧) પરના ઠરાવમાં નીચે મુજબની શરતો / જોગવાઈઓ ઉમેરવાનું આથી ઠરાવવામાં આવે છે:

- (૧) આ યોજના હેઠળ એગ્રીકલ્ચર ફીડરનું સોલરાઈઝેશન કરી શકાશે. એગ્રીકલ્ચર ફીડર માટે કુલ વાર્ષિક પાવરની જરૂરિયાતનું મૂલ્યાંકન કરી, વાર્ષિક પાવરની જરૂરિયાતને પૂરી કરી શકે તેટલી ક્ષમતાનો સોલાર પાવર પ્લાન્ટ RESCO મોડથી બનાવવાનો રહેશે, જે ફીડરમાં પાવર સપ્લાય કરશે.
- (૨) ફીડર લેવલ સોલરાઈઝેશનની કેન્દ્ર સરકારની ઉક્ત વંચાણે લીધેલ ક્રમાંક-(૩) પરની RESCO મોડ અંગેની ગાઈડલાઈન્સને અનુસરવાની રહેશે.

(૩) ફીડર લેવલ સોલરાઈઝેશન (PM KUSUM Component-C) યોજનામાં સમાવિષ્ટ ખેડૂતોને નીચે જણાવેલ શરતોને આધીન ઈન્સેન્ટીવ આપવામાં આવશે:

1. “ફીડરમાં સમાવિષ્ટ ખેતીવિષયક વીજ જોડાણ ધરાવતા ગ્રાહકો જો તેમના બેન્ચમાર્ક વીજવપરાશ કરતા ઓછો વીજ વપરાશ કરે તો કરેલ વીજ બચતના રૂા .૦.૧૦/- પ્રતિ યુનિટ પ્રમાણે આપવામાં આવશે,
2. સરેરાશ વીજ વપરાશની આકારણી કરવા માટે ડીસ્કોમ જે તે વિસ્તાર મુજબ વિવિધ પરિબળો ધ્યાને લેશે.
3. જો ફીડરનો T&D લોસ ૧૦%થી નીચે હશે તો જ ઈન્સેન્ટીવ આપવામાં આવશે.
4. જો ફીડર લેવલે પ્રતિ હો.પા .બેન્ચમાર્ક વીજ વપરાશ કરતા ઓછો વીજ વપરાશ થાય તો જ ઈન્સેન્ટીવ આપવામાં આવશે.
5. હોર્સ-પાવર બેઝ વીજ ગ્રાહકોએ પોતાના વીજ જોડાણમાં મીટર સ્થાપિત કરવાની સંમતિ આપ્યેથી નિયમોનુસાર ઈન્સેન્ટીવ મળવાપાત્ર થશે” .

(૪) PM-KUSUM યોજનાના કોમ્પોનન્ટ-C હેઠળ ગ્રીડ કનેક્ટેડ કૃષિ પંપને સોલરાઈઝેશન કરવા અંગેની યોજનાના ઉક્ત વંચાણે લીધેલ ક્રમાંક (૧) પરના ઠરાવની અન્ય તમામ જોગવાઈઓ યથાવત રહેશે.

(૫) આ સુધારા ઠરાવ આ વિભાગની સમાન ક્રમાંકની ફાઇલ ઉપર નાણા વિભાગની તા.૦૮/૦૬/૨૦૨૩ની નોંધ પર મળેલ અનુમતિ અન્વયે બહાર પાડવામાં આવે છે.

ગુજરાતના રાજ્યપાલ શ્રી ના હુકમથી અને તેમના નામે,

Sign

Signed by: BHAKTI C SHAMAL
Organization Unit: Energy and
Petrochemicals Department
Organization Name:
GOVERNMENT OF GUJARAT
Date: 26-Jul-2023 (06:44 PM)

(ભક્તિ શામળ)

સંયુક્ત સચિવ

ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગ

પ્રતિ,

૧. માન.રાજ્યપાલશ્રીના અંગત સચિવશ્રી, રાજભવન, ગાંધીનગર (અલગ પત્રથી)
૨. માન.મુખ્યમંત્રીશ્રીના અધિક મુખ્ય સચિવશ્રી, સચિવાલય, ગાંધીનગર
૩. માન.મંત્રીશ્રી(નાણાં, ઉર્જા અને પેટ્રો.)ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૪. મુખ્ય સચિવશ્રીના સંયુક્ત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૫. અધિક મુખ્ય સચિવશ્રી(નાણા)ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૬. અગ્ર સચિવશ્રી(ઉપેવિ)ના રહસ્ય સચિવશ્રી, સચિવાલય, ગાંધીનગર
૭. મેનેજીંગ ડાયરેક્ટરશ્રી,ગુજરાત ઉર્જા વિકાસ નિગમ લી., વડોદરા
૮. મેનેજીંગ ડાયરેક્ટરશ્રી, ઉત્તર ગુજરાત વીજ કંપની લી., મહેસાણા
૯. મેનેજીંગ ડાયરેક્ટરશ્રી, પશ્ચિમ ગુજરાત વીજ કંપની લી., રાજકોટ
૧૦. મેનેજીંગ ડાયરેક્ટરશ્રી, દક્ષિણ ગુજરાત વીજ કંપની લી., સુરત
૧૧. મેનેજીંગ ડાયરેક્ટરશ્રી, મધ્ય ગુજરાત વીજ કંપની લી., વડોદરા
૧૨. નિયામકશ્રી, ગુજરાત ઉર્જા વિકાસ એજન્સી, ઉદ્યોગ ભવન,ગાંધીનગર

૧૩. મુખ્ય વિદ્યુત નિરીક્ષકશ્રી અને શુલ્ક સમાહર્તાશ્રી, ઉદ્યોગભવન, ગાંધીનગર
૧૪. નાણાં સલાહકારશ્રી(ઉર્જા અને પેટ્રોકેમિકલ્સ), નાણાં વિભાગ, સચિવાલય, ગાંધીનગર
૧૫. વિભાગના સર્વે અધિકારીશ્રીઓ
૧૬. સિલેક્ટ ફાઇલ/નાયબ સેક્શન અધિકારીશ્રીની અંગત ફાઇલ

17087 BT. 11-11-20
 C.E. (OP)
 C.E. (P)
 AGE (T)
 AGE (PROT)
 AGE (CIVIL)
 SE (T)/RE/P
 SE (Vig)/CIVIL
 S.E. (Comm.)
 Legal
 CCC
 SE (DSM)
 IT
 CVO

રાજ્યમાં પ્રધાનમંત્રી કિસાન ઉર્જા સુરક્ષા
 એવમ ઉત્થાન મહાભિયાન (PM-KUSUM)
 યોજનાના કોમ્પોનન્ટ-C હેઠળ ગ્રીડ કનેક્ટેડ
 કૃષિ પંપને સોલરઇઝેશન કરવા અંગેની
 યોજના બાબત.

ગુજરાત સરકાર
 ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગ
 ઠરાવ ક્રમાંક : SLR/11/2020/851/B1
 સચિવાલય, ગાંધીનગર
 તા. 05/11/2020

વંચાણે લીધા:

- 1) ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગનો તા-૨૭.૦૭.૨૦૧૮ નો ઠરાવ ક્રમાંક: SLR/૧૧/૨૦૧૭/૨૨૮૪/બી૧
- 2) ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગનો તા-૨૯.૦૯.૨૦૧૮નો ઠરાવ ક્રમાંક: SLR/૧૧/૨૦૧૭/ ૨૨૮૪/બી૧
- 3) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય, ભારત સરકારનો તા-૦૮.૦૩.૨૦૧૯નો હુકમ ક્રમાંક: ૩૨/૪૪૫/૨૦૧૭-SPV ડીવીઝન
- 4) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય, ભારત સરકારની તા- ૨૨.૦૭.૨૦૧૯ ની કચેરી યાદી ક્રમાંક: ૩૨/૪૪૫/૨૦૧૭-SPV ડીવીઝન
- 5) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય, ભારત સરકારની તા- ૧૩.૦૮.૨૦૧૯ની કચેરી યાદી ક્રમાંક: ૩૨/૪૪૫/૨૦૧૭-SPV ડીવીઝન
- 6) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય, ભારત સરકારની તા- ૦૮.૧૧.૨૦૧૯ની કચેરી યાદી ક્રમાંક: ૩૨/૪૪૫/૨૦૧૭- SPV ડીવીઝન
- 7) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય, ભારત સરકારની તા- ૩૧.૧૨.૨૦૧૯ની કચેરી યાદી ક્રમાંક: ૩૨/૪૪૫/૨૦૧૭- SPV ડીવીઝન
- 8) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય, ભારત સરકારનો તા- ૧૯.૦૩.૨૦૨૦ નો હુકમ ક્રમાંક: ૩૨/૫૪/૨૦૧૮- SPV ડીવીઝન
- 9) ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગનો તા-૦૧.૦૭.૨૦૨૦નો ઠરાવ ક્રમાંક: SLR/૧૧/૨૦૧૯/૧૭૫૭/બી૧

- 10) નવી અને નવીનીકરણ ઉર્જા મંત્રાલય, ભારત સરકારની તા-૨૭.૦૭.૨૦૨૦ની કચેરી યાદી ક્રમાંક: ૩૨/૪૪૫/૨૦૧૭-SPV ડીવીઝન(પાર્ટ-૩)

પ્રસ્તાવના:

કેન્દ્ર સરકાર દ્વારા વર્ષ ૨૦૨૨ સુધીમાં ૧૦૦ ગીગા વોટ સોલાર પાવર ઉત્પાદનનો મહત્વાકાંક્ષી લક્ષ્યાંક રાખવામાં આવેલ છે. આ માટે કેન્દ્ર સરકારના નવી અને નવીનીકરણીય ઉર્જા મંત્રાલય(MNRE) દ્વારા ખેડૂતો માટે વંચાણે લીધેલ (૩) ના તારીખ ૦૮.૦૩.૨૦૧૯ ના હુકમથી સોલાર પંપ સેટ્સ ઉપલબ્ધ કરાવવા અને ગ્રીડ કનેક્ટેડ સોલાર પાવર પ્લાન્ટ સ્થાપવા માટે પ્રધાન મંત્રી કિસાન ઉર્જા સુરક્ષા એવમ ઉત્થાન મહાભિયાન(PM-KUSUM) યોજનાને મંજૂરી આપવામાં આવેલ છે. આ યોજનાના કોમ્પોનન્ટ-C હેઠળ દેશભરમાં ૧૦ લાખ ગ્રીડ કનેક્ટેડ કૃષિ પંપને સોલરઇઝ કરવાની મંજૂરી આપવામાં આવેલ. આ યોજનાની અમલવારી ગુજરાત રાજ્યમાં કરવા અંગેની બાબત રાજ્ય સરકારની વિચારણા હેઠળ હતી.

ઠરાવ:

રાજ્ય સરકાર દ્વારા સઘન વિચારણાને અંતે રાજ્યનાં ખેડૂતોના લાભાર્થે કેન્દ્ર સરકારની પ્રધાન મંત્રી કિસાન ઉર્જા સુરક્ષા એવમ ઉત્થાન મહાભિયાન (PM-KUSUM) કોમ્પોનન્ટ-સી ગ્રીડ કનેક્ટેડ કૃષિ પંપને સોલરઈઝ કરવાની યોજનાની અમલવારી ગુજરાત રાજ્યમાં MNREની આ યોજના અંગેની ગાઈડ લાઈન પ્રમાણે નીચેની શરતો તથા ધારાધોરણો મુજબ કરવા માટે આથી ઠરાવમાં આવે છે:

શરતો:

- (1) આ યોજનામાં ગ્રીડ સાથે જોડાયેલ સિંચાઈ હેતુ માટેના ખેતીવાડી વિજબેડાણ ધરાવતા અરજદારોનો તથા પિયત સહકારી મંડળી/સંગઠન અને કલરટર આધારિત સિંચાઈ સિસ્ટમનો સમાવેશ થઈ શકશે.
- (2) આ યોજના હેઠળ નાના અને સીમાંત ખેડૂતોને તથા સૂક્ષ્મ સિંચાઈ પદ્ધતિઓનો ઉપયોગ કરતા તે યોજના/સિસ્ટમ હેઠળ આવરી લેનારા ખેડૂતો/અરજદારોને પ્રાધાન્ય આપવામાં આવશે.
- (3) જે તે ખેતીવાડી ફીડર પરના ઓછામાં ઓછા **૭૦% સુધી** ખેતીવાડી વીજ બેડાણ ધરાવતા ગ્રાહકો, આ યોજનામાં બેડાવા સહમતી આપે તેવા ફીડરનો આ યોજનામાં સમાવેશ થઈ શકશે.
- (4) સરકારશ્રીની દિનકર યોજનામાં આવરી લેવાતા ખેતીવાડી ફીડરો ઉપરના ખેતીવાડી વીજ ગ્રાહકો પણ આ યોજનાનો લાભ લઈ શકશે. આ માટે જે તે કિસાન સૂર્યોદય યોજનાના ફીડર માટે ઉપરોક્ત ૭૦ % સમાવેશનું ધોરણ લાગુ પડશે નહીં, પરંતુ આવા ફીડરો ઉપર થ્રી ફેઝ વીજ પુરવઠો નિયમ મુજબ ૮ કલાક ચાલુ રહેશે. જે આવા ફીડરો ઉપર આ યોજનામાં બેડતા ખેતીવાડી ગ્રાહકોની સંખ્યા ૭૦ % સુધી પહોંચે ત્યારે ફીડરમાં દિવસ દરમિયાન સૂર્યોદય થી સુર્યાસ્ત સુધી થ્રી ફેઝ વીજ પુરવઠો શરત નં. '11' મુજબ ચાલુ રાખવાનો રહેશે અને બાકીના યોજનામાં ન બેડતા ગ્રાહકોનો થ્રી ફેઝ વીજ પુરવઠો શરત નં. '12' મુજબ રહેશે.
- (5) ડાર્ક ઝોન વિસ્તારમાં ફક્ત સૂક્ષ્મ પિયત પદ્ધતિનો ઉપયોગ કરતા હયાત વીજ બેડાણ ધરાવતા ખેડૂતો જ આ યોજનામાં બેડાઈ શકશે.
- (6) આ યોજનામાં બેડાતા ખેડૂતો પોતાના ખેતરમાં તેમના સિંચાઈ હેતુના ખેતીવાડી વીજ બેડાણના કરારીત વિજભારને HP માંથી kW માં રૂપાંતરિત કરી, જે તે kW ના ૧.૭૫ ગણા લેખે સોલાર ફોટોવોલ્ટિક પીવી સિસ્ટમ સ્થાપિત કરી શકશે.
- (7) આ યોજનામાં બેડાતા ખેડૂતોને સોલાર સિસ્ટમ સ્થાપિત કરવાના કુલ ખર્ચના ૩૦ % રકમ કેન્દ્ર સરકારની સહાય (CFA) તરીકે, ૩૦ % રકમ રાજ્ય સરકારની સહાય (સનસિડી) તરીકે આપવામાં આવશે અને બાકીની ૪૦ % રકમ લાભાર્થી એટલે કે ખેડૂતે ભોગવવાની રહેશે.

- (8) ઉપરોક્ત સળસીડી અને CFA ૭.૫ હોર્સપાવર (HP)ની ક્ષમતા સુધીના કરારીત વિજભાર ધરાવતા વિજબેડાણ માટે, તેમના કરારીત વિજભાર(5.595 kW) ને ૧.૭૫ ગણા લેખે એટલે કે 9.79 kW (5.595 kW × 1.75) સોલાર ફોટોવોલ્ટિક પીવી સિસ્ટમ માટે જ મર્યાદિત રહેશે.
- (9) આ યોજનામાં મળવાપાત્ર સોલાર સિસ્ટમ માટે ૭.૫ HP સુધીના જ કરારીત વિજભાર ધરાવતા ખેતીવાડી વીજ બેડાણનો સમાવેશ કરી શકાશે. ૭.૫ HPથી ઉપરના કરારીત વિજભાર ધરાવતા વીજ બેડાણો માટે સોલાર ક્ષમતા અને સળસીડી માટે ૭.૫ HPના ખેતીવાડી વીજ બેડાણને મળવાપાત્ર ક્ષમતા સુધી મર્યાદિત રહેશે.
- (10) ખેડૂત અને જે તે વીજવિતરણ કંપની વચ્ચે વધારાની ઉત્પાદિત સોલાર વીજળીની ખરીદ-વેચાણ માટે ૨૫ વર્ષનો કરાર કરવામાં આવશે. આ કરાર દરમિયાન ખેડૂત દ્વારા ખેતીવાડી સિંચાઈ હેતુના વીજ વપરાશ ને બાદ કર્યા પછીની ગ્રીડમાં દાખલ કરેલ વધારાની સરપ્લસ (surplus) (net-injected) વીજળી જે તે વીજવિતરણ કંપની દ્વારા ₹૨.૮૩/યુનિટના દરે ૨૫ વર્ષ સુધી ખરીદવામાં આવશે તથા નેટ ઇમ્પોર્ટના કિસ્સામાં પ્રવર્તમાન ખેતીવાડી વીજદર મુજબ ચૂકવણી કરવાની રહેશે. આ અંગેનો હિસાબ વર્ષાન્તે કરવાનો રહેશે. આ માટે માનનીય GERC દ્વારા નક્કી થયેલ દર માન્ય રહેશે.
- (11) આ યોજનામાં સમાવેશ કરવામાં આવેલ ફીડરમાં સોલાર સિસ્ટમથી ઉત્પાદિત વીજળીને ગ્રીડમાં મોકલવા (inject કરવા) માટે દિવસ દરમિયાન સૂર્યોદય થી સુર્યાસ્ત સુધી થ્રી ફેઝ વીજ પુરવઠો ચાલુ રાખવાનો રહેશે. ભૂગર્ભજળનું શોષણ (water exploitation) ઘટાડવા અને પાણીનો સંચય કરવાના હેતુથી યોજનામાં ભાગ લેતા ખેડૂતના પંપસેટને રાજ્ય સરકારની નીતિ મુજબ ૮ કલાક સીમીત વીજ પુરવઠો મળી રહે તે માટે ટેકનીકલ વ્યવસ્થા કરવાની રહેશે.
- (12) જે તે ફીડરના આ યોજનામાં ન બેડાતા ગ્રાહકોનો થ્રી ફેઝ વીજ પુરવઠો પ્રવર્તમાન નીતિ મુજબ ૮(આઠ) કલાક મળવા પાત્ર રહેશે. ફીડરના મેનેજમેન્ટ, મોનીટરીંગ, એનર્જી એકાઉન્ટીંગ માટે અન્ય ઉપકરણ જેવા કે, નિરીક્ષક ડીવાઈસ/ Feeder Management System, ડેટા રાજ અને ટ્રાન્સફોર્મરના અર્થીંગ, વિગેરેની રકમ રાજ્ય સરકારથી તરફથી વધારાની ગ્રાન્ટ તરીકે આપવામાં આવશે.
- (13) આ યોજનાના અમલીકરણ માટે ભારત સરકારના નવી અને નવીનીકરણીય ઊર્જા મંત્રાલયની (MNRE) ગાઈડલાઈન મુજબ પારદર્શી બીડીંગ પ્રક્રિયા અપનાવી એજન્સીઓ નિયત કરવાની રહેશે. આ એજન્સીઓએ કુદરતી આપત્તિઓ અને ચોરી સામે સ્થાપિત સિસ્ટમો માટે સિસ્ટમોના કાર્યાન્વિત થયાની તારીખથી ૫ વર્ષના સમયગાળા માટેનો હરજિયાતપણે વીમો અને પાંચ વર્ષ માટે વાર્ષિક સમારકામ કોન્ટ્રાક્ટ(AMC) લેવાનો રહેશે તથા MNREની ગાઈડલાઈન મુજબ રીમોટ મોનીટરીંગ સિસ્ટમની વ્યવસ્થા કરવાની રહેશે.
- (14) આ યોજનામાં સ્થાપિત થયેલ સોલાર સિસ્ટમમાં વપરાયેલ સોલાર સેલ અને સોલાર મોડ્યુલ, મોટરપંપ સેટ્સ, કન્ટ્રોલર, બેલેન્સ ઓફ સિસ્ટમ(BOS) વગેરે ભારતમાં ઉત્પાદિત થયેલ હોવા જોઈએ.
- (15) સોલર સિસ્ટમની માલિકી પાંચ વર્ષ સુધી સરકારશ્રીની રહેશે. સોલર પેનલની સફાઈની જવાબદારી લાભાર્થીની રહેશે તથા લાભાર્થી પોતાની જમીનમાંથી સોલાર સિસ્ટમ અન્યત્ર ખસેડી શકશે નહીં કે કોઈને તબદીલ કરી શકશે નહીં.

- (16) જે સોલાર સિસ્ટમના સ્થાપન કર્યાના ૫ વર્ષની અંદર લાભાર્થી જમીનને બિનખેતીમાં રૂપાંતરીત કરાવે કે વેચાણ કરે તો તેણે સબસીડીની ની સંપૂર્ણ રકમ સરકારથીમાં પરત કરવાની રહેશે.
- (17) અરજદારને આ હેતુ માટે કેન્દ્ર સરકાર/રાજ્ય સરકારની બીજી કોઈ પણ યોજના હેઠળ અન્ય કોઈ લાભ મળી શકશે નહિ. જે અરજદારે સરકારથીની બીજી કોઈ પણ યોજના હેઠળ કોઈ લાભ લીધો હોય તેવું જણાશે તો સબસીડીની રકમ તાત્કાલિક ધોરણે વસુલ કરવામાં આવશે.
- (18) આ યોજનાના અમલીકરણ માટેની નોડલ એજન્સી ગુજરાત ઊર્જા વિકાસ નિગમ લિમિટેડ(GUVNL) રહેશે. આ યોજનાની અમલવારી જે તે વિસ્તારની વીજ વિતરણ કંપની દ્વારા કરવામાં આવશે અને તે બદલ MNRE ની માર્ગદર્શિકા મુજબ મળવા પાત્ર CFA ના ૨% સર્વિસ ચાર્જીસની સહાય MNRE દ્વારા કરવામાં આવશે.
- (19) ઉપરોક્ત બાબતો સિવાય આ યોજના માટે વખતો વખત MNRE દ્વારા બહાર પાડવામાં આવતી ગાઈડ લાઈન/સુચન/નિયમો લાગુ પડશે.
- (20) સદર યોજનાની બેગવાઈના અમલીકરણ કે અર્થઘટનની સમસ્યાનું નિવારણની સત્તા ઊર્જા અને પેટ્રોકેમિકલ્સ વિભાગ ગુજરાત સરકારને હસ્તક રહેશે.

આ ઠરાવ આ વિભાગની સમાન ક્રમાંકની હાઇલ ઉપર નાણા વિભાગની તા.૦૫/૧૧/૨૦૨૦ ની નોંધથી આપેલ અનુમતિ અન્વયે બહાર પાડવામાં આવે છે.

ગુજરાતના રાજ્યપાલશ્રીના હુકમથી અને તેમના નામે,

Date: 17/11/2020

✓	EE(P)	DE1(S)	DE2(S)	JE(CR)	EST
					

(ડૉ. નિસર્ગ બેષી)

નાયબ સચિવ

ઊર્જા અને પેટ્રોકેમિકલ્સ વિભાગ

પ્રતિ,

૧. માન.રાજ્યપાલશ્રીના અંગત સચિવશ્રી, રાજભવન, ગાંધીનગર (અલગ પત્રથી)
૨. માન.મુખ્યમંત્રીશ્રીના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૩. માન.નાયબ મુખ્યમંત્રીશ્રીના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૪. માન.મંત્રીશ્રી(ઊર્જા)ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૫. માન.રા.ક.મંત્રીશ્રી(ઊર્જા)ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૬. મુખ્ય સચિવશ્રીના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૭. અધિક મુખ્ય સચિવશ્રી(નાણાં)ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૮. અધિક મુખ્ય સચિવશ્રી(ઉપેધિ)ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
૯. મેનેજીંગ ડાયરેક્ટરશ્રી, ગુજરાત ઊર્જા વિકાસ નિગમ લી., વડોદરા
૧૦. મેનેજીંગ ડાયરેક્ટરશ્રી, ઉત્તર ગુજરાત વીજ કંપની લી., મહેસાણા
૧૧. મેનેજીંગ ડાયરેક્ટરશ્રી, પશ્ચિમ ગુજરાત વીજ કંપની લી., રાજકોટ
૧૨. મેનેજીંગ ડાયરેક્ટરશ્રી, દક્ષિણ ગુજરાત વીજ કંપની લી., સુરત
૧૩. મેનેજીંગ ડાયરેક્ટરશ્રી, મધ્ય ગુજરાત વીજ કંપની લી., વડોદરા
૧૪. નિયામકશ્રી, ગુજરાત ઊર્જા વિકાસ એજન્સી, ઉદ્યોગ ભવન, ગાંધીનગર
૧૫. મુખ્ય વિદ્યુત નિરીક્ષકશ્રી અને શુદ્ધ સમાહર્તાશ્રી, ઉદ્યોગભવન, ગાંધીનગર
૧૬. નાણાં સલાહકારશ્રી(ઊર્જા અને પેટ્રોકેમિકલ્સ), નાણાં વિભાગ, સચિવાલય, ગાંધીનગર
૧૭. વિભાગના સર્વે અધિકારીશ્રીઓ
૧૮. સિલેક્ટ હાઇલ/નાયબ સેક્શન અધિકારીશ્રીની અંગત હાઇલ

Government of Gujarat
Energy and Petrochemicals Department
G. R. No: SLR/11/2020/Mini-185/B1
Sachivalaya, Gandhinagar
Date: 11 /12/2020

1. READ:

- 1) Energy & Petrochemicals Dept. G.R. No.SLR/11/2019/51/B1, Date: 06/03/2019.
- 2) MNRE,Gol's Order No. 32/645/2017-SPV DIVISION, Date: 08/03/2019.
- 3) MNRE,Gol's OM No. 32/645/2017-SPV DIVISION, Date: 22/07/2019.
- 4) MNRE,Gol's OM No. 32/54/2018-SPV DIVISION, Date: 13/08/2019.
- 5) MNRE,Gol's OM No. 32/645/2017-SPV DIVISION, Date: 31/12/2019.
- 6) MNRE,Gol's OM No. 32/645/2017-SPV DIVISION, Date: 13/11/2020.

2. PREAMBLE

The Government of Gujarat is committed for the development of renewable energy sector and more particularly solar power sector to curb the threats of effects of Climate Change and to provide clean and green energy for the future generations to come.

The State also aims to generate power on decentralized locations for its consumption locally as well as facilitating small investors to contribute in green energy generation through small scale solar power plants on decentralized basis.

The Central Government through its Ministry of New & Renewable Energy has launched Component-A of Pradhan Mantri Kisan Urja Suraksha evam Utthan Mahabhiyan (PM-KUSUM) scheme for Decentralized Ground/Stilt Mounted Grid Connected Solar or other Renewable Energy Power Plants.

It is aimed at developing decentralized Solar energy and other renewable energy generation Plants of capacity up to 2 MW which could be connected directly to existing sub-stations of State Utility, thus saving in transmission system requirement apart from T&D losses. Such plants near these sub-stations may be developed, preferably by farmers, giving them an opportunity to increase their income.

The Renewable Energy based Power Plants (REPP) under the scheme would be implemented primarily on barren, uncultivable, fallow, pasturelands and marshlands of farmers. Agricultural land is also permitted under the scheme provided that solar plants are installed in stilt fashion (i.e. raised structure for installation of Solar panels) and with adequate spacing between panel rows for ensuring that farming activity is not affected. The RPG would be free to adopt any renewable energy source or technology while responding to the bid. However, in case of cultivable land with solar plants, the same may be installed on stilts, so that the farmers continue to cultivate the land, apart from getting the benefit of lease rent. In such a case DISCOM may also float bids (in case of specific substations) where setting up of solar projects on stilts may be mandatorily required, and bids for energy tariff invited accordingly.

3. RESOLUTION

Upon elaborate discussion and consultation with the concerned administrative departments of Government of Gujarat and various stakeholders, the State Government is pleased to announce that the Scheme for Decentralized Ground/Stilt Mounted Grid Connected Solar or other Renewable Energy Power Plants under Component A of PM-KUSUM Scheme is to be implemented in Gujarat state in consonance with MNRE's scheme guidelines and following terms and conditions:

1. The Solar Projects having size of 0.5 MW and above but not exceeding 2.00 MW installed and commissioned during the operative period of this Scheme shall qualify to be termed as "PM KUSUM-A PROJECTS" and be eligible for benefit of this Scheme. To support small farmers, the solar power projects smaller than 500 KW may be allowed based on techno-commercial feasibility.
2. REPP will be setup by individual farmers/ group of farmers/ cooperatives/ panchayats/ Farmer Producer Organizations (FPO)/Water User associations (WUA) hereinafter called Renewable Power Generator (RPG).
3. In case of REPP being developed by a developer, the Net-Worth of the developer should not be less than Rs. 1.00 Crore per MW (of the capacity applied). This shall not be applicable for farmers cooperative or panchayats or Farmer Producer Organizations (FPO) /Water User associations (WUA) or farmers setting up REPP in their own lands.
4. Tariff applicable under this Scheme shall be as per following mechanism: The tariff contracted in the competitive bidding process conducted by GUVNL and adopted by GERC at which PPAs are signed for procurement of Solar Power from projects located outside Solar Park prevailing as on 31st March (computed based on simple average of such tariff discovered and contracted over six months ending on 31st March) of any given year *with an addition of* Rs. 0.20 per unit shall be the applicable tariff at which the PPAs shall be signed during the immediately succeeding period of April to September by DISCOMs with these Solar Projects under this Scheme and similarly the contracted tariff prevailing as on 30th September of any given year (computed based on simple average of such tariff discovered and contracted and adopted by GERC over six months ending on 30th September) *with an addition of* Rs. 0.20 per unit shall be the applicable tariff for PPAs to be signed during the immediately succeeding period of October to March. However, the above mechanism of applicable tariff shall be subject to approval of GERC and the DISCOMs shall take one time approval of GERC. The Rs. 0.20 per unit addition in tariff is allowed towards Rs.0.12 per unit for saving in transmission loss as power will be injected in distribution grid and Rs.0.08 per unit is to compensate for expensive land cost, higher capital investment and maintenance cost due to small size of projects.

As the mechanism to determine tariff applicable is same as the "Policy of Development of Small Scale Distributed Solar Projects - 2019". The tariff

applicable for projects under "Policy of Development of Small Scale Distributed Solar Projects – 2019" can be made applicable/adopted under the "PM KUSUM - A SCHEME" subject to approval of GERC.

5. The above mentioned tariff shall be applicable for a PPA term of 25 years from Commercial Operation Date of the Projects.
6. The REPP Project shall be developed preferably on the land within 5 km radius of the substation, in order to avoid cost of transmission line and reduce transmission losses. In case the farmers/ group of farmers/ cooperatives/ panchayats/ Farmer Producer Organizations (FPO)/ Water User associations (WUA) etc. are not able to arrange equity required for setting up the REPP, they can opt for developing the REPP through developer(s) which will be considered as RPG in this case. In such a case, the land owner will get lease rent as mutually agreed between the parties. The lease rent may be in terms of Rs per year per acre of land or in terms of Rs per unit energy generated per acre of land area. The farmer(s) may opt for payment of lease rent directly in their bank account by the DISCOM, from the payment due to the developer.
7.
 - a. **Notification of sub-station wise generation capacity**
GETCO shall assess and notify RE generation capacity that can be injected in to all 66/11 kV or 132/11 kV or 220/11 kV sub-station of rural areas and place such notification on its website for information of all stakeholders. To facilitate farmers willing to lease out their land for development of RE plants near above notified substation(s), as per provisions of this scheme, DISCOM may also place list of such farmers on their website. However, the leasing of land of any farmers will be a bi-partite agreement between the farmer and the developer and DISCOM will not be held responsible for failure in getting the land leased out to a developer. To meet additional demand DISCOM will augment the capacity of sub-station under IPDS or any other scheme.
 - b. **Expression of Interest (EoI) for Short-listing of RPG**
GEDA shall invite 66/11 kV or 132/11 kV or 220/11 kV sub-station wise EoI from RPG to participate in selection process for development of decentralized renewable power plants. The RPG shall submit their interest against the EoI as per the schedule notified by GETCO. An RPG will not be allowed to apply for more than one renewable power plant for a particular 66/11 kV or 132/11 kV or 220/11 kV sub-station. The EoI of an RPG will also be disqualified if it is found that its proprietor/partner/director/member has also filed EoI as proprietor/partner/director /member for another RPG for the same sub-station.
8. In case the total aggregate capacity of eligible applications received for a particular sub-station is less than or equal to the capacity notified for connectivity at the sub-station, LoA will be awarded to all eligible applicants for procurement of renewable power at a pre-fixed levelised tariff.

In case the total aggregate capacity of eligible application received for a particular sub-station is more than the capacity notified for connectivity at the sub-station, then DISCOM or any agency authorized by the DISCOM shall invite Bids from all these applicants, in such cases the prefixed levelised tariff will be the ceiling tariff for bidding. All eligible applicants will have to submit tariff bids within a prescribed time. Selection of bidders will be based on the lowest tariff offered in the ascending order as quoted by the bidders in the closed bid or e-reverse auction as the case may be. LoA will be awarded to all successful bidders.

9. The DISCOM or any agency authorized by the DISCOM may request to submit non-refundable processing fee from the interested RPGs, which in no case shall be higher than Rs. 5000 per MW or part thereof of the capacity applied for.
10. Gujarat Energy Developer Agency (GEDA) shall be the State Government Nodal Agency for facilitation and implementation of this Scheme. The nodal agency will facilitate and assist the Project Developers to undertake the activities like registration of projects, responding to queries and problems of Developers of Power Projects, issuing Commissioning certificates etc.
11. The RPG shall provide the following Bank Guarantees to DISCOM as follows:
 - Earnest Money Deposit (EMD) of Rs. 1 Lakh/MW in the form of Bank Guarantee along with EoI.
 - Performance Bank Guarantee (PBG) of Rs. 5 Lakh/MW within 30 days from date of issue of Letter of Award.

The Bank Guarantees against EMD shall be returned to the selected RPG on submission of valid PBGs. The selected RPGs are required to sign PPA with the DISCOM in line with the timeline given in the Guidelines. In case, the selected RPG fails to execute the PPA within the stipulated time period, the Bank Guarantee equivalent to EMD shall be en-cashed by DISCOM as penalty. In case any bidder is not selected, DISCOM shall release the EMD within 15 days of the date of issue of LoA to selected RPG(s). The PBGs shall be valid for a period of 12 months from the date of issue of LoA for the REPP. The PBG will be returned to the RPG immediately after successful commissioning of solar power plant, after taking into account any penalties due to delay in commissioning as per provisions stipulated in the Guidelines.

12. The selected RPG shall commission the solar power plant within twelve months from date of issuance of LoA. The DISCOM is obliged to purchase power from that commissioned REPP any time after the issuance of LoA. A Committee duly constituted by GEDA comprising of DISCOM and GEDA officials will physically inspect the Plant in not more than 03 days from the date of receiving a call from the RPG and GEDA shall certify successful commissioning of the plant. In case any RPG fails to achieve COD within the stipulated period of twelve months, DISCOM shall encash the Performance Bank Guarantee (PBG) in the following manner:
 - a. Delay up to two months - The PBG on per day basis and proportionate to the balance capacity not commissioned.

- b. In case the commissioning of the solar power plant is delayed over two months, the PPA capacity shall stand reduced / amended to the Project capacity commissioned at the end of 11th month from date of issuance of Letter of Award.

In case of delays of plant commissioning due to the reasons beyond the control of the RPG, DISCOM after having been satisfied with documentary evidences produced by the RPG for the purpose can extend the time for commissioning date without any financial implications to the RPG.

13. **Commercial Operation Date (COD)**
The Commercial Operation Date (COD) shall be considered as the actual date of commissioning of the solar power plant as declared by the Commissioning Committee.
14. **Release of Performance Based Incentive to DISCOM**
DISCOM would be eligible to get PBI @ Rs. 0.40 per unit purchased or Rs. 6.6 lakh per MW of capacity installed, whichever is less, for a period of five years from the COD from MNRE as mentioned in MNRE's guideline.
15. **Clearances required from the State Government and other local bodies**
The RPG is required to obtain necessary clearances as required for setting up the REPP.
16. The Central Electricity Authority (CEA), GoI has published Central Electricity Authority (Technical Standards for connectivity to the Grid) Amendment Regulations, 2013, specifying various technical requirements for grid connection of renewable energy sources. These regulations and provisions of Grid Code, as amended from time to time, shall be binding to the Power Projects.
17. Interconnection voltages for projects upto 2 MW shall be 11KV or 66 KV. The Interconnection voltages shall be governed as per GERC Regulations, as amended from time to time. However, the injection from MW Scale Projects shall be preferred directly in 66/132/220 KV Sub-station through a dedicated 11 KV feeder for better grid stability and reliability for injection of power.
18. Solar Project Developers shall be allowed to inject power at Interconnection Point, which shall be determined by DISCOM based on technical feasibility. The developers shall lay dedicated line at their own cost for evacuation of power up to Interconnection Point as per system study by DISCOM.
19. To optimize costs, Common dedicated evacuation line may be set up by a cluster of adjoining Developers with appropriate metering at their respective end of project as well as a common meter for such Project Developers at the Interconnection Point. Energy injection by each Solar Project at the receiving end shall be worked out on the basis of meter reading of common meter appropriately apportioned as

per the respective meter reading at the sending end meter of that Solar Project by DISCOM / SLDC / ALDC.

20. The electricity generated from the Solar Projects, shall be metered on 15-minute time block basis by DISCOM / ALDC / SLDC at Interconnection Point. For the purpose of energy accounting, solar generating projects shall provide ABT-compliant meters and RTUs at the interface points. Interface metering shall conform to the Central Electricity Authority (Installation and Operation of Meters) Regulations 2014 and amendment thereto. DISCOM / SLDC / ALDC shall stipulate specifications in this regard.
21. DISCOMs have to abide by the GERC Regulations and Orders from time to time. GERC has been deciding the overall RPO and sub-category wise procurement of Renewable energy Power from each Renewable energy Source. The DISCOMs shall buy Solar Power under this Scheme for meeting their RPO.
22. The Hon'ble Gujarat Electricity Regulatory Commission shall be guided by this Scheme while framing its rules, regulations and orders. The Solar Projects shall abide by the provisions of the GERC Regulation for forecasting and scheduling of Power Projects. The drawl of reactive power shall be charged as per the GERC order, as amended from time to time.
23. The Operation and Maintenance of dedicated evacuation line shall be carried out at the cost of the Project Developer as per applicable technical standards and best practices.
24. After commissioning of solar project, the installation shall not be allowed to be transferred inter se or from one location to another.
25. If there is any confusion or dispute about the meaning, intent or purpose of any provision of this Scheme, the interpretations given by Energy & Petrochemicals Department, Government of Gujarat shall be final and binding to all concerned.

This is issued with the concurrence of the Finance Department dated 12/10/2020 on the Department's file of even number.

By order and in the name of the Governor of Gujarat



(Dr. Nisarg Joshi)

Deputy Secretary to the Government

Copy To :-

- o *The Principal Secretary to H.E. The Governor of Gujarat, Raj Bhavan, Gandhinagar.
- o The Additional Chief Secretary to Hon. Chief Minister, Sachivalaya, Gandhinagar.
- o The P.S. to Hon. Dy. Chief Minister, Sachivalaya, Gandhinagar.
- o The P. S. to Hon. Minister (Energy), Sachivalaya, Gandhinagar.
- o The P.S. to Hon. MoS (Energy), Sachivalaya, Gandhinagar.
- o The Secretary, Ministry of Power, Govt. of India, Shram Shakti Bhavan, New Delhi.

- The Secretary, Ministry of New & Renewable Energy, CGO Complex, New Delhi.
 - The Secretary, Central Electricity Regulatory Commission, New Delhi.
 - The Chairman, Central Electricity Authority, New Delhi.
 - The Joint Secretary to Chief Secretary, Sachivalaya, Gandhinagar.
 - *The Secretary, GERC, Gift City, Gandhinagar.
 - *The Registrar, Gujarat High Court, Ahmedabad.
 - *The Secretary, Vigilance Commission, Gandhinagar.
 - The Additional Chief Secretary, Finance Department, Sachivalaya, Gandhinagar
 - The Principal Secretary, Climate Change Department, Sachivalaya, Gandhinagar
 - *The Secretary, Gujarat Legislature Secretariat, Sachivalaya, Gandhinagar.
 - The Resident Commissioner, Gujarat State, New Delhi.
 - The Account General, Ahmedabad / Rajkot.
 - All Departments of Secretariat, Sachivalaya, Gandhinagar.
 - All Branches of Energy & Petrochemicals Department.
 - The Chairman, Power Finance Corpo. Ltd. New Delhi.
 - The Managing Director, Gujarat Power Corpo. Ltd., Gandhinagar.
 - The Managing Director, Gujarat Urja Vikas Nigam Ltd., Vadodara.
 - The Managing Director, Gujarat State Electricity Corpo. Ltd., Vadodara.
 - The Managing Director, Gujarat Energy Transmission Corpo. Ltd., Vadodara.
 - The Managing Director, Uttar Gujarat Vij Company Ltd., Mehsana.
 - The Managing Director, Madhya Gujarat Vij Company Ltd., Vadodara.
 - The Managing Director, Dakshin Gujarat Vij Company Ltd., Surat.
 - The Managing Director, Paschim Gujarat Vij Company Ltd., Rajkot.
 - The Director, Gujarat Energy Development Agency, Gandhinagar
 - The Chief Electrical Inspector & Collector of Electricity Duty, Gandhinagar
 - All Collectors.
 - The Chief Executive Officer, Torrent Power Ltd., Lal Darwaja, Ahmedabad.
 - Dy. Section Officer's select file.
- *By Letter.**

୧୨୮

በዚህ ሪፖርት ላይ የተጠቀሱት ስራዎች በጥቅምት ፬፻፲፱፻፲፱ ዓ.ም. በሚከተለው መንገድ ተከናውኗል፡

፡በኮከቦቹ

0608'h0'6-11 1051215 1211124-2608/8h/28 : 8185 K4 110110121 99MRE (26)

[illegible]

(90) MNRE (06) 2002-60'hb-11) 1992-09-26/28/29/30/31/32/33/34/35/36/37/38/39/40/41/42/43/44/45/46/47/48/49/50/51/52/53/54/55/56/57/58/59/60/61/62/63/64/65/66/67/68/69/70/71/72/73/74/75/76/77/78/79/80/81/82/83/84/85/86/87/88/89/90/91/92/93/94/95/96/97/98/99/100/101/102/103/104/105/106/107/108/109/110/111/112/113/114/115/116/117/118/119/120/121/122/123/124/125/126/127/128/129/130/131/132/133/134/135/136/137/138/139/140/141/142/143/144/145/146/147/148/149/150/151/152/153/154/155/156/157/158/159/160/161/162/163/164/165/166/167/168/169/170/171/172/173/174/175/176/177/178/179/180/181/182/183/184/185/186/187/188/189/190/191/192/193/194/195/196/197/198/199/200/201/202/203/204/205/206/207/208/209/210/211/212/213/214/215/216/217/218/219/220/221/222/223/224/225/226/227/228/229/230/231/232/233/234/235/236/237/238/239/240/241/242/243/244/245/246/247/248/249/250/251/252/253/254/255/256/257/258/259/260/261/262/263/264/265/266/267/268/269/270/271/272/273/274/275/276/277/278/279/280/281/282/283/284/285/286/287/288/289/290/291/292/293/294/295/296/297/298/299/300/301/302/303/304/305/306/307/308/309/310/311/312/313/314/315/316/317/318/319/320/321/322/323/324/325/326/327/328/329/330/331/332/333/334/335/336/337/338/339/340/341/342/343/344/345/346/347/348/349/350/351/352/353/354/355/356/357/358/359/360/361/362/363/364/365/366/367/368/369/370/371/372/373/374/375/376/377/378/379/380/381/382/383/384/385/386/387/388/389/390/391/392/393/394/395/396/397/398/399/400/401/402/403/404/405/406/407/408/409/410/411/412/413/414/415/416/417/418/419/420/421/422/423/424/425/426/427/428/429/430/431/432/433/434/435/436/437/438/439/440/441/442/443/444/445/446/447/448/449/450/451/452/453/454/455/456/457/458/459/460/461/462/463/464/465/466/467/468/469/470/471/472/473/474/475/476/477/478/479/480/481/482/483/484/485/486/487/488/489/490/491/492/493/494/495/496/497/498/499/500/501/502/503/504/505/506/507/508/509/510/511/512/513/514/515/516/517/518/519/520/521/522/523/524/525/526/527/528/529/530/531/532/533/534/535/536/537/538/539/540/541/542/543/544/545/546/547/548/549/550/551/552/553/554/555/556/557/558/559/560/561/562/563/564/565/566/567/568/569/570/571/572/573/574/575/576/577/578/579/580/581/582/583/584/585/586/587/588/589/590/591/592/593/594/595/596/597/598/599/600/601/602/603/604/605/606/607/608/609/610/611/612/613/614/615/616/617/618/619/620/621/622/623/624/625/626/627/628/629/630/631/632/633/634/635/636/637/638/639/640/641/642/643/644/645/646/647/648/649/650/651/652/653/654/655/656/657/658/659/660/661/662/663/664/665/666/667/668/669/670/671/672/673/674/675/676/677/678/679/680/681/682/683/684/685/686/687/688/689/690/691/692/693/694/695/696/697/698/699/700/701/702/703/704/705/706/707/708/709/710/711/712/713/714/715/716/717/718/719/720/721/722/723/724/725/726/727/728/729/730/731/732/733/734/735/736/737/738/739/740/741/742/743/744/745/746/747/748/749/750/751/752/753/754/755/756/757/758/759/760/761/762/763/764/765/766/767/768/769/770/771/772/773/774/775/776/777/778/779/780/781/782/783/784/785/786/787/788/789/790/791/792/793/794/795/796/797/798/799/800/801/802/803/804/805/806/807/808/809/810/811/812/813/814/815/816/817/818/819/820/821/822/823/824/825/826/827/828/829/830/831/832/833/834/835/836/837/838/839/840/841/842/843/844/845/846/847/848/849/850/851/852/853/854/855/856/857/858/859/860/861/862/863/864/865/866/867/868/869/870/871/872/873/874/875/876/877/878/879/880/881/882/883/884/885/886/887/888/889/890/891/892/893/894/895/896/897/898/899/900/901/902/903/904/905/906/907/908/909/910/911/912/913/914/915/916/917/918/919/920/921/922/923/924/925/926/927/928/929/930/931/932/933/934/935/936/937/938/939/940/941/942/943/944/945/946/947/948/949/950/951/952/953/954/955/956/957/958/959/960/961/962/963/964/965/966/967/968/969/970/971/972/973/974/975/976/977/978/979/980/981/982/983/984/985/986/987/988/989/990/991/992/993/994/995/996/997/998/999/1000/1001/1002/1003/1004/1005/1006/1007/1008/1009/1010/1011/1012/1013/1014/1015/1016/1017/1018/1019/1020/1021/1022/1023/1024/1025/1026/1027/1028/1029/1030/1031/1032/1033/1034/1035/1036/1037/1038/1039/1040/1041/1042/1043/1044/1045/1046/1047/104

(င) MNRE လျှောက်ထားချက်အရ ၂၀၁၆-၁၇ ခုနှစ်တွင် အောက်ဖော်ပြပါအတိုင်း အသုံးပြုခွင့်ရရှိခဲ့ပါသည်။

(2) MNRE ලබාගත් ලේඛන 213 ක් : 2007/11-2008/11 වන අවධිය තුළ

(၄)MNR ဂျူနီယာ အထက၊ ကမ္ဘောဇ-၁၀၆/၈၃၅/၂၀၁၉-၂၀၂၀ ခုနှစ်၊ မတ်လ ၁ ရက်နေ့မှ စတင် ပြန်ရောက်အားပြုပေးပါ။

ՃԵՌՆՈՂ-ԻՍ ԽԵՐԻՆ ՄԻԽԵԼԵ

(5) ଅନୁସନ୍ଧାନ (MNR) ବିଭାଗର ମୁଖ୍ୟ ଅଧିକାରୀଙ୍କୁ: 32/54/2099-

[illegible]

ኩ-6826-8600-2ኃ/ከ : ናዘድ ከጌዓ ሆከጌዓጌዓ ጋር-10 ሆከጌዓጌዓ ኩ-6826-8600-2ኃ/ከ (2)

17-6828-2602-2ኦክ) : ዳይሬክቶሬት ለግብርናና ለጥሬ ጥቅምት ምርት ማሻሻያና ለጥሬ ጥቅምት ምርት ማሻሻያ (ደ)

[illegible][illegible]

ՆԱԽԲ ԼՈՒԷԹ

0202/50/ဒ်း:ကုဉ်းပု

ግሪክ ስጦታ

ቴሌ/ፎኢክስ/ጸሐፊ/ጊዜ : ያዘዘ ከጊዜ

ଇଚ୍ଚିତ୍ତ୍ୱ ଲେଖକମାନଙ୍କର ଗୁଣ ଓ ଗୁଣ

ଅନୁରୋଧ ପତ୍ର

[illegible]

કેન્દ્ર સરકાર દ્વારા વર્ષ ૨૦૨૨ સુધીમાં ૧૦૦ ગીગા વોટ સોલાર પાવર ઉત્પાદનનો મહત્વાકાંક્ષી લક્ષ્યાંક રાખવામાં આવેલ છે. આ માટે કેન્દ્ર સરકારના મીનીસ્ટ્રી ઓફ ન્યુ એન્ડ રીન્યુએબલ એનર્જી (MNRE) દ્વારા ખેડૂતો માટે તારીખ ૮.૩.૨૦૧૯ ના હુકમથી સોલાર પંપ સેટ્સ ઉપલબ્ધ કરાવવા માટે પ્રધાન મંત્રી કિસાન ઉર્જ સુરક્ષા એવમ ઉત્થાન મહાભિયાન (PM-KUSUM) યોજનાને મંજૂરી આપવામાં આવેલ છે. MNRE દ્વારા તારીખ ૨૨.૭.૧૯ની કચેરી યાદીથી કોમ્પોનન્ટ-A, B અને C ની ગાર્ડ લાઈન બહાર પાડવામાં આવેલ છે. જે અંતર્ગત કોમ્પોનન્ટ-B હેઠળ દેશભરમાં ૧૭.૫૦ લાખ રેટેન્ડ એલોન સોલાર ઉર્જ સંચાલિત કૃષિ સિંચાઈ પંપ આપવા માટે અમલવારીની શરતો સાથે કામગીરીની માર્ગદર્શિકા આપવામાં આવેલ છે.

આ યોજનામાં PM-KUSUM કોમ્પોનન્ટ-B હેઠળ ગુજરાત રાજ્યને MNRE દ્વારા શરૂઆતમાં ૪૦૦૦ રેટેન્ડ એલોન સોલાર પંપ લગાડવા માટે તારીખ ૧૫.૦૧.૨૦૨૦ ના હુકમથી મંજૂરી આપવામાં આવેલ છે.

ઠ રા વ :

રાજ્ય સરકાર દ્વારા સઘન વિચારણાને અંતે રાજ્યનાં ખેડૂતોના લાભાર્થે કેન્દ્ર સરકારની પ્રધાન મંત્રી કિસાન ઉર્જ સુરક્ષા એવમ ઉત્થાન મહાભિયાન (PM-KUSUM) યોજનાના કોમ્પોનન્ટ-B હેઠળ રેટેન્ડ એલોન ઓફ ગ્રીડ સોલાર ઉર્જ સંચાલિત સિંચાઈ પંપ સેટ્સ ઉપલબ્ધ કરાવવાની યોજનાની અમલવારી PM-KUSUM યોજનાની ગાર્ડ લાઈન પ્રમાણે નીચેની શરતો મુજબ કરવા આથી ઠરાવવામાં આવે છે.

આ યોજનાના અમલીકરણ માટેની નોડલ એજન્સી ગુજરાત ઉર્જ વિકાસ નિગમ લિમિટેડ (GUVNL) રહેશે તથા અમલવારી જે તે વિસ્તારની વીજ વિતરણ કંપની દ્વારા કરવામાં આવશે.

શરતો:-

- A. આ યોજનામાં જ્યાં ગ્રીડ સપ્લાય ઉપલબ્ધ નથી તેવા ઓફ ગ્રીડ વિસ્તારમાં પિયત માટે/હયાત ડીઝલથી ચાલતા પંપ સેટને બદલવા માટે ખેડૂતોને રેટેન્ડ એલોન સોલાર એગ્રીકલ્ચર પંપ સ્થાપિત કરવા માટે સહાય કરવામાં આવશે. આ યોજનામાં હયાત ગ્રીડથી વિજબેડાણ આપવું ટેકનીકલી શક્ય ન હોય તેમજ કોમર્શીયલી વાચેબલ (વ્યવહારુ) ન હોય તેવા દુર-સુદુરના વિસ્તાર, જંગલ, ઓફ ગ્રીડ વિસ્તારમાં ડીઝલથી ચાલતા પંપ સેટને બદલવા માટે ખેત તલાવડી તથા સરહેસ વોટરથી પિયત સુવિધા ધરાવતા અરજદારોનો સમાવેશ કરવામાં આવશે.
- B. આ યોજનામાં સોલાર ફોટોવોલ્ટેઇક સંચાલિત ઓફ ગ્રીડ આધારીત, કૃષિ હેતુ ૧ હો.પા., ૨ હો.પા., ૩ હો.પા., ૫ હો.પા., ૭.૫ હો.પા. અને ૧૦ હો.પા.નાં ડી.સી./ એ.સી. સબમર્સીબલ

- પંપ (વોટર ફિલ્ડ મોટર્સ), સરફેસ પંપ અને સબમર્સીબલ પંપ (ઓર્બલ ફિલ્ડ મોટર્સ) સોલાર પંપનો સમાવેશ થઈ શકશે.
- C. આ યોજના હેઠળ પિયત સહકારી મંડળી/સંગઠન અને કલરુટર આધારિત સિંચાઈ સિસ્ટમ પણ આવરી લેવામાં આવશે. જે કે, નાના અને સીમાંત ખેડૂતોને પ્રાધાન્ય આપવામાં આવશે.
- D. સિંચાઈના હેતુ માટે પાણીનો ઉપયોગ ઓછો કરવા માટે, સૂક્ષ્મ સિંચાઈ પદ્ધતિઓનો ઉપયોગ કરતા અથવા સૂક્ષ્મ સિંચાઈ યોજનાઓ હેઠળ આવરી લેનારા અથવા સૂક્ષ્મ સિંચાઈ સિસ્ટમની યોજનામાં ખેડાનાર ખેડૂતો/અરજદારોને પ્રાધાન્ય આપવામાં આવશે.
- E. આ યોજનામાં લાભાર્થીને કુલ સીસ્ટમ ખર્ચના 30% રકમ કેન્દ્ર સરકારની સહાય (CFA) તરીકે, 30% રકમ રાજ્ય સરકારની સહાય (સબસીડી) તરીકે આપવામાં આવશે અને બાકીની 40% રકમ લાભાર્થી એટલે કે ખેડૂતે ભોગવવાની રહેશે.
- ઉપરોક્ત સબસીડી/CFA ૭.૫ હો.પા. ની ક્ષમતા સુધીના પંપસેટ પુરતી મર્યાદિત રહેશે. ૭.૫ હો.પા. થી ઉપરની ક્ષમતાના પંપસેટ માટે ૭.૫ હો.પા. ના પંપસેટને મળવા પાત્ર સબસીડી લાગુ પડશે અને તફાવતની રકમ લાભાર્થીએ ભરવાની રહેશે.
- F. ડાર્કઝોન વિસ્તારમાં નવા પંપ સેટને મંજૂર કરવામાં આવશે નહીં પરંતુ હયાત ડીઝલ પંપ સેટને સોલાર પંપમાં રૂપાંતરીત કરવા માટે અરજદારોએ સરકારશ્રીનાં પ્રવર્તમાન ધારાધોરણો અનુસાર સૂક્ષ્મ પિયત પદ્ધતિનો અમલ કરવાનો રહેશે.
- G. વધુમાં જ્યારે પણ ઓફગ્રીડ વિસ્તારમાં કૃષિ વીજ ખેડાણો માટેની વીજ ગ્રીડની આંતર માળખાકીય સુવિધાઓ પહોંચે ત્યારે આવા ઓફ-ગ્રીડ સોલાર વોટર પંપને ગ્રીડની ક્ષમતાના આધારે ગ્રીડ સાથે સરપ્લસ વીજળી ફીડ (FEED) કરવા બેડી શકાય. આ સરપ્લસ વીજળી સંબંધિત વીજ વિતરણકંપની દ્વારા રાજ્ય સરકાર/ભૂઈઆરસીએ નક્કી કરેલ દરે ખરીદી શકાશે.
- H. કેન્દ્ર સરકાર દ્વારા મળવાપાત્ર સબસીડીનો લાભ લેવા માટે GUVNL એ MNREની ગાર્ડ લાઈન તથા સંદર્ભ દર્શિત કચેરી યાદી ક્રમાંક (ક) થી (૧૨) મુજબની કાર્યવાહી કરવાની રહેશે.

આ યોજનાનો લાભ લેવા ઈચ્છતા ખેડૂતો/અરજદારો માટેનાં માપદંડો/ ધારાધોરણો/ શરતો નીચે મુજબ રહેશે :-

- (૧) જે અરજદારના નામે ઓછામાં ઓછી એક એકર જમીન અને તેમાં બોર/કુવો/ખેત તલાવડી હયાત હશે તેમને જ આ યોજનાનો લાભ મળી શકશે. આમ છતાં જે અરજદારની જમીનમાં બોર/કુવો/ખેત તલાવડી નહીં હોય છતાં અરજી કરેલ હશે તો આવા અરજદારોની અરજીનો અગ્રતાક્રમ હયાત બોર/કુવો/ખેત તલાવડી ધરાવતા અરજદારો પછી રહેશે. તેમજ લાભાર્થીને જ્ઞાનો ભરવાની બજા કર્યા પછી બોર/કુવો/ખેત તલાવડી બનાવવા માટે બે માસનો સમય આપવાનો રહેશે.

- (૨) લાભાર્થી એક જ સર્વે નંબરમાં અથવા પાસ પાસેના સંયુક્ત સર્વે નંબરો ગણતરીમાં લેતા એક જ માલિકીની કુલ ઓછામાં ઓછી એક એકર જમીન ધરાવતો હશે તો તે સદર યોજનામાં નોંધણી કરાવી શકશે. સદર કિરસામાં જમીન એક સાથે હોવી અનિવાર્ય રહેશે તથા લાભાર્થીને ૫ વર્ષ સુધી પરંપરાગત વીજ બેડાણ મળવા પાત્ર રહેશે નહીં અને લાભાર્થી કે લાભાર્થીના વારસદારો તેવી માંગણી કરી શકશે નહીં.
- (૩) કૃષિ હેતુ પરંપરાગત વીજ બેડાણ માટે નોંધાયેલ તમામ અરજીઓ કે જેમાં અંદાજિત રકમ પાઠવેલ હોય અથવા જે અરજદારોએ અંદાજિત રકમ ભરપાઈ કરેલ હોય પરંતુ કામ શરૂ ના થયું હોય તથા અગાઉ કૃષિ વીજબેડાણ માટે અરજીની નોંધણી કરાવેલ ન હોય એવા તથા તત્કાલ યોજનામાં વીજ બેડાણ મેળવવા રવીચ ઓવર/તબદીલ કરેલ તમામ અરજદારોને આ યોજનાનો લાભ મળી શકશે.
- (૪) રાજ્ય સરકારની અગાઉની સોલાર પંપની યોજનામાં જે અરજદારે અરજી કરેલ હોય તેમને સોલાર પંપ કે પરંપરાગત વીજ બેડાણ હજુ સુધી મળેલ ન હોય તેઓ એક મહિનાની નિયત સમય મર્યાદામાં જુની નોંધણીની પાવતીની ઝેરોક્ષ નકલ સાથે અરજી કરશે તો આવા અરજદારોને અગ્રતા આપવામાં આવશે.
- (૫) જે અરજદારોએ પરંપરાગત વીજબેડાણ માટે અંદાજિત રકમ ભરી દીધી હશે તેમને આ યોજનામાં ભરવી પડતી ફાળાની રકમ સામે આ રકમ સરભર કરી આપવામાં આવશે.
- (૬) આ યોજનામાં અરજી કરનાર તમામ અરજદારોએ અરજીફોર્મ સાથે રૂ. ૧૦૦૦/- ડીપોઝીટ પેટે જે તે સંબંધિત પેટા વિભાગીય કચેરીમાં ભરવાના રહેશે. અરજદારે એમએનઆરઈ થકી EOI પ્રક્રિયાથી નિયત કરેલ સોલાર સિસ્ટમની કુલ કીંમતના ૪૦% ફાળાની રકમ તથા વધારાની ભરવાપાત્ર રકમ સંલગ્ન વીજ વિતરણ કંપનીની જે તે પેટા વિભાગીય કચેરી ખાતે એક મહિનામાં ભરપાઈ કરવાની રહેશે. આ રકમ ભરતી વખતે ડિપોઝીટની રકમ બાદ આપવામાં આવશે. ખાસ સંજોગોમાં ફાળાની ૪૦%ની રકમ એક મહિનામાં ન ભરી શકે તેવા કિરસામાં જે તે વીજ વિતરણ કંપનીના પ્રવર્તમાન નિયમ અનુસાર સમય મર્યાદા વધારી શકશે.
- (૭) સોલાર પંપ અને તેને સંલગ્ન તમામ સાધનોની માલિકી પાંચ વર્ષ સુધી સરકારની રહેશે. આ સમયગાળો પૂર્ણ થયા બાદ લાભાર્થી પરંપરાગત કૃષિ વીજ બેડાણ માંગી શકશે. પરંતુ સોલાર પંપ સિસ્ટમને ગ્રીડ સાથે જોડવાની રહેશે અને તે માટે ગ્રીડ ટાઈ ઈન્વર્ટરનો થનાર ખર્ચ લાભાર્થીએ ભરવાનો રહેશે.
- (૮) સોલાર પંપ, પેનલ તથા અન્ય માળખાની જાળવણી માટે જરૂરી ફેન્સીંગ લાભાર્થીએ સ્વખર્ચે કરાવવાની રહેશે તથા સિસ્ટમની સંપૂર્ણ જવાબદારી લાભાર્થીની રહેશે તથા લાભાર્થી પોતાની જમીનમાંથી સોલાર ઉર્જા પંપ અન્યત્ર ખસેડી શકશે નહીં કે કોઈને તબદીલ કરી શકશે નહીં.

(૯) સોલાર ઉર્જા પંપના સ્થાપન બાદ જે લાભાર્થી ૫ (પાંચ) વર્ષમાં પોતાની જમીનનું વેચાણ કરે/જમીનનો હેતુ ફેર કરાવે તો તેણે સબસીડીની તમામ રકમ સંબંધિત વીજ વીતરણ કંપનીને પરત કરવાની રહેશે.


(૧૦) સોલાર પેનલ દ્વારા ઉત્પન્ન થતી વીજળી ખેડૂત પોતાના વપરાશ માટે ઉપયોગ કરી શકશે. વીજ વીતરણ કંપની દ્વારા સોલાર ઉર્જાના વપરાશના યુનિટની નોંધણી કરવામાં આવશે પરંતુ તેનું બિલીંગ કરવામાં આવશે નહીં. આ માટે કોઈ પણ પ્રકારનો વીજ દર (ટેરીફ) લાગુ પડશે નહીં.

(૧૧) અરજદારને આ હેતુ માટે કરેલ એક જ સમાન રોકાણ માટે કેન્દ્ર સરકાર/રાજ્ય સરકાર ની બીજી કોઈ પણ યોજના હેઠળ અન્ય કોઈ લાભ મળી શકશે નહીં. જે અરજદારે સરકારશ્રીની બીજી કોઈ પણ યોજના હેઠળ કોઈ લાભ લીધો હોય તેવું જણાશે તો સબસીડીની રકમ તાત્કાલિક ધોરણે વસૂલ કરવામાં આવશે.

(૧૨) ઉપરોક્ત બાબતો સિવાય વખતો વખત આ યોજના માટે MNRE દ્વારા બહાર પાડવામાં આવતી ગાઈડ લાઈન/સુચન/નિયમો લાગુ પડશે.

(૧૩) સદર યોજનાની ભેગવાઈના અમલીકરણ કે અર્થઘટનની સમસ્યાનું નિવારણની સત્તા ઉર્જા અને પેટ્રોકેમિકલ્સ વિભાગ, ગુજરાત સરકારને હસ્તક રહેશે.

ગુજરાતના રાજ્યપાલશ્રીના હુકમથી અને તેમના નામે,


(વિજયસિંહ વાઘેલા)

અધિક સચિવ

ઊર્જા અને પેટ્રોકેમિકલ્સ વિભાગ

પ્રતિ,

- માન. રાજ્યપાલશ્રીના અંગત સચિવશ્રી, રાજભવન, ગાંધીનગર (અલગ પત્રથી)
- માન. મુખ્યમંત્રીશ્રીના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
- માન. ઉર્જા મંત્રીશ્રીના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
- માન. રાજ્ય કક્ષાના મંત્રીશ્રી (ઉર્જા) ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
- સર્વે માન. મંત્રીશ્રીઓના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
- સર્વે માન. રાજ્ય કક્ષાના મંત્રીશ્રીઓના અંગતસચિવશ્રી, સચિવાલય, ગાંધીનગર
- મુખ્ય સચિવશ્રીના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
- અ.મુ.સ.શ્રી (ઉર્જા અને પેટ્રોકેમિકલ્સ) ના અંગત સચિવશ્રી, સચિવાલય, ગાંધીનગર
- અધિક મુખ્ય સચિવશ્રી (નાણાં) ના અંગત સચિવશ્રી, નાણાં વિભાગ, સચિવાલય, ગાંધીનગર
- મેનેજીંગ ડાયરેક્ટરશ્રી, ગુજરાત ઉર્જા વિકાસ નિગમ લીમિટેડ, વડોદરા
- મેનેજીંગ ડાયરેક્ટરશ્રી, ઉત્તર ગુજરાત વીજ કંપની લીમિટેડ, મહેસાણા

- મેનેજીંગ ડાયરેક્ટરશ્રી, પશ્ચિમ ગુજરાત વીજ કંપની લીમીટેડ, રાજકોટ
- મેનેજીંગ ડાયરેક્ટરશ્રી, દક્ષિણ ગુજરાત વીજ કંપની લીમીટેડ, સુરત
- મેનેજીંગ ડાયરેક્ટરશ્રી, મધ્ય ગુજરાત વીજ કંપની લીમીટેડ, વડોદરા
- નિયામકશ્રી, ગુજરાત ઉર્જા વિકાસ એજન્સી, ગાંધીનગર
- નાણાંકીય સલાહકારશ્રી (ઉર્જા અને પેટ્રોકેમિકલ્સ), નાણાં વિભાગ, સચિવાલય, ગાંધીનગર
- મુખ્ય ઇજનેરશ્રી, ગુજરાત ઉર્જા વિકાસ નિગમ લીમીટેડ, વડોદરા
- વિભાગના સર્વે અધિકારીશ્રીઓ - વિભાગની સર્વે શાખાઓ
- સીલેક્ટ ક્ષાઇલ/ ના. સે. અધિ. અંગત ક્ષાઇલ

Annexure-B

F. No. 32/645/2017-SPV Division
Government of India
Ministry of New and Renewable Energy

Block no. 14, CGO Complex,
Lodi Road, New Delhi -110003

Date: 04 December 2020

Office Memorandum

Subject: Guidelines for Implementation of Feeder Level Solarisation under Component-C of PM-KUSUM Scheme

Vide OM of even number dated 04.11.2020, Ministry had issued scale-up and expansion of Pradhan Mantri Urja Suraksha evam Utthaan Mahabhiyaan (PM KUSUM) Scheme. Under the scaled up Scheme, a target of solarization of 7.5 lakh existing agricultural pumps has been kept through feeder level solarization under Component-C.

2. Under the above mentioned Order, it was also informed that guidelines for feeder level solarization under Component-C will be issued separately. Accordingly, in continuation of the above mentioned Order and Guidelines for PM KUSUM Scheme dated 22.07.2019 along with amendments and additions thereof, undersigned is directed to issue the Guidelines for implementation of feeder level solarisation under Component-C of PM-KUSUM Scheme.
3. This issues with approval of Competent Authority.



(Shobhit Srivastava)
Scientist-D

To

All concerned

Guidelines for Implementation of Feeder Level Solarisation under Component-C of PM-KUSUM Scheme

1. Background

Ministry had issued detailed Guidelines for implementation of Component-C of PM-KUSUM Scheme on 8 November 2019. As per provisions of the PM-KUSUM Scheme, the grid connected agriculture pumps can be solarised with central and state subsidy of 30% each and farmer's contribution of 40%. The solar capacity allowed is up to two times of the pump capacity in kW and surplus power will be purchased by DISCOM. Since this component was to be implemented on pilot mode, flexibility was given to states for using different models like net-metering, replacing pump with BLDC pump or any other innovative model as deemed fit by the states.

Based on discussions held with states it has been decided to also include feeder level solarisation under Component-C of PM-KUSUM Scheme. Accordingly, these guidelines are being issued to provide broad implementation framework for feeder level solarisation.

2. Implementation Methodology

The Distribution Company (DISCOM)/Power Department will be the implementing agency for feeder level solarisation in their respective areas. However, state Government may appoint any other expert agency to help DISCOM for tendering and other related activities of installation of solar power plant for feeder level solarisation.

Where agriculture feeders have already been separated the feeders may be solarised under the scheme. This will lead to lower cost both in terms of lower capital cost and cost of power. Feeders having major load for agriculture may also be considered for solarisation under the Scheme. The requirement of total annual power for an agriculture feeder will be assessed and a solar power plant of capacity that can cater to the requirement of annual power for that agriculture feeder can be installed either through CAPEX mode or RESCO mode, which will supply solar power to that feeder.

For example, a feeder having annual power requirement of say 10 lakh units, the power can be supplied by solar power plant of capacity around 600 kW with CUF of 19%. Higher or lower CUF, depending upon the average solar insolation available in the areas, may be considered for assessing solar power capacity.

Feeder level solar power plant may be installed to cater to the requirement of power for a single feeder or for multiple agriculture feeders emanating from a distribution sub-station (DSS) to feed power at 11 kV or at the higher voltage level side of the DSS depending upon on factors like availability of land, technical feasibility, etc., and there is no cap of the capacity of solar power plant for feeder level solarisation.

The DISCOMs may identify land near DSS, get ownership of land or its lease rights, provide connectivity at DSS and lay sub-transmission line between DSS and solar power plant.

For the purpose of calculating CFA, the cost of installation of solar power plant has been estimated as Rs. 3.5 Cr/MW. Under the Scheme solarisation of pumps of any capacity is allowed, however, in case of pumps of capacity above 7.5 HP, the CFA will be limited to solar capacity for 7.5 HP pumps.

A. Implementation under CAPEX Model

For installation of feeder level solar power plant CFA of 30% (50% in case of NE States, hilly states/UTs and Island UTs) will be provided by central Government and balance will be met through loan from NABARD/PFC/REC. Concessional financing will be available for solarisation of agriculture pumps as RBI has already included this component under priority sector lending and MoAFW has included community level solarisation under Agriculture Infrastructure Fund. The current outlay on subsidy being presently provided for supply of electricity to agriculture pumps by State Government can be used to repay the loan in five to six years after which power will be available free of cost and outflow from State Government's exchequer on account of electricity subsidy for agriculture will come to an end. On an average power for agriculture will be required only for 150 days in a year, the electricity produced from the solar power plant in the remaining days will possibly provide an additional income to the DISCOM. If this is also used to pay off the loans taken from NABARD/PFC/REC, the loan can be repaid sooner.

Advance CFA up to 40% of the total eligible CFA will be released to DISCOMs on completion of tendering process and signing of work agreement with EPC contractor selected for installation of solar power plant. Balance CFA will be released on successful commissioning of solar power plant and plant starts supplying power to agriculture feeder(s). The process of tendering and signing of work agreement with EPC contractor should normally be completed by implementing agency within six months from the date of issuance of sanction by MNRE.

The DISCOM may carry-out operation and maintenance of the solar power plant. Alternatively, the EPC contractor who install the solar power plant may also be given task for O&M of plant and supply guaranteed solar power for 25 years. Payment for O&M of solar plant can be linked with energy production. In case of failure of solar power plant to supply required solar power for the complete 25 years of project life, the MNRE may direct the DISCOM to refund the CFA amount on prorata basis. An undertaking to this effect will be submitted by DISCOM to MNRE.

B. Implementation under RESCO Model

For installation of feeder level solar power plants through RESCO model, the developers will be selected on the basis of lowest tariff offered for supply of required solar power for a period of 25 years. The developer will get CFA @ 30% of the estimated cost of installation of solar power plant i.e. Rs. 1.05 Cr/MW (30% of Rs. 3.5 Cr/MW). The solar power supplied by RESCO developer would be much cheaper than present cost of power delivered at distribution sub-station and therefore, DISCOM will save the amount equal to difference between the two. In the RESCO model the burden of electricity subsidy for agriculture will be reduced to the extent of difference mentioned above and not become zero as in case of CAPEX model, where once the loan is repaid, subsidy support from state Government is no longer required.

States may choose to provide upfront subsidy in lieu of electricity subsidy being given to agriculture consumers. This upfront subsidy from state could be in the form of VGF to RESCO developer, in addition to 30% CFA, to supply power to farmers of an agriculture feeder at present subsidised rates or any other rate fixed by state Government. For example, if present subsidised rate for agriculture is Rs. 1.50/kWh, the RESCO developer will be selected on the basis of lowest VGF bid for supply of solar power at Rs. 1.50/kWh.

CFA up to 100% of the total eligible CFA will be released to the RESCO developer through DISCOM on successful commissioning and declaration of Commercial Operation Date (COD) of solar power plant. The release of CFA to RESCO developer is subject to submission of bank guarantee equivalent to CFA amount. Bank Guarantee will be released in four lots of 25% each on successful operation of plant after 2.5 yrs, 5 yrs, 7.5 yrs and 10 yrs from CoD. For selection of RESCO developer and PPA, the Guidelines and model PPA issued by MNRE for implementation of Component-A of PM-KUSUM Scheme may be used, with suitable modifications. The maximum timeline allowed for commissioning of solar power plant by RESCO Developer will be nine months from the date of signing of PPA. The process of selection of RESCO Developer and signing of PPA should normally be completed by implementing agency within six months from the date of issuance of sanction by MNRE.

3. Feeder Separation:

Where agriculture feeders are not separated, loan for feeder separation will be available from NABARD/PFC/REC. Ministry of Power is also in process of finalising a Scheme to provide assistance for feeder separation. The savings on account of electricity subsidy on agriculture and the possible income from the surplus electricity generated by the solar power plant when it is not being used for irrigation can also be used to pay off the loan taken for feeder separation.

4. Water saving and enhancing farmers' income

The objective of Component-C of PM-KUSUM Scheme is to provide reliable day-time power to farmers, enhancing their income by purchasing surplus solar power and thus

incentivising them for saving water. In case of feeder level solarisation, farmers will get daytime reliable solar power for irrigation, but there is no provision of selling surplus solar power. Therefore, farmers can be incentivised for saving water and enhancing their income. The DISCOMs shall assess the average power requirement by farmers of an area depending upon various factors. This power requirement will be treated as their benchmark consumption. The DISCOMs shall incentivise farmers for consuming power less than benchmark consumption. Such saving of power shall be treated as surplus power injected by farmers and they will be paid by DISCOMs against this saved power at pre-determined tariff. This will be an important measure for conserving groundwater level.

5. Feeder level solarisation with enhanced capacity of solar plant

The state may choose to install feeder level solar power plant of capacity higher than capacity required for supplying power to agriculture feeder. The additional solar power generated may be used for supplying nearby rural/urban loads during day time or alternatively stored/banked for supplying power during evening hours for lighting/induction cooking and other household purposes. However, in this case CFA will be limited for solar capacity required for supplying power to the agriculture feeder.

6. Allocation of capacity and Service Charges

Under Component-C of PM-KUSUM Scheme solarisation of total 4 lakh grid connected pumps are targeted for sanction by 2020-21 and 50% of these are to be solarised through feeder level solarisation and balance 50% through individual pump solarisation. The Scheme being demand driven the capacity will be allocated to states depending upon demand raised by them. MNRE will request states to send their demand within given timeframe. The states may send their demand for individual pump solarisation or feeder level solarisation or both. The allocation of capacity will be made by Screening Committee headed by Secretary, MNRE. Implementing agency will get service charges as applicable under Scheme Guidelines.

7. System Specifications and Quality Control

All components used for installation of solar power plants shall confirm to applicable BIS/MNRE specifications and follow quality control guidelines issued by MNRE. It will be mandatory to use indigenously manufactured solar panels with indigenous solar cells and modules.

Thorough maintenance of selected agriculture feeders is required to maintain feeder availability during sunshine hours. This includes maintenance of DSS, sub-transmission/LT lines and distribution transformers, etc., on regular basis in a time bound manner.

8. Monitoring

It will be mandatory for DISCOMs to monitor solar power generation and performance of the solar power plant through online system. The online data will be integrated with central monitoring portal which will extract data from the State portals for monitoring of the scheme.

9. Interpretation of the Guidelines

In case of any ambiguity in interpretation of any of the provisions of these guidelines, the decision of the Ministry shall be final. The Guidelines would be reviewed by the Ministry from time to time and necessary modifications would be incorporated after getting approval of competent authority.

SE SOLAR GUVNL

From: Shobhit Srivastava <shobhit.srivastava@nic.in>
Sent: 20 May 2021 09:35
To: cetech guvnl; sesolar guvnl; de1solar guvnl; gedagoa@yahoo.com; pkn hareda; pkn2020 hareda; ajitpo hareda; info@anert.in; manoharan@anert.in; aneesh@anert.in; tredaagartala@gmail.com; md@jvvn.org; XENDSM@jvvn.org; md@upcl.org; do upcl; neerajkumar upcl; cmd@wbsedcl.in; Navjot Pal Singh Randhawa; pcbains@gmail.com; PARKASH CHAND BAINS; bhuvneshpatel bp; md@mahadiscom.in; mdmsedcl@gmail.com; mp jusnl; md@jvbnl.co.in; gmdsm work; md@bescom.co.in; cescgmt@gmail.com; md@hescom.co.in; gmt hescom; edinfra3@gmail.com; md@cescmysore.org; cmd@tssouthernpower.com; cmd@tsnpsdcl.in; md jvvn; umeshjaipur@yahoo.com; ce dsm3; avvnlsproject20@gmail.com; seprojects mepdcl; dd mepdcl; cecr2018@gmail.com; secssjodhpur@gmail.com; ceremsedcl@gmail.com; cecomcseb@gmail.com; eedsmandrnd hescom; gmdsm@bescom.co.in; secss jdvn; gm1@teda.in; tnebsankar in; pdsolartsredco@gmail.com; se@tsredco.telangana.gov.in
Cc: Jeevan Kumar Jethani; VELIVELA SRI; Himani Mehta; ADITYA GANGWAR
Subject: Calculation of CFA for Feeder Level Solarization under Component-C of the PM-KUSUM
Attachments: Feeder Level Solarization Guidelines.pdf

Sir/ Madam,

Please refer to the trailing mail regarding the calculation of solar capacity and resultant CFA under feeder level solarization component under the PM-KUSUM Scheme. The methodology as specified in the Guidelines was clarified to avoid any confusion on the same. It has, however, been noted that few agencies need clarity and support in this regard. In interest of seamless implementation, it has been decided that calculations worked out by SIAs may be reviewed by MNRE. It is, therefore, requested that **all SIAs under feeder level solarization** shall share the estimation of solar capacity and CFA calculated thereon with the Ministry so that discrepancy, if any, may be checked and rectified in the initial stage itself.

It has further been noted that few agencies are not attending the biweekly meetings on 1st and 3rd Tuesdays of every month and not responding to communications of the Ministry. In case such a non-responsive approach persists, the Ministry would be inclined to consider sanctions in such cases.

Regards,

Shobhit Srivastava
 Scientist-D
 MNRE

From: "Shobhit Srivastava" <shobhit.srivastava@nic.in>
To: gedagoa@yahoo.com, hanifq@gmail.com, "pkn hareda" <pkn.hareda@gmail.com>, "pkn2020 hareda" <pkn2020.hareda@gmail.com>, "ajitpo hareda" <ajitpo.hareda@gmail.com>, tredaagartala@gmail.com, "Navjot Pal Singh Randhawa" <ceo@peda.gov.in>, pcbains@gmail.com, "pc banis" <pc.banis@punjab.gov.in>, "bhuvneshpatel bp" <bhuvneshpatel.bp@gmail.com>, md@mahadiscom.in, mdmsedcl@gmail.com, cecr2018@gmail.com, "rishi jseb" <rishi.jseb@gmail.com>, "sesolar guvnl" <sesolar.guvnl@gebmail.com>, "md" <md@bescom.co.in>, "gmdsm work"

<gmdsm.work@gmail.com>, "md" <md@hescom.co.in>, "md" <md@cescmysore.org>, "cmdkse" <cmdkse@kse.in>, "se" <se@tsredco.telangana.gov.in>, "seprojects mepdcl" <seprojects.mepdcl@gmail.com>, cecomseb@rediffmail.com, "ce dsm3" <ce.dsm3@gmail.com>, "edinfra3" <edinfra3@gmail.com>

Cc: "Jeevan Kumar Jethani" <jethani.jk@nic.in>, "Himani Mehta" <himani.mehta@gov.in>, "VELIVELA SRI" <chaitanyavss.mnre@gov.in>

Sent: Monday, March 1, 2021 8:30:54 AM

Subject: Calculation of CFA for Feeder Level Solarization under Component-C of the PM-KUSUM

Sir/Madam,

This has reference to Guidelines for feeder level solarization issued vide Order dated 04.12.2020 (copy attached) and subsequent allocation of capacities in various States. Some SIAs have requested clarity for calculating CFA under this component.

It is hereby informed and emphasized that CFA for feeder level solarization will be available for the solar power capacity calculated as specified in the above-mentioned Guidelines.

As per the Guidelines, requirement of total annual power for an agriculture feeder shall be assessed by SIA/Discom and a solar power plant of capacity that can cater to the requirement of annual power for that agriculture feeder can be installed either through CAPEX mode or RESCO mode. For the purpose of calculating CFA, the cost of installation of solar power plant has been estimated at Rs. 3.5 Cr/MW.

CFA will available for capacity so calculated and any additional capacity which the State chooses to install would not be eligible for MNRE CFA. A sample calculation is shown below for ease of understanding.

Sample Calculation:

For example, a feeder supplying power to 200 farmers with an average pump capacity of 5 HP and an average consumption of 1000 units per annum per HP, the total annual power requirement of the feeder would be $200 \times 5 \times 1000 = 10,00,000$ units or 10 lakh units, the power can be supplied by the solar power plant of capacity around 600 kW with CUF of 19%. $(600 \times 0.19 \times 8760)$.

Please note that the actual load and power requirement will have to be worked out, instead of average capacity shown above for illustration.

In case further clarification is needed, it is suggested that SIA may send feeder details to us for calculation of solar power plant capacity and eligible CFA.

Regards

Shobhit Srivastava
Scientist-D
Ministry of New & Renewable Energy
Government of India
New Delhi

SE SOLAR GUVNL

From: Shobhit Srivastava <shobhit.srivastava@nic.in>
Sent: 12 March 2021 13:01
To: cetech guvnl; sesolar guvnl; de1solar guvnl; gedagoa@yahoo.com; hanifq@gmail.com; pkn hareda; pkn2020 hareda; ajitpo hareda; info@anert.in; manoharan@anert.in; aneesh@anert.in; tredaagartala@gmail.com; md@jvvn.org; XENDSM@JVVNL.ORG; md@upcl.org; do upcl; neerajkumar upcl; cmd@wbsedcl.in; Navjot Pal Singh Randhawa; pcbains@gmail.com; PARKASH CHAND BAINS; bhuvneshpatel bp; md@mahadiscom.in; mdmsedcl@gmail.com; mp jusnl; md@jvbnl.co.in; gmdsm work; md; cescgmt; md; gmt hescom; edinfra3; md; se@tsredco.telangana.gov.in; cmd@tssouthernpower.com; cmd@tsnpsdcl.in; md jvvn; umeshjaipur; ce dsm3; avnlsproject20@gmail.com; seprojects mepdcl; dd mepdcl; cecr2018@gmail.com; secssjodhpur@gmail.com; cmdkse
Cc: Jeevan Kumar Jethani
Subject: Provision for enhancing farmers' income under feeder level solarization
Attachments: Guidelines for Implementation of Feeder Level Solarisation under Component-C.pdf
Follow Up Flag: Follow up
Flag Status: Flagged

Sir/ Madam,

Please refer to para-4 of the Feeder Level Solarization Guidelines issued on 04.12.2020 (attached) regarding water saving and enhancing farmers' income. To achieve the objective of increasing farmers' income following provision has been made in the above mentioned para:

"The DISCOMs shall assess the average power requirement by farmers of an area depending upon various factors. This power requirement will be treated as their benchmark consumption. The DISCOMs shall incentivise farmers for consuming power less than benchmark consumption. Such saving of power shall be treated as surplus power injected by farmers and they will be paid by DISCOMs against this saved power at pre-determined tariff. This will be an important measure for conserving groundwater level."

You are, therefore, requested to ensure compliance of above mentioned instruction. Non-compliance may result in cancellation of the sanction.

Regards,

Shobhit Srivastava / शोभित श्रीवास्तव
 Scientist 'D' / वैज्ञानिक 'डी'
 Off-grid & Decentralized Solar Division / ऑफ-ग्रिड और विकेंद्रीकृत सौर डिवीजन
 Ministry of New & Renewable Energy / नवीन और नवीकरणीय ऊर्जा मंत्रालय
 New Delhi / नई दिल्ली

Solar Plant Capacity Calculation Under Feeder Level Solarization

All SIAs are requested to take note of the following provisions of the Feeder Level Solarization Guidelines issued by MNRE on 04.12.2020 and instructions issued on queries received from the Implementation Agencies:

- (i) The requirement of total annual power for an agriculture feeder will be assessed and a solar power plant of capacity that can cater to the requirement of annual power for that agriculture feeder can be installed either through CAPEX mode or RESCO mode, which will supply solar power to that feeder. For example, a feeder having annual power requirement of say 10 lakh units, the power can be supplied by solar power plant of capacity around 600 kW with CUF of 19%.
- (ii) Average of consumption of last three years shall be considered for calculating the solar plant capacity as illustrated above.
- (iii) Mixed feeders can also be solarized, however, MNRE CFA will be available based on capacity calculated for agriculture consumption.
- (iv) Under the Scheme solarisation of pumps of any capacity is allowed, however, in case of pumps of capacity above 7.5 HP, the CFA will be limited to solar capacity for 7.5 HP pumps.
- (v) For calculating consumption for pumps of capacity higher than 7.5 HP, for the purpose of calculating plant capacity eligible for MNRE CFA, average consumption of 7.5 HP pumps on the same feeder may be considered. This average consumption may be used in estimating consumption for all pumps of capacity higher than 7.5 HP.
- (vi) The state may choose to install feeder level solar power plant of capacity higher than capacity required for supplying power to agriculture feeder. The additional solar power generated may be used for supplying nearby rural/urban loads during day time or alternatively stored/banked for supplying power during evening hours for lighting/induction cooking and other household purposes. However, in this case CFA will be limited for solar capacity required for supplying power to the agriculture feeder.
- (vii) Since the projects are to be commissioned near the point of consumption, distribution losses would be reduced, therefore, losses shall not be considered in plant capacity estimation.
- (viii) CUF shall be taken as per the solar insolation on site, however, CUF of minimum 19% shall be considered for calculation of plant capacity eligible for CFA. No restrictions to be made on installing DC capacity higher than total contracted AC capacity of the plant to help achieve higher CUF.
- (ix) In case of unmetered connections, following methods may be followed for calculation of consumption:

- a. Indexation approved by the State Electricity Regulatory Commission may be followed.
- b. If both metered and unmetered connections are there on the same feeder, capacity-wise average of consumption of the metered connections may be extended to the unmetered connections. This shall be cross-checked with the feeder level meter.
- c. Consumption on feeder level meters may be used for estimation of plant capacity. However, if pumps of capacity higher than 7.5 HP are there on such feeder, capacity may be calculated based on consumption reduced in proportion of the load if capacity capped at 7.5 HP and actual load on the feeder.

F. No. 32/645/2017-SPV Division (Part-3)
Government of India
Ministry of New and Renewable Energy

*Block no. 14, CGO Complex, Lodi
 Road, New Delhi -110003*

Date: 11 May 2022

Office Memorandum

Subject: Amendment in provisions of bank guarantees in PM-KUSUM Scheme Guidelines - reg.

Under Para 3(1)(A)(g) of the PM-KUSUM Guidelines issued vide OM No. 32/645/2017-SPV Division dated 22.07.2019, on 'Bank Guarantees' related to Component-A of PM-KUSUM, it has been mentioned that:

"The RPG shall provide the following Bank Guarantees to DISCOM as follows:

- *Earnest Money Deposit (EMD) of Rs. 1 Lakh/MW in the form of Bank Guarantee along with EoI.*
- *Performance Bank Guarantee (PBG) of Rs. 5 Lakh/MW within 30 days from date of issue of Letter of Award.*

The Bank Guarantees against EMD shall be returned to the selected RPG on submission of valid PBGs. The selected RPGs are required to sign PPA with the DISCOM in line with the timeline given in the Guidelines. In case, the selected RPG fails to execute the PPA within the stipulated time period, the Bank Guarantee equivalent to EMD shall be encashed by DISCOM as penalty. In case any bidder is not selected, DISCOM shall release the EMD within 15 days of the date of issue of LoA to selected RPG(s). The PBGs shall be valid for a period of 12 months from the date of issue of LoA for the REPP. The PBG will be returned to the RPG immediately after successful commissioning of solar power plant, after taking into account any penalties due to delay in commissioning as per provisions stipulated in the Guidelines."

2. Undersigned is directed to convey that the requirement of separate PBG of Rs. 5 Lakh/MW has been removed and the above clause stands amended as given below:

"The Solar Power Generator (SPG) shall provide Earnest Money Deposit (EMD) of Rs. 1 Lakh/MW in the form of Bank Guarantee along with EoI. The EMD of Rs. 1 lakh per MW will be converted into PBG for the successful bidder, who has signed the PPA within stipulated time period. In case, the selected SPG fails to execute the PPA within the stipulated time period, the Bank Guarantee shall be encashed by DISCOM as penalty. In case, a bidder is not selected, DISCOM shall release the EMD within 15 days of the date of issue of LoA to selected SPG(s). The PBGs shall be valid for a period of 12 months from the date of issue of LoA for the Solar Energy Project. The PBG will be returned to the SPG immediately after successful commissioning of solar power plant, after taking into account any penalties due to delay in commissioning as per provisions stipulated in the Guidelines."

The above amendment in Component-A will apply prospectively to all projects which have not been physically set up on the date of issue of this OM.

3. Under Para 2(B) of the Guidelines for Solarization of Agriculture Feeders under Component-C of PM-KUSUM Scheme, issued vide OM No. 32/645/2017-SPV Division dated 04.12.2020, it has been mentioned that:

"CFA up to 100% of the total eligible CFA will be released to the RESCO developer through DISCOM on successful commissioning and declaration of Commercial Operation Date (COD) of solar power plant. The release of CFA to RESCO developer is subject to submission of bank guarantee equivalent to CFA amount. Bank Guarantee will be released in four lots of 25% each on successful operation of plant after 2.5 yrs, 5 yrs, 7.5 yrs and 10 yrs from CoD."

4. Undersigned is directed to convey that that requirement of bank guarantee in the above clause has been removed and the clause stands amended as given below:

"CFA up to 100% of the total eligible CFA will be released to the RESCO developer through DISCOM on successful operation and performance of the solar plant for two months after the commissioning, with at least one month CUF as per minimum CUF agreed in PPA. Further, a suitable clause in PPA shall be included to ensure that RESCO developer does not sell solar power to any other buyer except the concerned Discom during tenure of PPA, including penal provision calling for refund of proportionate CFA granted to the project by MNRE on violation of this condition. In case of any liquidation of assets of the solar power plant prior to completion of PPA period, the first charge shall be towards recovery of proportionate CFA granted to the project by MNRE."

The above amendment in Component-C will be applicable prospectively to all sanctions for feeder solarization issued by MNRE under the Scheme, except for the cases where bids are closed before issuance of this amendment.

5. This issues with approval of Competent Authority.


(Shobhit Srivastava)
Scientist-D

To

All concerned

F. No. 32/54/2018- SPV Division
Government of India
Ministry of New & Renewable Energy

Block No.14, CGO Complex
Lodi Road, New Delhi 110003
Dated: 18 May 2022

ORDER

Subject: Sanction for Solarization of Agricultural Feeders under Component-C of Pradhan Mantri Kisan Urja Suraksha evam Utthaan Mahabhiyaan (PM KUSUM)

With reference to demand received from various States for solarization of agricultural feeders under Component-C of Pradhan Mantri Kisan Urja Suraksha evam Utthaan Mahabhiyaan (PM KUSUM) Scheme, I am directed to convey the sanction of President of India for following quantities of existing grid connected agricultural pumps to State Implementation Agencies (SIAs) under the said component:

S. No.	State Implementation Agency (SIA)	Sanctioned Quantity of Solarization of Existing Agricultural Pumps (Nos.)
1	Chhattisgarh State Power Distribution Company Limited (CSPDCL)	43265
2	Gujarat Urja Vikas Nigam Limited (GUVNL)	39332
3	Uttar Haryana Bijli Vitran Nigam Limited	4215
4	Madhya Pradesh Urja Vikas Nigam Limited (MPUVNL)	12455
5	Distribution Companies in Odisha*	1311
6	Punjab Energy Development Agency (PEDA)	13111
7	Tamil Nadu Generation and Distribution Corporation Limited (TANGEDCO)	1311
	Total	115000

*State Government to finalize Discom-wise allocation and intimate to MNRE

3. SIAs shall follow all the terms and conditions stipulated in the Guidelines of the above mentioned Scheme issued vide Order no. 32/645/2017-SPV Division dated 22.07.2019 and amendments thereof, and Feeder Level Solarization Guidelines issued vide Order no. 32/645/2017-SPV Division dated 04.12.2020.

4. The requirement of total annual power for an agriculture feeder shall be assessed by the concerned SIA and a solar power plant of capacity that can cater to the requirement of annual power for that agriculture feeder can be installed either through CAPEX mode or RESCO mode, which will supply solar power to that feeder. For example, a feeder having annual power requirement of say 10 lakh units, the power can be supplied by solar power plant of capacity around 600 kW with CUF of 19%. Higher or lower CUF, depending upon the average solar insolation available in the areas, may be considered for assessing solar power capacity.



5. For the purpose of calculating CFA, the cost of installation of solar power plant has been estimated as Rs. 3.5 Cr/MW. Central Financial Assistance will be available at 30% of the estimated cost of installation of solar power plant i.e. Rs. 1.05 Cr/MW (30% of Rs. 3.5 Cr/MW). Feeders with connected agricultural pumps of any capacity can be solarized, however, feeder solarization capacity and the corresponding CFA will be worked out based on maximum agricultural pump capacity of 7.5 HP.
6. Timelines for implementation shall be as per the Scheme issued vide Order no. 32/645/2017-SPV Division dated 22.07.2019 and Feeder Level Solarization Guidelines issued vide Order no. 32/645/2017-SPV Division dated 04.12.2020 and amendments thereof.
7. If implemented in RESCO mode, concerned State Government may choose to provide upfront subsidy in lieu of electricity subsidy being given to agriculture consumers. This upfront subsidy from state could be in the form of VGF to RESCO developer, in addition to 30% CFA, to supply power to farmers of an agriculture feeder at present subsidised rates or any other rate fixed by state Government. For example, if present subsidised rate for agriculture is Rs. 1.50/kWh, the RESCO developer will be selected on the basis of lowest VGF bid for supply of solar power at Rs. 1.50/kWh.
9. SIAs shall carry out various activities as mentioned under Section on Responsibilities of State Implementation Agency under Component-C of the Guidelines, including creating awareness about the scheme. MNRE may retain a certain amount from service charge for nation-wide centralised IEC activities.
10. Eligible CFA and service charges would be released to SIAs as per provisions of Administrative Approval dated 08.03.2019 and terms and conditions stipulated in the Scheme Guidelines mentioned above.
11. SIAs will ensure use of indigenously manufactured solar panels with indigenous solar cells and modules. Further, the balance of system should also be manufactured indigenously. The vendor shall provide declaration to concerned SIA with a list of imported components used in the solarisation system.
12. SIA shall be liable for recovery of the whole or part amount of the CFA, with applicable penal interest, in case of non-compliance of the provisions of the Scheme/Sanction.
13. In terms of Rule 230 (7) of GFR 2017 and instructions of DoE, SIAs shall record the receipt of incentives and the expenditure therefrom in the EAT module of PFMS.
14. In terms of the Rule 230 (1) of GFR, concerned SIA will certify that they have not obtained or applied for grants for the same purpose or activity from any other Ministry or Department of the Government of India or State Government.
15. In terms of provisions contained in Rule 236(i) of GFR 2017, the account of concerned SIA shall be open to inspection by the sanctioning authority and audit (both by CAG of India and Internal Audit by the Principal Accounts Office of the MNRE), whenever the organization is called upon to do so.
16. SIAs will furnish year wise Utilization Certificate (UC) in the prescribed format of GFR-12(C) and Audited Statement of Expenditure (ASoE) along with detailed progress report periodically as per provisions of the scheme.



17. As per Rule 234 of GFR-2017, the sanction has been entered at S. No. 04 & Page No. 51 in the Expenditure Register of this Division.

18. This issues with the approval of Competent Authority.



(Shobhit Srivastava)

Scientist D

Phone No: 011-24360707/1016

To

Concerned SIAs/ Distribution Companies for Feeder Level Solarization under Component-C of PM-KUSUM Scheme

Copy to:

1. Principal Director of Audit, Scientific Dept., DG, ACR Building, IP Estate, N. Delhi
2. AG, CW & M.II (Science Audit), AGCR Building, New Delhi
3. Pay and Accounts Officer, MNRE
4. IFD, MNRE
5. Sanction folder

No. 32/645/2017-SPV Division
Government of India
Ministry of New and Renewable Energy

Atal Akshay Urja Bhawan,
Lodhi Road, New Delhi-110003
Dated: 1 August 2022

ORDER

Subject: Extension of Pradhan Mantri Urja Suraksha evam Utthaan Mahabhiyaan (PM-KUSUM).

This is in continuation to Order of even number dated 08 March 2019 regarding issuance of administrative approval of Pradhan Mantri Urja Suraksha evam Utthaan Mahabhiyaan (PM-KUSUM) and Order of even number dated 04 November 2020 regarding scale-up and expansion of the PM-KUSUM. Implementation Guidelines of the PM-KUSUM were issued vide OM dated 22.07.2019. Further, implementation guidelines for Component-C were issued on 08.11.2019 and for Feeder Level Solarization on 04.12.2020. Based on the feedback received from the stakeholders, amendments have been issued to these Guidelines from time to time.

2. The PM-KUSUM Scheme has been extended till 31.03.2026, with targets under the three components remaining unchanged and allowing inter-se transfer of quantities across Component-B and Component-C.
3. Along with the extension, the following amendments have been made to the implementation Guidelines of the Scheme:
 - i. Under Component-B and Component-C of the Scheme, Central Financial Assistance (CFA) will be available for pump capacity up to 15 HP to the individual farmers in the North-eastern States; UTs of Jammu & Kashmir and Ladakh; and the States of Uttarakhand and Himachal Pradesh. However, the CFA for pumps up to 15 HP will be restricted to 10% of the total installations.
 - ii. The condition of the domestic content requirement for solar cells has been waived off for the feeder level solarization under Component-C for the projects awarded by the implementing agency on or before 20.06.2023.
 - iii. Budgetary allocation of Rs. 10,000 Crore approved by CCEA will be utilized before accessing the extra-budgetary resources.
4. This Order is issued with the approval of the Competent Authority.


(Jeevan Kumar Jethani)
Sr. Director/Scientist-I

To

1. All Central Ministries and Departments;
2. Principle Director of Audit, Scientific Audit-II, DGACR Building, I.P. Estate, Delhi
3. ACS/Principal Secretaries/Secretaries (Energy Departments) of all States/UTs

4. State Implementation Agencies for all three components in all States
5. Pay & Accounts Officer, MNRE
6. Indian Banks Association (IBA)

Copy to:

1. PS to Hon'ble Minister for Power and New & Renewable Energy
2. Sr. PPS to Secretary, MNRE/ Sr. PPS to AS, MNRE/ PPS to JS & EA, MNRE/ PPS to JS(Solar), MNRE
3. All Advisers & Group Heads
4. Director (NIC) to upload this on the Ministry's website
5. Hindi section for Hindi version
6. Sanction folder


(Jeevan Kumar Jethani)
Sr. Director/Scientist-I

F. No. 32/54/2018- SPV Division
Government of India
Ministry of New & Renewable Energy

Atal Akshaya Urja Bhawan
Lodi Road, New Delhi 110003
Dated: 05 August 2022

ORDER

Subject: Sanction for Solarization of Agricultural Feeders under Component-C of Pradhan Mantri Kisan Urja Suraksha evam Utthaan Mahabhiyaan (PM KUSUM)

With reference to demand received from various States for solarization of agricultural feeders under Component-C of Pradhan Mantri Kisan Urja Suraksha evam Utthaan Mahabhiyaan (PM KUSUM) Scheme, I am directed to convey the sanction of President of India for following quantities of existing grid connected agricultural pumps to State Implementation Agencies (SIAs) under the said component:

S. No.	State Implementation Agency (SIA)	Sanctioned Quantity of Solarization of Existing Agricultural Pumps (Nos.)
1	Chhattisgarh State Power Distribution Company Limited (CSPDCL)	286735
2	Gujarat Urja Vikas Nigam Limited (GUVNL)	260668
3	Uttar Haryana Bijli Vitran Nigam Limited	27937
4	Madhya Pradesh Urja Vikas Nigam Limited (MPUVNL)	82545
5	Distribution Companies in Odisha*	8689
6	Punjab Energy Development Agency (PEDA)	86889
7	Tamil Nadu Generation and Distribution Corporation Limited (TANGEDCO)	8689
	Total	762152

3. SIAs shall follow all the terms and conditions stipulated in the Guidelines of the above mentioned Scheme issued vide Order no. 32/645/2017-SPV Division dated 22.07.2019 and amendments thereof, and Feeder Level Solarization Guidelines issued vide Order no. 32/645/2017-SPV Division dated 04.12.2020.

4. The requirement of total annual power for an agriculture feeder shall be assessed by the concerned SIA and a solar power plant of capacity that can cater to the requirement of annual power for that agriculture feeder can be installed either through CAPEX mode or RESCO mode, which will supply solar power to that feeder. For example, a feeder having annual power requirement of say 10 lakh units, the power can be supplied by solar power plant of capacity around 600 kW with CUF of 19%. Higher or lower CUF, depending upon the average solar insolation available in the areas, may be considered for assessing solar power capacity.

5. For the purpose of calculating CFA, the cost of installation of solar power plant has been estimated as Rs. 3.5 Cr/MW. Central Financial Assistance will be available at 30% of



the estimated cost of installation of solar power plant i.e. Rs. 1.05 Cr/MW (30% of Rs. 3.5 Cr/MW). Feeders with connected agricultural pumps of any capacity can be solarized, however, feeder solarization capacity and the corresponding CFA will be worked out based on maximum agricultural pump capacity of 7.5 HP.

6. The process of tendering and signing of work agreement with EPC contractor shall be completed by the concerned SIA within six months from the date of issuance of sanction by MNRE. The maximum timeline allowed for commissioning of solar power plant by RESCO Developer will be nine months from the date of signing of PPA. SIAs shall submit progress reports and completion reports on the online portal for PM-KUSUM Scheme.

7. If implemented in RESCO mode, concerned State Government may choose to provide upfront subsidy in lieu of electricity subsidy being given to agriculture consumers. This upfront subsidy from state could be in the form of VGF to RESCO developer, in addition to 30% CFA, to supply power to farmers of an agriculture feeder at present subsidised rates or any other rate fixed by state Government. For example, if present subsidised rate for agriculture is Rs. 1.50/kWh, the RESCO developer will be selected on the basis of lowest VGF bid for supply of solar power at Rs. 1.50/kWh.

8. SIAs/ DISCOMs shall incentivise farmers for consuming power less than benchmark consumption. Such saving of power shall be treated as surplus power injected by farmers and they will be paid by DISCOMs against this saved power at pre-determined tariff.

9. SIAs shall carry out various activities as mentioned under Section on Responsibilities of State Implementation Agency under Component-C of the Guidelines, including creating awareness about the scheme. MNRE may retain a certain amount from service charge for nation-wide centralised IEC activities.

10. Eligible CFA and service charges would be released to SIAs as per provisions of Administrative Approval dated 08.03.2019 and terms and conditions stipulated in the Scheme Guidelines mentioned above.

11. The condition of domestic content requirement for solar cells has been waived off for the feeder solarization projects under Component-C for which work is awarded to the implementing company (EPC contractor in case of CAPEX or the RESCO Company) by 20.06.2023.

12. SIA shall be liable for recovery of the whole or part amount of the CFA, with applicable penal interest, in case of non-compliance of the provisions of the Scheme/Sanction.

13. In terms of Rule 230 (7) of GFR 2017 and instructions of DoF, SIAs shall record the receipt of incentives and the expenditure therefrom in the EAT module of PFMS.


14. In terms of the Rule 230 (1) of GFR, concerned SIA will certify that they have not obtained or applied for grants for the same purpose or activity from any other Ministry or Department of the Government of India or State Government.

15. In terms of provisions contained in Rule 236(i) of GFR 2017, the account of concerned SIA shall be open to inspection by the sanctioning authority and audit (both by CAG of India and Internal Audit by the Principal Accounts Office of the MNRE), whenever the organization is called upon to do so.

16. SIAs will furnish year wise Utilization Certificate (UC) in the prescribed format of GFR-12(A) and Audited Statement of Expenditure (ASoE) along with detailed progress report periodically as per provisions of the scheme.

17. As per Rule 234 of GFR-2017, the sanction has been entered at S. No. 09 & Page No. 52 in the Expenditure Register of this Division.

18. This issues with the approval of Competent Authority.




(Shobhit Srivastava)
Scientist D

To

Concerned SIAs/ Distribution Companies for Feeder Level Solarization under Component-C of PM-KUSUM Scheme

Copy to:

1. Principal Director of Audit, Scientific Dept., DG, ACR Building, IP Estate, N. Delhi
2. AG, CW & M.II (Science Audit), AGCR Building, New Delhi
3. Pay and Accounts Officer, MNRE
4. IFD, MNRE
5. Sanction folder

	Gujarat Urja Vikas Nigam Limited (An ISO 9001:2015 Certified Company) Sardar Patel Vidyut Bhavan Race Course, Vadodara-390007 (CIN U40109GJ2004SGC045195)	
cetech.guvnl@gebmail.com	Tele (Di): (0265) 2340205	
No. GUVNL/Tech/SolarCell/PM-KUSUM-C/FLS/ (S2)		Date: 04.03.2023

By E-mail

To,
 The Managing Director
 DGVCL/ MGVL/ PGVCL/ UGVCL,
 Corporate Office,
Surat/ Vadodara/ Rajkot/ Mehsana

Sub: Office Memorandum issued by MNRE regarding "Implementation of Feeder Level Solarisation under Component C of PM-KUSUM Scheme"
Ref: MNRE OM F.No.32/54/2018-SPV Division dated 24.02.2023


Respected Sir,

In connection to the subject cited above, MNRE vide F.No.32/54/2018-SPV Division dated 24.02.2023 has issued Office Memorandum regarding "Implementation of Feeder Level Solarisation under Component C of PM-KUSUM Scheme". Same is attached herewith.

This is for appropriate action after observing all the formalities, please.

Thanking you,

Yours faithfully,


 (S S Modi)

Addl. Chief Engineer (Tech)

Encl: - As above

Cfwcs to:-

The Director (Tech), GUVNL

DE1 SOLAR GUVNL

From: Sanjay Modi <cetech.guvnl@gebmil.com>
Sent: 02 March 2023 18:24
To: Vala SE; GUVNL@Diwan; Ho.Alap Shah-Solar
Subject: Fwd: OM regarding implementation of FLS under Component C of PMKUSUM
Attachments: MNRE OM dated 24-2-2023 regading implementation of FLS under Component C of PMKUSUM.pdf

Follow Up Flag: Follow up
Flag Status: Flagged

----- Forwarded message -----

From: adityagangwar.mnre@gov.in
Date: 02-Mar-2023 11:08 am
Subject: Fwd: OM regarding implementation of FLS under Component C of PMKUSUM
To: md.apdel@apdel.org,cecomeseb@gmail.com.ak.ambastha@espe.co.in,62tesharma@gmail.com,ramakant.cec@gmail.com,amal.sinhal@relianceada.com,ceo.sectt@relianceada.com,abhishek.r.ranjan@relianceada.com,m.g.sethi@tatapower-ddl.com,cetech.guvnl@gebmil.com,sesolar.guvnl@gebmil.com,gedagoa@yahoo.com,cecommercial@dhbvn.org,cecommercial@uhbvn.org.in,vinsood99@gmail.com,CEO Himurja <himurja-hp@nic.in>,ceojakeda2@gmail.com,mdjpdcl3@gmail.com,semrekathua@gmail.com,ceer2018@gmail.com,mdvitran@gmail.com,cerees@kseb.in," Managing Director M.P Urja Vikas Nigam Ltd" <mduvn@mp.gov.in>,bhuvneshpatel.bp@gmail.com,ce.mpuvn1982@gmail.com,ceermsedcl@gmail.com,seprojects.mepdel@gmail.com,ashok.oreda@gmail.com," Superintending Engineer-cum-Head of the Department, Electricity Department, Puducherry" <selped.pon@nic.in>,"M.P. Singh" <mpsingh@peda.gov.in>,rrec2016@gmail.com,ddh.hq.hort@rajasthan.gov.in,eesolarproj@tnebnet.org,pdsolartsredco@gmail.com,tredaagartala@gmail.com,ad_comm@rediffmail.com,cmd.tsecl@rediffmail.com,diprupneda@gmail.com
Cc: Jeevan Kumar Jethani <jethani.jk@nic.in>,Shobhit Srivastava <shobhit.srivastava@nic.in>

Sir/Mam,

Please find attached the OM dated 24.02.2023 which is self explanatory.

Regards

Aditya Gangwar
 Scientist-'B'
 MNRE

From: "Shobhit Srivastava" <shobhit.srivastava@nic.in>
To: "Swati" <swati.11@nic.in>
Cc: "Priya" <priya.mnre@gov.in>, "Jeevan Kumar Jethani" <jethani.jk@nic.in>, "adityagangwar mnre" <adityagangwar.mnre@gov.in>, sachinmunot@novatricetechnologies.com, "SHIV DAYAL" <shiv.dayal@nic.in>
Sent: Friday, February 24, 2023 6:49:26 PM
Subject: OM regarding implementation of FLS under Component C of PMKUSUM

Swati.

Please get the attached OM uploaded on MNRE portal under current notices section.

@Sachin: Please upload on PM-KUSUM central portal.

@Aditya: Please circulate to SIAs under Component-A and C.

Regards

Shobhit Srivastava

From: "SHIV DAYAL" <shiv.dayal@nic.in>

To: "Shobhit Srivastava" <shobhit.srivastava@nic.in>, "adityagangwar mnre" <adityagangwar.mnre@gov.in>

Cc: "Jeevan Kumar Jethani" <jethani.jk@nic.in>

Sent: Friday, February 24, 2023 6:38:43 PM

Subject: Scan copy of MNRE OM dated 24-2-2023 regarding implementation of FLS under Component C of PMKUSUM

Sir

PFA.

Thanks and Regards,


Shiv Dayal

Assistant Section Officer

Atal Akshay Urja Bhawan,

Opposite CGO Complex,

Lodhi Road New Delhi-110003



F. No. 32/54/2018-SPV Division
Government of India
Ministry of New and Renewable Energy

Atal Akshay Urja Bhawan
Lodi Road, New Delhi - 110003


Date: 24 February 2023

Office Memorandum

Subject: Implementation of Feeder Level Solarisation under Component C of PM-KUSUM Scheme.

Ministry of New & Renewable Energy (MNRE) is implementing PM-KUSUM Scheme and under Component-C of the Scheme, Feeder Level Solarisation (FLS) was also introduced, wherein instead of solarizing individual agriculture pumps, the agriculture feeders on which such pumps are connected can be solarized by installing a solar power plant of capacity sufficient cater to the load of agricultural consumers on the feeder. The solar power plants can be installed for a single or multiple agriculture feeders based on the technical feasibility and other parameters such as substation capacity, availability of land, transmission lines, etc. Under Component-A of PM-KUSUM Scheme also the solar power plants are being installed by the farmers at identified distribution substations where DISCOMs have assessed the solar capacity that can be injected into the grid through these substations. Ministry has issued guidelines for implementation of Component-A through participation of individual farmers/Group of farmers/Solar Power Developers/ Cooperatives/Panchayats/Farmers Producer Organisations. Under FLS, there is a provision of providing Central Financing Assistance (CFA) of Rs. 1.05 crore/MW, whereas there is no provision of CFA in case of plants installed under Component-A. For plants installed under Component-A, the solar power is being purchased by DISCOMs at a tariff decided by the respective SERC or tariff discovered through bidding process, as the case may be. In case of FLS of Component-C, the plant can be installed on CAPEX mode by DISCOMs or through RESCO mode where the tariff will be discovered through bidding process.

2. There could be situations where for particular distribution substations, the solar power plants can be installed either under Component -A or under FLS of Component-C of the PM-KUSUM Scheme. In such situation, the DISCOMs would prefer to install solar power plant under Component-C as there is a provision for CFA in this component. Therefore, DISCOMs are advised that while bidding for installation of solar power plants under FLS of Component C, the qualification requirements may be kept at par with the guidelines issued by Ministry for Component-A and allowing all the eligible participants under Component-A to also participate under FLS of Component-C. This will facilitate achieving the Scheme objectives of making the *Annadata as Urjadata* and increasing the income of farmers.


(Shobhit Srivastava)
Scientist-D

To

All concerned State Implementation Agencies

32/54/2018-SPV Division-Part (1)
Government of India
Ministry of New and Renewable Energy

Atal Akshay Urja Bhavan
Lodhi Road, New Delhi 110003

Date: 12th July 2023

Office Memorandum


Subject: Amendment in the implementation guidelines of Pradhan Mantri Kisan Urja Suraksha Evam Utthaan Mahabhiyaan (PM-KUSUM) Scheme

Vide OM 32/645/2017-SPV Division dated 22.07.2019, Ministry had issued guidelines for Pradhan Mantri Urja Suraksha evam Utthaan Mahabhiyaan (PM KUSUM). Vide OM of even number dated 04.11.2020, scale-up and expansion of PM KUSUM were issued. The detailed guidelines for implementation of FLS were issued vide OM dated 04.12.2020 and simplification where issued vide OM dated 14.12.2021. Further, the quantities under Component B and C were made fungible. Based on the implementation experience of PM KUSUM, it is observed that Component C is gaining traction among states, and is very important due to its universal access to agricultural feeders. Most of the pumps that are grid connected pumps are now being solarized. For carrying out bids under Component C (FLS), land was observed to be the main issue. On examination of existing arrangements being carried out by various states, it is observed that land aggregation model being implemented by Maharashtra is forward-thinking and meticulously planned. The intention is to take land on lease with commensurate lease rent for farmers, to make sure the availability of land for solar projects. Therefore, in order to facilitate the implementation of the PM KUSUM scheme and ease the process of land availability for solar power plants under Component C (FLS), the scheme is hereby modified with following modalities:

a) Identifying the substation

State Nodal Agencies/Implementing Agencies/ DISCOM will identify substations having downstream agriculture load along with the number of pumps connected to that substation. The annual power requirement for the agriculture feeders and the capacity of solar power plant that can cater to the power requirement for that agriculture feeder may be assessed. Preference may be given to the substations with 11/33 kV bus bars. The identification may include an assessment of:

- Latitude/longitude of substations
- Details of agriculture load served downstream
- MW capacity installed downstream
- Details of spare bay available at LV side
- Any other requirement



b) Land Lease Rate:

Land lease rates would be announced by the state government. Currently, the state of Maharashtra offers Rs 1.25 lakhs/hectare/year for private land or 6% of ready reckoner rate, whichever is higher, with a yearly 3% increment of the base rate, and Rs 1/hectare/year for public land for a period of 30 year. The states may decide similar competitive provisions. The Government will advertise these rates along with the list of substations and request farmers to offer their land on lease in the vicinity of the substations at the offered lease rent.

c) Development of Online portal

A dedicated online portal can be developed by the States/SIA/DISCOM which will serve as centralized portal for land aggregation. The state should have the details of identified substations. The portal may be developed by State/SIA/DISCOM. The States/SIA/DISCOMs will advertise their intention to take land on lease from the farmers along with a declaration of land lease rates. The farmers who wish to offer their land near the substation on lease may apply directly on the portal. They may also apply to the Tehsildar/District Magistrates. It would be the responsibility of the District Collector/District Magistrates to ensure that the offline applications received at their end from the framers to lease their land for the installation of solar power plants, are shared with DISCOM/SIAs. The DISCOM/SIA would update the same on online portal on regular basis.

d) Modalities for leasing

- (i) Public Land: The State may facilitate by providing unutilized land on lease at a pre-decided annual rent. The state may also include their unutilized water bodies for the development of the projects.
- (ii) Private Land: All the private land owners who are interested in providing their land for projects may be encouraged to offer their land through the above-mentioned portal. The revenue authority should also verify the authenticity of the land through the respective District Collectors/Magistrates. In order to protect the interest of land owner, the State may decide the amount of lease rent for the land along with annual escalation provisions.

Considering the land required for 1 MW is around 4-5 acres, contiguous land of a minimum of 5 acres and nearer to the substation would be given the preference.



e) Provision of SPV

The DISCOMs may form an SPV which can implement the project along with arrangements for leasing the land etc.

f) Lessee and Lessor Agreement

The Nodal Agency/DISCOM/SPV may also become the single entity to sign land lease agreements with all landowners. In such cases, the individual land owner need not interact with SPD and face uncertainty in timely lease payment. The nodal agency should sign an agreement with individual land owner and a tripartite agreement between DISCOM, Nodal Agency and Solar Power Developers may be worked out where payments are transferred to nodal agency for the purpose of lease rent.

Nodal agency will inform the District Collector/District Magistrate from time to time, about the requirement of land and get in touch with the farmers to lease their land for the purpose.

g) Selection of Solar Power Developers (SPD)

Since the scale of an individual solar project with substation is relatively small, therefore in order to get the benefit of economy of scale, as well as to attract much creditable Solar Power Developers, multiple substations may be grouped as one bidding group. The SPD may be permitted to quote the tariff common for all projects under one group and SPD may sign a single PPA with DISCOM.

For the project under this mechanism, the states are free to choose Renewable Energy Implementing Agencies of Government of India to act as an intermediary procurer.

4. The above amendments are issued with the approval of the Competent Authority.

Nikhil Gakkhar
12/7/23
(Dr Nikhil Gakkhar)
Scientist C

To

All concerned

F. No. 32/645/2017-SPV Division
 Government of India
 Ministry of New and Renewable Energy

Block-14, CGO Complex,
 Lodhi Road, New Delhi
 Dated: 22 July, 2019

Office Memorandum

Subject: Guidelines for implementation of Pradhan Mantri Kisan Urja Suraksha evam Utthan Mahabhayan Scheme.

This refers Ministry's OM of even number dated 8.3.2019 vide which sanction was issued for launch of New Scheme for Farmers covering following three Components:

- i. Component A: 10,000 MW of Decentralized Ground Mounted Grid Connected Renewable Power Plants of individual plant size up to 2 MW.
 - ii. Component B: Installation of 17.50 lakh standalone Solar Powered Agriculture Pumps of individual pump capacity up to 7.5 HP.
 - iii. Component C: Solarisation of 10 Lakh Grid-connected Agriculture Pumps of individual pump capacity up to 7.5 HP.
2. The Scheme will be called as Pradhan Mantri Kisan Urja Suraksha evam Utthan Mahabhayan (PM KUSUM) Scheme. The operational Guidelines for implementation of the PM KUSUM Scheme are enclosed.
3. This issues with the approval of Competent Authority.

Enclosed: As above.

To
 All Concern


 (J. K. Jethani)
 Scientist-E

Ministry of New and Renewable Energy

Guidelines for Implementation of Pradhan Mantri Kisan Urja Suraksha evam Utthan Mahabhiyan (PM KUSUM) Scheme

1. Background

As a part of Intended Nationally Determined Contributions (INDCs), India has committed to increase the share of installed capacity of electric power from non-fossil-fuel sources to 40% by 2030.

The Cabinet had approved scaling-up of solar power target from 20,000 MW of Grid Connected Solar power Projects to 1,00,000 MW by 2022.

While Large Scale Solar power generation projects are being installed to achieve the ambitious target of 100 GW of Solar Power generation by 2022, it has been planned to simultaneously develop decentralized Solar energy and other renewable energy generation Plants of capacity up to 2 MW which could be connected directly to existing 33/11 kV or 66/11 kV or 110/11 kV sub-stations of Distribution Company, thus saving in transmission system requirement apart from T&D losses. Such plants near these sub-stations may be developed, preferably by farmers, giving them an opportunity to increase their income by utilising their barren and uncultivable land for solar or other renewable energy based power plants. Cultivable land may also be used if the Solar plants are set up on stiits where crops can be grown below the stilts and sell RE power to DISCOMs.

Besides, developing decentralized renewable power, it is planned to replace Agriculture Diesel pumps with Solar Water pumps and Solarise Grid connected Agriculture pumps. At present, over 30 million agricultural pumps are installed in India, out of which nearly 10 million pumps are diesel based. The Distribution Companies (DISCOMs) are not in a position to energize these pumps through grid connection as seen from the long waiting lists with such Distribution Companies. Hence there is a need to provide energy to these pumps through solar energy. Also, over 20 million grid-connected agriculture water pumps installed in the country consume more than 17 percent of total annual electricity consumption of the country. Solarization of the same can reduce dependence of these pumps on conventional sources of energy supplied by DISCOMs and thus reducing their burden of subsidy on agriculture consumption of Electricity. This will also provide additional source of income to farmers who will be in a position to sell the surplus power to DISCOMs.

The new Scheme has provision for the decentralised renewable energy plants, Solar agriculture water pumps and solarisation of existing Grid connected Agriculture pumps.

2. Approval of the New Scheme for Farmers

The Government of India has launched New Scheme for Farmers with following components:

- i. Component-A: Setting up of 10,000 MW of Decentralized Ground/ Stilt Mounted Grid Connected Solar or other Renewable Energy based Power Plants;
- ii. Component-B: Installation of 17.50 Lakh Stand-alone Solar Agriculture Pumps; and

iii. Component-C: Solarisation of 10 Lakh Grid Connected Agriculture Pumps.

The Component-A and Component-C will be implemented initially on pilot mode for 1000 MW capacity and one lakh grid connected agriculture pumps respectively and Component-B will be implemented in full-fledged manner with total Central Government support of Rs. 19,036.5 Crore.

After successful implementation of pilot project of Components A and C, the same shall be scaled up with necessary modifications based on the learning from the pilot phase with total Central Government support of ₹ 15,385.5 Crores.

All three components of the scheme aim to add Solar capacity of 25,750 MW by 2022 with the total Central Financial Support of ₹ 34,422 crore.

3. Implementation mechanism:

These guidelines have been formulated to provide broad implementation framework of the Scheme.

I. Component A: Setting up of 10,000 MW of Decentralized Ground/Stilt Mounted Grid Connected Solar or other Renewable Energy based Power Plants

Under this component, solar or other renewable energy based power plants (REPP) of capacity 500 kW to 2 MW will be setup by individual farmers/ group of farmers/ cooperatives/ panchayats/ Farmer Producer Organisations (FPO)/Water User associations (WUA) hereinafter called Renewable Power Generator (RPG). However, States/DISCOMs may allow setting-up of solar or other renewable energy based power plants of capacity less than 500 kW in specific cases. The REPP will be preferably installed within five km radius of the sub-stations in order to avoid high cost of sub-transmission lines and to reduce transmission losses.

The Distribution companies (DISCOMs) will notify sub-station wise surplus capacity which can be fed from such RE power plants to the Grid and shall invite applications from interested beneficiaries for setting up the renewable energy plants. The renewable power generated will be purchased by DISCOMs at a pre-fixed levelised tariff. In case, the aggregate capacity offered by Applicants is more than notified capacity for a particular sub-station, bidding route will be followed by DISCOMs to select Renewable Power generator and in such cases the pre-fixed levelised tariff will be the ceiling tariff for bidding. Selection of bidders will be based on the lowest tariff offered in the ascending order as quoted by the bidders in the closed bid or e-reverse auction as the case may be. A model PPA (Power Purchase Agreement) to be executed between RPG and DISCOMs has been prepared by MNRE and attached at Annexure-I. The duration of PPA will be 25 years from Commercial Operation Date (COD) of the project. The total energy purchased from these RE plants will be accounted for fulfillment of RPO by the DISCOM.

In case the farmers/ group of farmers/ cooperatives/ panchayats/ Farmer Producer Organisations (FPO)/ Water User associations (WUA) etc. are not able to arrange equity required for setting up the REPP, they can opt for developing the REPP through developer(s) or even through local DISCOM, which will be considered as RPG in this case. In such a case, the land owner will get lease rent as mutually agreed between the parties. The lease rent may be in terms of Rs per year per acre of land or in terms of Rs per unit energy generated per acre

of land area. The farmer(s) may opt for payment of lease rent directly in their bank account by the DISCOM, from the payment due to the developer. A model Land Lease Agreement to facilitate the beneficiaries has been prepared by MNRE and is attached at Annexure-II. However, the terms of Land Lease Agreement may be finalised on mutual consent of concerned parties.

The REPP under the scheme would be implemented primarily on Barren / uncultivable land. Agricultural land is also permitted under the scheme provided that solar plants are installed in stilt fashion (i.e. raised structure for installation of Solar panels) and with adequate spacing between panel rows for ensuring that farming activity is not affected. The RPG would be free to adopt any renewable energy source or technology while responding to the bid. However, in case of cultivable land with solar plants, the same may be installed on stilts, so that the farmers continue to cultivate the land, apart from getting the benefit of lease rent. In such a case DISCOM may also float bids (in case of specific substations) where setting up of solar projects on stilts may be mandatorily required, and bids for energy tariff invited accordingly.

A. Selection and Implementation of Decentralised Renewable Energy Power Plants

a. Notification of sub-station wise generation capacity

DISCOM shall assess and notify RE generation capacity that can be injected in to all 33/11 kV or 66/11 kV or 110/11 kV sub-station of rural areas and place such notification on its website for information of all stakeholders. To facilitate farmers willing to lease out their land for development of RE plants near above notified substation(s), as per provisions of this scheme, DISCOM may also place list of such farmers on their website. However, the leasing of land of any farmers will be a bi-partite agreement between the farmer and the developer and DISCOM will not be held responsible for failure in getting the land leased out to a developer. To meet additional demand DISCOM will augment the capacity of sub-station under IPDS or any other scheme.

b. Expression of Interest (EoI) for Short-listing of RPG

DISCOM or any agency authorized by the DISCOM shall invite 33/11 kV or 66/11 kV or 110/11 kV sub-station wise EoI from RPG to participate in selection process for development of decentralised renewable power plants. The RPG shall submit their interest against the EoI as per the schedule notified by DISCOM. An RPG will not be allowed to apply for more than one renewable power plant for a particular 33/11 kV sub-station. The EoI of an RPG will also be disqualified if it is found that its proprietor/partner/director/member has also filed EoI as proprietor/partner/director/member for another RPG for the same sub-station.

The DISCOM or any agency authorized by the DISCOM may request to submit non-refundable processing fee from the interested RPGs, which in no case shall be higher than Rs. 5000 per MW or part thereof of the capacity applied for.

In order to ensure only quality systems are installed, prevailing MNRE/BIS specifications and quality control orders applicable for solar modules, inverters, BoS and other equipment shall be followed.

In case of REPP being developed by a developer, the Net-Worth of the developer should not be less than Rs. 1.00 Crore per MW (of the capacity applied). This shall not be applicable for

farmers cooperative or panchayats or Farmer Producer Organisations (FPO) /Water User associations (WUA) or farmers setting up REPP in their own lands.

c. Selection of REPP

In case the total aggregate capacity of eligible applications received for a particular sub-station is less than or equal to the capacity notified for connectivity at the sub-station, LoA will be awarded to all eligible applicants for procurement of renewable power at a pre-fixed levelised tariff.

In case the total aggregate capacity of eligible application received for a particular sub-station is more than the capacity notified for connectivity at the sub-station, then DISCOM or any agency authorized by the DISCOM shall invite Bids from all these applicants. All eligible applicants will have to submit tariff bids within a prescribed time. Selection of bidders will be based on the lowest tariff offered in the ascending order as quoted by the bidders in the closed bid or e-reverse auction as the case may be. LoA will be awarded to all successful bidders.

d. Connectivity with the sub-station

REPP of capacity up to 2 MW may be connected at 11 kV side of sub-station and the selected RPG will be responsible for laying of dedicated 11 kV line from REPP to sub-station, construction of bay and related switchgear at sub-station where the plant is connected to the grid and metering is done. The DISCOM will facilitate the RPG in getting right of way for laying of 11 kV line. Alternatively, RPG can get constructed the 11 kV lines through DISCOM by paying the applicable cost and other charges. RPG will be responsible for maintaining this dedicated 11 kV line. In case more than one bidders are awarded projects to be connected to same Sub-station, they shall be permitted to co-ordinate with each other for setting up common transmission line for feeding to Sub-Station if they so desire and with the approval of DISCOM. However, in North Eastern States, Sikkim, Jammu & Kashmir, Himachal Pradesh and Uttarakhand, Lakshadweep and A&N Islands, where States/UTs allows RE plants of capacity less than 500 kW the plant may be connected through LT line subject to technical feasibility and approval by DISCOM.

The RPG shall comply grid connectivity and other regulations as applicable.

e. Clearances required from the State Government and other local bodies

The RPG is required to obtain necessary clearances as required for setting up the REPP.

f. Power Purchase Agreement (PPA)

A copy of standard Power Purchase Agreement to be executed between the DISCOM and the RPG shall be provided by DISCOM along with invitation for submission of EoI. The model PPA agreement shall be as provided by MNRE (Copy enclosed). Within two months of the date of issue of Letter of Award (LoA) by DISCOM or any agency authorized by the DISCOM, the Power Purchase Agreement (PPA) will have to be executed by RPG. The PPA shall be for a period of 25 years from the date of COD. The DISCOM will be obliged to buy the entire power from RPG within the contract capacity. However, the RPG is required to achieve a minimum CUF of 15% on annual basis during the PPA period. However, in case of low Solar radiation zones, minimum CUF can be revised by concerned DISCOM. The RPG will be free to operate the plant after expiry of the 25 years of PPA period if other conditions like land

lease, etc., permits. However, any extension of the PPA period beyond 25 years shall be through mutual agreements between the RPG and DISCOM. As a payment security measure DISCOM will have to maintain LC and Escrow Arrangement as defined in the PPA.

g. Bank Guarantees

The RPG shall provide the following Bank Guarantees to DISCOM as follows:

- Earnest Money Deposit (EMD) of Rs. 1 Lakh/MW in the form of Bank Guarantee along with EoI.
- Performance Bank Guarantee (PBG) of Rs. 5 Lakh/MW within 30 days from date of issue of Letter of Award.

The Bank Guarantees against EMD shall be returned to the selected RPG on submission of valid PBGs. The selected RPGs are required to sign PPA with the DISCOM in line with the timeline given in the Guidelines. In case, the selected RPG fails to execute the PPA within the stipulated time period, the Bank Guarantee equivalent to EMD shall be en-cashed by DISCOM as penalty. In case any bidder is not selected, DISCOM shall release the EMD within 15 days of the date of issue of LoA to selected RPG(s). The PBGs shall be valid for a period of 12 months from the date of issue of LoA for the REPP. The PBG will be returned to the RPG immediately after successful commissioning of solar power plant, after taking into account any penalties due to delay in commissioning as per provisions stipulated in the Guidelines.

h. Commissioning

The selected RPG shall commission the solar power plant within nine months from date of issuance of LoA. The RPG may commission the REPP during this period of nine months and the DISCOM is obliged to purchase power from that commissioned REPP any time after the issuance of LoA. A duly constituted Committee of DISCOM officials will physically inspect the Plant in not more than 03 days from the date of receiving a call from the RPG and certify successful commissioning of the plant. In case any RPG fails to achieve this milestone, DISCOM shall encash the Performance Bank Guarantee (PBG) in the following manner:

- a. Delay up to two months - The PBG on per day basis and proportionate to the balance capacity not commissioned.
- b. In case the commissioning of the solar power plant is delayed over two months, the PPA capacity shall stand reduced / amended to the Project capacity commissioned at the end of 11th month from date of issuance of Letter of Award.

In case of delays of plant commissioning due to the reasons beyond the control of the RPG, DISCOM after having been satisfied with documentary evidences produced by the RPG for the purpose, can extend the time for commissioning date without any financial implications to the RPG.

i. Shortfall in minimum generation

During PPA, if for any year, it is found that the RPG has not been able to generate minimum energy corresponding to CUF of 15% or as prescribed by DISCOMs; such shortfall in performance shall make RPG liable to pay the compensation as provided in the PPA to the DISCOM. This will, however be relaxable to the extent of grid non-availability for evacuation, which is beyond the control of the RPG. Further, this compensation shall not be applicable in

events of Force Majeure identified under PPA with Discom affecting supply of solar power by RPG.

j. Commercial Operation Date (COD)

The Commercial Operation Date (COD) shall be considered as the actual date of commissioning of the solar power plant as declared by the Commissioning Committee.

k. Release of PBI to DISCOM

DISCOM would be eligible to get PBI @ Rs. 0.40 per unit purchased or Rs. 6.6 lakh per MW of capacity installed, whichever is less, for a period of five years from the COD. However, to avail the PBI, DISCOM shall submit following documents after completion of one year from the COD and every year thereafter till five years:

- Timely payment of monthly lease rent, if applicable, to the land owner of the project.
- Monthly units purchased from the plant and corresponding payment made to the project developer.

Applicable PBI would be released to the DISCOM after submission of these documents by DISCOM to MNRE.

B. Roles and responsibilities of stakeholders:

(i) Ministry of New and Renewable Energy:

MNRE shall allocate initial capacity of 1000 MW for Pilot Project to DISCOMs based on their demand and readiness for implementation. Pilot projects will be continuously monitored during implementation and also on completion to evaluate their success and a detailed report will be prepared for recommending further scaling up of the capacity under this component. Such evaluation may be done internally or through external agency as per decision of the MNRE.

Ministry will issue Model PPA and model Lease Agreement for implementation of the scheme.

MNRE will provide Procurement Based Incentive (PBI) to the DISCOMs @ 40 paise/kWh or Rs.6.60 lakhs/MW/year, whichever is lower, for buying solar/ other renewable power under this scheme. The PBI will be given to the DISCOMs for a period of five years from the Commercial Operation Date of the plant. Therefore, the total PBI that shall be payable to DISCOMs will be Rs. 33 Lakh per MW.

(ii) DISCOMs:

The DISCOMs shall have to send their demand for sanction under the scheme along with details on their readiness to implement the component A of the scheme

The concerned DISCOM shall declare the renewable power capacity that can be connected to a 33/11 kV sub-station and carry-out the procedure for selection of RPG. On selection of RPG, DISCOMs shall issue the LoA and sign PPA with RPG. DISCOMs will provide connectivity at the sub-station to the selected RPG. The DISCOMs will ensure “must-run” status to the solar/ other renewable power plants installed under this scheme and will keep the feeders ‘ON’

during sunshine hours of a day. They shall act as facilitator to the beneficiaries in implementation of this scheme.

In case, RPG has taken land from a farmer/group of farmers on lease for the project, the amount of monthly lease rent would be paid by the DISCOMs to the lessor directly in his/her bank account before 5th day of the month following the month for which the lease rent is due. In such a case, the lease rent paid by the DISCOM will be deducted from monthly payment due to the RPG.

(iii) State Nodal Agency (SNA):

State Nodal Agency (SNA) will coordinate with States/UTs, DISCOMs and farmers for implementation of the scheme. They will assist the farmers in project development activities including formulation of DPR, PPA/EPC contracts, getting funds from financial institutions, etc. For settlement of any issues arising during selection of solar/ other renewable energy based power plants and their implementation, a State level Committee under the chairmanship of Principal Secretary (Renewable Energy/Energy) will be setup by the participating State/UT and SNA of that State will be responsible to coordinate/organize the quarterly meetings of the State Level Committee. In addition, SNAs shall ensure publicity of the scheme and create awareness through advertisements etc, and also monitor the implementation of the scheme. The SNA will be eligible to get service charge of Rs.0.25 Lakh per MW after commissioning of the projects.

(iv) Renewable Power Generator (RPG):

Individual farmers/ group of farmers/ cooperatives/ panchayats/ Farmer Producer Organisations (FPO) /Water User associations (WUA) or projects developer would be the RPG. They have to participate in the selection process to be carried out by DISCOMS. In case of selection, they have to sign PPA and install the plant as per provisions of these guidelines and applicable rules and regulations.

II. Component B: Installation of 17.50 Lakh Stand-alone Solar Pumps

Under this Component, individual farmers will be supported to install standalone solar Agriculture pumps of capacity up to 7.5 HP for replacement of existing diesel Agriculture pumps / irrigation systems in off-grid areas, where grid supply is not available. Installation of new pumps shall also be permitted under this scheme except in dark zone areas. Pumps of capacity higher than 7.5 HP may be allowed, however, the CFA will be limited to the CFA applicable for pump of 7.5 HP. Water User Associations and community/cluster based irrigation system will also be covered under this component. However, priority would be given to small and marginal farmers. In order to minimize the water usage for irrigation purpose, preference will be given to the farmers using Micro irrigation systems or covered under Micro irrigation schemes or who opt for micro irrigation system. The size of pump would be selected on the basis of water table in the area, land covered and quantity of water required for irrigation.

Solar PV capacity in kW for the pump capacity in HP will be allowed as per MNRE specifications under the scheme. It will be mandatory to use indigenously manufactured solar panels with indigenous solar cells and modules. Further, the motor-pump-set, controller and balance of system should also be manufactured indigenously. The vendor has to declare the list of imported components used in the manufacturing of solar water pumping system.

CFA of 30% of the benchmark cost or the tender cost, whichever is lower, of the stand-alone solar Agriculture pump will be provided. The State Government will give a subsidy of 30%; and the remaining 40% will be provided by the farmer. Bank finance may be made available for farmer's contribution, so that farmer has to initially pay only 10% of the cost and remaining up to 30% of the cost as loan. In case the State Government provides subsidy more than 30%, the beneficiary share will reduce accordingly.

However, in North Eastern States, Sikkim, Jammu & Kashmir, Himachal Pradesh and Uttarakhand, Lakshadweep and A&N Islands, CFA of 50% of the benchmark cost or the tender cost, whichever is lower, of the stand-alone solar pump will be provided. The State Government will give a subsidy of 30%; and the remaining 20% will be provided by the farmer. Bank finance may be made available for farmer's contribution, so that farmer has to initially pay only 10% of the cost and remaining up to 10% of the cost as loan. In case the State Government provides subsidy more than 30%, the beneficiary share will reduce accordingly.

New Solar Agriculture pumps would not be covered under this component in Dark zones/black zones. However, existing standalone diesel pumps, can be converted into standalone solar pumps in these areas provided they use micro irrigation techniques to save water.

Possibilities would be explored by implementing agencies for convergence of present scheme with schemes on promotion of micro irrigation system and replacement of agriculture pumps with energy efficient pumps and they may work out the modalities in coordination with respective Ministries/Departments.

Further, whenever the grid reaches in the off-grid area, the stand alone Solar Agriculture Pumps can be connected to the grid to feed surplus power depending on grid capacity. DISCOMs may purchase this surplus power from the farmer at the rate decided by the respective State/SERC.

DISCOMs/ Agricultural Department/ Minor Irrigation Department / any other Department designated by State Government will be the implementing agencies for this component. 2% of the eligible CFA will be provided as service charges in totality to all the agencies involved in implementation including the designated State Implementing Agency. Part of service charges (to be decided by MNRE) shall be given to the central agency for centralised tendering. Additionally, some part of the service charge may also be retained by MNRE for nation-wide centralized IEC activities.

a. Allocation and procurement of pumps

State-wise allocation of solar pumps will be issued by MNRE once in a year or as and when required, after approval by a Screening Committee under the chairmanship of Secretary, MNRE. Much before the start of every financial year during the Scheme tenure, MNRE will call for submission of demand from the implementation agencies. Based on overall target for the year and the demand received from implementation agencies, MNRE will allocate quantity of pumps to the implementation agencies in the States. On acceptance of the allocated quantity by the implementation agencies and submission of detailed proposal as per MNRE format, within a given time period, final sanction will be issued by MNRE. MNRE will have the discretion to amend the sanction any time of the year after ascertaining the pace of progress in any particular state, or as per requirements of the scheme.

Implementing agencies will submit proposals through online portal to MNRE for approval. Offline proposals will not be accepted, unless MNRE has given a general exemption from the requirement of online submission to any agency for any specific period of time.

Proposals for new installations will only be considered by the Screening Committee. Proposals wherein the systems have already been installed/ under installation will not be considered for approval under the Programme by the Screening Committee.

There will be centralized tendering of solar water pumping system through Central PSUs. These CPSUs will carry out tendering process as per Guidelines and standards & specifications issued by MNRE. Any deviation shall normally be not permissible except in specific cases with the approval of Secretary, MNRE.

For centralized tendering the designated CPSUs may come out region-wise/State-wise tenders, however, their role will be limited to selection of bidders and discovery of rates. To ensure quality and post installation services only manufacturers of solar water pumps or controllers or manufacturers of solar panels would be allowed to participate in the bidding process. Normally, three bidders would be selected and they have to match L1 rates and the quantity allocated to those who agree to match the L1 rates they would be 50%, 30%, and 20% of the total tender quantity respectively in the ascending order of rates quoted by them. Number of bidders selected may vary depending upon the tender quantity. The selection of beneficiaries and implementation of scheme would be the responsibility of the State Implementation Agency. Cluster based approach would be used for allocation of districts to the selected bidders to optimize the resources and ensure quality services made available to the farmer. As far as possible contiguous districts would be allotted to the successful bidders, with the total requirements of pumps in the allocated area matching the quantity allotted to them.

Installation of 17.5 lakh Stand-alone Solar Water Agriculture Pumping Systems will create solar PV capacity of over 8000 MW. Since pumps are generally used for 150 days in a year, this capacity can be optimally utilized by using Universal Solar Pump Controller (USPC), through which farmer can use solar power for other activities like operating chaff cutter, floor mill, cold storage, drier, battery charges, etc., and increase his income. Option would be given to the farmer to opt for USPC and additional cost of solar PV pumping system with USPC would be discovered by the tendering agency. The entire additional cost for solar pumping system with USPC would be borne by the farmer. States/UTs may bear this additional cost to facilitate use of solar energy for other activities and increasing the income of farmers.

In all cases, the successful bidder shall provide AMC for five years from the date of installation, real time monitoring, helpline, district level service centres and comply standards of performance in dealing with complaints/redressal mechanism.

The Implementation Agency would also be responsible for carrying out publicity of the scheme so as to increase awareness amongst potential beneficiaries. For this purpose, apart from their own publicity content, they shall also be guided by advice of MNRE on this matter.

b. Installation timeline and Penalties

Projects for installation of solar Agriculture pumps systems shall be completed within 12 months from the date of sanction by MNRE. However, for North Eastern States including Sikkim, Jammu & Kashmir, Himachal Pradesh, Uttarakhand, Lakshadweep and A&N Islands

this time limit will be 15 months from the date of sanction. Extension in project completion timelines, up to a maximum period of three months, will be considered at the level of Group Head in MNRE and upto 6 months at the level of Secretary in MNRE on submission of valid reasons by the implementing agency. However, such extension will attract reduction in service charges to implementing agency as under:

- a. 10% reduction in applicable service charges for delay of more than one month in completion of project.
- b. Further reduction of 10% of service charges for delay of more than two month and up to three months.
- c. Further reduction of 10% of service charges for delay of more than three month and up to six months
- d. No service charges for delay in completion of more than six months.

No extension will be granted beyond six months and only the systems which are installed in all respects and commissioned within stipulated time period will be considered for release of CFA.

c. Release of funds

Funds up to 40% of the applicable CFA for the sanctioned quantity would be released as advance to the implementing agency only after placement of letter of award(s) to the selected vendors. The implementing agencies may pass on this fund to the selected vendors in different stages on achievement of various milestones as per terms and conditions of letter of award(s). Second installment up to 30% of the applicable CFA would be released on submission of UCs and SoE for the first release. The balance eligible CFA along with applicable service charges would be released on acceptance of the Project Completion Report in the prescribed format, Utilization Certificates as per GFR and other related documents by the Ministry.

d. Monitoring and maintenance

Selected vendors shall be responsible for design, supply, installation and commissioning of solar agriculture pumps. Vendors will mandatorily provide AMC for a period of 5 years from the date of commissioning of the systems including insurance coverage for the installed systems against natural calamities and theft. AMC will include inspection by Vendor at least once in a quarter and submission of quarterly inspection report of the installed pumps as per prescribed format. To ensure timely maintenance of the systems the vendor shall have one authorized service centre in each operational district and a helpline in local language in each operational State. Helpline number shall be indicated on the pump/ controller at suitable location easily visible to the user.

All solar Agriculture pumps sanctioned under the Programme shall be provided with remote monitoring system by the vendor. It will be mandatory to submit performance data of solar power plant online to MNRE in the manner and format prescribed by MNRE.

Monitoring of the Scheme and its implementation will be carried out during the period of implementation of the Scheme as is given below:

- i. The implementing agency would be responsible for monitoring parameters such as end-use verification and compilation of statistical information.

- ii. Implementing agencies will submit monthly progress report for the sanctioned projects.
- iii. Funds may be released by implementing agency to the vendor on submission of bank guarantee equivalent to 10% of the cost of systems installed by that vendor for a period of five years. Alternatively, BG may be provided initially for a period of one year which may be extended on year to year basis thereafter.
- iv. The Ministry officials or designated agency may inspect the ongoing installation or installed plants. In case the installed systems are not as per standards, non-functional on account of poor quality of installation, or non-compliance of AMC, the Ministry reserves the right to blacklist the vendor. Blacklisting may inter-alia include the following:
 - a. The Vendor/Firm will not be eligible to participate in tenders for Government supported projects.
 - b. In case, the concerned Director(s) of the firm/company joins another existing or starts/ joins a new firm/company, the company will automatically be blacklisted.

e. Responsibilities of Implementation Agency

The Implementing Agencies will be responsible for the following activities:

- i. Demand aggregation for solar Agriculture pumps through online portal.
- ii. Prepare proposal and submit to MNRE for sanction
- iii. Oversee installation of systems.
- iv. Inspection of installed systems and online submission of completion reports to MNRE.
- v. Submission of utilization certificates and audited statement of expenditure through EAT module and disbursement of MNRE CFA.
- vi. Online submission of monthly and quarterly progress reports.
- vii. Ensure project completion within the given timelines and compliance of MNRE Guidelines and Standards.
- viii. Online and offline maintenance for records.
- ix. Real time monitoring through dedicated web-portal
- x. Performance monitoring of installed system through third party
- xi. Ensure compliance of AMC and training of locals by the vendors.
- xii. Carrying out publicity of the scheme so as to increase awareness, for which purpose advice of MNRE may also be adopted apart from its own publicity.
- xiii. Any other activity to ensure successful implementation of the programme.

III. Component C: Solarisation of 10 Lakh Grid Connected Agriculture Pumps

Under this Component, individual farmers having grid connected agriculture pump will be supported to solarise pumps. Solar PV capacity up to two times of pump capacity in kW is allowed under the scheme. However, State may specify lower solar PV capacity in kW, which

in any case shall be not be less than pump capacity in HP e.g. for 2 HP pump it will not be less than 2 kW. The farmer will be able to use the generated solar power to meet the irrigation needs and the excess solar power will be sold to DISCOMs. Water User Associations and community/cluster based irrigation system will also be covered under this component. However, priority would be given to small and marginal farmers. In order to minimize the water usage for irrigation purpose, preference will be given to the farmers using Micro irrigation systems or covered under Micro irrigation schemes or who opt for Micro irrigation systems.

Possibilities would be explored by implementing agencies for convergence of present scheme with schemes on promotion of micro irrigation system and replacement of agriculture pumps with energy efficient pumps and they may work out the modalities in coordination with respective Ministries/Departments.

It will be mandatory to use indigenously manufactured solar panels with indigenous solar cells and modules. Further, the balance of system should also be manufactured indigenously. The vendor has to declare the list of imported components used in the solarisation system.

CFA of 30% of the benchmark cost or the tender cost, whichever is lower, of the solar PV component will be provided. The State Government will give a subsidy of 30%; and the remaining 40% will be provided by the farmer. Bank finance may be made available for farmer's contribution, so that farmer has to initially pay only 10% of the cost and remaining up to 30% of the cost as loan. In case the State Government provides subsidy more than 30%, the beneficiary share will reduce accordingly.

However, in North Eastern States, Sikkim, Jammu & Kashmir, Himachal Pradesh and Uttarakhand, Lakshadweep and A&N Islands, CFA of 50% of the benchmark cost or the tender cost, whichever is lower, of the solar PV component will be provided. The State Government will give a subsidy of 30%; and the remaining 20% will be provided by the farmer. Bank finance may be made available for farmer's contribution, so that farmer has to initially pay only 10% of the cost and remaining up to 10% of the cost as loan. In case the State Government provides subsidy more than 30%, the beneficiary share will reduce accordingly.

Further, the CFA will be limited to Solar PV capacity up to two times of pump capacity in kW for pumps up to 7.5 HP. Solarisation of Pumps of capacity higher than 7.5 HP may be allowed, however, the CFA will be limited to the CFA applicable for pump of 7.5 HP in the respective State/UTs. This will help to create an avenue for extra income to the farmers, and for the DISCOMs to meet their RPO targets. The solar power fed in to the grid and solar power utilized by farmer both will be accounted for fulfillment of solar RPO by the DISCOM.

DISCOM may adopt any of the modalities for solarisation of pumps viz, (i) Net-metering: in this case the agriculture pump will continue to run at rated capacity taking power from solar panels and balance power from grid, if required, and in case solar power generation is higher than required by pump, the additional solar power would be fed to the grid; (ii) Pump to run on solar power only: in this case the pump will run from the solar power as in case of stand-alone solar pump and no power will be drawn from the grid for operation of pump. In case solar power generation is higher than required by pump, the additional solar power would be fed to the grid.

DISCOMs /GENCO/ any other Department designated by State Government will be the implementing agencies. 2% of the eligible CFA will be provided as total service charges to all agencies implementing the scheme including the designated State Implementing Agencies. In case of centralised tendering, some percentage/fixed amount out of service charges (to be decided by MNRE) shall be given to the central agency. MNRE may also retain a certain amount from service charge for nation-wide centralised IEC activities.

This component will be applicable to farmers already connected to grid. Feeder-wise implementation is proposed to be carried out. All agriculture pumps in a feeder will be solarised, however, States may impose a minimum solarisation requirement for a feeder in terms of minimum % of pumps solarized on that feeder.

In case of dark zones/black zones only existing grid connected pumps will be solarized provided they use micro irrigation techniques to save water.

Possibilities would be explored by implementing agencies for convergence of present scheme with schemes on promotion of micro irrigation system and replacement of agriculture pumps with energy efficient pumps and they may work out the modalities in coordination with respective Ministries/Departments.

DISCOMs will purchase excess power from the farmer at the rate decided by the respective State/SERC. The DISCOMs will ensure “must-run” status to the solarised feeders and will keep such feeders ‘ON’ during sunshine hours of a day.

It will be mandatory for implementing agency to create remote monitoring system to monitor performance of the system post-installation.

States may also formulate state specific policy for grid connected solar pumps, customised to needs of the respective State, keeping the broad framework provided by MNRE intact.

a. Allocation of solarisation capacity and procurement

State-wise allocation for solarisation of pumps will be issued by MNRE once in a year, after approval by a Screening Committee under the chairmanship of Secretary, MNRE. In the beginning of every financial year during the Scheme tenure, MNRE will call for submission of feeder-wise demand for solarization. Based on overall target for the year and the demand received from implementation agencies, MNRE will allocate solarization capacity to the implementation agencies in the States. On acceptance of the allocated quantity by the implementation agencies and submission of detailed proposal as per MNRE format, within a given time, final sanction will be issued by MNRE.

As per approval, the component is to be implemented on pilot mode for initial one lakh grid connected agriculture pumps and accordingly, initially this capacity will be allocated by MNRE to implementing agencies based on their demand and readiness for implementation of the component. Pilot projects will be continuously monitored during implementation and also on completion to evaluate the success of pilot run and a detailed report will be prepared for recommending further scaling up of the capacity under this component. Such evaluation may be done internally or through external agency as per decision of the MNRE.

Implementing agencies will submit proposals through online portal to MNRE for approval. Offline proposals will not be accepted, unless MNRE has given a general exemption from the requirement of online submission for any specific period of time.

Proposals for new installations will only be considered by the Screening Committee. Proposals wherein the pumps are already solarized prior to sanction of MNRE will not be considered for approval under the Scheme by the Screening Committee.

MNRE may specify either a centralized tendering of solarisation system through Central PSUs or by the State Implementation Agencies. These CPSUs or State Implementation agencies will carry out tendering process as per the Guidelines, standards and specifications issued by MNRE. Any deviation shall normally be not permissible except in specific cases with the approval of Secretary, MNRE

In case of centralized procurement the designated CPSUs may come out with region-wise/State-wise tenders, however, their role will be limited to selection of bidders. The selection of beneficiaries and implementation of scheme would be the responsibility of the State Implementation Agency.

In all cases, the bids shall require the successful bidder to provide for AMC for five years from the date of installation, helpline, district level service centres and comply standards of performance in dealing with complaints.

The Implementation Agency would also be responsible for carrying out publicity of the scheme so as to increase awareness amongst potential beneficiaries. For this purpose, apart from their own publicity content, they shall also be guided by advice of MNRE on this matter.

b. Installation timeline and Penalties

Projects for solarisation of pumping systems shall be completed within 12 months from the date of sanction by MNRE. However, for North Eastern States including Sikkim, Jammu & Kashmir, Himachal Pradesh, Uttarakhand, Lakshadweep and A&N Islands this time limit will be 15 months from the date of sanction. Extension in project completion timelines, up to a maximum period of three months, will be considered at the level of Group Head in MNRE and upto 6 months at the level of Secretary in MNRE on submission of valid reasons by the implementing agency. However, such extension will attract reduction in service charges to implementing agency as under:

- a. 10% reduction in applicable service charges for delay of more than one month in completion of project.
- b. Further reduction of 10% of service charges for delay of more than two month and up to three months.
- c. Further reduction of 10% of service charges for delay of more than three month and up to six months
- d. No service charges for delay in completion of more than six months.

No extension will be granted beyond six months and only the systems which are installed in all respects and commissioned within stipulated time period will be considered for release of CFA.

The implementing agencies after submitting proposal to MNRE may choose to start the preparatory activities including tendering process. However, the Letter of Award/Purchase Order shall be placed to the selected vendor(s) only after the issue of sanction letter by MNRE. Further, MNRE will not be responsible for any liabilities arising out of a situation where the proposal is eventually rejected.

c. Release of funds

Funds up to 40% of the applicable CFA for the sanctioned quantity would be released as advance to the implementing agency only after placement of letter of award(s) to the selected vendors. The implementing agencies may pass on this fund to the selected vendors in different stages on achievement of various milestones as per terms and conditions of letter of award(s). Second installment up to 30% of the applicable CFA would be released on submission of UCs and SoE for the first release. The balance eligible CFA along with applicable service charges would be released on acceptance of the Project Completion Report in the prescribed format, Utilization Certificates as per GFR and other related documents by the Ministry.

d. Monitoring and maintenance

Selected vendors shall be responsible for all aspects of solarisation viz., design, supply, installation and commissioning. Vendors will mandatorily provide AMC for a period of 5 years from the date of commissioning of the systems including insurance coverage for the installed systems against natural calamities and theft. AMC will include submission of quarterly inspection report of the installation as per prescribed format. To ensure timely maintenance of the systems the vendor shall have one authorised service centre in each operational district and a helpline in local language in each operational State.

Under the Programme along with solarisation, the vendor shall also provide a remote monitoring system. It will be mandatory to submit quarterly maintenance report along with performance data of solar power plant online to MNRE in a manner and format prescribed by MNRE.

Monitoring of the Scheme and its implementation will be carried out during the period of implementation of the Scheme as is given below:

- i. The implementing agency would be responsible for monitoring parameters such as end-use verification and compilation of statistical information.
- ii. Implementing agencies will submit monthly progress report for the sanctioned projects.
- iii. Funds may be released by implementing agency to the vendor on submission of bank guarantee equivalent to 10% of the cost of systems installed by that vendor for a period of five years. Alternatively, BG may be provided initially for a period of two years which may be extended on year to year basis thereafter.
- iv. The Ministry officials or designated agency may inspect the ongoing installation or installed plants. In case the installed systems are not as per standards, non-functional on account of poor quality of installation, or non-compliance of AMC, the Ministry reserves the right to blacklist the vendor. Blacklisting may inter-alia include the following:

- a. The Vendor/Firm will not be eligible to participate in tenders for Government supported projects.
- b. In case, the concerned Director(s) of the firm/company joins another existing or starts/ joins a new firm/company, the company will automatically be blacklisted.

e. Responsibilities of Implementation Agency

The Implementing Agencies will be responsible for the following activities:

- i. Issue additional instructions/ conditions such as minimum solarisation level of feeder.
- ii. Issue connectivity standards/regulations, if required, and facilitate connection to the grid.
- iii. Selection of feeder for solarisation and demand aggregation for solarisation of pumps.
- iv. Prepare proposal and submit to MNRE for sanction
- v. Conduct tendering process as per MNRE guidelines
- vi. Oversee installation of systems.
- vii. Inspection of installed systems and online submission of completion reports to MNRE.
- viii. Disbursement of MNRE CFA and submission of utilization certificates and audited statement of expenditure through EAT module.
- ix. Online submission of monthly and quarterly progress reports.
- x. Ensure project completion within the given timelines and compliance of MNRE Guidelines and Standards.
- xi. Online and offline maintenance for records.
- xii. Real time monitoring through dedicated web-portal
- xiii. Performance monitoring of installed system through third party
- xiv. Ensure compliance of AMC and training of locals by the vendors.
- xv. Carrying out publicity of the scheme so as to increase awareness, for which purpose advice of MNRE may also be adopted apart from its own publicity.
- xvi. Any other activity to ensure successful implementation of the programme.

4. Quality Assurance and Evaluation Mechanism

Systems installed under this Programme should meet technical specification and construction standards as specified by BIS and MNRE from time to time. Non-compliance will be taken seriously to the extent of blacklisting of the vendor, in the same manner as specified, apart from taking action under any other law in force. In case of centralized tendering the CPSUs will be responsible for performance evaluation of the selected vendors. Evaluation of pilot implementation of Component-A and Component-C will be carried out through third party selected for this purpose. In order to ensure, the scheme meets expected outcomes continuous evaluation of scheme would be undertaken and mid-course correction, as required, shall be implemented.

5. Interpretation of the Guidelines

In case of any ambiguity in interpretation of any of the provisions of these guidelines, the decision of the Ministry shall be final.

The Guidelines would be reviewed by the Ministry from time to time and necessary modifications would be incorporated after getting approval of Minister, NRE.

Annexure-I

STANDARD
POWER PURCHASE AGREEMENT FOR
PROCUREMENT OF MW _____ POWER ON LONG TERM
BASIS

Between

[Name of Renewable Power Generator]

And

[Name of Distribution Company]

[month and year]

This Power Purchase Agreement is made on the _____ day of _____ of _____ at _____

Between

_____ [name of the Renewable Power Generator], _____, [details of Renewable Power Generator] (hereinafter referred to as “**Renewable Power Generator or RPG**”, which expression shall, unless repugnant to the context or meaning thereof, be deemed to include its successors and permitted assigns) as a Party of the **First Part**;

And

_____ [**Distribution Company**], a company incorporated under the Companies Act 1956, having its registered office at _____ (hereinafter referred to as “**DISCOM**”, which expression shall, unless repugnant to the context or meaning thereof, be deemed to include its successors and assignees) as a Party of the **Second Part**;

The RPG and DISCOM are individually referred to as ‘Party’ and collectively referred to as ‘Parties’.

WHEREAS:

A. The Ministry of New and Renewable Energy [MNRE] has launched a scheme for farmers on 8th March 2019 and issued implementation guidelines on _____.

B. The MNRE has accorded a sanction and allotted a capacity of _____ MW to DISCOM for under the said scheme of 8th March 2019.

C. DISCOM had initiated a selection process for procurement of _____ MW of the power generated from the Grid connected _____ Power Project on the terms and conditions contained in the EoI/RfS No. _____ dated _____.

D. The RPG has been selected in the Process for development, generation and supply of electricity from the _____ MW _____ Power Project to be established by RPG at _____ [location of proposed power plant] and electricity generated to be fed to the _____ [Name and location of 33/11 kV sub-station];

E. DISCOM has issued the Letter of Award No. dated in favour of the RPG for development and establishment of the MW _____ Power Project as per the terms and conditions contained in the EoI/RfS.

F. The RPG has furnished the Performance Bank Guarantee in the sum of Rs. in favour of DISCOM as per the format prescribed by the DISCOM.

G. The RPG has fulfilled the terms and conditions for signing this Power Purchase Agreement as a definitive agreement for establishing the _____ Power Project of MW at,

for generation and sale of electricity by the RPG to DISCOM at _____ 33(or 66 or 110)/11 kV S/S;

H. The parties have agreed to execute this Power Purchase Agreement in terms of the EoI/RfS and the Letter of Award in regard to the terms and conditions for establishment of the _____ Power Project at, and for generation and supply of electricity by the RPG to DISCOM.

Now therefore, in consideration of the premises and mutual agreements, covenants and conditions set forth herein, it is hereby agreed by and between the Parties as follows:

ARTICLE 1: DEFINITIONS AND INTERPRETATION

1.1 Definitions

The terms used in this Agreement, unless as defined below or repugnant to the context, shall have the same meaning as assigned to them by the Electricity Act, 2003 and the rules or regulations framed there under, including those issued/framed by the Appropriate Commission (as defined hereunder), as amended or re-enacted from time to time.

"Act" or "Electricity Act, 2003"	shall mean the Electricity Act, 2003 and include any modifications, amendments and substitution from time to time;
"Agreement" or "Power Purchase Agreement" or "PPA"	shall mean this Power Purchase Agreement including its recitals and Schedules, amended or modified from time to time in accordance with the terms hereof;
"Appropriate Commission"	Unless otherwise stated, Appropriate Commission shall be the commission of the state where DISCOM is situated;
"Bill Dispute Notice"	shall mean the notice issued by a Party raising a Dispute regarding a Monthly Bill or a Supplementary Bill issued by the other Party;
"Business Day"	shall mean with respect to RPG and DISCOM, a day other than Sunday or a statutory holiday, on which the banks remain open for business in the State;
"Capacity Utilisation Factor" or "CUF"	shall have the same meaning as provided in CERC (Terms and Conditions for Tariff determination from Renewable Energy Sources) Regulations, 2009 as amended from time to time; However for avoidance of any doubt, it is clarified that the CUF shall be calculated on the Contracted Capacity; In any Contract Year, if 'X' MWh of energy has been metered out at the Delivery Point for 'Y' MW Project capacity, $CUF = (X \text{ MWh} / (Y \text{ MW} * 8766)) * 100\%$;
"Change in Law"	shall have the meaning ascribed thereto in Article 12 of this Agreement;

“Commercial Operation Date (COD)”	shall mean the date on which the commissioning certificate is issued upon successful commissioning (as per provisions of this Agreement) of the project;
“Competent Court of Law”	shall mean any court or tribunal or any similar judicial or quasi-judicial body in India that has jurisdiction to adjudicate upon issues relating to this Agreement;
“Consents, Clearances and	shall mean all authorizations, licenses, approvals, registrations, permits, waivers,
“Permits”	privileges, acknowledgements, agreements, or concessions required to be obtained from or provided by any concerned authority for the purpose of setting up of the generation facilities and/ or supply of power;
“Consultation Period”	shall mean the period of ninety (90) days or such other longer period as the Parties may agree, commencing from the date of issuance of a RPG Preliminary Default Notice or DISCOM Preliminary Default Notice as provided in Article 13 of this Agreement, for consultation between the Parties to mitigate the consequence of the relevant event having regard to all the circumstances;
“Contract Year”	shall mean the period beginning from the Effective Date and ending on the immediately succeeding March 31 and thereafter each period of 12 months beginning on April 1 and ending on March 31 provided that: (i) in the financial year in which the COD would occur, the Contract Year shall end on the date immediately before the COD and a new Contract Year shall commence once again from the COD and end on the immediately succeeding March 31, and thereafter each period of twelve (12) months commencing on April 1 and ending on March 31, and (ii) provided further that the last Contract Year of this Agreement shall end on the last day of the Term of this Agreement
"Contracted Capacity"	shall mean [Insert capacity] MW contracted with DISCOM for supply by the RPG to DISCOM at the Delivery Point from the _____ Power Project;
“Delivery Point”	“Delivery Point” shall mean the point at the voltage level of 11kV or above of the 33/11 kV Sub-station. Metering shall be done at this interconnection point where the power is injected into the 33/11 kV Sub-station. For interconnection with grid and metering, the RPG shall abide by the relevant and applicable regulations, Grid Code notified by the State Commission and Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006 as amended and revised from time to time, or orders passed thereunder by the Appropriate Commission or CEA. All charges and losses related to Transmission of power from project up to Delivery Point as notified by the Appropriate Commission shall be borne by the RPG.

"Dispute"	shall mean any dispute or difference of any kind between DISCOM and the RPG, in connection with or arising out of this Agreement including but not limited to any issue on the interpretation and scope of the terms of this Agreement as provided in Article 16 of this Agreement;
"Due Date"	Due Date shall mean the forty-fifth (45th) day after a Monthly Bill (including all the relevant documents) or a Supplementary Bill is received in hard copy and duly acknowledged by the DISCOM or, if such day is not a Business Day, the immediately succeeding Business Day, by which date such Monthly Bill or a Supplementary Bill is payable by the DISCOM.
"Effective Date"	shall have the meaning ascribed thereto in Article 2.1 of this Agreement;
"Electricity Laws"	shall mean the Electricity Act, 2003 and the rules and regulations made there under from time to time along with amendments thereto and replacements thereof and any other Law pertaining to electricity including regulations framed by the Appropriate Commission;
"Event of Default"	shall mean the events as defined in Article 13 of this Agreement;
"Expiry Date"	Shall mean the date occurring twenty five (25) years from the Commercial Operation Date subject to that the supply of power shall be limited for a period of 25 years from the COD unless extended by the Parties as per this Agreement;
"Financing Agreements"	shall mean the agreements pursuant to which the RPG has sought financing for the Power Project including the loan agreements, security documents, notes, indentures, security agreements, letters of credit and other documents, as may be amended, modified, or replaced from time to time, but without in anyway increasing the liabilities of DISCOM;
"Force Majeure" or "Force Majeure Event"	shall have the meaning ascribed thereto in Article 11 of this Agreement;
"Indian Governmental Instrumentality"	shall mean the Government of India, Governments of state of _____ and any ministry, department, board, authority, agency, corporation, commission under the direct or indirect control of Government of India or the above state Government or both, any political sub-division of any of them including any court or Appropriate Commission or tribunal or judicial or quasi-judicial body in India;
"Insurances"	shall mean the insurance cover to be obtained and maintained by the RPG in accordance with Article 8 of this Agreement;

"Interconnection Facilities"	shall mean the facilities on RPG's side of the Delivery Point for scheduling, transmitting and metering the electrical output in accordance with this Agreement and which shall include, without limitation, all other transmission lines and associated equipment, transformers, relay and switching equipment and protective devices, safety equipment and RTU, Data Transfer and Acquisition facilities for transmitting data subject to Article 7, the Metering System required for supply of power as per the terms of this Agreement;
"Invoice" or "Bill"	shall mean either a Monthly Bill / Supplementary Bill or a Monthly Invoice/ Supplementary Invoice raised by any of the Parties;
"Late Payment Surcharge"	shall have the meaning ascribed thereto in Article 10.3.3 of this Agreement;
"Law"	shall mean in relation to this Agreement, all laws including Electricity Laws in force in India and any statute, ordinance, regulation, notification or code, rule, or any interpretation of any of them by an Indian Governmental Instrumentality and having force of law and shall further include without limitation all applicable rules, regulations, orders, notifications by an Indian Governmental Instrumentality pursuant to or under any of them and shall include without limitation all rules, regulations, decisions and orders of the Appropriate Commissions;
"Letter of Credit" or "L/C"	shall have the meaning ascribed thereto in Article 10.4 of this Agreement;
"Letter of Award" or "LoA"	shall mean Letter of Award issued by the DISCOM to the RPG for the project;
"MNRE"	shall mean the Ministry of New and Renewable Energy, Government of India;
"Month"	shall mean a period of thirty (30) days from (and excluding) the date of the event, where applicable, else a calendar month;
"Party" and "Parties"	shall have the meaning ascribed thereto in the recital to this Agreement;
"Payment Security Mechanism"	shall have the meaning ascribed thereto in Article 10.4 of this Agreement;

“Power Project” or “Project”	shall mean the _____ power generation facility of Contracted Capacity of[Insert capacity] MW, located at, [Insert name of the District and State] having a separate control system, metering and separate points of injection into the grid at Delivery point of 33/11 kV substation. The Project shall include all units and auxiliaries such as water supply, treatment or storage facilities, bay(s) for transmission system in the switchyard, dedicated transmission line up to the Delivery Point and all the other assets, buildings/structures, equipment, plant and machinery, facilities and related assets required for the efficient and economic operation of the power generation facility, whether completed or at any stage of development and construction or intended to be developed and constructed for the purpose of supply of power as per this Agreement;
“Preliminary Default Notice”	shall have the meaning ascribed thereto in Article 13 of this Agreement;
“Project Capacity”	shall mean the maximum AC capacity of the Project at the point of injection on which the Power Purchase Agreement has been signed.
"Prudent Utility Practices"	shall mean the practices, methods and standards that are generally accepted internationally from time to time by electric utilities for the purpose of ensuring the safe, efficient and economic design, construction, commissioning, operation and maintenance of power generation equipment and which practices, methods and standards shall be adjusted as necessary, to take account of: a) operation and maintenance guidelines recommended by the manufacturers of the plant and equipment to be incorporated in the Power Project; b) the requirements of Indian Law; and the physical conditions at the site of the Power Project
“Rebate”	shall have the same meaning as ascribed thereto in Article 10.3.5 of this Agreement;
"Rupees", "Rs.", "₹"	shall mean Indian rupees, the lawful currency of India;
“Scheduled Commissioning Date” or “SCD” of the Project	Shall mean [Insert Date that is nine (9) Months from the Date of issuance of LoA by the DISCOM to the RPG];
"Tariff"	Shall have the same meaning as provided for in Article 9 of this Agreement;
"Tariff Payment"	shall mean the payments to be made under Monthly Bills as referred to in Article 10 and the relevant Supplementary Bills;
“Termination Notice”	shall mean the notice given by either Parties for termination of this Agreement in accordance with Article 13 of this Agreement;

"Term of Agreement"	shall have the meaning ascribed thereto in Article 2 of this Agreement;
---------------------	---

ARTICLE 2: TERM OF AGREEMENT

2.1 *Effective Date*

2.1.1 This Agreement shall come into effect from _____ and such date shall be referred to as the Effective Date.

2.2 *Term of Agreement*

2.2.1 Subject to Article 2.3 and 2.4 of this Agreement, this Agreement shall be valid for a term from the Effective Date until the Expiry Date. This Agreement may be extended for a further period at least one hundred eighty (180) days prior to the Expiry Date, on mutually agreed terms and conditions.

2.2.2 The RPG is free to operate their plants beyond the Expiry Date if other conditions like land lease / Right to Use of Land (as applicable), permits, approvals and clearances etc. allow. In such case unless otherwise agreed by the DISCOM, DISCOM shall not be obligated to procure power beyond the Expiry Date.

2.3 *Early Termination*

2.3.1 This Agreement shall terminate before the Expiry Date if either DISCOM or RPG terminates the Agreement, pursuant to Article 13 of this Agreement.

2.4 *Survival*

2.4.1 The expiry or termination of this Agreement shall not affect any accrued rights, obligations and liabilities of the Parties under this Agreement, including the right to receive penalty as per the terms of this Agreement, nor shall it affect the survival of any continuing obligations for which this Agreement provides, either expressly or by necessary implication, which are to survive after the Expiry Date or termination including those under Article 11 (Force Majeure), Article 13 (Events of Default and Termination), Article 14 (Liability and Indemnification), Article 16 (Governing Law and Dispute Resolution), Article 17 (Miscellaneous Provisions), and other Articles and Schedules of this Agreement which expressly or by their nature survive the Term or termination of this Agreement shall continue and survive any expiry or termination of this Agreement.

ARTICLE 3: CONDITIONS SUBSEQUENT

3.1 The RPG agrees and undertakes to make Project Financing Arrangements for its Project and shall provide necessary documents to DISCOM in this regard within six Months from the Date of issue of LoA by DISCOM for the project.

ARTICLE 4: CONSTRUCTION & DEVELOPMENT OF THE PROJECT

4.1 *RPG's Obligations*

4.1.1 The RPG undertakes to be responsible, at RPG's own cost and risk, for:

- a) The RPG shall be solely responsible and make arrangements for Land & associated infrastructure for development of the Project and for Connectivity with the 33/11 kV sub-station for confirming the evacuation of power by the Scheduled Commissioning date or COD, whichever is earlier, and all clearances related thereto;
The RPG shall furnish the necessary documents to establish possession in the name of the Project Developer of the required land/ Lease Agreement;
- b) obtaining all Consents, Clearances and Permits as required and maintaining all documents.
- c) Designing, constructing, erecting, commissioning, completing and testing the Power Project in accordance with the applicable Law, the Grid Code, the terms and conditions of this Agreement and Prudent Utility Practices.
- d) the commencement of supply of power up to the Contracted Capacity to DISCOM no later than the Scheduled Commissioning Date and continuance of the supply of power throughout the term of the Agreement;
- e) Connecting the Power Project switchyard with the Interconnection Facilities at the Delivery Point. The RPG shall make adequate arrangements to connect the Power Project switchyard with the Interconnection Facilities at Interconnection / Metering / Delivery Point.
- f) owning the Power Project throughout the Term of Agreement free and clear of encumbrances, except those expressly permitted under Article 15;
- f) fulfilling all obligations undertaken by the RPG under this Agreement.
- g) The RPG shall be responsible to for directly coordinating and dealing with the DISCOM, and other authorities in all respects in regard to declaration of availability, scheduling and dispatch of Power and due compliance with deviation and settlement mechanism and the applicable Grid code/State Regulations.

4.2 *Purchase and sale of Contracted Capacity*

4.2.1 Subject to the terms and conditions of this Agreement, the RPG undertakes to sell to DISCOM and DISCOM undertakes to pay Tariff for all the energy supplied at the Delivery Point corresponding to the Contracted Capacity.

4.3 *Right to Contracted Capacity & Energy*

4.3.1 DISCOM, in any Contract Year shall not be obliged to purchase any additional energy from the RPG beyond the contract capacity. If for any Contract Year except for the first year of operation, it is found that the RPG has not been able to generate minimum energy ofMillion kWh (MU) till the end of 10 years from the COD and Million kWh (MU) for the rest of the Term of the Agreement, on account of reasons solely attributable to the RPG, the non-compliance by RPG shall make the RPG liable to pay the compensation. For the first year of operation, the above limits shall be considered on pro-rata basis. The lower limit will, however be relaxable by DISCOM to the extent

of grid non-availability for evacuation which is beyond the control of the RPG. This compensation shall be applied to the amount of shortfall in generation during the Contract Year. The amount of such penalty shall be as determined by the Appropriate Commission, and such penalty shall ensure that the DISCOM is offset for all potential costs associated with low generation and supply of power under the PPA. However, the minimum compensation payable to DISCOM by the RPG shall be 25% (twenty-five percent) of the cost of this shortfall in energy terms, calculated at PPA tariff. This compensation shall not be applicable in events of Force Majeure identified under PPA.

4.3.2 In case at any point of time, the peak of capacity reached is higher than the contracted capacity and causes disturbance in the system at the point where power is injected, the RPG will have to forego the excess generation and reduce the output to the contract capacity and shall also have to pay the penalty/charges (if applicable) as per applicable regulations.

4.4 *Extensions of Time*

4.4.1 In the event that the RPG is prevented from performing its obligations under Article 4.1 by the Scheduled Commissioning Date due to:

- a) any DISCOM Event of Default; or
- b) Force Majeure Events affecting DISCOM, or
- c) Force Majeure Events affecting the RPG,

the Scheduled Commissioning Date and the Expiry Date shall be deferred, subject to Article 4.4.5, for a reasonable period but not less than 'day for day' basis, to permit the RPG or DISCOM through the use of due diligence, to overcome the effects of the Force Majeure Events affecting the RPG or DISCOM, or till such time such Event of Default is rectified by DISCOM.

4.4.2 In case of extension due to reasons specified in Article 4.4.1(b) and (c), and if such Force Majeure Event continues even after a maximum period of three (3) months, any of the Parties may choose to terminate the Agreement as per the provisions of Article 13.5. In case neither party terminates the agreement under this clause, the agreement shall stand terminated on the expiry of twelve (12) months of the continuation of the Force majeure event unless the parties mutually agree to extend the agreement for the further period.

4.4.3 If the Parties have not agreed, within thirty (30) days after the affected Party's performance has ceased to be affected by the relevant circumstance, on the time period by which the Scheduled Commissioning Date or the Expiry Date should be deferred, any Party may raise the Dispute to be resolved in accordance with Article 16.

4.4.4 As a result of such extension, the newly determined Scheduled Commissioning Date and newly determined Expiry Date shall be deemed to be the Scheduled Commissioning Date and the Expiry Date for the purposes of this Agreement.

4.4.5 Notwithstanding anything to the contrary contained in this Agreement, any extension of the Scheduled Commissioning Date arising due to any reason envisaged in this Agreement shall not be allowed beyond the date pursuant to Article 4.5.2.

4.4.6 Delay in commissioning of the project beyond the scheduled commissioning date for reasons other than those specified in Article 4.4.1 shall be an event of default on part of the RPG and shall be subject to the consequences specified in the Article 4.5.

4.5 *Liquidated Damages not amounting to penalty for delay in Commissioning*

4.5.1 If the RPG is unable to commission the Project by the Scheduled Commissioning Date other than for the reasons specified in Article 4.4.1, the RPG shall pay to DISCOM, damages for the delay in such commissioning and making the Contracted Capacity available for dispatch by the Scheduled Commissioning Date as per the following:

Delay beyond the Scheduled Commissioning Date upto (& including) the date as on nine months from the Date of issue of LoA: The total Performance Bank Guarantee amount shall be encashed on per day basis and proportionate to the balance capacity not commissioned.

4.5.2 The maximum time period allowed for commissioning of the full Project Capacity with encashment of Performance Bank Guarantee shall be limited to 11 Months from the Date of issue of LoA. In case, the Commissioning of the Project is delayed beyond 11 Months from the Date of issue of LoA, it shall be considered as an RPG Event of Default and provisions of Article 13 shall apply and the Contracted Capacity shall stand reduced / amended to the Project Capacity Commissioned within 11 Months of the Date of issue of LoA and the PPA for the balance Capacity will stand terminated and shall be reduced from the project capacity.

4.5.3 The RPG further acknowledge that the amount of the liquidated damages fixed is genuine and reasonable pre-estimate of the damages that may be suffered by DISCOM.

4.6 *Acceptance/Performance Test*

4.6.1 Prior to synchronization of the Power Project, the RPG shall be required to get the Project certified for the requisite acceptance/performance test as may be laid down by respective authorities.

4.7 *Third Party Verification*

4.7.1 The RPG shall be further required to provide entry to the site of the Power Project free of all encumbrances at all times during the Term of the Agreement to DISCOM and a third Party nominated by any Indian Governmental Instrumentality for inspection and verification of the works being carried out by the RPG at the site of the Power Project.

4.7.2 The third party may verify the construction works/operation of the Power Project being carried out by the RPG and if it is found that the construction works/operation of the Power Project is not as per the Prudent Utility Practices, it may seek clarifications from RPG or require the works to be stopped or to comply with the instructions of such third party.

4.8 ***Breach of Obligations***

4.8.1 The Parties herein agree that during the subsistence of this Agreement, subject to DISCOM being in compliance of its obligations & undertakings under this Agreement, the RPG would have no right to negotiate or enter into any dialogue with any third party for the sale of Contracted Capacity of power which is the subject matter of this Agreement. It is the specific understanding between the Parties that such bar will apply throughout the entire term of this Agreement.

4.9 ***Generation compensation for Off-take constraints***

4.9.1 Generation Compensation in offtake constraints due to Grid Unavailability: During the operation of the plant, there can be some periods where the Project can generate power but due to temporary transmission unavailability, the power is not evacuated, for reasons not attributable to the RPG. In such cases, subject to the submission of documentary evidences from the competent authority, the generation compensation shall be restricted to the following and there shall be no other claim, directly or indirectly against DISCOM:

Duration of Grid unavailability	Provision for Generation Compensation
Grid unavailability in a contract year as defined in the PPA: (only period from 8 am to 6 pm to be counted):	<i>Generation Loss = [(Average Generation per hour during the Contract Year) × (number of hours of grid unavailability during the Contract Year)]</i> Where, Average Generation per hour during the Contract Year (kWh) = Total generation in the Contract Year (kWh) ÷ Total hours of generation in the Contract Year.

The excess generation by the RPG equal to this generation loss shall be procured by DISCOM at the PPA tariff so as to offset this loss in the succeeding 3 (three) Contract Years.

4.9.2 Offtake constraints due to Backdown: The RPG and DISCOM shall follow the forecasting and scheduling process as per the regulations in this regard by the Appropriate Commission. In the eventuality of backdown, subject to the submission of documentary evidences from the competent authority, the RPG shall be eligible for a minimum generation compensation, from DISCOM, restricted to the following and there shall be no other claim, directly or indirectly against DISCOM:

Duration of Backdown	Provision for Generation Compensation
Hours of Backdown during a monthly billing cycle.	<i>Minimum Generation Compensation = 50% of [(Average Generation per hour during the month) X (number of backdown hours during the month)] X PPA tariff</i> Where, Average Generation per hour during the month (kWh) = Total generation in the month (kWh) ÷ Total hours of generation in the month

The RPG shall not be eligible for any compensation in case the Backdown is on account of events like consideration of grid security or safety of any equipment or personnel or other such conditions. The Generation Compensation shall be paid as part of the energy bill for the successive month after JMR.

ARTICLE 5: SYNCHRONISATION, COMMISSIONING AND COMMERCIAL OPERATION

5.1 *Synchronization, Commissioning and Commercial Operation*

5.1.1 The RPG shall give the DISCOM at least thirty (30) days' advanced preliminary written notice and at least fifteen (15) days' advanced final written notice, of the date on which it intends to synchronize the Power Project to the Grid System.

5.1.2 Subject to Article 5.1.1, the Power Project may be synchronized by the RPG to the Grid System when it meets all the connection conditions prescribed in applicable Grid Code then in effect and otherwise meets all other Indian legal requirements for synchronization to the Grid System.

5.1.3 The synchronization equipment and all necessary arrangements / equipment including RTU for scheduling of power generated from the Project and transmission of data to the concerned authority as per applicable regulation shall be installed by the RPG at its generation facility of the Power Project at its own cost. The RPG shall synchronize its system with the Grid System only after the approval of synchronization scheme is granted by the head of the concerned substation/ and checking/verification is made by the concerned authorities of the DISCOM.

5.1.4 The RPG shall immediately after each synchronization/tripping of generator, inform the sub-station of the Grid System to which the Power Project is electrically connected in accordance with applicable Grid Code. In addition, the RPG will inject in-firm power to grid time to time to carry out operational/ functional test prior to commercial operation. For avoidance of doubt, it is clarified that Synchronization / Connectivity of the Project with the grid shall not to be considered as Commissioning of the Project.

5.1.5 The RPG shall commission the Project within nine (9) Months from the Date of issue of LoA. Declaration of COD shall only be done upon the successful visit by the Commissioning Committee.

5.1.6 The Parties agree that for the purpose of commencement of the supply of electricity by RPG to DISCOM, liquidated damages for delay etc., the Scheduled Commissioning Date as defined in this Agreement shall be the relevant date.

ARTICLE 6: DISPATCH AND SCHEDULING

6.1 *Dispatch and Scheduling*

6.1.1 The RPG shall be required to schedule its power as per the applicable regulations of SERC /SLDC or any other competent agency and same being recognized by the SLDC or any other competent authority / agency as per applicable regulation/ law / direction and maintain compliance to the applicable Codes/ Grid Code requirements and directions, if any, as specified by concerned SLDC from time to time. Any deviation from the Schedule will attract the provisions of applicable regulation / guidelines / directions and any financial implication on account of this shall be on the account of the RPG.

6.1.2 The RPG shall be responsible for directly coordinating and dealing with the DISCOM, State Load Dispatch Centers, and other authorities in all respects in regard to declaration of availability, scheduling and despatch of Power and due compliance with deviation and settlement mechanism and the applicable Grid code Regulations.

6.1.3 The RPG shall be responsible for any deviation from scheduling and for any resultant liabilities on account of charges for deviation as per applicable regulations. UI charges on this account shall be directly paid by the RPG.

6.1.4 Auxiliary power consumption will be treated as per the concerned state regulations.

ARTICLE 7: METERING

7.1 *Meters*

7.1.1 For installation of Meters, Meter testing, Meter calibration and Meter reading and all matters incidental thereto, the RPG and DISCOM shall follow and be bound by the Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006, the Grid Code, as amended and revised from time to time.

7.1.2 The RPG shall bear all costs pertaining to installation, testing, calibration, maintenance, renewal and repair of meters at RPG's side of Delivery Point.

7.1.3 In addition to ensuring compliance of the applicable codes, the RPG shall install Main & Check meters at the Delivery Point, along with Stand-by meter(s) as per the applicable regulations of the State where the Project is located.

7.2 *Reporting of Metered Data and Parameters*

7.2.1 The grid connected renewable power plants will install necessary equipment for regular monitoring of required data and simultaneously for monitoring of the electric power generated from the Project.

7.2.2 Online arrangement would have to be made by the RPG for submission of above data regularly for the entire period of this Power Purchase Agreement to the DISCOM, the MNRE and concerned agency as per applicable regulation / directions.

7.2.3 Reports on above parameters on monthly basis (or as required by regulation / guidelines) shall be submitted by the RPG to Ministry of New and Renewable Energy/National Institute of Solar Energy through DISCOM for entire period of PPA.

ARTICLE 8: INSURANCES

8.1 *Insurance*

8.1.1 The RPG shall effect and maintain or cause to be effected and maintained, at its own cost and expense, throughout the Term of PPA, Insurances against such risks to keep the Project in good condition and shall take Industrial All Risk insurance policy covering risks against any loss or damage, with such deductibles and with such endorsements and co-insured(s), which the Prudent Utility Practices would ordinarily merit maintenance of and as required under the Financing Agreements, and under the applicable laws.

8.2 *Application of Insurance Proceeds*

8.2.1 In case of the Project not being implemented through Financing Agreement(s), save as expressly provided in this Agreement or the Insurances, the proceeds of any insurance claim made due to loss or damage to the Power Project or any part of the Power Project shall be first applied to reinstatement, replacement or renewal of such loss or damage.

In case of the Project being financed through Financing Agreement(s), save as expressly provided in this Agreement or the Insurances, the proceeds of any insurance claim made due to loss or damage to the Power Project or any part of the Power Project shall be applied as per such Financing Agreements.

8.2.2 If a Force Majeure Event renders the Power Project no longer economically and technically viable and the insurers under the Insurances make payment on a "total loss" or equivalent basis, DISCOM shall have claim on such proceeds of such Insurance limited to outstanding dues of DISCOM against RPG.

8.3 *Effect on liability of DISCOM*

8.3.1 Notwithstanding any liability or obligation that may arise under this Agreement, any loss, damage, liability, payment, obligation or expense which is insured or not or for which the RPG can claim compensation, under any Insurance shall not be charged to or payable by DISCOM. It is for the RPG to ensure that appropriate insurance coverage is taken for payment by the insurer for the entire loss and there is no under insurance or short adjustment etc.

ARTICLE 9: APPLICABLE TARIFF

9.1 The RPG shall be entitled to receive the Tariff of Rs. / kWh, fixed for the entire term of this Agreement, with effect from the COD, for the power sold to the DISCOM as reflected in the Energy Accounts.

ARTICLE 10: BILLING AND PAYMENT

10.1 General

10.1.1 From the commencement of supply of power, DISCOM shall pay to the RPG the monthly Tariff Payments subject to the adjustments as per provisions of this Agreement including Article 6, in accordance with Article 9. All Tariff Payments by DISCOM shall be in Indian Rupees.

10.1.2 The RPG shall be required to make arrangements and payments for import of energy (if any) as per applicable regulations.

10.2 Delivery and Content of Monthly Bills/Supplementary Bills

10.2.1 The RPG shall issue to DISCOM hard copy of a signed Monthly Bill for the immediately preceding Month based on the JMR/Energy Account along with all relevant documents (payments made by RPG for drawl of power, payment of reactive energy charges, Metering charges or any other charges as per regulations of SERC/SLDC, if applicable.)

Each Monthly Bill shall include all charges as per this Agreement for the energy supplied for the relevant Month based on JMR/Energy Accounts. The Monthly Bill amount shall be the product of the energy as per Energy Accounts and the Applicable Tariff. Energy drawn from the grid will be regulated as per the regulations of respective State the Project is located in.

10.3 Payment of Monthly Bills

10.3.1 DISCOM shall pay the amount payable under the Monthly Bill by the Due Date to such account of the RPG, as shall have been previously notified by the RPG.

10.3.2 All payments required to be made under this Agreement shall also include any deduction or set off for:

- i) deductions required by the Law; and
- ii) Amount claimed by DISCOM, if any, from the RPG, will be adjusted from the monthly energy payment.

The RPG shall open a bank account (the "RPG's Designated Account") for all Tariff Payments to be made by DISCOM to the RPG, and notify DISCOM of the details of such account at least sixty (60) Days before the dispatch of the first Monthly Bill.

10.3.3 Late Payment Surcharge

In the event of delay in payment of a Monthly Bill by DISCOM beyond thirty (30) days of its Due Date, a Late Payment Surcharge shall be payable to the RPG at the rate of 1.25% per month on the

outstanding amount calculated on a day to day basis. The Late Payment Surcharge shall be claimed by the RPG through the Supplementary Bill.

10.3.5 *Rebate*

For payment of any Bill on or before Due Date, the following Rebate shall be paid by the RPG to DISCOM in the following manner and the RPG shall not raise any objections to the payments made under this article.

- a) A Rebate of 2% shall be payable to the DISCOM for the payments made within a period of seven clear working days of the presentation of hard copy of Bill along with required supporting documents at DISCOM office.
- b) Any payments made after seven clear working days of the date of presentation of hard copy of the Bill along with the required supporting documents at DISCOM office up to the Due Date shall be allowed a rebate of 1 %.
- c) For the above purpose, the date of presentation of Bill shall be the next Business Day of delivery of the physical copy of the Bill at DISCOM. .
- d) No Rebate shall be payable on the Bills raised on account of Change in Law relating to taxes, duties, cess etc. and on Supplementary Bill.

For the above purpose date of presentation of bill shall be the same day of delivery in hard copy. However, for consideration of rebate, next business day shall be considered.

10.4 *Payment Security Mechanism*

Letter of Credit (LC):

10.4.1 DISCOM shall provide to the RPG, in respect of payment of its Monthly Bills and/or Supplementary Bills, a monthly unconditional, revolving and irrevocable letter of credit ("Letter of Credit"), opened and maintained which may be drawn upon by the RPG in accordance with this Article.

10.4.2 Not later than one (1) Month before the start of supply, DISCOM through a scheduled bank open a Letter of Credit in favour of the RPG, to be made operative from a date prior to the Due Date of its first Monthly Bill under this Agreement. The Letter of Credit shall have a term of twelve (12) Months and shall be renewed annually, for an amount equal to:

- i) for the first Contract Year, equal to the estimated average monthly billing;
- ii) for each subsequent Contract Year, equal to the average of the monthly billing of the previous Contract Year.

10.4.3 Provided that the RPG shall not draw upon such Letter of Credit prior to the Due Date of the relevant Monthly Bill and/or Supplementary Bill, and shall not make more than one drawal in a Month.

10.4.4 Provided further that if at any time, such Letter of Credit amount falls short of the amount specified in Article 10.4.2 due to any reason whatsoever, DISCOM shall restore such shortfall within fifteen (15) days.

10.4.5 DISCOM shall cause the scheduled bank issuing the Letter of Credit to intimate the RPG, in writing regarding establishing of such irrevocable Letter of Credit.

10.4.6 DISCOM shall ensure that the Letter of Credit shall be renewed not later than its expiry.

10.4.7 All costs relating to opening, maintenance of the Letter of Credit shall be borne by DISCOM.

10.4.8 If DISCOM fails to pay undisputed Monthly Bill or Supplementary Bill or a part thereof within and including the Due Date, then, subject to Article 10.4.6 & 10.5.2, the RPG may draw upon the Letter of Credit, and accordingly the bank shall pay without any reference or instructions from DISCOM, an amount equal to such Monthly Bill or Supplementary Bill or part thereof, in accordance with Article 10.4.3 above, by presenting to the scheduled bank issuing the Letter of Credit, the following documents:

- i) a copy of the Monthly Bill or Supplementary Bill which has remained unpaid to RPG and;
- ii) a certificate from the RPG to the effect that the bill at item (i) above, or specified part thereof, is in accordance with the Agreement and has remained unpaid beyond the Due Date;

10.5 Disputed Bill

10.5.1 If the DISCOM does not dispute a Monthly Bill or a Supplementary Bill raised by the RPG within fifteen (15) days of receiving such Bill shall be taken as conclusive.

10.5.2 If the DISCOM disputes the amount payable under a Monthly Bill or a Supplementary Bill, as the case may be, it shall pay undisputed amount of the invoice amount and it shall within fifteen (15) days of receiving such Bill, issue a notice (the "Bill Dispute Notice") to the invoicing Party setting out:

- i) the details of the disputed amount;
- ii) its estimate of what the correct amount should be; and iii) all written material in support of its claim.

10.5.3 If the RPG agrees to the claim raised in the Bill Dispute Notice issued pursuant to Article 10.5.2, the RPG shall revise such Bill and present along with the next Monthly Bill. In such a case excess amount shall be refunded along with interest at the same rate as Late Payment Surcharge, which shall be applied from the date on which such excess payment was made by the disputing Party to the invoicing Party and up to and including the date on which such payment has been received as refund.

10.5.4 If the RPG does not agree to the claim raised in the Bill Dispute Notice issued pursuant to Article 10.5.2, it shall, within fifteen (15) days of receiving the Bill Dispute Notice, furnish a notice (Bill Disagreement Notice) to the DISCOM providing:

- i) reasons for its disagreement;
- ii) its estimate of what the correct amount should be; and
- iii) all written material in support of its counter-claim.

10.5.5 Upon receipt of the Bill Disagreement Notice by the DISCOM under Article 10.5.4, authorized representative(s) or a director of the board of directors/ member of board of the DISCOM and RPG shall meet and make best endeavours to amicably resolve such dispute within fifteen (15) days of receipt of the Bill Disagreement Notice.

10.5.6 If the Parties do not amicably resolve the Dispute within fifteen (15) days of receipt of Bill Disagreement Notice pursuant to Article 10.5.4, the matter shall be referred to Dispute resolution in accordance with Article 16.

10.5.7 For the avoidance of doubt, it is clarified the despite a Dispute regarding an invoice, DISCOM shall, without prejudice to its right to Dispute, be under an obligation to make payment of undisputed amount of the invoice amount in the Monthly Bill.

10.6 Quarterly and Annual Reconciliation

10.6.1 The Parties acknowledge that all payments made against Monthly Bills and Supplementary Bills shall be subject to quarterly reconciliation within 30 days of the end of the quarter at the beginning of the following quarter of each Contract Year and annual reconciliation at the end of each Contract Year within 30 days to take into account the Energy Accounts, Tariff adjustment payments, Tariff Rebate, Late Payment Surcharge, or any other reasonable circumstance provided under this Agreement.

10.6.2 The Parties, therefore, agree that as soon as all such data in respect of any quarter of a Contract Year or a full Contract Year as the case may be has been finally verified and adjusted, the RPG and DISCOM shall jointly sign such reconciliation statement. Within fifteen (15) days of signing of a reconciliation statement, the RPG shall make appropriate adjustments in the next Monthly Bill. Late Payment Surcharge/ interest shall be payable in such a case from the date on which such payment had been made to the invoicing Party or the date on which any payment was originally due, as may be applicable. Any Dispute with regard to the above reconciliation shall be dealt with in accordance with the provisions of Article 16.

10.7 Payment of Supplementary Bill

10.7.1 RPG may raise a ("Supplementary Bill") for payment on account of:

- i) Adjustments required by the Energy Accounts (if applicable); or
- ii) Change in Law as provided in Article 12

And such Supplementary Bill shall be paid by the other Party.

10.7.2 DISCOM shall remit all amounts due under a Supplementary Bill raised by the RPG to the RPG's Designated Account by the Due Date, except open access charges, RLDC or scheduling charges and transmission charges (if applicable). For Supplementary Bill on account of adjustment required by energy account, Rebate as applicable to Monthly Bills pursuant to Article 10.3.5 shall equally apply. No surcharge will be applicable other than that on the monthly energy payment and associated debit and credit note.

10.7.3 In the event of delay in payment of a Supplementary Bill by either Party beyond its Due Date, a Late Payment Surcharge shall be payable at the same terms applicable to the Monthly Bill in Article 10.3.3.

ARTICLE 11: FORCE MAJEURE

11.1 Definitions

11.1.1 In this Article, the following terms shall have the following meanings:

11.2 Affected Party

11.2.1 An affected Party means DISCOM or the RPG whose performance has been affected by an event of Force Majeure.

11.3 Force Majeure

11.3.1 A 'Force Majeure' means any event or circumstance or combination of events those stated below that wholly or partly prevents or unavoidably delays an Affected Party in the performance of its obligations under this Agreement, but only if and to the extent that such events or circumstances are not within the reasonable control, directly or indirectly, of the Affected Party and could not have been avoided if the Affected Party had taken reasonable care or complied with Prudent Utility Practices:

- a) Act of God, including, but not limited to lightning, drought, fire and explosion (to the extent originating from a source external to the site), earthquake, volcanic eruption, landslide, flood, cyclone, typhoon or tornado if and only if it is declared / notified by the competent state / central authority / agency (as applicable);
- b) any act of war (whether declared or undeclared), invasion, armed conflict or act of foreign enemy, blockade, embargo, revolution, riot, insurrection, terrorist or military action if and only if it is declared / notified by the competent state / central authority / agency (as applicable); or
- c) radioactive contamination or ionising radiation originating from a source in India or resulting from another Force Majeure Event mentioned above excluding circumstances where the source or cause of contamination or radiation is brought or has been brought into or near the Power Project by the Affected Party or those employed or engaged by the Affected Party.

11.4 *Force Majeure Exclusions*

11.4.1 Force Majeure shall not include (i) any event or circumstance which is within the reasonable control of the Parties and (ii) the following conditions, except to the extent that they are consequences of an event of Force Majeure:

- a. Unavailability, late delivery, or changes in cost of the plant, machinery, equipment, materials, spare parts or consumables for the Power Project;
- b. Delay in the performance of any contractor, sub-contractor or their agents ;
- c. Non-performance resulting from normal wear and tear typically experienced in power generation materials and equipment;
- d. Strikes at the facilities of the Affected Party;
- e. Insufficiency of finances or funds or the agreement becoming onerous to perform; and
- f. Non-performance caused by, or connected with, the Affected Party's:
 - i. Negligent or intentional acts, errors or omissions;
 - ii. Failure to comply with an Indian Law; or
 - iii. Breach of, or default under this Agreement.

11.5 *Notification of Force Majeure Event*

11.5.1 The Affected Party shall give notice to the other Party of any event of Force Majeure as soon as reasonably practicable, but not later than seven (7) days after the date on which such Party knew or should reasonably have known of the commencement of the event of Force Majeure. If an event of Force Majeure results in a breakdown of communications rendering it unreasonable to give notice within the applicable time limit specified herein, then the Party claiming Force Majeure shall give such notice as soon as reasonably practicable after reinstatement of communications, but not later than one (1) day after such reinstatement.

11.5.2 Provided that such notice shall be a pre-condition to the Affected Party's entitlement to claim relief under this Agreement. Such notice shall include full particulars of the event of Force Majeure, its effects on the Party claiming relief and the remedial measures proposed. The Affected Party shall give the other Party regular (and not less than monthly) reports on the progress of those remedial measures and such other information as the other Party may reasonably request about the Force Majeure Event.

11.5.3 The Affected Party shall give notice to the other Party of (i) the cessation of the relevant event of Force Majeure; and (ii) the cessation of the effects of such event of Force Majeure on the performance of its rights or obligations under this Agreement, as soon as practicable after becoming aware of each of these cessations.

11.6 *Duty to Perform and Duty to Mitigate*

11.6.1 To the extent not prevented by a Force Majeure Event pursuant to Article 11.3, the Affected Party shall continue to perform its obligations pursuant to this Agreement. The Affected Party shall use its reasonable efforts to mitigate the effect of any Force Majeure Event as soon as practicable.

11.7 *Available Relief for a Force Majeure Event*

11.7.1 Subject to this Article 11:

- (a) no Party shall be in breach of its obligations pursuant to this Agreement except to the extent that the performance of its obligations was prevented, hindered or delayed due to a Force Majeure Event;
- (b) every Party shall be entitled to claim relief in relation to a Force Majeure Event in regard to its obligations;
- (c) For avoidance of doubt, neither Party's obligation to make payments of money due and payable prior to occurrence of Force Majeure events under this Agreement shall be suspended or excused due to the occurrence of a Force Majeure Event in respect of such Party.
- (d) Provided that no payments shall be made by either Party affected by a Force Majeure Event for the period of such event on account of its inability to perform its obligations due to such Force Majeure Event.

ARTICLE 12: CHANGE IN LAW

12.1 *Definitions*

In this Article 12, the term Change in Law shall refer to the occurrence of any of the following events pertaining to this project only after the last date of the bid submission, including

- (i) the enactment of any new law; or
- (ii) an amendment, modification or repeal of an existing law; or
- (iii) the requirement to obtain a new consent, permit or license; or
- (iv) any modification to the prevailing conditions prescribed for obtaining an consent, permit or license, not owing to any default of the RPG; or (v) any change in the rates of any Taxes including any duties and cess or Introduction of any new tax made applicable for setting up the power project and supply of power from the Power project by the RPG Which have a direct effect on the Project. However, Change in Law shall not include (i) any change in taxes on corporate income or (ii) any change in any withholding tax on income or dividends distributed to the shareholders of the RPG, or (iii) any change on account of regulatory measures by the Appropriate Commission.

In the event a Change in Law results in any adverse financial loss/ gain to the RPG then, in order to ensure that the RPG is placed in the same financial position as it would have been had it not been for the occurrence of the Change in Law, the RPG/ DISCOM shall be entitled to compensation by the other party, as the case may be, subject to the condition that the quantum and mechanism of compensation payment shall be determined and shall be effective from such date as may be decided by the Appropriate Commission.

In the event of any decrease in the recurring/ nonrecurring expenditure by the RPG or any income to the RPG on account of any of the events as indicated above, RPG shall file an application to the Appropriate Commission no later than sixty (60) days from the occurrence of such event, for seeking approval of Change in Law. In the event of the RPG failing to comply with the above requirement, in case of any gain to the RPG, DISCOM shall withhold the monthly tariff payments on immediate basis, until compliance of the above requirement by the RPG.

12.2 *Relief for Change in Law*

12.2.1 The aggrieved Party shall be required to approach the Appropriate Commission for seeking approval of Change in Law.

12.2.2 The decision of the Appropriate Commission to acknowledge a Change in Law and the date from which it will become effective, provide relief for the same, shall be final and governing on both the Parties.

ARTICLE 13: EVENTS OF DEFAULT AND TERMINATION

13.1 *RPG Event of Default*

13.1.1 The occurrence and/or continuation of any of the following events, unless any such event occurs as a result of a Force Majeure Event or a breach by DISCOM of its obligations under this Agreement, shall constitute an RPG Event of Default:

- (i) the failure to commence supply of power to DISCOM up to the Contracted Capacity, by the end of the period specified in Article 4, or failure to continue supply of Contracted Capacity to DISCOM after Commercial Operation Date throughout the term of this Agreement, or
if
 - a) the RPG assigns, mortgages or charges or purports to assign, mortgage or charge any of its assets or rights related to the Power Project in contravention of the provisions of this Agreement; or
 - b) the RPG transfers or novates any of its rights and/ or obligations under this agreement, in a manner contrary to the provisions of this Agreement; except where such transfer
 - is in pursuance of a Law; and does not affect the ability of the transferee to perform, and such transferee has the financial capability to perform, its obligations under this Agreement or
 - is to a transferee who assumes such obligations under this Agreement and the Agreement remains effective with respect to the transferee;
- (ii) if (a) the RPG becomes voluntarily or involuntarily the subject of any bankruptcy or insolvency or winding up proceedings and such proceedings remain uncontested for a period of thirty (30) days, or (b) any winding up or bankruptcy or insolvency order is passed against the RPG, or (c) the RPG goes into liquidation or dissolution or has a receiver or any similar officer appointed over all or substantially all of its assets or official liquidator is appointed to manage its affairs, pursuant to Law, provided that a dissolution or liquidation of the RPG will not be a RPG Event of Default if such dissolution or liquidation is for the purpose of a merger, consolidation or

reorganization and where the resulting company retains creditworthiness similar to the RPG and expressly assumes all obligations of the RPG under this Agreement and is in a position to perform them; or

- (iii) the RPG repudiates this Agreement and does not rectify such breach within a period of thirty (30) days from a notice from DISCOM in this regard; or
- (iv) except where due to any DISCOM's failure to comply with its material obligations, the RPG is in breach of any of its material obligations pursuant to this Agreement, and such material breach is not rectified by the RPG within thirty (30) days of receipt of first notice in this regard given by DISCOM.
- (v) occurrence of any other event which is specified in this Agreement to be a material breach/default of the RPG.
- (vi) except where due to any DISCOM's failure to comply with its material obligations, the RPG is in breach of any of its material obligations pursuant to this Agreement, and such material breach is not rectified by the RPG within thirty (30) days of receipt of first notice in this regard given by DISCOM.

13.2 DISCOM Event of Default

13.2.1 The occurrence and the continuation of any of the following events, unless any such event occurs as a result of a Force Majeure Event or a breach by the RPG of its obligations under this Agreement, shall constitute the Event of Default on the part of defaulting DISCOM:

- (i) DISCOM fails to pay (with respect to a Monthly Bill or a Supplementary Bill), subject to Article 10.5, for a period of ninety (90) days after the Due Date and the RPG is unable to recover the amount outstanding to the RPG through the Letter of Credit,
- (ii) DISCOM repudiates this Agreement and does not rectify such breach even within a period of sixty (60) days from a notice from the RPG in this regard; or
- (iii) except where due to any RPG's failure to comply with its obligations, DISCOM is in material breach of any of its obligations pursuant to this Agreement, and such material breach is not rectified by DISCOM within sixty (60) days of receipt of notice in this regard from the RPG to DISCOM; or

if

- DISCOM becomes voluntarily or involuntarily the subject of any bankruptcy or insolvency or winding up proceedings and such proceedings remain uncontested for a period of sixty (60) days, or
- any winding up or bankruptcy or insolvency order is passed against DISCOM, or
- DISCOM goes into liquidation or dissolution or a receiver or any similar officer is appointed over all or substantially all of its assets or official liquidator is appointed to manage its affairs, pursuant to Law, provided that it shall not constitute a DISCOM Event of Default, where such dissolution or liquidation of DISCOM or DISCOM is for the purpose of a merger, consolidation or reorganization and where the resulting entity has the financial standing to perform its obligations under this Agreement and has creditworthiness similar to DISCOM and expressly assumes all obligations of DISCOM and is in a position to perform them; or;

- (iv) Occurrence of any other event which is specified in this Agreement to be a material breach or default of DISCOM.

13.3 Procedure for cases of RPG Event of Default

13.3.1 Upon the occurrence and continuation of any RPG Event of Default under Article 13.1, DISCOM shall have the right to deliver to the RPG, with a copy to the representative of the lenders to the RPG with whom the RPG has executed the Financing Agreements, a notice stating its intention to terminate this Agreement (DISCOM Preliminary Default Notice), which shall specify in reasonable detail, the circumstances giving rise to the issue of such notice.

13.3.2 Following the issue of a DISCOM Preliminary Default Notice, the Consultation Period of ninety (90) days or such longer period as the Parties may agree, shall apply and it shall be the responsibility of the Parties to discuss as to what steps shall be taken with a view to mitigate the consequences of the relevant Event of Default having regard to all the circumstances.

13.3.3 During the Consultation Period, the Parties shall continue to perform their respective obligations under this Agreement.

13.3.4 Within a period of seven (7) days following the expiry of the Consultation Period unless the Parties shall have otherwise agreed to the contrary or the RPG Event of Default giving rise to the Consultation Period shall have ceased to exist or shall have been remedied, DISCOM may terminate this Agreement by giving a written Termination Notice of sixty (60) days to the RPG.

13.3.5 Subject to the terms of this Agreement, upon occurrence of a RPG Event of Default under this Agreement, the lenders in concurrence with the DISCOM, may exercise their rights, if any, under Financing Agreements, to seek substitution of the RPG by a selectee for the residual period of the Agreement, for the purpose of securing the payments of the total debt amount from the RPG and performing the obligations of the RPG. However, in the event the lenders are unable to substitute the defaulting RPG within the stipulated period, DISCOM may terminate the PPA and may acquire the Project assets for an amount equivalent to 90% of the debt due or less as mutually agreed, failing which, the lenders may exercise their mortgage rights and liquidate the Project assets.

Provided that any substitution under this Agreement can only be made with the prior consent of DISCOM including the condition that the selectee meets the eligibility requirements of Request for Selection (RIS) issued by DISCOM and accepts the terms and conditions of this Agreement.

13.3.6 The lenders in concurrence with DISCOM, may seek to exercise right of substitution under Article 13.3.5 by an amendment or novation of the PPA in favour of the selectee. The RPG shall cooperate with DISCOM to carry out such substitution and shall have the duty and obligation to continue to operate the Power Project in accordance with this PPA till such time as the substitution is finalized. In the event of Change in Shareholding/Substitution of Promoters triggered by the Financial Institutions leading to signing of fresh PPA with a new entity, an amount of Rs. 1 Lakh per

MW +18% GST per transaction as facilitation fee (non-refundable) shall be deposited by the RPG to DISCOM.

13.3.7 In the event the lenders are unable to substitute the defaulting RPG within the stipulated period, DISCOM may terminate the PPA and may acquire the Project assets for an amount equivalent to 90% of the debt due, failing which, the lenders may exercise their mortgage rights and liquidate the Project assets.

13.4 Procedure for cases of DISCOM Event of Default

13.4.1 Upon the occurrence and continuation of any DISCOM Event of Default specified in Article 13.2, the RPG shall have the right to deliver to DISCOM, a RPG Preliminary Default Notice, which notice shall specify in reasonable detail the circumstances giving rise to its issue.

13.4.2 Following the issue of a RPG Preliminary Default Notice, the Consultation Period of ninety (90) days or such longer period as the Parties may agree, shall apply and it shall be the responsibility of the Parties to discuss as to what steps shall be taken with a view to mitigate the consequences of the relevant Event of Default having regard to all the circumstances.

13.4.3 During the Consultation Period, the Parties shall continue to perform their respective obligations under this Agreement.

13.4.4 After a period of two hundred ten (210) days following the expiry of the Consultation Period and unless the Parties shall have otherwise agreed to the contrary or DISCOM Event of Default giving rise to the Consultation Period shall have ceased to exist or shall have been remedied, DISCOM under intimation to RPG shall, subject to the prior consent of the RPG, novate its part of the PPA to any third party, including its Affiliates within the stipulated period. In the event the aforesaid novation is not acceptable to the RPG, or if no offer of novation is made by DISCOM within the stipulated period, then the RPG may terminate the PPA and at its discretion require DISCOM to either (i) takeover the Project assets by making a payment of the termination compensation equivalent to the amount of the debt due and 150% (one hundred and fifty per cent) of the adjusted equity or, (ii) pay to the RPG, damages, equivalent to 6 (six) months, or balance PPA period whichever is less, of charges for its contracted capacity, with the Project assets being retained by the RPG.

Provided further that at the end of three (3) months period from the period mentioned in this Article 13.4.4, this Agreement may be terminated by the RPG.

13.5 Termination due to Force Majeure

13.5.1 If the Force Majeure Event or its effects continue to be present beyond a period as specified in Article 4.4.2, either Party shall have the right to cause termination of the Agreement. In such an event this Agreement shall terminate on the date of such Termination Notice without any further liability to either Party from the date of such termination.

ARTICLE 14: LIABILITY AND INDEMNIFICATION

14.1 *Indemnity*

14.1.1 The RPG shall indemnify, defend and hold DISCOM harmless against:

- a) any and all third party claims against DISCOM for any loss of or damage to property of such third party, or death or injury to such third party, arising out of a breach by the RPG of any of its obligations under this Agreement; and
- b) any and all losses, damages, costs and expenses including legal costs, fines, penalties and interest actually suffered or incurred by DISCOM from third party claims arising by reason of a breach by the RPG of any of its obligations under this Agreement, (provided that this Article 14 shall not apply to such breaches by the RPG, for which specific remedies have been provided for under this Agreement).

14.1.2 DISCOM shall indemnify, defend and hold the RPG harmless against:

- a) any and all third party claims against the RPG, for any loss of or damage to property of such third party, or death or injury to such third party, arising out of a breach by DISCOM of any of their obligations under this Agreement; and
- b) any and all losses, damages, costs and expenses including legal costs, fines, penalties and interest ('Indemnifiable Losses') actually suffered or incurred by the RPG from third party claims arising by reason of a breach by DISCOM of any of its obligations.

14.2 *Procedure for claiming Indemnity*

14.2.1 *Third party claims*

a. Where the Indemnified Party is entitled to indemnification from the Indemnifying Party pursuant to Article 14.1.1(a) or 14.1.2(a), the Indemnified Party shall promptly notify the Indemnifying Party of such claim referred to in Article 14.1.1(a) or 14.1.2(a) in respect of which it is entitled to be indemnified. Such notice shall be given as soon as reasonably practicable after the Indemnified Party becomes aware of such claim. The Indemnifying Party shall be liable to settle the indemnification claim within thirty (30) days of receipt of the above notice. Provided however that, if:

- i) the Parties choose to refer the dispute before the Arbitrator in accordance with Article 16.3.2; and
- ii) the claim amount is not required to be paid/ deposited to such third party pending the resolution of the Dispute,

the Indemnifying Party shall become liable to pay the claim amount to the Indemnified Party or to the third party, as the case may be, promptly following the resolution of the Dispute, if such Dispute is not settled in favour of the Indemnified Party.

b. The Indemnified Party may contest the claim by referring to the Arbitrator for which it is entitled to be Indemnified under Article 14.1.1(a) or 14.1.2(a) and the Indemnifying Party shall reimburse to the Indemnified Party all reasonable costs and expenses incurred by the Indemnified party. However, such Indemnified Party shall not settle or compromise such claim without first getting the consent of the Indemnifying Party, which consent shall not be unreasonably withheld or delayed.

An Indemnifying Party may, at its own expense, assume control of the defence of any proceedings brought against the Indemnified Party if it acknowledges its obligation to indemnify such Indemnified Party, gives such Indemnified Party prompt notice of its intention to assume control of the defence, and employs an independent legal counsel at its own cost that is reasonably satisfactory to the Indemnified Party.

14.3 *Indemnifiable Losses*

14.3.1 Where an Indemnified Party is entitled to Indemnifiable Losses from the Indemnifying Party pursuant to Article 14.1.1(b) or 14.1.2(b), the Indemnified Party shall promptly notify the Indemnifying Party of the Indemnifiable Losses actually incurred by the Indemnified Party. The Indemnifiable Losses shall be reimbursed by the Indemnifying Party within thirty (30) days of receipt of the notice seeking Indemnifiable Losses by the Indemnified Party. In case of nonpayment of such losses after a valid notice under this Article 14.3, such event shall constitute a payment default under Article 13.

14.4 *Limitation on Liability*

14.4.1 Except as expressly provided in this Agreement, neither the RPG nor its/ their respective officers, directors, agents, employees or affiliates (or their officers, directors, agents or employees), shall be liable or responsible to the other Party or its affiliates, officers, directors, agents, employees, successors or permitted assigns or their respective insurers for incidental, indirect or consequential damages, connected with or resulting from performance or non-performance of this Agreement, or anything done in connection herewith, including claims in the nature of lost revenues, income or profits (other than payments expressly required and properly due under this Agreement), any increased expense of, reduction in or loss of power generation or equipment used therefore, irrespective of whether such claims are based upon breach of warranty, tort (including negligence, whether of DISCOM, the RPG or others), strict liability, contract, breach of statutory duty, operation of law or otherwise.

14.4.2 DISCOM shall have no recourse against any officer, director or shareholder of the RPG or any Affiliate of the RPG or any of its officers, directors or shareholders for such claims excluded under this Article. The RPG shall have no recourse against any officer, director or shareholder of DISCOM, or any affiliate of DISCOM or any of its officers, directors or shareholders for such claims excluded under this Article.

14.5 *Duty to Mitigate*

14.5.1 The Parties shall endeavour to take all reasonable steps so as to mitigate any loss or damage which has occurred under this Article 14.

ARTICLE 15: ASSIGNMENTS AND CHARGES

15.1 *Assignments*

This Agreement shall be binding upon, and inure to the benefit of the Parties and their respective successors and permitted assigns. This Agreement shall not be assigned by any Party, except to the Project Lenders or Lender's Representative as security for their debt under the Financing Agreements, other than by mutual consent between the Parties to be evidenced in writing. Such assignment shall be agreed to by DISCOM subject to the compliance of provisions contained in this Agreement and more specifically to the provisions of Article 4.1.1 of this Agreement. In no case, such assignment shall be permissible prior to the declaration of COD.

Provided that, DISCOM shall permit assignment of any of RPG's rights and obligations under this Agreement in favour of the lenders to the RPG, if required under the Financing Agreements.

Provided that, such consent shall not be withheld if DISCOM seeks to transfer to any transferee all of its rights and obligations under this Agreement.

The enforcement of the rights and obligation between the RPG and the DISCOM provided in this Agreement shall not be treated as an assignment but an enforcement of the terms agreed under this Agreement.

Provided further that any successor(s) or permitted assign(s) identified after mutual agreement between the Parties may be required to execute a new agreement on the same terms and conditions as are included in this Agreement. An amount of Rs. 1 Lakh per Transaction as Facilitation Fee (non-refundable) shall be deposited by the RPG to DISCOM. Provided further that, such consent shall not be withheld by the RPG if DISCOM seeks to transfer to any affiliate all of its rights and obligations under this Agreement.

In the event of Change in Shareholding/Substitution of Promoters triggered by the Financial Institutions leading to signing of fresh PPA with a New Entity, an amount of Rs. 1 Lakh per Transaction as Facilitation Fee (non-refundable) shall be deposited by the RPG to DISCOM.

15.2 *Permitted Charges*

15.2.1 RPG shall not create or permit to subsist any encumbrance over all or any of its rights and benefits under this Agreement, other than as set forth in Article 15.1 and the Guidelines.

ARTICLE 16: GOVERNING LAW AND DISPUTE RESOLUTION

16.1 *Governing Law*

16.1.1 This Agreement shall be governed by and construed in accordance with the Laws of India. Any legal proceedings in respect of any matters, claims or disputes under this Agreement shall be under the jurisdiction of appropriate courts in _____.

16.2 Amicable Settlement and Dispute Resolution

16.2.1 Amicable Settlement

- i. Either Party is entitled to raise any claim, dispute or difference of whatever nature arising under, out of or in connection with this Agreement ("Dispute") by giving a written notice (Dispute Notice) to the other Party, which shall contain:
 - (a) a description of the Dispute;
 - (b) the grounds for such Dispute; and
 - (c) all written material in support of its claim.
- ii. The other Party shall, within thirty (30) days of issue of Dispute Notice issued under Article 16.2.1(i), furnish:
 - (a) counter-claim and defences, if any, regarding the Dispute; and
 - (b) all written material in support of its defences and counter-claim.
- iii. Within thirty (30) days of issue of Dispute Notice by any Party pursuant to Article 16
 - (i) if the other Party does not furnish any counter claim or defence under Article 16
 - (ii) or thirty (30) days from the date of furnishing counter claims or defence by the other Party, both the Parties to the Dispute shall meet to settle such Dispute amicably. If the Parties fail to resolve the Dispute amicably within thirty (30) days from the later of the dates mentioned in this Article 16.2.1.
 - (iii) the Dispute shall be referred for dispute resolution in accordance with Article 16.3.

16.3 Dispute Resolution

16.3.1 Dispute Resolution by the Appropriate Commission

- i) Where any Dispute or differences arises in relation to this agreement of any nature whatsoever including the construction, interpretation or implementation of the provisions of this agreement as well as claim made by any Party for any change in or determination of the Tariff or any matter related to Tariff or claims made by any Party which partly or wholly relate to any change in the Tariff or determination of any of such claims could result in change in the Tariff, and relates to any matter agreed to be referred to the Appropriate Commission, shall be submitted to adjudication by the Appropriate Commission. Appeal against the decisions of the Appropriate Commission shall be made only as per the provisions of the Electricity Act, 2003, as amended from time to time.
- ii) DISCOM shall be entitled to co-opt the lenders (if any) as a supporting party in such proceedings before the Appropriate Commission.

16.3.2 Dispute Resolution through Arbitration

- i) If the Dispute arising as per Article 16.2.1 is not amicably resolved & such dispute is not covered in Article 16.3.1(i), such Dispute shall be resolved by arbitration under the provisions of the Electricity Act, 2003 (as amended from time to time) as under: Proceedings as well as appointment of the arbitrator(s) shall be carried out by the Appropriate Commissions under the Electricity Act 2003 as amended from time to time. As stipulated by the said Electricity Act

2003, the said arbitration will take place as per the provisions of the Arbitration and Conciliation Act 1996 as amended from time to time.

- ii) ii) The place of arbitration shall be the _____ (City where head quarter of DISCOM is located). The language of the arbitration shall be English.
- iii) The Arbitration Tribunal's award shall be substantiated in writing. The Arbitration Tribunal shall also decide on the costs of the arbitration proceedings and the allocation thereof.
- iv) The provisions of this Article shall survive the termination of this PPA for any reason whatsoever.
- v) The award shall be of majority decision.
- vi) DISCOM shall be entitled to co-opt the lenders (if any) as a supporting party in such arbitration proceedings.

16.4 *Parties to Perform Obligations*

16.4.1 Notwithstanding the existence of any Dispute and difference referred to the Appropriate Commission and save as the Appropriate Commission may otherwise direct by a final or interim order, the Parties hereto shall continue to perform their respective obligations (which are not in dispute) under this Agreement.

ARTICLE 17: MISCELLANEOUS PROVISIONS

17.1 *Amendment*

17.1.1 This Agreement may only be amended or supplemented by a written agreement between the Parties.

17.2 *Third Party Beneficiaries*

17.2.1 This Agreement is solely for the benefit of the Parties and their respective successors and permitted assigns and shall not be construed as creating any duty, standard of care or any liability to, any person not a party to this Agreement.

17.3 *Waiver*

17.3.1 No waiver by either Party of any default or breach by the other Party in the performance of any of the provisions of this Agreement shall be effective unless in writing duly executed by an authorised representative of such Party.

17.3.2 Neither the failure by either Party to insist on any occasion upon the performance of the terms, conditions and provisions of this Agreement nor time or other indulgence granted by one Party to the other Parties shall act as a waiver of such breach or acceptance of any variation or the relinquishment of any such right or any other right under this Agreement, which shall remain in full force and effect.

17.4 *Confidentiality*

17.4.1 The Parties undertake to hold in confidence this Agreement and not to disclose the terms and conditions of the transaction contemplated hereby to third parties, except:

- a) to their professional advisors;
- b) to their officers, contractors, employees, agents or representatives, financiers, who need to have access to such information for the proper performance of their activities; or
- c) disclosures required under Law, without the prior written consent of the other Party.

17.5 *Severability*

17.5.1 The invalidity or unenforceability, for any reason, of any part of this Agreement shall not prejudice or affect the validity or enforceability of the remainder of this Agreement, unless the part held invalid or unenforceable is fundamental to this Agreement.

17.6 *Notices*

17.6.1 All notices or other communications which are required to be given under this Agreement shall be in writing and in the English language.

17.6.2 If to the RPG, all notices or other communications which are required must be delivered personally or by registered post or facsimile or any other method duly acknowledged to the addresses below:

Address:

Attention:

Email:

Fax. No. :

Telephone No. :

17.6.3 If to DISCOM, all notices or communications must be delivered personally or by registered post or facsimile or any other mode duly acknowledged to the address(es) below:

Address:

Attention:

Email:

Fax. No. :

Telephone No. :

17.6.4 All notices or communications given by facsimile shall be confirmed by sending a copy of the same via post office in an envelope properly addressed to the appropriate Party for delivery by registered mail. All notices shall be deemed validly delivered upon receipt evidenced by an acknowledgement of the recipient, unless the Party delivering the notice can prove in case of delivery through the registered post that the recipient refused to acknowledge the receipt of the notice despite efforts of the postal authorities.

17.6.5 Any Party may by notice of at least fifteen (15) days to the other Party change the address and/or addresses to which such notices and communications to it are to be delivered or mailed.

17.7 *Language*

17.7.1 All agreements, correspondence and communications between the Parties relating to this Agreement and all other documentation to be prepared and supplied under the Agreement shall be written in English, and the Agreement shall be construed and interpreted in accordance with English language.

17.7.2 If any of the agreements, correspondence, communications or documents are prepared in any language other than English, the English translation of such agreements, correspondence, communications or documents shall prevail in matters of interpretation.

17.8 *Restriction of Shareholders / Owners' Liability*

17.8.1 Parties expressly agree and acknowledge that none of the shareholders of the Parties hereto shall be liable to the other Parties for any of the contractual obligations of the concerned Party under this Agreement. Further, the financial liabilities of the shareholder/s of each Party to this Agreement, shall be restricted to the extent provided in the Indian Companies Act, 2013.

17.9 *Taxes and Duties*

17.9.1 The RPG shall bear and promptly pay all statutory taxes, duties, levies and cess, assessed/levied on the RPG, contractors or their employees that are required to be paid by the RPG as per the Law in relation to the execution of the Agreement and for supplying power as per the terms of this Agreement.

17.9.2 DISCOM shall be indemnified and held harmless by the RPG against any claims that may be made against DISCOM in relation to the matters set out in Article 17.9.1.

17.9.3 DISCOM shall not be liable for any payment of, taxes, duties, levies, cess whatsoever for discharging any obligation of the RPG by DISCOM on behalf of RPG.

17.10 *Independent Entity*

17.10.1 The RPG shall be an independent entity performing its obligations pursuant to the Agreement.

17.10.2 Subject to the provisions of the Agreement, the RPG shall be solely responsible for the manner in which its obligations under this Agreement are to be performed. All employees and representatives of the RPG or contractors engaged by the RPG in connection with the performance of the Agreement shall be under the complete control of the RPG and shall not be deemed to be employees, representatives, contractors of DISCOM and nothing contained in the Agreement or in any agreement or contract awarded by the RPG shall be construed to create any contractual relationship between any such employees, representatives or contractors and DISCOM.

17.11 Compliance with Law

Despite anything contained in this Agreement but without prejudice to this Article, if any provision of this Agreement shall be in deviation or inconsistent with or repugnant to the provisions contained in the Electricity Act, 2003, or any rules and regulations made there under, such provision of this Agreement shall be deemed to be amended to the extent required to bring it into compliance with the aforesaid relevant provisions as amended from time to time.

17.13 Breach of Obligations

The Parties acknowledge that a breach of any of the obligations contained herein would result in injuries. The Parties further acknowledge that the amount of the liquidated damages or the method of calculating the liquidated damages specified in this Agreement is a genuine and reasonable pre-estimate of the damages that may be suffered by the non-defaulting party in each case specified under this Agreement.

IN WITNESS WHEREOF the Parties have caused the Agreement to be executed through their duly authorized representatives as of the date and place set forth above.

For and on behalf of
[DISCOM]

For and on behalf of [RPG]

Name, Designation and Address

Name, Designation and Address

Signature with seal

Signature with seal

Witness:

- 1.
- 2.

Witness:

- 1.
- 2.

Annexure-II**MODEL LEASE AGREEMENT**

This **AGREEMENT OF LEASE** entered into on this _____ day of _____ at _____.

BETWEEN:

(hereinafter referred to as the “**LESSOR/OWNER**”, which expression shall, wherever the context so requires or admits, SHALL mean and include his legal heirs, executors, administrators and assignees);

AND:

_____ (Name of Renewable Power Generator (RPG))

Represented by _____

(hereinafter referred to as the “**LESSEE**”, which expression shall, wherever the context so requires or admits, SHALL mean and include its executors, administrators and assignees successors in interest).

I. WHEREAS the Lessor is the owner in possession of the Barren/ Agricultural land measuring _____ Acre _____ Kanal _____ marla _____ Share out of Hadbast No. _____ Khewat No. _____ Khatoni No. _____ Khasra No. _____ Mustil No. _____ Kila No. _____ situated at Village/City _____ Tehsil _____ District which is morefully described in the Schedule hereunder and hereinafter referred to as the Schedule property.

(Note: The legal revenue terms to be changes to those prevalent in the State)

II. WHEREAS the _____ (Name of RPG) being a _____ (Details of RPG) with an object to plan, develop and operate Renewable Energy based Power Plant (REPP) under MNRE Scheme notified on 8th March 2019.

III. (a) WHEREAS pursuant to the request of the Lessee, the Lessor has agreed to grant the lease, the Lessee has agreed to take on lease from the Lessor the land which is morefully

described in Schedule written hereunder and hereinafter referred to as "THE SCHEDULE PROPERTY" for setting up of the "_____ Power Plant".

(b) That pursuant to the request of the Lessee, the Lessor has submitted an application under Section _____ for the conversion of the land and on behalf of the Lessor/owner the _____ (Name of RPG) shall presume that the land is deemed to have been converted for non-agricultural purposes. (Clause to be modified as per State Policy for use of Agriculture land for generation of renewable power)

IV. NOW THIS AGREEMENT OF LEASE WITNESSES THAT in consideration of the above and of the mutual covenants of the Parties hereto, the Lessor hereby grants and the Lessee hereby accepts the lease of the Schedule property on the following terms and conditions:

1. PURPOSE OF LEASE:

The grant of lease by the Lessor to the lessee in respect of the Schedule property is for the purpose of developing a _____ Power Plant under MNRE Scheme notified on 8th March 2019.

2. PERIOD OF THE LEASE

The period of this Lease shall be for Twenty-seven (27) years from this day which may be renewed at the option of the Lessee and Lessor for further period, on such mutually agreeable terms as may be agreed at the time of renewal, by both the parties, by executing and registering separate Lease Agreement.

3. RENT

- (a) The rent payable by the Lessee to the Lessor for the Schedule Property shall be Rs. _____/- (Rupees _____) only per annum per Acre. The portion of the land less than one Acre shall be calculated in terms of Square meter and the rent payable for the same shall be at Rs. _____/- per Square meter or part thereof, per annum.

OR

The rent payable by the Lessee to the Lessor after Commercial Operation of the power plant shall be Rs. _____ per unit of total power generated from the power

plant installed on the land of Lessor. Till the start of commercial operation of the plant, the rent shall be Rs. _____/- (Rupees _____) only per annum per Acre.

- (b) The annual rent shall be paid in twelve equal instalments and each instalment to be paid by 5th day of every month, by crediting the same to the Lessor's Bank Account the details of which may be furnished by the Lessor from time to time.

OR

In case of lease rent on the basis of Rs. _____per unit, the monthly lease rent would be calculated on the basis of monthly electricity injected in to the grid from the power plant installed on the land of Lessor.

- (c) Lessor may opt for payment of lease rent directly from the Distribution company, which will sign Power Purchase Agreement with Lessee for the above-mentioned _____ Power Plant to be installed by Lessee. In such a case the Distribution company will pay the lease rent to Lessor on monthly basis from the proceeds payable to the Lessee in lieu of Power supplied by Lessee. In order to give this effect a suitable provision will be made in the PPA to be signed between Lessee and the Distribution Company.
- (d) [on mutual agreement between Lessor and Lessee] The rent hereby reserved shall be paid by enhancing the same at the end of every _____ year(s), at _____% on the rent hereby agreed.
- (e) If the Lessee delays the payment of rent by due date of every month, for any reason, the same shall be paid by adding the interest at the rate _____% for the said delayed period.

4. GENERAL TERMS

- i. In consideration of the rent herein agreed as payable to the Lessor being paid by the Lessee regularly and on complying other terms and conditions and covenants by the Lessee, the Lessee shall peacefully possess and enjoy the **Schedule Property** during the lease period without any interruption by the Lessor.

- ii. The Lessor shall allow the Lessee or its representatives to conduct survey and other related work.
- iii. The Lessor has no objections for the Lessee to establish the _____ Power Plant in the Schedule property which is the purpose of the grant of this lease and to that effect the Lessee entering into any agreement/s, deeds with companies, individuals, developers/third party etc. in respect of the Schedule property.
- iv. The Lessor has no objections for the Lessee or its representatives for installation of machineries, equipments, etc. for generation of _____ power in the Schedule property and all work relating to thereto including but not limited to laying poles, wires, etc.

5. EVENT OF SALE, ACCEPTANCE OF LEASE BY THE NEW OWNER

- (a) In the event of the owners transferring their rights/interest in any manner during the existence of the lease to any other person, the same may be allowed without affecting the rights of the Lessee under the Lease Agreement in any manner and the owners/purchasers/transferees shall inform the Lessee about the acquiring of the right/interest in respect of the leased property and on receipt of such information, the Lessee shall accept such new purchaser's/transferee's ownership of the land and obtain a written confirmation from such new owner/purchaser/transferee to the effect that he will be bound by the terms of the Lease Agreement.
- (b) In the event of the owners transferring their rights/interest to any other person, the same may be informed to the Lessee and the Lessor shall ascertain and obtain all the necessary documents from the transferee to the effect that the transferee will be bound by the terms and conditions of the Lease Agreement for the balance period of the lease or for using the said documents for renewal of the lease for the balance period.
- (c) During the subsistence of the lease, the Lessor shall not carry any activity, in the Schedule property, other than those agreed in this agreement;

- (d) The change in the legal status of the Lessee shall not affect the terms and conditions of this Agreement.
- (e) The original Lease Agreement shall be with the Lessee and the copy of the same will be with the Lessor.
- (f) In the event of any dispute in respect of the land, the Lessee shall deposit the rent in the concerned civil court. In the event of retention of the rent with the Lessee, the Lessee shall be pay the same together with interest thereon at the rate ____% for such period.
- (g) The Lessee shall not offer or create any charge or encumbrance by offering the same as by way of mortgage, security, etc. in favour of any Banks or financial institutions in respect of the loans or advances or any other financial facilities that may be availed by the Lessee.
- (h) The owners shall pay the land tax/revenue in respect of the lands.

6. PAYMENT OF STAMP DUTY AND REGISTRATION CHARGES:

The stamp duty and other registration charges, as applicable for this Agreement of Lease shall be paid by the Lessee.

7. FORCE MAJEURE:

It is also agreed and understood between the parties that in case of any mishap due to fire, earthquake, strike, floods, tempest, war, riot, civil war or civil commotions, mob violence, civil disturbance, act of God or on account of terrorist attack, the Lessor shall not be liable for any loss or damage that may be occasioned to the Lessee/its merchandise.

8. ADDRESSES FOR CORRESPONDENCE, ETC

Any notice and/or communications between the Parties shall be deemed to be sufficient, if delivered by hand under acknowledgement or sent by registered post acknowledgement due to the following address or the address that may be intimated in writing to the Lessee by the Lessor from time to time:

LESSOR'S:

LESSEE'S:**9. LESSOR'S DUTIES, COVENANTS AND OBLIGATIONS**

- a) The Lessor hereby covenants with the Lessee that the Lessee paying regularly the rents hereby reserved and performing and observing all the covenants of the Lessee herein contained, shall be entitled, during the subsistence of this lease to enjoy the Schedule property without let, hindrance or interference from the Lessor or any other person/s claiming through or under him; Still, in the event of the Lessee restrained from enjoying the peaceful possession of the Schedule property or on account of any action by the Government during the period of lease and in the event of dispossession of the Lessee from the Schedule property or any portion thereof forcibly, due to any default of the Lessor, the Lessor shall make good the reasonable loss that may be suffered by the Lessee.
- b) The Lessor shall offer necessary support and co-operation to the Lessee in its process to obtain required permission/s, approval/s, clearances, etc., from any Statutory Authority or other Local Bodies for the purpose of obtaining and licence, permissions, etc., for installation of power plant. However, obtaining such permission/s, approval/s, clearances, etc., shall be the sole responsibility of Lessee.

10. LESSEE'S COVENANT AND OBLIGATIONS

The Lessee hereby covenants with the Lessor as under:

- (a) The Schedule property shall be utilised for the purpose referred to in Clause (1) above;
- (b) The Lessee shall pay the rents (as per Clause (3)) regularly and promptly;

11. TERMINATION AND RE-ENTRY

The Lease shall be determinable under all or any of the following circumstances, namely

- i) by efflux of time;
- ii) in the event of breach by either party of the terms, conditions and covenants hereof;

- iii) if the Scheduled Premises or any part thereof is severely damaged or destroyed due to any unforeseen circumstances or civil commotion, act of God, etc., and these damages be not restored to by the LESSOR within a reasonable time or if the demised premises is acquired compulsorily by any authority;
- iv) After the expiry of lease period, the Lessee shall handover the land to the Lessor as it was existed previously at the time of this agreement (subject to normal wear and tear).

12. **VARIATION:**

The Lessor and the Lessee hereto acknowledge that this agreement supersedes all prior communications between them including all oral or written proposals. Any variation, addition and modifications of this agreement between the parties shall be valid only if in writing by the Lessor and Lessees authorized representative.

13. **ARBITRATION:**

- a) Any disputes or differences arising between the Parties hereto as to the effect, interpretation or application any of the clauses of this LEASE AGREEMENT or as to their rights, duties or liabilities thereunder, or as to any act, matter or thing arising out of, or consequent to, or in connection with this LEASE AGREEMENT shall be referred to and resolved by Arbitration by referring the same for arbitration to any retired District Judge and shall be resolved finally at his arbitration under Arbitration and Conciliation Act 1996 and its Amendments or any other Enactment. The Arbitration proceedings shall be held at _____ and shall be in English/_____ Language.
- b) This LEASE AGREEMENT shall be governed by the laws of India. The Courts at _____ alone shall have the jurisdiction to entertain and or try any dispute arising out of or in connection with or in relation to the terms of this LEASE AGREEMENT.

IN WITNESS WHEREOF the parties hereto have executed these presents in the presence of the witnesses attesting hereunder on the day, month and year mentioned hereinabove.

LESSOR

LESSEE

WITNESSES:

1.

2.

SCHEDULE PROPERTY

All that piece and parcel of Barren/ Agricultural land measuring _____ Acre _____
 Kanal _____ marla _____ Share out of Hadbast No. _____ Khewat
 No. _____ Khatoni No. _____ Khasra No. _____ Mustil No. _____ Kila No.
 _____ situated at Village/City _____ Tehsil _____ District and
 bounded on the:

(Note: The legal revenue terms to be changes to those prevalent in the State)

East by:

West by :

North by :

South by :

GUJARAT URJA VIKAS NIGAM LTD.	GUJARAT
WARD NO.	2124
DATE	03/02/2023



Gujarat Urja Vikas Nigam Limited

Sardar Patel Vidyut Bhavan, Corporate Office, Racecourse, Vadodara 390007

No. GUVNL / DT/PRO/ 03

Date: 25/01/2023

CIRCULAR:

Sub: - Guidelines for publishing of Tender Advertisements in Newspapers

Ref: - 1) Circular No. SP/MPP/F.24/776 dated 11.03.2003

2) Circular No.PR/GUVNL/Tender/Advt/668 dated 06.06.2005.

In reference to above referred Circular, GUVNL and companies are following these guideline for releasing advertisement of tender notices and public notices in the newspaper on rotation basis.

However, to bring more competition and participations of vendor through wider publication and looking at the current competitive scenario, the overall tender advertisement policy followed by GUVNL and its companies was reviewed.

As approved by the Competent Authority of GUVNL, Circular/ Guideline for publishing of Tender Advertisements for GUVNL and Subsidiary Companies is as under:-

1) Criteria for publication of tender notices in newspapers on rotation basis -

Sr. No.	Estimated Cost of Work/Purchase	No. of Newspapers
A	From Rs. 25,000 /- up to Rs. 50 lakhs	01 Gujarati
B	Above Rs. 50 lakhs Up to Rs. 10 Crore	02 (One Gujarati + One English Gujarat edition)
C	Above Rs. 10 Crores Up to Rs. 100 Crores	02 (One Gujarati + One English Gujarat edition) <u>OR</u> 03 (One Gujarati + One English All India edition + One Financial daily - opt for combo wherever available) with the approval of <u>MD Level Committee</u> of respective Company for <u>specific nature of work</u> ; where all India level vendors' attention are required, on case to case basis.
D	Above Rs. 100 Crores	03 (One Gujarati + One English All India edition + One Financial daily All India edition) (opt for <u>combo offer for English main newspaper + their financial daily</u> wherever available)

- 2) The size of advertisement should be kept minimum with standard font size and masthead size, logo size etc.
- 3) No name should be published at the bottom of the advertisement and only designation of the issuing authority is to be mentioned.
- 4) A indicative sample format (Gujarati & English advertisement) is attached herewith at **Annexure - A**
- 5) Long & detailed tender advertisement should not be given in newspapers.
- 6) If there is more than one tender for different locations of the same company, then the advertisements should be clubbed for publication, as far as possible.
- 7) All Companies may register in various online platforms/ portals/ website including Tender Trade newspaper-portal, Tender Tiger, Tender Detail, All Tenders and IEEMA and ensure that our tenders appear/ are displayed.
- 8) Companies should issue tender advertisements directly to the respective newspaper as per rates approved by GoG Information Department or All India discounted rates offered to GUVNL by respective newspapers.
- 9) For tender of specific nature and high value, tender advertisements may be published in colour after proper designing with due approval from MD of respective company. Advertisement on Company's website.
- 10) Advertisement on GUVNL's website with link on subsidiary company's website. The detailed modality, of the same will issued separately.
- 11) All Tender Advertisement should be displayed on Company Office Notice Boards.

It is therefore requested to ensure that above guidelines are followed scrupulously, after observing all the formalities.

(Signature)
(H P Kothari)
Director (Technical)

To,
The Managing Director,
GSECL/ GETCO/ MGVL/ DGVCL/ PGVL/ UGVCL
Corporate Office,
Vadodara/ Surat/ Rajkot/ Mehsana

Cfwcs to: -
The Managing Director, GUVNL
Copy to: -

No: UGVCL/R&C/Tech/ 101

Date: 01/02/2023

To,
CE(PP)/GM(F)/ACE(TECH)/ACE(PROJ)/ACE(COM)/AGM(HR)
SE(CIVIL)/SE(P)/SE(RE)/SE(DSM)/SE(EMC)/SE(QCC)/SE(SOLOR)/SE(VIGI)
ACE/SE
Uttar Gujarat Vij Company Ltd.
R & C Office/ Circle Office,
Mehsana/Palanpur/Sabarmati/Himatnagar
This is for your information and take needful action.

(Signature)
Superintending Engineer (Tech)
UGVCL, Mehsana

As per GUVNL letter no. GUVNL/DT/PRO/03 Dtd.25.01.2023 for tender advertisement & GUVNL letter no. GUVNL/Tech/Solar cell/PM KUSUM C/FLS/58 Dtd.06.01.2023 for properly publicise for more competition, Accordingly, the tender notice is attached herewith for advertisement in leading One Gujarat + One English All India edition + One Financial


www.ubvcl.com & www.optocure.com

Sub: Advertisement in news paper for Request for Selection of Solar Power Generators for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of PM-KUSUM Component-C Feeder level Solarization Scheme against Tender No: UGVCL/Project/Solar Cell/PM-KUSUM-C-FLS/TN-42 to TN-104 (63 Tenders).

Office Notes:-



UG CL



UTTAR GUJARAT VIJ COMPANY LIMITED

CIN - U40102GJ2003SGC042906, GST No.-24AAACU6551F121

Regd. & Corporate Office: Visnagar Road, MEHSANA - 384 001 (North Gujarat)

Website: www.ugvcl.com

http://gujregd.gov.in

e-mail: corporate@ugvcl.com

SE (Solar) :

Recommendation for tender invite.

ACE (P&Re) :

15.3.23

CE (P&P) :

To: Manager CC Cell: R&C Office: UGVCL: Mehsana

The copy of above tender notice is attached herewith.



Uttar Gujarat Vidyut Company Limited
 Regd. & Corporate Office: Plot No. 154/551
 GUDKAT ENCL. Res. Bldg., Gandhinagar, Gandhinagar, Gandhinagar
 Gandhinagar, Gandhinagar, Gandhinagar

**E-Tender Notice :UGVCL Project Solar PM-KUSUM-C-FLS/
 TN-42 to TN-104 (63 nos. of Tenders)**

UGVCL invites Request for Bid (RfB) for Solar Power Generators for Purchase of Solar Power through competitive bidding process (followed by reverse e-auction) for installation of various 11 KV Agricultural feeders of selected 63 Sub-stations in supply area of UGVCL under RESO mode of PM-KUSUM Component-C Feeder level Solarization Scheme covering 63 Substations with aggregate Solar plant capacity of 252 MW. Interested Bidders are requested to visit web www.ugvcl.co.in for view & download of RfB documents view, download and on the submission) and web site www.ugvcl.co.in for view & download of RfB documents. Interested bidders are requested to regularly visit the above websites to check for amendment, if any in the tender.

Date:- 17/03/2023

Chief Engineer (P&P)



UGVCL
Uttar Gujarat Vij Company Ltd.
CIN - U40102GJ2003SGC042906

UGVCL/RCO/CCCell/2023/043

CORPORATE COMMUNICATION CELL

Date : 17.03.2023

To,
The Publisher,
Divya Bhaskar Ahmedabad,
[Ahmedabad Edition: Gujarati], Black & White.

Subject: ADVERTISEMENT RELEASE LETTER – Advt. No. 032/2023.

Sir/Madam,

Pursuant to the approval of Competent Authority for publication of this advertisement, I am directed to send a copy of the draft advertisement for publication at a prominent place in the inner pages of your news paper/s in **Black & White** as per Govt. of Gujarat/DAVP/DIPR approved rates only in **Ahmedabad EDITION.**

The advertisement matter must be published with **UGVCL Logo in Govt. approved font size only** and use minimum space possible.

You are requested to send the bill in triplicate with advanced stamp money receipt, copy of the newspapers, Advt. Release Letter and other documents to **Chief Engineer (P), UGVCL, Regd. & Corporate Office, Visnagar Road, Mehsana - 384001.**

Yours faithfully,


f Superintending Engineer (Tech. & Vig.)

CFWCs to:

- Chief Engineer (P), UGVCL, Regd. & Corporate Office, Visnagar Road, Mehsana - 384001.
- Dy. CAO (Exp.), UGVCL, RCO, Mehsana



Uttar Gujarat Vij Company Limited

Regd. & Corporate Office: Vishnagar Road, Mehsana - 384001
GUJARAT-INDIA, Phone no. (02763) 222080-81 www.ugvcl.com

E-Tender Notice : UGVCL/Project/Solar/PM-KUSUM-C-FLS/ TN-42 to TN-104 (63 nos. of Tenders)

UGVCL invites Request for Selection of **Solar Power Generators** for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of **PM-KUSUM Component-C Feeder level Solarization** Scheme of MNRE, covering 63 Substations with aggregate Solar plant capacity of 208.5 MW. Interested Bidders are requested to visit web-site <https://ugvcl.nprocure.com> (for RIS documents view, down load and on line submission) and web site www.ugvcl.com (for view & down load only). Interested bidders are requested to regularly visit the above websites to check for amendment, if any in the Tender.

Date:- 17/03/2023

Chief Engineer (P&P)



UGVCL
Uttar Gujarat Vij Company Ltd.
CIN – U40102GJ2003SGC042906

UGVCL/RCO/CCCeII/2023/044

CORPORATE COMMUNICATION CELL

Date : 17.03.2023

To,
The Publisher,
Indian Express Ahmedabad,
[All India Edition: English], Black & White.

Subject: ADVERTISEMENT RELEASE LETTER – Advt. No. 032/2023.

Sir/Madam,

Pursuant to the approval of Competent Authority for publication of this advertisement, I am directed to send a copy of the draft advertisement for publication at a prominent place in the inner pages of your news paper/s **The Indian Express All India + Financial Express All India in Black & White only 'All India EDITION.**

The advertisement matter must be published with UGVCL Logo in Govt. approved font size only and use minimum space possible.

Your Specified Rates are as under.

Publication	No of Edition	Tender Rate Card Per Sqcm B/W	Discount	Net Offer rate after discount
<u>The Indian Express + Financial Express All India</u> <i>IE:</i> Mumbai, Pune, Nagpur, Ahmedabad, Baroda, Delhi, Chandigarh, Lucknow, Kolkata, Jaipur <i>FE:</i> Ahmedabad (Gujarati + English), Mumbai, Pune, Delhi, Lucknow, Chandigarh, Kolkata, Hyderabad, Chennai, Bangalore, and Kochi	22	Rs.7985/-	15%	6787.25/- + 5% GST

You are requested to send the bill in triplicate with advanced stamp money receipt, copy of the newspapers, Advt. Release Letter and other documents to **Chief Engineer (P), UGVCL, Regd. & Corporate Office, Visnagar Road, Mehsana - 384001.**

Yours faithfully,


Superintending Engineer (Tech. & Vig.)

CFWCs to:

- Chief Engineer (P), UGVCL, Regd. & Corporate Office, Visnagar Road, Mehsana - 384001.
- Dy. CAO (Exp.), UGVCL, RCO, Mehsana

Uttar Gujarat Vij Company Limited

Regd. & Corporate Office: Visnagar Road, Mehsana -384001
GUJARAT-INDIA. Phone No. (02762) 222080-81 www.ugvcl.com

E-Tender Notice : UGVCL/Project/Solar/PM-KUSUM-C-FLS/ TN-42 to TN-104 (63 nos. of Tenders)

UGVCL invites Request for Selection of **Solar Power Generators** for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of **PM-KUSUM Component-C Feeder level Solarization** Scheme of MNRE, covering 63 Substations with aggregate Solar plant capacity of 208.5 MW. Interested Bidders are requested to visit web-site <https://ugvcl.nprocure.com> (for RfS documents view, download and on line submission) and web-site www.ugvcl.com (for view & download only). Interested bidders are requested to regularly visit the above websites to check for amendment, if any in the Tender.

Date:- 17/03/2023

Chief Engineer (P&P)

dedsmcell.pgvc1@gebmail.com

From: "eedsmcell.pgvc1" <eedsmcell.pgvc1@gebmail.com>
Date: Friday, March 4, 2022 12:10 PM
To: "DE DSM PGVCL" <dedsmcell.pgvc1@gebmail.com>; "SOLAR SRT" <srt.pgvc1@gebmail.com>
Cc: "C jedsm pg" <je2dsmcell.pgvc1@gebmail.com>
Attach: FLS Capacity Calculation.docx
Subject: Fw: Calculation of Solar Power Plants Capacity under Feeder Level Solarization

EE- DSM Cell,
PGVCL, Corporate Office,
Rajkot

From: I/C ACE SOLAR GUVNL

Sent: Wednesday, March 2, 2022 10:28 AM

To: ceproject.pgvc1@gebmail.com ; aceproj.pgvc1@gebmail.com ; acerc.mgvc1@gebmail.com ;
acesdp.dgvc1@gmail.com ; 'B R Icecreamwala' ; aceproject@ugvc1.com ; 'SE (Solar)' ; 'A V Saxena' ;
sedsm.dgvc1@gmail.com ; 'SE DSM' ; ser_c. pgvc1@gebmail.com ; eedsmcell.pgvc1@gebmail.com

Cc: cetech.guvnl@gebmail.com ; de1solar.guvnl@gebmail.com ; de2solar.guvnl@gebmail.com ;
solarcell.guvnl@gmail.com

Subject: FW: Calculation of Solar Power Plants Capacity under Feeder Level Solarization

Sir,

Please find the trailing mail from MNRE with the methodology of calculating the Solar power plant capacity under the Feeder Level Solarization of the PM-KUSUM Scheme Component-C.

As you know that GUVNL has demanded 1000 MW capacity for 3Lakh Ag. connections from MNRE and sanction would be received soon. So we will required the SS wise solar capacity in next fortnight.

Kindly prepare the data of the Substation wise Estimated Solar Plant capacity as per the methodology.

So, concerned Nodal Officer is requested to undertake the exercise for their DISCOM to estimate the Solar plant capacity.

With regards,
R. J. Vala
I/C ACE(Solar Cell),
GUVNL, Vadodara.

From: Shobhit Srivastava [mailto:shobhit.srivastava@nic.in]

Sent: 10 February 2022 09:16

To: md.apdcl <md.apdcl@apdcl.org>; cecomcseb@gmail.com; 62tcsharma@gmail.com; ramakant ece <ramakant.ece@gmail.com>; amal sinhal <amal.sinhal@relianceada.com>; ceo sectt <ceo.sectt@relianceada.com>; Abhishek r ranjan <Abhishek.r.ranjan@relianceada.com>; g sethi <g.sethi@tatapower-ddl.com>; cetech guvnl <cetech.guvnl@gebmail.com>; sesolar guvnl

07/03/2022

<sesolar.guvnl@gebmail.com>; gedagoa@yahoo.com; cecommercial@dhbvn.org.in; cecommercial@uhbvn.org.in; secommercial@uhbvn.org.in; secommercial@dhbvn.org.in; vinsood99@gmail.com; CEO Himurja <himurja-hp@nic.in>; ceojakeda2@gmail.com; mdjpdcl3@gmail.com; semrekathua@gmail.com; cecr2018@gmail.com; mdvitran@gmail.com; cerees@kseb.in; Managing Director M.P Urja Vikas Nigam Ltd <mduvn@mp.gov.in>; bhuvneshpatel bp <bhuvneshpatel.bp@gmail.com>; ce mpuvn1982 <ce.mpuvn1982@gmail.com>; ceremstedcl@gmail.com; sujitppre@gmail.com; seprojects mepdcl <seprojects.mepdcl@gmail.com>; ashok oreda <ashok.oreda@gmail.com>; Superintending Engineer-cum-Head of the Department, Electricity Department, Puducherry <se1ped.pon@nic.in>; M.P. Singh <mpsingh@peda.gov.in>; rrec2016@gmail.com; DDH HQ HORT <DDH.HQ.HORT@RAJASTHAN.GOV.IN>; eesolarproj@tnebn.net.org; pcbains@gmail.com; pdsolartsredco@gmail.com; tredaagartala@gmail.com; ad comm <ad_comm@rediffmail.com>; cmd tsecl <cmd.tsecl@rediffmail.com>; dirupneda@gmail.com; vc@nredcap.in; assamrenewable@gmail.com; info@jreda.com; agm sgkredl <agm.sgkredl@gmail.com>; gmdsm@bescom.co.in; gmdsm work <gmdsm.work@gmail.com>; eedsmandrnd hescom <eedsmandrnd.hescom@gmail.com>; projectscesc@gmail.com; jayakumar@anert.in; secssjodhpur@gmail.com; secss jdvn1 <secss.jdvn1@rajasthan.gov.in>; md avvn1 <md.avvn1@rajasthan.gov.in>; md@jvn1.org; gm1@teda.in; tnebsankar in <tnebsankar.in@gmail.com>; sethuc2@gmail.com; ce dsm4 <ce.dsm4@gmail.com>; neerajkumar upcl <neerajkumar.upcl@gmail.com>; solarwbsedcl2018@gmail.com
Cc: Jeevan Kumar Jethani <jethani.jk@nic.in>; Himani Mehta <himani.mehta@gov.in>

Subject: Calculation of Solar Power Plants Capacity under Feeder Level Solarization

Sir/ Madam,

This has reference to calculation of solar power plant capacity under feeder level solarization of Component-C of PM-KUSUM. Ministry has received requests from SIAs for clarifications in the estimation of plant capacity. Based on the queries received and also highlighting the relevant provisions of the Guidelines issued on 04.12.2022, a summary of methodology to be adopted for estimation of plant capacity has been prepared and attached herewith for information. All SIAs are requested to follow the methodology mentioned in the attached document. SIAs do not need prior approval of MNRE on capacity of the plant to be installed. The CFA will be released as per the attached methodology.

Regards

Shobhit Srivastava
Scientist-D
MNRE



07/03/2022

Solar Plant Capacity Calculation Under Feeder Level Solarization

All SIAs are requested to take note of the following provisions of the Feeder Level Solarization Guidelines issued by MNRE on 04.12.2020 and instructions issued on queries received from the Implementation Agencies:

- (i) The requirement of total annual power for an agriculture feeder will be assessed and a solar power plant of capacity that can cater to the requirement of annual power for that agriculture feeder can be installed either through CAPEX mode or RESCO mode, which will supply solar power to that feeder. For example, a feeder having annual power requirement of say 10 lakh units, the power can be supplied by solar power plant of capacity around 600 kW with CUF of 19%.
- (ii) Average of consumption of last three years shall be considered for calculating the solar plant capacity as illustrated above.
- (iii) Mixed feeders can also be solarized, however, MNRE CFA will be available based on capacity calculated for agriculture consumption.
- (iv) Under the Scheme solarisation of pumps of any capacity is allowed, however, in case of pumps of capacity above 7.5 HP, the CFA will be limited to solar capacity for 7.5 HP pumps.
- (v) For calculating consumption for pumps of capacity higher than 7.5 HP, for the purpose of calculating plant capacity eligible for MNRE CFA, average consumption of 7.5 HP pumps on the same feeder may be considered. This average consumption may be used in estimating consumption for all pumps of capacity higher than 7.5 HP.
- (vi) The state may choose to install feeder level solar power plant of capacity higher than capacity required for supplying power to agriculture feeder. The additional solar power generated may be used for supplying nearby rural/urban loads during day time or alternatively stored/banked for supplying power during evening hours for lighting/induction cooking and other household purposes. However, in this case CFA will be limited for solar capacity required for supplying power to the agriculture feeder.
- (vii) Since the projects are to be commissioned near the point of consumption, distribution losses would be reduced, therefore, losses shall not be considered in plant capacity estimation.
- (viii) CUF shall be taken as per the solar insolation on site, however, CUF of minimum 19% shall be considered for calculation of plant capacity eligible for CFA. No restrictions to be made on installing DC capacity higher than total contracted AC capacity of the plant to help achieve higher CUF.
- (ix) In case of unmetered connections, following methods may be followed for calculation of consumption:

- a. Indexation approved by the State Electricity Regulatory Commission may be followed.
- b. If both metered and unmetered connections are there on the same feeder, capacity-wise average of consumption of the metered connections may be extended to the unmetered connections. This shall be cross-checked with the feeder level meter.
- c. Consumption on feeder level meters may be used for estimation of plant capacity. However, if pumps of capacity higher than 7.5 HP are there on such feeder, capacity may be calculated based on consumption reduced in proportion of the load if capacity capped at 7.5 HP and actual load on the feeder.

Annexure-E**UTTAR GUJARAT VIJ COMPANY LIMITED**

REQUEST FOR SELECTION (RfS) OF SPG
FOR

**PURCHASE OF SOLAR POWER THROUGH COMPETITIVE BIDDING
PROCESS [FOLLOWED BY REVERSE E-AUCTION]**

FOR

**SOLARIZATION OF VARIOUS 11KV FEEDERS OF 66/11 KV CHORIWAD
SUBSTATION IN UGVCL**

UNDER
RESCO MODE OF
PM-KUSUM COMPONENT-C
FEEDER LEVEL SOLARIZATION SCHEME

Issued by:
The Chief Engineer (P&P)
Uttar Gujarat Vij Company Ltd.,
CIN: U40102GJ2003SGC042906,
Regd. & Corporate Office, Visnagar road,
MEHSANA-384001, GUJARAT-INDIA
Web: www.ugvcl.com, Email: cepp@ugvcl.com

Disclaimer:

1. Though adequate care has been taken while preparing this RfS document, the Bidders shall satisfy themselves that the document is complete in all respects. Intimation of any discrepancy shall be given to this office immediately. If no intimation is received from any Bidder within fifteen (15) days from the date of notification of RfS/ Issue of the RfS documents, it shall be considered that the RfS document is complete in all respects and has been received by the Bidder.
2. Uttar Gujarat Vij Company Limited (UGVCL) reserves the right to modify, amend or supplement this RfS document and the draft PPA including selection process and evaluation criteria, if deemed necessary by it or the same is required under Law. Such change shall be posted on Bidding Portal.
3. While this RfS has been prepared in good faith, neither UGVCL nor their employees or advisors make any representation or warranty, express or implied, or accept any responsibility or liability, whatsoever, in respect of any statements or omissions herein, or the accuracy, completeness or reliability of information, and shall incur no liability under any law, statute, rules or regulations as to the accuracy, reliability or completeness of this RfS, even if any loss or damage is caused by any act or omission on their part.
4. This RfS is not an agreement and is neither an offer nor invitation to the prospective bidders or any other person. The purpose of this RfS is to set the terms for the selection process and to provide Bidders with information that may be useful to them in preparation and submission of their Bids.
5. The bidder shall bear all its costs associated with or relating to the preparation and submission of its bid, including but not limited to preparation, copying, postage, delivery fees or any other costs incurred in connection with or relating to its bid. All such costs and expenses will remain with the bidder and the authority shall not be liable in any manner whatsoever for the same or for any other costs or other expenses incurred by a bidder in preparation of submission of the bid, regardless of the conduct or the outcome of the bidding process.
6. UGVCL reserves the right to annul the bid process and/or reject any or all of the Bids submitted in response to this RfS document at any stage without assigning any reasons whatsoever. In such cases UGVCL will refund the EMD, if any, and cannot be subjected to any liability whatsoever due to such rejection/cancellation.
7. This RfS is invited from SPG under Component –C of MNRE, Government of India's PM-KUSUM Scheme for Solarization Agricultural feeders of selected 66/11 KV Sub-station and the availability of CFA is subject fulfillment of terms & conditions of the scheme, disbursement of CFA by MNRE to the State of Gujarat and MNRE's evaluation of data for various projects under this Tender. UGVCL and GUVNL shall not be responsible for non-receipt / part receipt of CFA or delay in disbursement of CFA to any project of any feeder, if reasons for such non-receipt / part receipt or delay in disbursement of CFA is attributable to the SPG entity. In such a case, UGVCL /GUVNL shall not be liable to pay /compensate any difference of CFA on account of less amount of CFA received from MNRE.

Notice Inviting RfS**No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42 DT: 15.03.2023**

As authorized by the Gujarat Urja Vikas Nigam Ltd. (GUVNL) being State Implementing Agency (SIA) for Component-C of PM-KUSUM Scheme in the Gujarat State, the Chief Engineer (P&P)-UGVCL **invites this Request for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode.**

The setting up of Solar Power Generator (SPG) under this RfP shall involve Design, survey, supply, installation, testing, commissioning, operation & maintenance for 25 years from Commercial Operation Date, grid connectivity through erection of 11kV line to connect the plant with concerned 66 / 11 KV Substation, installation & operation of RMS of Solar power plant through RESCO model for Solarization of 11kV feeders of 66/11 KV CHORIWAD substation in UGVCL under PM-KUSUM scheme – Component C -feeder level Solarization (FLS).

The RfS documents may be down loaded from web site <https://ugvcl.nprocure.com> (For view, download and on line submission) and UGVCL's website www.ugvcl.com (for view download only.) (To view the PDF file please use "Acrobat Reader" software which can be downloaded from "Adobe website.)

RfS bid offer is required to be submitted by **online mode only in electronic form on website <https://ugvcl.nprocure.com>** (i.e. under preliminary, technical and price offer stage of online). **The copy of necessary documents as specifically mentioned in RfS is/are required to be submitted in physical form also at following address, within 5 days from the date of submission through online mode, to:-**

**The Chief Engineer (P&P),
Uttar Gujarat Vij Company Ltd.,
Regd. & Corporate Office,
Visnagar road,
MEHSANA-384001, GUJARAT-INDIA**

RfS Schedule: -

1	NIT /RfS No.	UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42
2	NIT Issue Date	15.03.2023
3	Bidding portal	https://ugvcl.nprocure.com
4	Document description	RfS Document for purchase of power through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL. Which involves Design, Survey, Supply, installation, testing , commissioning ,Operation & maintenance for 25 years from Commercial Operation date (COD) of grid connected substation level Solar power plant , erection and maintenance of its associated 11 KV Line to evacuate power to the substation with Remote Monitoring System (RMS) as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.
5	Tender/Rfs Document fee	Rs. 10000+ Rs. 1800/- (GST @18%)= Rs. 11800/- (Eleven Thousand Eight hundred only) Payment of Tender fee can be accepted by RTGS/NEFT. In case of payment through DD/Banker's Cheque the scanned copy of original documents shall have to be uploaded with the bid on- line and original copy of the same will have to be submitted, at the office of the Chief Engineer (P&P), UGVCL Mehsana, within 5 days from the scheduled date of the on-line bid opening (Tender Fee EMD stage).
6	EMD	Payment of Earnest Money deposit (EMD) can be accepted by RTGS/NEFT. In case of payment through DD/Banker's Cheque/Pay Order /Bank Guarantee, the scanned copy of original documents shall have to be uploaded with the bid on- line and original copy of the same will have to be submitted, at the office of the Chief Engineer (P&P), UGVCL Mehsana, within 5 days from the scheduled date of on-line bid opening. (Tender Fee EMD stage). The EMD of Rs. 1 lakhs / MW as per offered capacity .
7	Pre-bid meeting	Date and timing: 28.03.2023 at 11:30 Hrs Venue: Conference Hall, UGVCL, Corporate Office, Visanagar Road, Mehsana (The Agency who wants to attend the pre-bid meeting is requested to intimate us at least one day in advance prior to pre-offer meeting by e-mail only on following e-mail IDs

		sesolar@ugvcl.com cepp@ugvcl.com
8	Last Date & Time of submission of On- line bid in electronic form (Tender Fee, EMD, Technical & Financial Tariff offer. (This is mandatory)	Date: 05.04.2023, Time:-18:00 Hrs
9	Date of opening of Tender Fee, EMD on-line	Date: 06.04.2023, Time:-11:00 Hrs
10	Submission of original copy of DD/ Banker's Cheque/Pay Order /Bank Guarantee	Within 5 days from the scheduled date of on-line bid opening of Tender Fee & EMD stage. (On working days, During office hours)
11	Date of opening of Technical offer on-line (If possible)	Date: 15.04.2023, Time:-11:00 Hrs
12	Tentative Date of on – line opening of financial “Tariff bid” (Price bid) (If possible)	Date: 18.04.2023, Time:-11:00 Hrs
13	Reverse e-auction	Date of Reverse e-auction will be displayed on e-reverse bidding portal and it will be conveyed through e-mail to the eligible bidders. . The bidders shall require to create e auction user id on https://e-auction.nprocure.com/ The bidder shall require to mention their e-auction user id in the on-line submission of technical bid. This is mandatory.
Note: Bidders shall ensure that they have verified the scanned copies of the documents uploaded by them and documents shall open properly without any error. It shall be sole responsibility of the bidder that the uploaded documents (in PDF form) remain legible and should not be password protected.		

UGVCL GSTIN No: 24AAACU6551F1Z1

- Every bidder has to inform their GSTIN No. at the time of payment of applicable fees

Care to be taken for submission of bid:

AS PER THE NOTICE OF THE INVITATION OF RfS DOCUMENT (NEWS PAPER ADVERTISEMENT), THE BID IS INVITED BY **e-tender (ON – LINE) SYSTEM**, FOR WHICH FOLLOWING CONDITIONS ARE MANDATORY.

[A] ALL REQUIRED DOCUMENTS ARE TO BE SUBMITTED IN ONLINE MODE ONLY EXCEPT DOCUMENTS REQUIRED AGAINST PAYMENT OF TENDER FEE & EARNEST MONEY DEPOSIT (EMD), Bank Guarantee etc. as specifically mentioned in this tender documents.

[B] The documents mentioned in RfS Document are required ***to be uploaded in technical stage of online bid submission***. In case of not uploading of required document in online offer or uploading of wrong document, the bid may not be considered for technical evaluation. However, the Bidder have to furnish all required documents physically and it will be the responsibility of the bidder to submit the same within specified timeline.

[C] Bidders are requested to submit price – offer (financial bid) through on-line mode (e-RfS electronic form) only and not to submit the price offer in physical form. This is mandatory. If price offer is submitted in physical form, the bid/RfS offer will be summarily rejected.

[D] It is mandatory for all the bidders to confirm and agree all the terms and condition of bid including the condition to submit the bid only through on-line mode, the RfS documents, draft Power Purchase Agreement and RMS Communication and Security Architecture- PM KUSUM SEDM Platform attached herewith as a part of the whole tender. By confirming this, bidder will also confirm all the amendments thereafter issued time to time and will be automatically binding to the bidder.

[E] UGVCL at its sole discretion may ask additional clarification or information or documents from the bidder who is found to be eligible in pre-qualification criteria.

Note:- Bidder should be familiar with websites <https://ugvcl.nprocure.com> & www.ugvcl.com, <https://e-auction.nprocure.com/> for information regarding revision/corrigendum/Amendment in RfS Document till due date of online submission and thereafter. No separate / individual communications shall be sent in this regard and no public notice shall be issued in newspaper.

Any technical query, information and clarifications that may be required pertaining to this RfP should be referred to: **The Chief Engineer(P&P), Uttar Gujarat Vij Company Ltd., Regd. & Corporate Office, Visnagar Road, MEHSANA-384001, (Gujarat)**

E-Mail:- cepp@ugvcl.com; with a copy to sesolar@ugvcl.com

UGVCL reserves the right to reject any OR all RfS Documents/offers without assigning any reasons thereof.

**For and on behalf of UGVCL
Chief Engineer (P&P)**

LIST OF ABBREVIATIONS

1.	+	Plus (Addition)
2.	AC	Alternating Current
3.	CEA	Central Electricity Authority
4.	CEIG	Chief Electrical Inspector of Gujarat
5.	CERC	Central Electricity Regulatory Commission
6.	COD	Commercial Operation Date
7.	DC	Direct Current
8.	DCR certificate	Domestic Content Requirement certificate
9.	DTR	Distribution Transformer
10.	HP	Horse Power
11.	IEC	International Electro technical Commission
12.	IoT	Internet of Things
13.	IS	Indian Standard
14.	IST	Indian Standard Time
15.	kV	Kilo Volt
16.	kW	Kilo Watts
17.	kWp	Kilo Watt peak
18.	JV	Joint Venture
19.	LoI	Letter of Intent
20.	MDAS	Meter Data Acquisition System
21.	MIS	Management Information System
22.	MNRE	Ministry of New & Renewable Energy, Government of India
23.	MWp	Mega Watt Peak
24.	NIT	Notice Inviting Tender
25.	PBG	Performance Bank Guarantee
26.	PV	Photovoltaic
27.	GERC	Gujarat Electricity Regulatory Commission
28.	GEDA	Gujarat Energy Development Agency
29.	GETCO	Gujarat Energy Transmission Corporation
30.	RESCO	Renewable Energy Service Company
31.	RMS	Remote Monitoring System
32.	RTC	Real Time Clock
33.	SCADA	Supervisory Control And Data Acquisition
34.	SPG	Solar Power Generator
35.	SPV	Solar Photo Voltaic
36.	STC	Standard Testing Condition ("STC" shall mean Standard Testing Condition for solar cells and PV modules with air mass AM1.5, irradiance 1000W/ m ² , and cell temperature of 25°C)
37.	W	Watt
38.	Wp	Watt peak
39.	UGVCL	Uttar Gujarat Vij Company LTD
40.	GUVNL	Gujarat Urja Vikas Nigam Ltd.
41.	RfS	Request for Selection
42.	CFA	Central Finance Assistance (provided by MNRE)
43.	FLS	Feeder level Solarization under PM-KUSUM Scheme
44.	SLDC	State Load Dispatch Centre of Gujarat

CONTENTS

	Notice Inviting RfS	1
SECTION - A:	INTRODUCTION	8
SECTION - B:	KEY DEFINITIONS	10
SECTION - C:	KEY BID DATA	14
SECTION - D:	Computation of notified Solar capacity and criteria of bid capacity for each selected 66 KV Sub-station	19
SECTION - E:	Power Evacuation and metering	20
SECTION - F:	SCOPE OF WORK	21
SECTION - G:	ELIGIBILITY & QUALIFICATION	26
SECTION - H:	SUBMISSION OF BIDS	29
SECTION - I:	BID OPENING & EVALUATION	34
SECTION - J:	AWARD OF CONTRACT	42
SECTION - K:	BILLING AND PAYMENT CONDITIONS	44
SECTION - L:	OTHER TERMS AND CONDITIONS	44
SECTION - M:	Bank detail and Annexures and Forms	47

Details of Annexures and Forms

ANNEXURE-1	Metering infrastructure Philosophy and Remote Monitoring System
ANNEXURE-2	Power Purchase Agreement
ANNEXURE-3	List of Substation wise notified Solar Power Plants capacity with details viz: Name of feeders, Energy requirement, etc.
Form-1	Bid Submission Letter with undertaking of RFP conditions by Bidder
Form-2	Summary of Informations of the Bidding entity
Form-3	Summary of Substation wise offered Plant capacity and EMD details
Form-4	Undertaking for producing GSTIN
Form-5	Positive Networth Certificate by CA
Form-6	Power of Attorney in favour of Authorized Signatory (In Case of Bidder is Single Entity)
Form-7	Power of Attorney in favour of Authorized Signatory (In Case Bidder is Joint Venture)
Form-8	Undertaking by the Joint Venture Partners (In Case Bidder is Joint Venture)
Form-9	EMD Bank Guarantee Form
Form-10	Performance Bank Guarantee Form

SECTION - A: INTRODUCTION**A.1. Background**

1.1.1. Pursuant transfer scheme notified by Government of Gujarat under Gujarat Electricity Industry (Reorganization & Regulation) Act-2003, the erstwhile Gujarat Electricity Board has been restructured into seven companies.

- a) Gujarat Urja Vikas Nigam Limited (GUVNL) to do co-ordination activities among all subsidiaries and undertake purchase of power in bulk and supply to four distribution Companies for onward supply to consumers.
- b) Gujarat State Electricity Corporation Ltd. (GSECL) manages the electricity generation business of erstwhile GEB.
- c) Gujarat Electricity Transmission Corporation Limited (GETCO) to manage the electricity transmission and bulk supply business of erstwhile GEB.
- d) Dakshin Gujarat Vij Company Ltd (DGVCL)- distribution and retail supply business of erstwhile GEB in Southern region of Gujarat
- e) Madhya Gujarat Vij Company Ltd (MGVCL)- distribution and retail supply business of erstwhile GEB in Central region of Gujarat
- f) Uttar Gujarat Vij Company Ltd (UGVCL)- distribution and retail supply business of erstwhile GEB in Northern region of Gujarat
- g) Paschim Gujarat Vij Company Limited (PGVCL)- distribution and retail supply business of erstwhile GEB in Saurashtra and Kutch region of Gujarat.

1.1.2. On 22-07-2019 Ministry of New and Renewable Energy (MNRE), Government of India announced Guidelines for Implementation of Pradhan Mantri Kisan Urja Suraksha evem Utthan Mahabhiyan (PM KUSUM) Scheme for installation of solar pumps and grid connected solar power plants through three components, viz.

- Component A: Decentralized Ground Mounted Grid Connected Renewable Energy (RE) based Power Plants of individual plant size up to 2 MW.
- Component B: Installation of standalone Solar Powered AgriculturePumps
- Component C: Solarization of Grid-connected Agriculture Pumps - individual

1.1.3. Subsequently on 04 December 2020, MNRE introduced and issued guidelines for implementation of **feeder level solarization under Component-C** of PM-KUSUM Scheme. Under the scheme, agriculture feeders already segregated or, feeders having major load for agriculture may be solarized using installation of grid connected solar power plant to cater the annual power requirement of such agricultural feeder(s). The Scheme guideline is available on MNRE's Website www.mnre.gov.in and GUVNL's PM-KUSUM Portal <https://pmkusum.guvnl.com>.

1.1.4. As per above MNRE guidelines for feeder level Solarization, the annual power requirement of agriculture feeder(s) emanating from the selected sub-station is to be assessed and a solar power plant of capacity that can cater to the annual power requirement of that agriculture feeder(s) can be installed either through CAPEX model or RESCO model, which will supply solar power to that feeder(s). This RfS is for setting up of solar power generating plant (SPG) for sale of solar energy to UGVCL under the RESCO model.

- 1.1.5. As per MNRE guidelines for feeder level Solarization for installation of feeder level Solar power plants through RESCO model, the SPGs will be selected on the basis of lowest tariff quoted for generation and sale of energy for an agreement period of 25 years from the date of commissioning of power project (unless extended by both the parties on mutual agreement).

- A.2.** As per MNRE's Scheme guideline, the project entity will get CFA @ 30% of the estimated cost of installation of solar power plant **Rs. 1.05 Cr / MW (30% of estimated capital cost of Rs. 3.5 Cr / MW)**. For the purpose of calculating CFA, the cost of installation of solar power plant has been estimated as Rs. 3.5 Cr/MW. It is to clarify that incase the project cost is higher than Rs. 3.5 Crores/ MW, the CFA shall be Rs. 1.05 Crores per MW being 30% of Rs. 3.50 Crores / MW.

Objective

- 2.1.1. The objective of this RfP is to select the bidders for purchase of power from the Solar Power Projects set up in accordance with the provisions of this RfS document and standard Power Purchase Agreement (PPA). The selected bidder shall be responsible for design, survey, supply, installation, testing, commissioning, operation & maintenance of grid connected solar power plants to be set up and connected with 66/11 KV CHORIWAD Sub-station for supply of solar power at a fixed quoted tariff for 25 years (unless extended by both the parties on mutual agreement) from the commercial operation date for Solarization of various 11kV feeders associated with 66/11 KV CHORIWAD substation in UGVCL under PM-KUSUM scheme – Component C (feeder level Solarization). This shall also include erection and maintenance of 11 KV evacuation line & bays to connect the plant with concerned substation and Remote Monitoring System (RMS).

The details of Sub-station wise notified solar capacity for which bids are invited as per the terms and conditions of this RfP is as per **Annexure 3**.

- 3.1.1. The selected bidder shall install solar power project along with its associated **11kV line** to connect the plant with concerned 66KV/11 KV substation at 11 KV Bus and RMS of solar power plant as per the terms and conditions of this RfP & PPA. Detailed scope of work mentioned in Clause D.1.
- 3.1.2. **The basis of evaluation of the bids shall be the fixed tariff for 25 years in Rs. Per kWh quoted in the Price Schedule.** It is further to clarify that all the costs, distribution losses up to the delivery point including applicable taxes (incl. GST and cess as applicable), duties, etc. pertaining to design, survey, supply, installation, testing, commissioning, operation & maintenance of grid connected solar power plant, its associated 11kV line to connect the plant with concerned substation and RMS of solar power plant, shall be borne by the successful bidder. Bidders are required to quote the tariff on firm price End cost and no price variation shall be considered during the tenure of Power Purchase Agreement except Change in Law conditions provided in the Power Purchase Agreement.

SECTION - B: KEY DEFINITIONS

- (1) **"Act" or "EA 2003"** shall mean the Electricity Act, 2003 and include any modifications, amendments and substitution from time to time;
- (2) **"Affiliate"** shall mean a Bidder or a Bidding Entity that, directly or indirectly, controls, or is controlled by, or is under the common control with such Company. The expression "control" shall mean the ownership, directly or indirectly, of more than 50% of the voting shares of such Company or right to appoint majority Directors.
- (3) **"Authorized Officer"** shall mean Officer Designated by Discom for specific task
- (4) **"Bid"** shall mean the "Proposal" / "Quotation" submitted by eligible bidders for selection under this RfP for installation of solar power project and supply of Power to UGVCL.
- (5) **"Bidder" or "Bidding Entity"** shall mean the entity: Company-Ltd /Pvt Ltd / Limited Liability Partnership firm / Partnership firm / Proprietorship firm / an individual / group of farmers/ cooperatives/ Panchayats / Farmer Producer Organizations (FPO)/ Water User Associations (WUA) or Any legal body, who participate and bid under the RfP as mentioned in the Section-E
- (6) Any reference to the Bidder includes an entity including its successors, executors and permitted assigns severally, as the context may require.
- (7) **"Bidding Portal"** shall mean [https:// ugvcl.nprocure.com](https://ugvcl.nprocure.com)
- (8) **"Capacity Utilization Factor (CUF)":** CUF in a Year shall mean the ratio of the net output energy injected at delivery point of the SPV Power Plant in a Year versus installed Project capacity x 365 x 24 (i.e. CUF = Cumulative Project output in kWh / (installed Project capacity in kWp x 24 x 365))
CUF to be considered on AC capacity (KW).
The annual CUF will be calculated every year from 1st April of the year (COD for first year) to 31st March next year.
- (9) **"CEI"/ "CEIG"** shall mean Chief Electrical Inspector to the State Government.
- (10) **"Company"** shall mean a body incorporated in India under the Companies Act, 1956 or the Companies Act, 2013, as applicable;
- (11) **"Commissioning"** with respect to the Project as certified by UGVCL shall mean when all equipment as per rated capacity has been installed and energy has flown into the grid.
- (12) **"Commercial Operation Date" (COD)** shall mean the date certified by the DISCOM's committee upon successful commissioning (as per provisions of the PPA) of the project when all equipments as per rated capacity have been installed and energy has flown into the grid.
- (13) **"Conflict of Interest"** shall mean a Bidder may be considered to be in a conflict of interest with one or more Bidders in the same bidding process if they have a relationship with each other and as defined in the section H-4.
- (14) **"Contracted Capacity"** shall mean ____ MWp AC contracted with DISCOM for supply by the SPG to DISCOM at the Delivery Point which shall be the maximum injection limit at

delivery point in any 15 minute time block during the entire term of the PPA.

- (15) **"Contract Year"** shall mean, with respect to the initial Contract Year, the period beginning on the Commercial Operation Date and ending at 12.00 midnight on 31st March of that Fiscal Year. Each successive Contract Year shall coincide with the succeeding Fiscal Year, i.e., a period of twelve months commencing on April 1 and ending on following March 31, except that the final Contract Year shall end on the date of expiry of the Term or on Termination of this Agreement whichever is earlier.
- (16) **"DISCOM"** shall mean Subsidiary Distribution Companies of GUVNL namely UGVCL, UGVCL, DGVCL & MGVL
- (17) **"Day"** shall mean calendar day.
- (18) **"Delivered Energy"** means the kilowatt hours of energy actually fed and measured by the energy meters at the Delivery Point and as certified by SLDC.
- (19) **"Delivery Point"** Delivery Point shall mean the point at the voltage level of 11kV of the 66/11 kV Sub-station i.e. 11kV side of 66/11kV respective substation under the PPA. Metering shall be done at this interconnection point where the power is injected into the 66/11 kV Sub- station. For interconnection with grid and metering, the SPG shall abide by the relevant and applicable regulations, Grid Code notified by the State Commission and Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006 as amended and revised from time to time, or orders passed thereunder by the Appropriate Commission or CEA. All charges and losses related to Transmission of power from project up to Delivery Point shall be borne by the SPG without any reimbursement thereof.
- (20) **"Effective Date"** shall have the meaning ascribed thereto in Article 2.1 of attached PPA;
- (21) **"Electrical Inspectorate"** shall mean Electrical Inspectorate Department Gujarat
- (22) **"Engineer In-charge"** shall mean the authorized Officer of the UGVCL
- (23) **"n-procure"** shall mean electronic procurement system of Gujarat.
- (24) **"Guidelines"** shall mean the "Guidelines for Implementation of Feeder Level Solarisation under Component-C of PM-KUSUM Scheme" issued by the Ministry of new and Renewable Energy vide OM 32/645/2017 –SPV dated 04/12/2020 as amended from time to time.
- (25) **"Interconnection Point/ Delivery point"** shall mean the point(s) of connection(s) at which the project is connected to the grid i.e. **it shall be at 11 kV bus bar level of 66/11kV substations mentioned in the tender against respective feeders.**
- (26) **Joint Venture** shall mean participating in the bid jointly by more than one members through Joint Venture Agreement for establishment and Operation & Maintenance of solar power project under the this RfS.
- (27) **"Letter of Award" or "LOA"** shall mean the work order issued by UGVCL to the Selected Bidder for award of contract.
- (28) **"Metering Point"** Metering point shall be at delivery point at 11 kV side of 66/11Kv substation.
- (29) **"Month"** shall mean calendar month.

- (30) **“Nodal Officer”** shall mean Superintending Engineer (R&C), UGVCL, Mehsana
- (31) **“Net-Worth”** means the Net-Worth as defined in Section 2 of the Companies Act 2013.
- (32) **“NIT” / “RfS document” / “RfS” / “Notice Inviting Tender”/ ‘Tender’** shall refer to this “Request for Selection of Solar Power Generator (SPG) for the work of design, survey, supply, installation, testing, commissioning, operation & maintenance for 25 years (unless extended by both the parties on mutual agreement) from COD, of grid connected feeder level solar power plant , its associated 11 kV line to connect the plant with concerned substation and RMS of solar power plant through RESCO model for solarization of different 11kV feeders of 66/11kV substation of in UGVCL under KUSUM scheme – Component C (feeder level solarization)”
- (33) **“Performance Bank Guarantee”** shall mean the irrevocable unconditional bank guarantee to be submitted by the successful bidder as per the RfS.
- (34) **“PPA”** shall mean the Power Purchase Agreement signed between the SPG and UGVCL according to the terms and conditions of the standard PPA enclosed with this RfS, for purchase of Solar Power at tariff discovered in the tender and adopted by the GERC, by procurer.
- (35) **“procurer”** shall mean UGVCL
- (36) **“DISCOMs”** shall mean all 4 Discoms in Gujarat namely: PGVCL, UGVCL, DGVCL, MGCL
- (37) **“Power Project” or “Solar Project” or “Project”** shall mean the Solar Power generation facility of Contracted Capacity having a separate control system, metering and separate points of injection into the grid at Delivery point. The Project shall include all units and auxiliaries such as water supply, treatment or water storage facilities, bay(s) for transmission system in the switchyard, dedicated electrical line up to the Delivery Point and all the other assets, buildings/structures, equipment, plant and machinery, facilities and related assets required for the efficient and economic operation of the power generation facility, whether completed or at any stage of development and construction or intended to be developed and constructed for the purpose of supply of power as per the PPA.
- (38) **“Project Site”** means any and all parcels of real property, rights-of-way, easements and access roads, upon which the Project and its related infrastructure will be located.
- (39) **“Project Capacity”** means the AC capacity of the project at the generating terminal(s) and to be contracted with UGVCL for supply from the Solar Power Project.
- (40) **“Project Commissioning”** shall mean the Project will be considered as commissioned if all equipment as per rated project capacity has been installed and energy has flown into grid, in line with the Commissioning procedures defined in the RfS/PPA.
- (41) **“Project Developer” or “Developer” or “Solar Power Generator (SPG)”** shall mean the successful Bidder whose Bid to perform the Contract as per this RfS has been accepted by UGVCL, Work order is issued by UGVCL and is named as such in the Contract Agreement, and includes the legal successors or permitted assigns of the Contractor
- (42) **“RESCO”** shall mean Renewable Energy Service Company i.e. an energy service company that develops, installs, finances, operates and owns the solar power project and supplies power generated from the Project to the UGVCL under this RfS.

- (43) **“Selected Bidder” or “Successful Bidder”** shall mean the Bidder selected pursuant to this RfS to set up the Project and supply electrical output as per the terms of standard PPA.
- (44) **“SLDC”** means the State Load Dispatch Center, Gujarat as notified by the State Government.
- (45) **“Solar PV Project”** means the solar Photo Voltaic Power project that uses sunlight for direct conversion into electricity through Photo Voltaic technology.
- (46) **“Week”** shall mean calendar week.
- (47) **“Voltage of Delivery”** means the voltage at which the Electricity generated by the Project is required to be delivered at 66/11kV substation.

SECTION - C: KEY BID DATA

1	Solar PV Plant technology	All components used for installation of solar power plants shall conform to applicable BIS / MNRE specifications and follow quality control guidelines issued by MNRE. <u>It will be mandatory to use domestically manufactured modules only.</u>
2	Project location & land arrangement	Project location: The location of the Solar Power project will be preferably within Five KM radius of the selected sub-stations in order to avoid high cost of evacuation line and losses. Project land: It shall be the responsibility of SPG to identify and arrange for required project land on ownership / lease basis. In case of lease land, the minimum period of lease agreement shall be such that it shall cover the 25 years of PPA and UGVCL and/or Govt. assumes no responsibility in procuring / arranging for project land.
3	Delivery point	11 KV Bus of associated 66Kv/11kv substation.
4	Notified Solar Capacity	The notified solar capacity against sub-station is as per Annexure 3.
5	Bid capacity to participating in the bid	There shall be single bid for 66/11 KV CHORIWAD sub-station. The bidder is allowed to bid for a minimum capacity of 0.5 MWp and maximum upto notified capacity for the respective Sub-station in multiple of 0.5 MWp.
6	Location wise project capacity	Irrespective of capacity bided for a given Sub- station, the solar project capacity at single location shall be minimum 0.5 MWp & maximum upto 4 MWp. The bidder shall have discretion to install solar power project at multiple location for bided capacity under the given bid considering the availability of land. It is to clarify that in case of bided capacity is more than 4 MW, the bidder is allowed to set up solar project for more than 4 MWp at single location subject to establishment of multiple 11 KV evacuation line & separate metering arrangement for each line considering limit of 4 MWp for 11 KV line.

7	Evacuation of Power & metering arrangement	The bidder shall be responsible to deliver the power upto 11 KV bus of 66/11 KV CHORIWAD sub-station. The 11 KV evacuation line shall be constructed and maintained by the bidder during the tenure of PPA. The use of common 11 KV evacuation line for multiple projects and amongst multiple bidders shall be encouraged to optimize the resources. The summation of power from all line (upto 4 MW) will be feed to a single 11 KV Panel and the cost of the panel and related infrastructure at receiving sub-station end shall be borne by and among the generators through proportionate sharing basis. For metering purpose, the individual receiving end ABT Meters should be put up by the generator by erecting the CTPT Unit at SS Wall. In no case, evacuation at 66 KV voltage level shall be permitted.
8	Guaranteed CUF / min CUF	19% (fixed i.e. no deration permitted) CUF in a Year shall mean the ratio of the net output energy injected at delivery point of the SPV Power Plant in a Financial Year versus installed Project capacity x 365 x 24 (i.e. CUF = Cumulative Project output in kWh / (installed Project capacity in kWp x 24 x 365)) The annual CUF will be calculated every year from 1st April of the year (COD for first year) to 31st March next year. However, SPG can add additional DC capacity to maintain 19% CUF in a year, for the entire period of PPA subject to CEA approval, if required.
9	Eligible CFA by MNRE	Successful bidder shall be eligible to get CFA @ Rs. 1.05 Cr per MW considering capital cost of solar project at Rs. 3.50 Crores per MW (subject to installation & commissioning of project in line with MNRE requirement). CFA up to 100% of the total eligible CFA will be released to the project entity through UGVCL on successful operation and performance of solar plant for two months after the commissioning subject to achieving guaranteed CUF agreed in PPA at least for one month CUF as per minimum CUF agreed in PPA, subject to further sanction and release of CFA by MNRE-Gol. SPG shall give an undertaking that he shall not sell power to any other party / buyer except the UGVCL during the tenure of PPA. At any point of time during the tenure of PPA, if it is found that the SPG has sold power produced from the solar plant to other party / buyer, strict legal action will be initiated against such SPG, including stop deal or black list from Participation in future tender of MNRE in Gujarat and the SPG shall require to refund the proportionate CFA granted for the project by MNRE to UGVCL.

		For the recovery of Proportionate CFA in case of default, the disbursed CFA will be divided by 25 years to arrive at CFA per year and the CFA shall be recovered for the balance period of PPA upon noticing the default. The recovery of the proportionate CFA will be made through the payments of invoices or through remedies taken in accordance with applicable laws. In case of any liquidation of assets of the solar power plants prior to completion of PPA period the first charge shall be towards recovery of the proportionate CFA granted to the project.
10	Mode of bid submission	All required documents are to be submitted in online mode only except documents required against payment of tender fee & earnest money deposit (EMD) etc. as specified in tender shall be required to submit in physical mode also.
11	Selection criteria	The bidder(s) shall be selected in ascending order of quoted tariff upto notified project capacity of the sub-station under bucket filling mode through reverse auction e-bidding. Say, a bidder who has quoted lowest tariff shall be awarded solar capacity for which bid is submitted and thereafter subsequent lowest bidder, and so on, till the notified capacity of given 66 KV Sub-station is exhausted.
12	Bid Validity	120 days from the date of opening of online Technical bid.
13	Performance Bank Guarantee (PBG) against commissioning	Performance Bank Guarantee (PBG) of Rs. 5 Lakh / MW basis is required to be submitted to UGVCL by the successful bidder upon issuance of Letter of Award by UGVCL towards payment security mechanism for recovery of liquidated damages for delay in commissioning of solar power project beyond scheduled commercial operation date. The PBG will be returned to the SPG after successful commissioning of solar power plant within scheduled commercial operation date. The PBG shall be valid from the date of issue until 2 months (i.e. sixty (60) days) beyond scheduled commercial operation date. It shall be responsibility of selected bidder to get the PBG extended, if required, such that it is valid till 2 months after date of commissioning of project.
14	Power Purchase Agreement (PPA)	PPA for a period of 25 years (unless extended by both the parties on mutual agreement) from the date of commercial operation of the project at a fixed quoted tariff shall be executed with successful bidder within 15 days from adoption of tariff by Hon'ble GERC.
15	Scheduled Commercial Operation Date	Within 9 months from date of signing of PPA
16	Terms of PPA	25 years (unless extended by both the parties on mutual agreement) of O&M from the date of commercial operation date of the project

1.1.1. Instructions for e- bid (Online bidding for RfS) to Bidders:

i	Downloading of RfS Documents
A	Offer document will be available on web site up to date shown in the RfS
	The Bidder willing to participate in RfS offer will have to get themselves registered on website www.nprocure.com
ii	Digital Signature
A	The Bidder should have valid digital certificate as per Information Technology Act 2000 using which they can sign their electronic offers. Agency can also procure the same from (n) code solutions, a division of GNFC Ltd., who are licensed certifying authority by Govt. of India.
B	In case RfS Bidder needs any clarification for e-bidding, details regarding digital certificate or if training required for participating in online RfS Document, they can contact the following office:- (n) Procure Cell M/s (n) Code Solution, A division of GNFC 403, GNFC Info Tower, Bodakdev, S.G. Road, Ahmedabad 380054.(Gujarat) E-mail: nprocure@gnfc.net Mob.: 9327084190; 9898589652 Toll Free: 1-800-233-1010 (Ext. 501, 512,516 , 517 , 525) Phone No. 079-26857315 / 316 / 317 Fax: 079-26857321 / 40007533 Other Terms & Conditions as per detailed EOI Document
C	Agency who already possess valid Digital certificate need not to procure a new digital certificate.
iii	On line Submission of Technical and Price Offer
A	Bidder can prepare and edit their offers number of times before RfS submission date and time. After RfS Document submission date and time, in any case, the applicant cannot edit their offer after bid deadline is over. No written or online request in this regard shall be entertained.
B	The applicant shall submit their offer, i.e. Technical Offer as well as price offer in Electronic format on above mentioned website and date shown in RfS Document before digitally signing the same.
C	Offers submitted without on-line confirmation and digitally signed will not be accepted.

1.1.2. The bidders are requested to submit their bids prior to scheduled date & time to avoid event of non-submission of their bids due to non-availability / connectivity or any other issue of Bidding portal, at last moment or any reason whatsoever. The last date of submission of bids will not be extended in such circumstances.

1.1.3. It is mandatory for all the participating bidders to submit the following in original at the mentioned address prior to schedule of Physical submission (upload the scanned copy on the n-procure bidding portal)

- a. **Bid security –EMD / EMD:** The EMD of Rs. 1 lakhs / MW basis shall be payable either through RTGS / NEFT/ DD/BG. The payment of bid security-EMD in form of BG shall be in the prescribed format attached herewith as **Form-9** on Non-Judicial Stamp Paper of Rs. 300/- for which the bidder wanted to participate.

- b. **Tender Fee:** - RTGS/NEFT /DD/Banker's Cheque only of prescribed value towards the **cost of tender fee**. Payment of Tender Fee Can be accepted by RTGS/NEFT
- c. In case of payment of amount through DD, it shall be in favor of UGVCL, payable at Mehsana.
- 1.1.4. The PBG shall be from any Scheduled / Nationalized Banks (in a standard format prescribed by UGVCL in Form-10) as notified vide finance department of Govt. of Gujarat GR no.: EMD/4/2022/002/DMO dated 20/05/2022 and further amendments if any. CORPORATE GUARANTEES ARE NOT ALLOWED.**
- 1.1.5. Cutting / overwriting if any in the figures of the tendered documents is required to be clarified / indicated in words, duly signed, failing which the tender may be rejected.**
- 1.1.6. Bidders shall not quote any deviation of any kind in the bid. Such deviations shall not prevail.**
- 1.1.7. The bidders shall provide complete information at the time of submission of bid. If the bidders are asked to furnish some more clarification/confirmation/document, they shall be required to furnish the same within specified time, failing which the case shall be finalized /decided on the basis of available information/documents. However, if there are any shortcomings in the submission of the information which may not materially affects the qualification criterion, then UGVCL shall have the right to consider the facts on the merit of the case and decide the bid evaluation accordingly.**
- 1.1.8. All the required information shall be furnished strictly in the prescribed Formats only. Any information indicated other than the prescribed Formats shall not be entertained. The bid shall be evaluated on the basis of information furnished in the prescribed Formats only.**
- 1.1.9. Clarifications regarding this RfS document for any type of typographical Errors or misunderstanding of document, the version/decision of UGVCL shall be final.**
- 1.1.10. UGVCL reserves the right to cancel / withdraw or alter the RfS without assigning any reason and shall bear no liability whatsoever consequent upon such a decision.**
- 1.1.11. Correspondence for enquiries and clarifications:** All correspondence in respect of this RfS and submission of the bid shall be addressed to:
- 1.1.12. Bidders have to enable e-auction id and mentioned detail at the time of filing of data on e -tender for e- auction facility.**

The Chief Engineer (P&P)
Uttar Gujarat Vij Company Ltd.,
CIN: U40102GJ2003SGC042906, Regd. & Corporate Office,
Visnagar Road,
MEHSANA-384001, GUJARAT-INDIA Email: ceproject.UGVCL@gebmail.com

SECTION - D: Computation of notified Solar capacity and criteria of bid capacity for 66/11 KV CHORIWAD Sub-station:

(1) Computation of notified Solar capacity for 66/11 KV CHORIWAD sub-station:

- a) As per the MNRE guideline for feeder level solarization, the Agricultural connection upto 7.5 HP is to be considered for computation of solar project capacity for availing CFA. In compliance to the same, the solar capacity mentioned against Sub-station in the Annexure-3 covers all the AG feeders emanating from the substation covering AG consumers' load upto 7.5 HP. Thus, the notified solar capacity for the Sub-station is decided as aggregate of AG load upto 7.5 HP and AG consumer's load in excess of 7.5 HP is not considered while computing solar capacity against each Sub-station.
- b) Further, the aggregate capacity so arrived as per (a) above, is round off at lower side in multiple of 0.5 MW (say if the total capacity is worked out to 3.8 MW, the notified plant capacity is considered at 3.5 MW) so as to avoid extra cost of redundant capacity of transformer and inverter for the bidders.

(2) The bidding criteria for sub-station

- a. There shall be single bid for selected sub-station by a bidder. Accordingly, bidder has to quote single fixed tariff for a given sub-station with minimum bid capacity of 0.5 MWp and maximum upto notified solar capacity for respective for the sub-station. The bidder can quote for a project capacity in multiple of 0.5 MW.
- b. For the solar capacity allocated to the bidder for respective sub-station, the bidder is allowed to set up the project at multiple location with minimum project size of 0.5 MWp and maximum project size upto 4 MWp, preferably within 5 KM periphery of respective sub-station. It is to clarify that in case of allocated solar capacity under given bid is more than 4 MW, the bidder is allowed to set up solar project at single location subject to creation of multiple 11 KV evacuation line & separate metering arrangement for each line considering limit of 4 MWp for 11 KV line.

SECTION - E: Power Evacuation and metering:

- (1) The bidder shall be responsible to deliver the power upto 11 KV bus of selected 66/11 KV sub-station. The 11 KV evacuation line shall be constructed and maintained by the bidder during the tenure of PPA. If multiple bidders are selected for the sub-station, the use of common 11 KV evacuation line amongst multiple bidders for evacuation of power at respective sub-station shall be encouraged to optimize the resources. In case of common evacuation line, the energy injection at receiving end sub-station shall be work out on the basis of meter of common meter installed at receiving end sub-station appropriately apportioned as per respective meter reading of individual meter at project end
- (2) The summation of power from all 11 KV evacuation line (upto 4 MW) will be feed to a single 11 KV Panel at respective 66 /11 KV Sub-station and the cost of the panel and related infrastructure shall be borne by and among the generators through proportionate sharing basis. For metering purpose, the individual receiving end ABT Meters should be put up by the generator by erecting the CTPT Unit at Sub-station Station Wall. In no case, evacuation at 66 KV voltage level shall be permitted.
- (3) Metering requirement: There shall be three ABT Meters to be installed by Generators: Main and check Meters at SS end with common CTPT unit and standby meter at Generating end.
- (4) For the billing purpose, the energy injection at receiving end sub-station shall be considered.
- (5) UGVCL will not be a party in the dispute resolution as the evacuation of the power will be the responsibility of the generator.

Section-F: SCOPE OF WORK**F.1. Role, Responsibility and Scope of Work of the successful bidder,**

1.1.1. Overall scope of work for installation solar project with RMS and supply of power under the PPA by Solar Power Generator (SPG) covers following:

- a. Detailed site survey,
- b. Procurement / arranging of required project land for 25 years for installation of the solar power plant for feeder level Solarization,

The SPG shall identify the project land preferably within the distance of Five KM radius of the respective 66/11 KV sub-station, get ownership of land or its lease rights and make necessary arrangement including ROW, clearances etc for the 11 KV electrical line between sub-station and the solar power plant. The SPG shall require to submit the final land documents before commissioning of project for the entire required land.

- c. The Solar Power plant will be preferably installed within Five KM radius of the concerned sub-station in order to avoid high cost of sub-transmission lines and to reduce transmission losses.
- d. Design, supply and installation of solar power plant in line with requirements under MNRE guidelines.
- e. Supply and erection of associated 11kV line connecting the solar power plant with associated 66/11kV substation (including bay, breakers and metering system at substation) as per design and specifications of UGVCL / GETCO / MNRE / CEA.

Further, if any 11 KV line is exist for evacuating Solar power from the Generator end to substation end, having private ownership of the SPG, the sharing of such line amongst different bidders shall be encouraged on mutual agreement / consent basis even with required extension/augmentation, subject to the aggregate capacity for evacuation from such line does not increase beyond 4 MW. It is clarified that such common use of evacuation line shall be without any financial implication for UGVCL. In such case necessary metering arrangement shall require to be implemented.

- f. Testing and commissioning of plant & associated 11kV line in presence of designated official(s) of DISCOM Committee.
- g. Operation & maintenance of the solar power plant as well as 11kV line for 25 years (unless extended by both the parties on mutual agreement) from COD.
- h. The work of installation and commissioning of solar plant, including Operation & maintenance of solar power project shall to be carried out by SPG by availing services of registered licensed electrical contractor of Gujarat.
- i. Supply of power at delivery point for 25 years at the quoted fixed tariff (Rs. per kWh) (*inclusive of applicable taxes incl. GST, duties, etc.*), at the guaranteed CUF.
- j. Installation, operation and maintenance of Remote Monitoring system for the Solar Power Project set up under this RfP for 25 years.

- 1.1.2. **It will be mandatory to use domestically manufactured Solar modules. An undertaking in this regard is required to be submitted by the SPG complying that only domestically manufactured Solar modules are used in the project.**
- 1.1.3. The SPG shall supply power to UGVCL at fixed quoted tariff and such tariff is not subject to change on any account during the PPA terms of 25 years except Change in Law conditions provided in the Power Purchase Agreement.
- 1.1.4. All approvals, permits and clearances required for setting up of the Project and associated 11 KV evacuation line including those required from State Government and local bodies along with any associated cost for getting the clearances shall be in the scope of the SPG.
- 1.1.5. It shall be the responsibility of the SPG, entirely at its cost and expense, to install such number of solar panels and associated equipment as may be necessary to achieve the required **minimum CUF of 19% throughout the PPA tenure of 25 years**, and for this purpose selected bidder shall make its own study and investigation of the Global Horizontal Irradiation (GHI) and other factors prevalent in the area which have implication on the quantum of generation.
- 1.1.6. **All components used for installation of solar power plants shall conform to applicable BIS/MNRE specifications and follow quality control guidelines issued by MNRE with its amendments issued by MNRE time to time.**
- 1.1.7. It is clarified that the project awarded under this RfS would not include energy storage with solar power plant.

F.2. Metering, grid connectivity and Remote Monitoring System

- 2.1.1. Metering and grid connectivity of the projects would be the responsibility of the SPG in accordance with the prevailing guidelines / practices of UGVCL and / or CEA. UGVCL may facilitate in the process; however, the entire responsibility & cost lies only with the SPG.
- 2.1.2. Meters and metering equipment (CT-PT sets) specifications shall be complied with CEA metering regulations and shall be tested as per provision of GERC order / directives and as per IS 14697 at CPRI or at any NABL accredited / distribution licensee lab before installation at site at the cost of SPG and should be properly sealed in the presence of designated authority from UGVCL at the time of installation.
- 2.1.3. The solar power generator shall install Metering infrastructure and Remote Monitoring System (RMS) as per the philosophy explained in the **Annexure-1**

F.3. Insurance

- 3.1.1. The SPG shall also take insurance for third party liability covering loss of human life, engineers and workmen and also covering the risks of damage, theft of material/ equipment/ properties after completion of the work(s). Before commencement of the work, the SPG shall ensure that all its employees and representatives are covered by suitable insurance against any damage, loss, injury or death arising out of the execution of the work. Implication on account of Liquidation, Death, Bankruptcy etc., shall be the responsibility of SPG only.

F.4. Type and quality of materials and workmanship

- 4.1.1. The design, supply, installation, testing, commissioning, operation and maintenance of the solar power plant and the associated 11kV line shall be in accordance with latest/ appropriate IEC/Indian Standards. Where appropriate Indian Standards and Codes are not available, other suitable standards and codes as approved by the MNRE/ CEA/ GERC/ UGVCL shall be used. All the relevant test certifications must be kept valid up to one (1) Year from the COD of the Project.
- 4.1.2. The SPG shall ensure that the specifications of the components / equipments like 11kV circuit breaker, 11kV CT-PT metering unit, etc should meet the technical specifications of UGVCL.
- 4.1.3. Any material / equipment which have not been specifically mentioned in this RfS but which are necessary during construction or O&M period of the plant & associated 11kV line shall be provided by the SPG without any extra cost and within the time schedule for efficient and smooth construction and O&M activities.

F.5. Completion and commissioning

- 5.1.1. Part Commissioning is NOT allowed for the Project. SPG, in coordination with UGVCL, shall submit commissioning certificate, issued by the committee constituted by UGVCL, in accordance with all applicable regulations/policies. For the purpose of obtaining commissioning certificate following documents shall be required:
- a) Inspection Report of the Work(s) for all equipments / material
 - b) CEIG approval for the PPA Capacity.

F.6. Commissioning Period

- 6.1.1. The design, survey, supply, installation, testing and commissioning of solar power plant with associated 11 kV line connecting the solar power plant with concerned substation and RMS of solar power plant as per terms & conditions of this RfS **is to be completed within 9 (nine) months from date of execution of Power Purchase Agreement (PPA).**

F.7. Delay in commissioning

- 7.1.1. The Committee constituted by UGVCL will physically inspect the Solar Power Plant in not later than 03 days from the date of receiving a call from the SPG and witness and certify successful commissioning of the solar power plant.
- 7.1.2. In case any SPG fails to achieve the commercial operation of the project by Schedule Commercial Operation Date which shall not be later than 9 months from the date of signing of PPA, UGVCL shall encash the Performance Bank Guarantee (PBG) as liquidated damages (LD) in the following manner:

Delay up to two months: LD equal to the PBG on per day basis. The no. of days in "month" for the LD calculation shall be considered as 30.

In case the commissioning of the solar power plant is delayed beyond two months:
The complete PBG amount shall be encashed.

In case of delays of plant commissioning due to force majeure events as specified in the PPA, Procurer / UGVCL after having been satisfied with documentary evidences produced by the SPG for the purpose in regard to force majeure events, can extend

the time in writing for commissioning date without any financial implications to the SPG.

F.8. Project milestones and timeline

S. No.	Milestone	Timeline
1	Issuance of Letter of Intent (LoI) to the successful bidders -SPG	T1
2	Unconditional acceptance of LoI by successful Bidder	T1 + 7 days
<i>Petition will be filed by UGVCL before GERC for adoption of tariff discovered under e-reverse bidding process</i>		
3	Issuance of Letter of Award (LOA) to the successful bidder after adoption of tariff by GERC	T2
4	Unconditional acceptance of Letter of Award (LOA) by successful Bidder and submission of Performance Bank Guarantee	T2 + 7 days
5	Signing of PPA between selected bidder (SPG) and UGVCL	T3 = T2 + 15 Days
6	Completion of design, supply, installation, testing and commissioning of the SPV power plant and associated 11V line for connecting solar power plant with concerned substation along with Submission of the final land documents for the entire required land duly registered by appropriate revenue authority	T3 + 9 months
7	Operation and maintenance of power plant and associated 11kV line	25 years from COD (unless extended by both the parties on mutual agreement)

F.9. Clearances required from the state government and other local bodies.

- a) The SPG is required to obtain and maintain necessary clearances and permits as required for setting up the Solar Power Project, including but not limited to the following:
 - i. Approval for water from the concerned authority (if applicable) required for the solar power plant and/or, associated 11kV line.
 - ii. Any other clearances (forest dept., etc) as may be legally required, in order to establish and operate the solar power plant and/or, associated 11kV line.
 - iii. Registration of land/land lease document as the case may be and permission for Non-Agricultural Use of land
- b) The above clearances, as applicable for the solar power plant and/or, associated 11 kV line, shall be required to be submitted to UGVCL prior to commissioning of the Project. In case of any of the clearances as indicated above being not applicable for the said Project, the SPG shall submit an undertaking in this regard, and it shall be

deemed that the SPG has obtained all the necessary clearances for establishing and operating the Project. Any consequences contrary to the above shall be the responsibility of the SPG. The SPG shall coordinate with UGVCL in case of any clarifications.

- c) Any cost associated with getting and maintaining the above required clearances for the project shall be borne by the SPG only.
- d) The SPG shall not be entitled to claim deemed generation in case of any delay in grant of connectivity.
- e) The Successful Bidder shall comply with the GERC / CERC regulations on Forecasting, Scheduling and Deviation Settlement mechanism, as applicable and shall be responsible for the same.

F.10. Notice Board for display at site

The selected bidder will have to put a notice board (atleast size of 180cmx120cm) at main entrance of project site prominently displaying the following message before declaration of COD:

PM-KUSUM
Scheme Feeder Level Solarization under Component-C
___ MWp Grid Connected Solar PV Project
Owned and operated by ...<insert name of the selected bidder>...
Implemented by UGVCL
...<Name of location,
Taluka>.....,
District>..., Gujarat

SECTION - G: ELIGIBILITY & QUALIFICATION of BIDDERS**G.1. Eligible Entities :**

Any individual or Company or Limited Liability Partnership (LLP) firm or partnership firm or proprietorship firm or body corporate or association or body of individuals, whether incorporated or not, or artificial juridical person, group of farmers or cooperatives or panchayats or Farmer Producer Organizations (FPO) or Water User associations (WUA) or any legal body shall be eligible to participate in the bid for establishment of Solar Power Project for feeder level solarization under this RfP.

G.2. Qualification criteria:

- (a) **Net worth:** The entity shall have positive net worth of the last year as on 31-03-2022 or 31-12-2022.
- (b) **Additional requirement for participating in bid through JV Agreement:** The participation in the bid through Joint Venture (JV) is allowed with one of the members as a Lead Member. In case of JV, the positive net worth criteria shall be fulfilled by all the members of JV. Further, following requirements shall be ensured by JV:
 - i. The lead member shall be authorized to incur liabilities and receive instructions for and on behalf of any all members of the joint venture, and the execution of the contract, including making / receiving payment, shall be done exclusively with the lead member so authorized by JV entity.
 - ii. All members of the joint venture shall be liable and responsible jointly and severally for the execution of the contract in accordance with the contract terms.
 - iii. A copy of the agreement entered into by the joint venture members shall be submitted with the bid along with Undertaking as per Form-8, including inter alia delineation of role, responsibilities and obligations of each partners appended thereto, notwithstanding the joint and several liability of each members.
 - iv. The joint venture agreement should indicate precisely the responsibility of all members of JV in respect of planning, design, survey, supply, installation and commissioning of solar project and operation & maintenance of solar project along with evacuation line for PPA tenure of 25 years from commercial operation date of the project.
 - v. All members of JV should have active participation in execution of the contract. This should not be varied/modified subsequently without prior approval of UGVCL.
 - vi. In case of JV, an entity can submit bid through single JV only for the bid of respective sub-station. In case the entity is participating in more than one JV in the bid of respective sub-station, such bids will be rejected.

G.3. Document requirement:

- (a) Following documents shall be submitted in support of eligibility and qualification criteria at the time of bid submission: Bidders shall upload the scanned copy of the applicable document/s duly signed by the authorized person on bidding portal n-procure.

S. No.	Type of Entity	Documents Required
1.1.	Individual / Proprietorship firm	(a) PAN card (b) Income Tax Return (ITR) of FY 2021-22 or Chartered Accountant Certificate in support of positive Net worth (duly mentioning UDIN). (c) In case of Sole Proprietor– Duly notarized Undertaking from Sole proprietor to submit GST registration at the time of signing of PPA, if not processing
1.2.	Limited Liability Partnership (LLP) firm / partnership firm	(b) PAN card (c) In case of LLP – Copy of Registration Certificate and LLP Agreement (a) In case of Partnership – Copy of Deed of Partnership (b) Income Tax Return (ITR) of FY 2021-22 or Chartered Accountant Certificate in support of positive Net worth (duly mentioning UDIN).
1.3.	Company (Public / Private Limited)	(a) Copy of Registration / Incorporation Certificate (b) PAN card (c) Details of Directors of Company as on date of submission of bid duly certified by practicing Company Secretary (d) Chartered Accountant Certificate in support of positive Net worth (duly mentioning UDIN) along with by Annual Accounts of FY 2021-22 (as per Form-5)
1.4	Association / cooperatives / Farmer Producer Organizations (FPO) / Water User associations (WUA) etc	(a) Valid documents in support formation of Association / FPO /WUA / Cooperatives etc (b) PAN card (PAN card of lead member, if Pan card is not available in name of Association / FPO /WUA / Cooperatives etc) (c) Details of name of members of Association / FPO /WUA / Cooperatives etc (d) Chartered Accountant Certificate in support of positive Net worth (duly mentioning UDIN) (as per Form-5)
1.5	Joint Venture	(a) Copy of incorporation / registration in case of Special Purpose Vehicle or Copy of Deed of JV (b) Undertaking as per the format in Form-8 to be signed by all members (c) PAN Card of all JV members (d) Chartered Accountant Certificate in support of positive Net worth of all members of JV (duly mentioning UDIN) (as per Form-5)

G.4. Other Document / information to be submitted in the prescribed format:

The bidders are required to submit the following information in the form through online mode and required to upload the scanned copy of documents duly signed as mentioned against the form: -

Form-1	Bid Submission Letter with undertaking of RFP conditions by Bidder	Fill in the form details through on-line mode and also upload the scanned copy of requisite documents duly signed by the bidder on the n-procure portal
Form-2	Summary of Informations of the Bidding entity	
Form-3	Summary of offered Plant capacity for Substation and EMD details	
Form-4	Undertaking for producing GSTIN	
Form-5	Positive Network Certificate by CA	Upload the scanned copy of the applicable document/s duly signed by authorized person
Form-6	Power of Attorney in favour of Authorized Signatory (In Case of Bidder is Single Entity)	
Form-7	Power of Attorney in favour of Authorized Signatory (In Case Bidder is Joint Venture)	
Form-8	Undertaking by the Joint Venture Partners (In Case Bidder is Joint Venture)	

SECTION - H: SUBMISSION OF BIDS

ALL REQUIRED DOCUMENTES ARE TO BE SUBMITTED IN ONLINE MODE ONLY EXCEPT DOCUMENTS REQUIRED AGAINST PAYMENT OF TENDER FEE & EARNEST MONEY DEPOSIT (EMD)

H.1. Sale of RfS Document

- 1.1.1. RfS documents may be down loaded from web site [https:// UGVCL.nprocure.com](https://UGVCL.nprocure.com) (For view, down load and on line submission) and UGVCL's web sites www.UGVCL.com for view & down load only). (To view the PDF file please use "Acrobat Reader" software which can be downloaded from "Adobe "website.)

H.2. Local Conditions

- 2.1.1. It will be imperative on each Bidder to fully acquaint himself of all local conditions and factors which may have any effect / bearing on the execution of the works covered under this RfS Document. UGVCL, shall not entertain any request for clarifications from the Bidder, regarding such local conditions, post award of contract. It must be understood and agreed that such factors have properly been investigated and considered while submitting the Bid. No claim for financial adjustment to the contract awarded under this RfS Document will be entertained by the UGVCL as applicable. Neither any change in the time schedule of the contract nor any financial adjustments arising thereof shall be permitted by the UGVCL. The bidder may take visit the proposed location of plant to get acquainted with local conditions, if required.

H.3. Amendment of Bidding Document

- 3.1.1. At any time prior to the deadline for submission of the Bids, UGVCL may amend the RfS document by issuing Corrigendum/ Addenda.
- 3.1.2. Any Corrigendum/ Addendum issued shall be a part of the RfS document and shall be communicated on the Bidding Portal.
- 3.1.3. To give prospective Bidders reasonable time in which to take a Corrigendum /Addendum into account in preparing their Bids, UGVCL may, at its discretion, extend the deadline for the submission of the Bids.
- 3.1.4. Any change in date of submission and opening of bids would be published on Bidding portal.

At any time prior to the deadline for submission of offers, UGVCL may, at its own discretion modify /add/delete/change the provision of this RfS document by amendments.

The amendment will be notified on Website. UGVCL will bear no responsibility or liability arising out of noncompliance of the same in time or otherwise.

In order to afford the bidder, the reasonable time to take the amendment into account in preparing their offers, UGVCL may at its discretion, extend the deadline for the submission of offers.

Such amendments, clarification etc. shall be binding on the bidder and will be given due consideration by the bidder before they submit their offers and invariably enclose such documents as a part of the offer. All such amendments will be considered as part of RfS Document.

H.4. Submission of Tender Fee and EMD

- 4.1.1. The Bidder shall require to pay the tender fee as mentioned in the RFP Schedule. The tender fee can be paid either through RTGS/NEFT /DD/Banker's Cheque only of prescribed value towards the cost of tender fee as mentioned in the RFP Schedule. Payment of Tender Fee Can be accepted by RTGS/NEFT. In case of payment of amount through DD, it shall be in favor of UGVCL, payable at Mehsana.
- 4.1.2. The Bidder has to pay the Earnest Money Deposit (EMD) at Rs. 1 lakh per MW basis for offered capacity for respective sub-station. The EMD can be paid either by RTGS/NEFT or by submitting Demand Draft (DD) or through submitting Bank Guarantee (BG) in the prescribed format (enclosed as Form-9), on Non-Judicial Stamp Paper of Rs. 300/- separately for each bid for respective sub-station.
- 4.1.3. The bids without Payment of the Tender Fee or EMD shall be treated as non-responsive and shall be out rightly rejected.
- 4.1.4. The EMD shall be encashed by UGVCL in following cases:
- (i) If the bidder withdraws or varies the bid after due date and time of bid submission and during the validity of the bid;
 - (ii) The bidder fails to submit Performance Bank Guarantee after issuance of Letter of Award
 - (iii) The bidder fails to execute the PPA within the stipulated time period.
 - (iv) If after date of issue of Lol, it is found that the documents furnished by the bidder during RfS are misleading or misrepresented in any way and that relevant facts have been suppressed;
 - (v) If the bidder fails to submit letter of acceptance within 15 days from the date of issue of Letter of Intent, EMD shall be encashed by UGVCL as penalty.
- In case the bidder is not selected for capacity allocation, UGVCL shall release the EMD on closure of e-reverse auction/ procedure.

H.5. Submission of Bids

- 5.1.1. E-procurement system as mentioned in this RfS shall be followed for the bidding.
- 5.1.2. The Bidder would ensure that all the required documents, as mentioned in this RfS Document, are submitted on-line along with the Bid and in the prescribed format and manner only. Non-submission of the required documents or submission of the documents in different format/contents & different manner may lead to the rejections of the Bid submitted by the Bidder, without further correspondence.

H.6. Language of Bids

- 6.1.1. Bidders are required to furnish all information and documents as called for in this RfS document in **English Language**.

H.7. Submission of Technical Bid (Part 1)

- 7.1.1. The technical bid comprises of:

All required documents are to be submitted through online mode only.

'TECHNICAL BID' SHALL CONTAINS THE FOLLOWING ON-LINE DOCUMENTS with SELF CERTIFICATION:

The documents Supporting/ establishing the Techno-commercial eligibility criteria as mentioned in the SECTION-E (E3&E4) **are required to be submitted in online mode only.**

Scanned copies of all Forms duly signed and supporting documents for establishing eligibility of the bidder as mentioned in section: E :ELIGIBILITY And QUALIFICATION criteria required to be submitted in online mode only.

H.8. Submission of Price Bid:

- 8.1.1. Bidders shall quote fixed tariff in Rs. per kWh in the on-line price bid on n-procure for supply of contracted power generated from the proposed solar power plant under this feeder level Solarization scheme to UGVCL for 25 years (unless extended by both the parties on mutual agreement) from date of CoD (commercial operations date) at minimum 19% CUF.

Individual evaluation of price bid (tariff quoted) shall be carried out for the notified capacity of Solar plant mentioned against respective substation(s).

- 8.1.2. The tariff has to be quoted up to two places of decimal only. If it is quoted with more than two digits after decimal, it shall be ignored after first two decimal places. (For e.g. if the quoted tariff is INR 1.786 / kWh, then it shall be considered as INR 1.78 / kWh).
- 8.1.3. SPG to get CFA @ Rs. 1.05 Cr per MW subject to installation & commissioning of project in line with MNRE stipulated timeline and requirement. The release of CFA to the selected bidder shall be subjected to release of CFA from MNRE to UGVCL.

Further, the SPG shall give undertaking that he shall not sell power to any other buyer except the UGVCL under the agreement of this tender during the tenure of this PPA. At any point of time during the tenure of PPA, if it is found that the SPG has sold the solar power produce from the contracted solar plant strict legal action will be taken against the SPG, including stopped/black list, from Participation in future tender of MNRE in Gujarat & the SPG shall require to refund the proportionate CFA granted for the project by MNRE.

For the recovery of the Proportionate CFA, the CFA granted by MNRE for the project will be divided by 25 years to arrive at per year CFA. If any event of sell of power is found at a particular time, the amount to be recover from the SPG shall be the remaining of PPA after the event multiply by per year CFA.

The recovery of the proportionate CFA in case of default, will be made through the payments of invoices or through remedies taken in accordance with applicable laws. In case of any liquidation of assets of the solar power plants prior to completion of PPA period the first charge shall be towards recovery of the proportionate CFA granted to the project by MNRE.

- 8.1.4. The tariff for the Solar Project Capacity for which the bidder wants to participate (subject to minimum capacity of 0.5 MW & maximum upto notified capacity) of

respective substation shall be quoted in the on-line price bid schedule by the bidder on n-procure before scheduled due date and time for submission of financial bids.

8.1.5. Due intimation shall be given to technically and commercially cleared bidders about date and time of opening of prices bids on bidding portal.

8.1.6. If price offer is submitted in technical bid, such bids will be rejected in technical bid evaluation stage and will not be considered for further process to conclude the bid.

H.9. Cost of Bidding:

9.1.1. The Bidder shall bear all costs associated with the preparation and submission of its Bid, and UGVCL shall not be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process.

H.10. Alternative Bids:

10.1.1. Alternative bids shall NOT be considered at all and all such alternative bids shall be liable to be rejected.

H.11. Period of Validity of Bids:

11.1.1. Bids shall remain valid for 120 days from the date of opening of Technical Bid as prescribed by UGVCL. A Bid valid for a shorter period shall be rejected and treated as non-responsive.

11.1.2. In exceptional circumstances, UGVCL may solicit the Bidder's consent to an extension of the period of validity. The request and the responses thereto shall be made in writing.

H.12. Format and Signing of Bid

12.1.1. The bid forms/templates/annexure etc., wherever applicable, shall be typed or written in indelible ink and shall be signed (all the pages) by a person duly authorized by Bidder to sign, in token of acceptance of all the terms and conditions of the RfS Document. This authorization shall consist of a written confirmation in the form of Power of Attorney as specified in the RfS document and shall be attached to the bid.

12.1.2. Any amendments such as interlineations, erasures, or overwriting shall be valid, only if it is signed or initialled by the authorized person signing the bid.

12.1.3. The bid documents shall be properly checked before uploading for submission of Bids.

12.1.4. The bid, duly signed (digitally) by Auth. Signatory, shall be uploaded on the Bidding portal in respective file/ format.

12.1.5. Bidders must submit their bids through Bidding Portal. Bids received by another means except as desired in this RfS Document shall not be accepted.

12.1.6. If bids are not submitted as per the details mentioned in this RfS document and not submitted through Bidding Portal, shall be rejected.

12.1.7. Bidders are required to carefully go through the instructions included in the RfS Document and furnish complete information, necessary documents and schedules.

12.1.8. The Bidder shall sign the bid on each page and also at the specified location. Each and every paper enclosed must be given a page no. like 1,2,3,.....etc. & a bid summary must be enclosed along with covering letter on the Letter Head of the firm

in the following format:

Sr. No.	Particulars/brief of information/ schedule/ Annexure	Page No:
1.		
2.		
3		
.....		
	Total Page	

Signature of Authorized Signatory, Seal of Entity, Date and Place

H.13. Withdrawal, Substitution, and Modification of Bids

13.1.1. A Bidder may withdraw its bid or re-submit its bid (technical and/ or financial cover) as per the instructions/ procedure mentioned in Bidding Portal, but not after bid submission end date and time.

13.1.2. Bids withdrawn in terms of 13.1.1 above shall not be opened and processed further by UGVCL.

SECTION - I: BID OPENING & EVALUATION**I.1. Bid Opening**

- 1.1.1. UGVCL will first perform the preliminary bid opening for tender fee and Bid security. Technical bids of those bidders will be opened who are qualified in the preliminary bid. Preliminary & Technical bid opening, which is a critical event in the bidding process, shall be done online and physical mode on the stipulated date & time.
- 1.1.2. After opening of Bids and till final selection of successful Bidder, no correspondence of any type will be entertained, unless called for by UGVCL. Any type of uncalled for clarifications on prices and or rebates shall not be accepted.

I.2. Confidentiality

- 2.1.1. Information relating to the examination, evaluation, comparison, and post qualification of bids, and recommendation of contract award, shall not be disclosed to bidders or any other persons not officially concerned with such process until publication of the contract award.
- 2.1.2. Any attempt by a bidder to influence UGVCL or other officials in the examination, evaluation, comparison, and post qualification of the bids or Contract award decisions may result in the rejection of his bid.

I.3. Clarification of Bids

- 3.1.1. To assist in the examination, evaluation, comparison and qualification of the bids, the UGVCL may, at its discretion, ask any bidder for a clarification regarding its bid. The UGVCL's request for clarification and the response of the bidder shall be in writing.
- 3.1.2. Any clarification submitted by a bidder with regard to its bid that is not in response to a request by UGVCL shall not be considered.
- 3.1.3. No change in the prices or substance of the bid shall be sought, offered, or permitted, except to confirm the correction of arithmetic errors discovered by the committee in the evaluation of the financial bids.
- 3.1.4. No substantive change to qualification information or to a submission, including changes aimed at making an unqualified bidder, qualified or an unresponsive submission, responsive shall be sought, offered or permitted.
- 3.1.5. All communications generated under this rule shall be included in the record of the procurement proceedings.

I.4. Conflict of Interest

- 4.1.1. UGVCL considers a conflict of interest to be a situation in which a party has interests that could improperly influence that party's performance of official duties or responsibilities, contractual obligations, or compliance with applicable laws and regulations. In pursuance of UGVCL's procurement ethics, the bidders, suppliers, and contractors under contracts, observe the highest standard of ethics, UGVCL will take appropriate actions against the Bidder, if it determines that a conflict of interest has flawed the integrity of any procurement process. Consequently, all Bidders found to have a conflict of interest shall be disqualified.

- 4.1.2. Conflict of interest will be determined in accordance with provisions of GUVNL's Purchase Policy, which read as under:

Conflict of Interest among Bidders/ Agents:-

A bidder shall not have conflict of interest with other bidders for particular quoted item. Such conflict of interest can lead to anti-competitive practices to the detriment of Procuring Entity's interests. The bidder found to have a conflict of interest shall be disqualified. A bidder may be considered to have a conflict of interest with one or more parties in this bidding process for particular quoted item, if:

- a) they have proprietor/ partner(s)/ Director(s) in common; or*
- b) they receive or have received any direct or indirect subsidy/ financial stake from any of them; or*
- c) they have the same legal representative/ agent for purposes of this bid; or*
- d) they have relationship with each other, directly or through common third parties, that puts them in a position to have access to information about or influence on the bid of another bidder; or*
- e) Bidder participates in more than one bid in this bidding process. Participation by a bidder in more than one Bid will result in the disqualification of all bids in which the parties are involved. However, this does not limit the inclusion of the components/ sub-assembly/ assemblies from one bidding manufacturer in more than one bid.*
- f) In cases of agents quoting in offshore procurements, on behalf of their principal manufacturers, one agent cannot represent two manufacturers or quote on their behalf in a particular tender enquiry. One manufacturer can also authorize only one agent/ dealer. There can be only one bid from the following:*
 - 1. The principal manufacturer directly or through one Indian agent on his behalf; and*
 - 2. Indian/ foreign agent on behalf of only one principal.*
- g) A Bidder or any of its affiliates participated as a consultant in the preparation of the design or technical specifications of the contract that is the subject of the Bid;*
- h) In case of a holding company having more than one independently manufacturing units, or more than one unit having common business ownership/ management, only one unit should quote. Similar restrictions would apply to closely related sister companies. Bidders must proactively declare such sister/ common business/ management units in same/ similar line of business.*
- i) Bidder shall not act in contravention/ violation to the provisions of competition act, as amended from time to time.*

Every bidder should, at the time of submission of bid, give a declaration, that bidder shall not have conflict of interest with other bidders in the bidding of respective substation.

- 4.1.3. Further, it may be considered to be in a conflict of interest with one or more parties in the bidding process for given substation if:

- a) they have controlling shareholders in common for bid submitted for given substation; or

- b) it receives or have received any direct or indirect subsidy from any of them; or
- c) they have the same legal representative for purposes of the Bid; or
- d) they have a relationship with each other, directly or through common third parties, that puts them in a position to have access to information about or influence on the Bid of another Bidder, or influence the decisions of UGVCL regarding this bidding process.

I.5. Technical Bid opening and evaluation (Step-1):

- 5.1.1. Technical Bid submitted online mode of only those bidders will be opened by UGVCL who are qualified in the preliminary bid. Documents received after the bid submission deadline, shall be rejected and returned unopened when called for, if super-scribed properly with address, to the bidder. Onlinesubmitted technical bid of such bidders shall not be opened.
- 5.1.2. If the above highlighted documents are received in order and as per the schedule, UGVCL will examine all the documents submitted by the Bidders and ascertain meeting of eligibility conditions prescribed in the RfS. During the examination of the bids, UGVCL may seek clarifications/ additional documents to the documents submitted etc. from the Bidders if required to satisfy themselves for meeting the eligibility conditions by the Bidders. Bidders shall be required to respond to any clarifications/ additional documents sought by UGVCL within the stipulated timeline. All correspondence in this regard shall be made through email / bidding portal. It shall be the responsibility of the Bidder to ensure that the email id of the authorized signatory of the Bidder is functional. It shall be the sole responsibility of the Bidders to remove all the discrepancies and furnish additional documents as requested. UGVCL shall not be responsible for rejection of any bid on account of the above.
- 5.1.3. The response to RfS submitted by the Bidder shall be scrutinized to establish Techno-commercial eligibility as per RfS.
- 5.1.4. However, it may be noted that if only one or two Bidder(s) is /are eligible for the next stage and/or aggregate quoted capacity is lower than notified capacity for respective substation , opening of the financial bid of the Bidder(s) will be at the discretion of UGVCL. Thereafter, UGVCL will take appropriate action as deemed fit.
- 5.1.5. Bids having following characteristics shall be considered non-responsive and shall be liable for disqualification/rejection:-
 - a) Bid is not received by the due date & time and Bids is not accompanied with the required documents & schedules.
 - b) Bid not submitted in accordance with RfS document.
 - c) Bid do not meet the minimum eligibility criteria as mentioned in the bidding document.
 - d) Bids is not accompanied by Bid Security Declaration /Cost of Tender Document /
 - e) Conditional Bid is submitted.
 - f) Proposal for bid validity is less than 120 days from the date of opening of online Technical Bid.

- g) During validity of the Bid or its extended period, if any, Bidder increases his quoted prices.
- h) Desired certificates in the required formats in the RfS not attached by the bidder.
- i) Prices not quoted in prescribed Performa /schedule.
- j) Bidder has made misleading or false representations in the forms, statements and attachments submitted in proof of the eligibility requirements.
- k) Bidder failed to provide clarifications related thereto, when sought.
- l) Bidder has submitted more than one bid for given substation. This will cause disqualification of all Bids submitted by such Bidders for respective substation including forfeiture of the Bid Security.
- m) Bidder who is found to canvass, influence or attempt to influence in any manner for the qualification or selection process, including without limitation, by offering bribes or other illegal gratification shall be disqualified from the process at any stage.
- n) Bid is not meeting any other pre-requisite as spelt out elsewhere in this document.

I.6. Financial Bid Opening:

- 6.1.1. Evaluation committee of UGVCL shall refer the evaluation report to the Competent Authority of UGVCL, which reserves the right to reject any Bid which is nonresponsive and no request for alteration, modification, substitution or withdrawal shall be entertained by UGVCL in respect of such Bids.
- 6.1.2. The Price Bid shall be kept unopened and shall be opened later individually for plant/Location on the date and time intimated to the bidders who qualify in the evaluation of technical bids.
- 6.1.3. The Bidders which could not qualify in technical evaluation will be informed about this fact. Their financial bid will be remain unopened for such Bidders.

I.7. Financial Evaluation:

7.1 Financial Bid Evaluation (Step-2):

In this step evaluations shall be done based on the "Tariff" quoted by the bidders in the Electronic Form of Financial Bid (On-line Price –bid). After this step, the shortlisted bidders shall be invited for the Reverse Auction.

- i) For evaluation in Step-2, the Price-bid (containing Tariff) of only those bidders shall be opened whose techno-commercial bids are found to be qualified.
- ii) The bidders will have to submit bid single bid for respective sub-station quoting tariff per kWh for the project. Tariff can be quoted up to two places of decimal only.
- iii) In this step, evaluation will be carried out based on tariff quoted by the Bidders.
- iv) On completion of Techno-commercial bid evaluation, if it is found that the total aggregate capacity of the Solar Power Projects short-listed is lower than or equal to notified solar project capacity OR there is only single / two shortlisted bidder(s) for respective sub-station, the UGVCL reserve its right to take appropriate actions.

Note: On completion of Techno-commercial bid evaluation, if it is found that only one / two bidder (s) is eligible OR aggregate capacity of the Solar Power Projects short-listed is lower than or equal to notified solar project capacity for respective sub-station, the opening of the financial bid of the bidder (s) will be at the discretion of UGVCL.

- v) If the first-round tariff quoted is same for two or more bidders for respective sub-station, then all the bidders with same tariff shall be considered of equal rank / standing in the order.
- vi) Ranking of bidders after Financial Bid Evaluation (but before e-reverse auction): The ranking of bidders shall be done in the ascending order of tariff quoted in Rs per kWh.
- vii) The bidder (s) who have quoted highest tariff for respective sub-station shall be considered as H1 Bidder.
- viii) The H1 bidder (s) shall be disqualified for participating in e-reverse bidding for respective sub-station subject to condition that after excluding H1 bidder (s), the remaining bidders are 5 nos or more and the aggregate project capacity of remaining bidders shall be more than or equal to twice the notified capacity of solar project.
- ix) For example: based on the price bid submitted by bidders, their ranking shall be as under:

Bidder	Submitted Financial bid	Ranking
B8	Rs. 1.00 (Tariff in Rs./ kWh)	L1
B5	Rs. 1.70 (Tariff in Rs./ kWh)	L2
B1	Rs. 1.80 (Tariff in Rs./ kWh)	L3
B4	Rs. 1.80 (Tariff in Rs./ kWh)	L3
B2	Rs. 2.00 (Tariff in Rs./ kWh)	L4
B3	Rs. 2.30 (Tariff in Rs./ kWh)	L5
B7	Rs. 2.40 (Tariff in Rs./ kWh)	L6
B6	Rs. 2.45 (Tariff in Rs./ kWh)	L7
B10	Rs. 2.50 (Tariff in Rs./ kWh)	L8
B9	Rs. 2.55 (Tariff in Rs./ kWh)	H1
B11	Rs. 2.55 (Tariff in Rs./ kWh)	H1

7.2 Reverse Auction (Step-3)

Shortlisted bidders for Reverse Auction will be able to login into <https://e-auction.nprocure.com/> for reverse auction 15 minutes before the start time of reverse auction.

- i) During 15 minutes prior to start of reverse auction process, the respective tariff

along with the total project capacity of the bidder for respective sub-station shall be displayed on its window.

- ii) The minimum decrement value for tariff shall be ₹ 0.01 per kWh. The bidder can mention its revised tariff which has to be at least 01 (one) paisa less than its current tariff.
- iii) Bidders can only quote any value lower than their previous quoted tariff taking into consideration of the minimum decrement value mentioned in previous Section. However, at any stage, increase in tariff will not be permissible. Bidders can improve their ranking by quoting the tariff lower than their last quoted tariff.
- iv) During Reverse Auction, the bidder shall not have the option of changing the total project capacity while quoting tariff during reverse auction.
- v) In the bidder's bidding window, the following information can be viewed by the bidder:
 1. Its tariff as their initial start price and there after last quoted tariff along with project capacity bided by the bidder;
 2. The list of all the bidders with their following details:
Pseudo Identity, last quoted tariff and bided capacity
- vi) The initial auction period will be of 30 (thirty) minutes with a provision of auto extension by 5 (five) minutes from the scheduled/ extended closing time. Such auto extension shall be effected if by way of reduction in tariff, a Bidder causes a change in its zonal placement at that instant. The 'zones' are as defined below:
 - (a) Green Zone: This zone consists of the Bidders who may be allocated their full quoted Project capacity if the auction is closed at that instant.
 - (b) Yellow Zone: This zone consists of the Bidders who may be allocated a part of their full quoted Project capacity if the auction is closed at that instant.
 - (c) Red Zone: This zone consists of the Bidders who will not be awarded their quoted Project capacity if the auction is closed at that instant.

If no such change as described above is effected during the last 5 minutes of auction period or extended auction period, then the reverse auction process will automatically get closed

7.3 Selection of Successful Bidders and capacity allocation

- 7.3.1 The lowest quoting bidder in e-reverse auction will be allotted full bided capacity and then, next higher bidder will be allotted it's bided capacity and so on, till the total capacity i.e. notified capacity for respective sub-station is exhausted.
- 7.3.2 In case of the last selected bidder, if the balance project capacity is less than the notified project capacity mentioned by such bidder, then the balance capacity shall be awarded to the bidder till the total notified capacity is exhausted subject to a

minimum allocation of 0.5 MW. Provided that, in case of allocation partial capacity (i.e. balance capacity till the total notified capacity is exhausted) offered to the last Bidder after completion of the e-reverse auction is lower than 50% of the total quoted capacity by such Bidder, the Bidder shall have an option to refuse such offered partial capacity within 7 days of issuance of Letter of Intent and the BG against EMD submitted by such Bidder shall be returned along with those of the unsuccessful Bidders

Further, in case the partial capacity offered is greater than or equal to 50% of the total quoted capacity by such Bidder, then it shall be mandatory for the last Bidder to accept such partial capacity offered against its quoted capacity, subject to the total cumulative capacity awarded after e-RA to the successful Bidders not exceeding notified capacity for respective sub-station. In case the last Bidder refuses to accept such partial capacity offered by UGVCL, the Bank Guarantee against EMD submitted by such Bidder shall be encashed by UGVCL.

7.3.3 In case of tie, among two or more bidders (i.e. their last quoted tariff being the same) they will be considered in the chronological order of their last bid with preference to that bidder who has quoted his last bid earlier than others.

7.3.4 In the above case (as mentioned in previous Section), if the time of quote also becomes exactly same among the bidders at a tie, then the ranking among these bidders shall be done as follow:

Step – 1: Lowest rank will be given to the bidder who has quoted the lowest in Financial Bid (Electronic Form) and so on. If there is also a tie among any of these bidders, then the following step (Step 2) will be followed.

Step – 2: Ranking will be done based on draw of lots.

7.3.5 At the end of selection process, UGVCL will have right to decide on the issuance of Lol to the Successful Bidders or any of them based on consideration of price discovered. In case of JV as Successful Bidder, the issuance of Lol shall be to the Lead Member of the JV.

In all cases, UGVCL's decision regarding selection of bidder through Reverse Auction or otherwise based on tariff or annulment of tender process shall be final and binding on all participating bidders.

Also, UGVCL reserves the right to short close the capacity lower than notified capacity at its discretion, if the discovered price is abruptly high.

I.8. Negotiations

8.1.1. Except in case of procurement by method of single source procurement or procurement by competitive negotiations, to the extent possible, no negotiations shall be conducted after the pre-bid stage. All clarifications needed to be sought shall

be sought in the pre-bid stage itself.

- 8.1.2. The Competent Committee appointed by UGVCL shall have full powers to undertake negotiations. Detailed reasons and results of negotiations shall be recorded in the proceedings.
- 8.1.3. Negotiations shall not make the original offer made by the bidder inoperative. The Competent Committee shall have option to consider the original offer in case the bidder decides to increase tariff originally quoted or imposes any new terms or conditions.
- 8.1.4. **In case of non-satisfactory achievement of tariff from single bidder, the Competent Committee may choose to make a written counter offer to the single bidder and LOA be awarded to the bidder if he accepts the counter-offer.**
- 8.1.5. In case the tariff even after the negotiation is considered very high, fresh bids shall be invited.

I.9. Right to Reject by UGVCL

- 9.1.1. UGVCL reserves the right to accept or reject any bid, and to annul the bidding process and reject all bids at any time prior to award of contract, without thereby incurring any liability to the affected Bidder or bidders or any obligation to inform the affected Bidder or bidders of the grounds for UGVCL's action.

SECTION - J: AWARD OF CONTRACT**J.1. Letter of Intent (LOI)**

- 1.1.1. A Letter of Intent (LOI) will be issued to the Successful bidders after completion of the selection process under financial bid evaluation as per clause G7 of this Rfp.
- 1.1.2. The successful bidders shall be asked to submit the Letter of acceptance from 7 days from date of issue of Letter of Intent by UGVCL

J.2. GERC approval

- 2.1.1. UGVCL will file the tariff petition before the Hon'ble GERC for adoption of the discovered tariff after completion of the competitive bidding process followed by e-reverse auction and negotiation, if any.
- 2.1.2. The bidders should note that further processing i.e. signing of PPA will be done with the successful bidder only after adoption of tariff by GERC.

J.3. Performance Bank Guarantee

- 3.1.1. The successful bidder shall be required to furnish Performance Bank Guarantee of 5 lakhs per MW basis within **7 days** from the date of issue of Letter of Award. The Performance bank guarantee shall be returned after 2 months of commissioning of the project. The PBG shall be initially valid from the date of issue until 2 months (i.e. sixty (60) days) beyond scheduled commercial operation date. It shall be responsibility of selected bidder to get the PBG extended, if required, such that it is valid till 2 months after date of commissioning of project
- 3.1.2. The Performance Bank Guarantee shall be in the Form of unconditional Bank Guarantee as per the Form 10 in favour of "The Chief Engineer (P&P), UGVCL, Mehsana" and to be submitted at the office of The Chief Engineer (P&P), UGVCL, Mehsana. The PBG shall be issued by Scheduled / Nationalized Banks (in a standard format prescribed by UGVCL) as notified vide finance department of Govt. of Gujarat GR no.: EMD/4/2022/0002/DMO dated 20/05/22 and further amendments if any. CORPORATE GUARANTEES NOT ALLOWED.
- 3.1.3. In case the selected bidder is a Joint Venture, the Bank Guarantees for performance bank guarantee shall be submitted in the name of all the partner(s) of the Joint Venture "OR" in the name of Lead/other Partner in the Joint Venture submitting the bid.

J.4. Forfeiture of Performance bank guarantee:

- 4.1.1. The Performance Bank Guarantee shall be encased by UGVCL in case delay/default in commissioning of Solar Power Projected beyond Scheduled Commercial operation Date SCOD subject to Terms and Conditions of the PPA.
- 4.1.2. No interest will be paid by UGVCL on the amount of Performance bank guarantee.

J.5. Signing of PPA:

- 5.1.1. After approval of the GERC for the adoption of the tariff the Letter of Award (LOA) will be placed to the successful bidder for the allocation of solar capacity for respective 66kV substation.

- 5.1.2. Power Purchase Agreement (PPA) as per the enclosed format of PPA in **Annexure-2** on a non-judicial stamp of Gujarat State of value worth Rs. 300/- shall be signed within 15 days from the date of issuance of LOA by UGVCL with the SPG subject to submission of PBG. The PPA shall be valid for a period of 25 years from COD as per provisions of PPA. Any extension of the PPA period beyond 25 years shall be through mutual agreement between the SPG and UGVCL.
- 5.1.3. Further, the SPG shall submit the final land documents at the time of commissioning of the project for the entire required land.
- 5.1.4. If the bidder, whose bid has been accepted, fails to furnish the required PBG or fails to sign a PPA within specified period, UGVCL shall take action against such bidder. UGVCL will forfeit the EMD submitted by bidder and may allocate capacity to next bidder or may cancel the tender process if deemed fit.

J.6. Reservation of Rights

- 6.1.1. To take care of unexpected circumstances, UGVCL shall reserve the rights for the following:
- a) Extend the closing date for submission of the bids.
 - b) Amend the bidding requirements at any time prior to the closing date, with the amendment being notified to prospective bidders.
 - c) Seek information from or negotiate with single bidder
 - d) Discontinue negotiations at any time with any bidder.
 - e) Allow a bidder to change its Technical proposal if the same opportunity is given to all bidders.
 - f) Terminate or abandon the Tender procedure or the entire Project whether before or after the receipt of Bids.
 - g) Make enquiries of any person, company or organization to ascertain information regarding the bidder and its Bid.
 - h) Reproduce for the purposes of the procedure the whole or any portion of the Bid despite any copyright or other intellectual property right that may subsist in the Bid.

SECTION - K: BILLING AND PAYMENT CONDITIONS

The conditions related to billing and payments shall be governed as per the Article 10 of PPA

SECTION - L: OTHER TERMS AND CONDITIONS**L.1. Jurisdiction of Contract**

- 1.1.1. The laws applicable to the Contract shall be the Laws in force in India. The court at Mehsana District i.e. city where the Corporate Office of UGVCL is situated shall have exclusive jurisdiction in all matters arising under this contract.

L.2. Change in Laws & Regulations

- 2.1.1. Change in Law conditions shall be applicable as mentioned in the Power Purchase Agreement
- 2.1.2. In addition to the receipt of applicable CFA from MNRE for the SPV plant, the Bidders will be free to avail fiscal incentives like Accelerated Depreciation, Concessional custom and Excise Duties, Tax Holidays etc. if available for such Projects. The same will not have any bearing on comparison of bids for selection. As equal opportunity is being provided to all bidders at the time of tendering itself, it is up to the bidders to avail various tax and other benefits. No claim shall arise on UGVCL for any liability if bidders are not able to avail any available fiscal incentives and this will not have any bearing on the applicable tariff.
- 2.1.3. If the Project is transferred or sold to a third party during its tenure (after initial lock in period of 1 year after COD), UGVCL will retain full rights to operationalize the PPA with the third party, which will be under full obligation to honor all the obligations and terms & conditions of the PPA.

L.3. Min. Generation Guarantee

- 3.1.1. The Selected bidder shall provide a minimum generation guarantee corresponding to a capacity utilization factor (CUF) of 19% (the "Guaranteed CUF") with respect to the AC capacity of the PV system.
- 3.1.2. This Guaranteed CUF shall be calculated on an annual-basis and shall be verified by UGVCL at the end of each year during the 25 (twenty-five) years operation period or any extension thereof on mutual agreement.
- 3.1.3. **There shall be no year-on-year reduction on the Guaranteed CUF during the 25 (twenty-five) year's period.**

L.4. Other Key Responsibilities**4.1.1. MNRE/ UGVCL Inspection & Reporting**

- a) The Ministry officials or designated agency may inspect the ongoing installation or installed plants. In case the installed systems are not as per standards, non-functional on account of poor quality of installation, or non-compliance of AMC, the Ministry reserves the right to blacklist the selected bidder. Blacklisting may inter-alia include the following:

- i) The SPG will not be eligible to participate in tenders for Government supported projects.
- ii) In case, the concerned Director(s) of the SPG joins another existing or starts/ joins a new firm/company, the company will automatically be blacklisted.
- b) The SPG shall be responsible for providing daily / weekly / monthly or customized information regarding progress of projects required by UGVCL / MNRE, online or in hard copy. For which the SPG is also responsible for maintaining online & off-line records.
- c) Assist UGVCL with a real-time monitoring dedicated web-portal (SEDM).

L.5. Code of Integrity

5.1.1. All the officers or employees of UGVCL shall:

- a) maintain an unimpeachable standard of integrity both inside and outside their office
- b) act in accordance with the provisions of the Act, these rules, guidelines issued under the Act and instructions
- c) not allow any bidders to have access to information on a particular procurement, before such information is available to the public at large
- d) not intentionally use unnecessarily restrictive or "tailored" specifications, terms of reference or statements of work that can discourage competition
- e) not solicit or accept any bribe, reward or gift or any material benefit of any directly or indirectly promise of future employment from anyone, who has sought or is seeking procurement from UGVCL.
- f) not have a financial interest in any bidder(s) responding to UGVCL's bidding process and any person having financial interest in any bidder shall not participate in this tender process
- g) not disclose proprietary and source selection information, directly or indirectly, to any person other than a person authorised to receive such information
- h) treat all bidders in a fair and equitable manner in line with the principle of fairness, integrity and transparency in the procurement process
- i) provide all bidders identical information at the same time, during the bidding process;
- j) apply the same criteria of evaluation as specified in the bidding documents, bidder registration documents or pre-qualification documents and under no circumstances new evaluation criteria shall be introduced during the evaluation process
- k) not entertain any favour, recreation, presents, services, etc. from the bidders or prospective bidders
- l) protect the interests of the UGVCL under all circumstances while dealing with information and information sources
- m) maintain confidentiality of all bids
- n) ensure that the selection of bidder is as per the RfS document and is not

influenced by personal reasons attributable to concerned officials in any manner

- o) Disclose conflict of interest, if any.

5.1.2. Any Bidder participating in Tender process shall:

- a) not offer any bribe, reward or gift or any material benefit either directly or indirectly in exchange for an unfair advantage in procurement process or to otherwise influence the procurement process
- b) not misrepresent or omit information that misleads or attempts to mislead so as to obtain a financial or other benefit or avoid an obligation
- c) not indulge in any collusion, bid rigging or anticompetitive behaviour to impair the transparency, fairness and progress of the Tender process
- d) not misuse any information shared between UGVCL and the bidders with an intent to gain unfair advantage in the Tender process
- e) not indulge in any coercion including impairing or harming or threatening to do the same, directly or indirectly, to any party or to its property to influence the Tender process;
- f) not obstruct any investigation or audit of a Tender process
- g) disclose conflict of interest, if any; and
- h) disclose any previous transgressions with any entity in India or any other country during the last three years or any debarment by any other procuring entity.

L.6. Breach of code of integrity by the bidder

- 6.1.1. In case of breach of any provision of the code of integrity by a bidder or prospective bidder, as the case may be, UGVCL may take appropriate action in accordance with the provisions.

L.7. Vexatious Appeals & Complaints

- 7.1.1. Whoever intentionally files any vexatious, frivolous or malicious appeal or complaint with the intention of delaying or defeating any procurement or causing Loss to UGVCL or any other bidder, shall be punished with fine as per the laws of land.

SECTION - M:**UGVCL Bank Details:**

UGVCL's Bank Details for issuance of Bank Guarantee through SFMS platform towards EMD/PBG/SD etc.

Name of Company-Uttar Gujarat Vij Company Ltd. Bank

Name:-Bank of Baroda Account Number:-01520500013524

IFS code-BARB0MEHSAN (FIFTH letter is ZERO)

Type of Account-Cash

Price Bid Format

The bidder shall require to quote their tariff in the on-line price bid on n-procure.

ANNEXURE- 1

Communication Architecture between RMS and State Level Server

-----Separately attached-----

ANNEXURE- 2

Draft Power Purchase Agreement (PPA)

-----Separately attached-----

ANNEXURE- 3

List of substation wise notified Solar Power Plants capacity with detils viz:, Name of

-----Separately attached-----

Form-1: Bid Submission Letter with Undertaking of RFP Conditions

The Bidder is required to upload scanned copy of this document on their letter head duly filled and signed with company Seal

From

(Full name of Bidder / Lead Member of JV)

Address of the Organization.....

Name of Authorized Signatory:

Designation:

Email ID:

Phone / Mobile No.:

To:

**The Chief Engineer (P&P),
Uttar Gujarat Vij Company Ltd.,
Regd. & Corporate Office,
Visnagar road,
MEHSANA-384001, (Gujarat)**

Sub: Bid towards Request for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode

Ref: NIT No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42

Dear Sir,

In connection with the above subject, I / We confirm the following:

1. I/We, the undersigned.....[insert name of the 'Bidder'] having read, examined and understood in detail the RfS document issued vide above referenced NIT, hereby submit our "Bid" in full compliance with terms & conditions of RfS document. A copy of the RfS document, duly signed on each page is also submitted as a proof of our acceptance of all specifications as well as terms/ Conditions. I/ We have submitted the Bid in electronic form on ON-LINE mode at the Bidding Portal mentioned in the RfS document.
2. [Insert this clause in case JV] I/We are submitted our Bid in form of Joint Venture, whereby M/s..... is the Lead Member and Partner, M/s..... is the other JV Partner. We have enclosed the Joint Deed of Undertaking executed by us in our Bid as per the requirement mentioned in the RfS document.
3. I/We have selected Mr....., as our Authorized Signatory in our Bid. We have enclosed the Power of Attorney (POA) executed in favour of Authorized Signatory in our Bid as per the requirement mentioned in the RfS document.
4. I/We have paid the requisite amount of EMD. I/we understand that without payment of the EMD by us, our offer shall out rightly be rejected. If, I/we are selected and shortlisted for as successful Bidder, we agree pay the required Performance bank

guarantee as per the terms & conditions mentioned in the RfS document. I/We understand that I/we shall not be awarded the Contract if we fail to pay the Performance bank guarantee in stipulated time.

5. I/We agree to treat the RfS document and other records connected with the Scope of Work as secret and confidential documents and shall not communicate information described therein to any person other than the person authorized by you or use the information in any manner prejudicial to the safety requirement.
6. I/We understand that you are not bound to accept the lowest or any bid you may receive.
7. I/ We are participating, as Bidders, in not more than one Bid in this Bidding process.
8. I / We declare that our Bid is strictly in line with RfS document Specification and there is no deviation. Further, I/We also agree that additional conditions / deviations, if any, found in our Bid, the Bid shall be outrightly rejected without assigning any reason thereof. We shall ensure that we execute such Bid documents as per the provisions of the NIT and provisions of such RfS document shall be binding on us. I/We confirm that we have not taken any deviation so as to be deemed non- responsive.
9. I/We hereby unconditionally and irrevocably agree and accept that the decision made by UGVCL in respect of any matter regarding or arising out of the Bid submitted by us/ RfS document issued by UGVCL shall be binding on us. We hereby expressly waive any and all claims in respect of Bid process.
10. I/ We confirm that there are no litigations or disputes against us, which materially affect our ability to fulfil our obligations with regard to execution of Project mentioned in the RfS document.
11. I / We hereby submit our Bid and undertake to keep our Bid valid for a period of 120 days from the date of opening of Technical Bid. I / We hereby further undertake that during the said period, I / We shall not vary/alter or revoke my/ our Bid.
12. I/We also agree to abide by and fulfil all the terms, conditions and provisions of the above mentioned RfS document, including .
13. I/We also agree to abide and hereby confirm and agree all the terms and condition by on-line mode only, the RfS documents along with all **Annexures 1 to 3 and form 1 to 10 as applicable**, including draft Power Purchase Agreement, RMS Communication and Security Architecture-PM KUSUM SEDM Platform, etc. documents attached herewith as a part of the whole on line tender. By confirming this, I/We also confirm all the amendments thereafter issued time to time and will be automatically binding to us.
14. I/We also agree to abide and hereby confirm and agree that all uploaded documents are copy of original documents. By submission of these documents on-line, I/We hereby agree that all such uploaded soft copy documents on the bidding platform as authentic, legal and will be binding to us.
15. We hereby declare that, we are in complete compliance of clause of Conflict of interest as per RfS Document.
16. we hereby confirm that except as mentioned in the Declaration Regarding Alternative, Deviations and Exceptions to the Provisions hereof and/or the Covering Letter, forming part of our Bid:

- (i) There are no discrepancies/inconsistencies and deviations/omissions/ reservations to the RfS document, in the price bid;
- (ii) The description of items and the unit thereof in the price schedules are in conformity with those indicated in the price schedule of the RfS document without any deviation to the specified scope of work.

We also confirm that in case any discrepancies/ inconsistencies and deviations/ omissions/ reservations, as referred to in para (i) and (ii) above, is observed in the online price bid, the same shall be deemed as withdrawn/rectified without any financial implication, whatsoever to UGVCL

I / We hereby declare that presently our Company/Limited Liability Partnership/ Partnership Firm/ Sole Proprietorship is not insolvent, not in receivership, not bankrupt or wound up, not have affairs administered by a court or a judicial officer, not have business activities suspended.

I / We further declare that presently our Company/Limited Liability Partnership/ Partnership Firm/ Sole Proprietorship is not blacklisted or debarred by any utility / government agency, and not have a conflict of interest.

If this declaration is found to be incorrect then without prejudice to any other action that may be taken, our security may be forfeited in full and the tender if any to the extent accepted may be cancelled.

Enclosed:

1. Form-2: Summary Details of Bidder/ JV Partners

(Signature & Seal of Authorized Signatory for which POA attached)

Name of Authorized Signatory:

Designation:

Date:

Place:

Form-2 Summary Details of Bidder

The Bidder (in case of JV for each individual members) is required to upload scanned copy of this document duly filled and signed on their letter head with company Seal

In Response to NIT No:	UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42
------------------------	--

S. No.	Information:	Details:
1.	Name of Bidder:	
2.	Bidding entity:	(JV / Sole Bidder)
3.	JV partners: (Not applicable for Sole Bidder)	1. Lead Member: 2. Other Partner:
4.	Registration status:	(Company/ LLP/ Partnership/ Sole Proprietor)
5.	Registration Number:	
6.	GST Registration Number:	
7.	PAN No:	
8.	Key Contact details:	Name: Email id: Mobile no.:
9.	Registered office details:	Address: Phone no.: Email ids:
10.	Other Branch offices in India:	
	(i)	Address: Phone no.: Email ids:
	(ii)	Address: Phone no.: Email ids:
11.	Details of firm's Directors:	
	(i) <Name of director>	Designation: Address: Mobile Number: Email ID:
	(ii) <Name of director>	Designation: Address: Mobile Number: Email ID:
	(iii) <Name of director>	Designation: Address: Mobile Number: Email ID:

(iv) <Name of director>	Designation: Address: Mobile Number: Email ID:
-------------------------	---

(Signature & Seal of Authorized Signatory for which POA attached)

Name of Authorized Signatory:

Designation:

Date:

Place:

Form-3 Summary of Sub-Station wise capacity bidded and EMD Detail

In Response to NIT No:	UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42
------------------------	--

Name of Bidder:-

Name of JV Partners, if bid is submitted through JV :-

Name of Bidder's contact Person:-

Bidder's contact Person mobile No:

Email ID of Bidder:

GST No of Bidder:

Please mention details as under in respect of all plants for which, bidder have submitted his bids.

Sr. No.	Bid No. (Plant Number) UG-SS-FLS-	Name of Sub station	Notified Plant Capacity as per Annexure-3	Offered plant Capacity by the bidder (MW)	Mode of Payment (Online/DD/BG)	EMD Amount in Rs. (Rs 1Lakhs /MW basis)	BG/DD/ On line mode payment Number	Date	Date upto which, BG is valid.
1									
2									
3									

(Signature & Seal of Authorized Signatory for which POA attached)

Name of Authorized Signatory:

Designation:

on: Date:

Place:

FORM-4 Undertaking for producing GSTIN

(On Non-Judicial Stamp Paper of Rs. 300/- attested by Notary Public/ First Class Magistrate) (In case of JV the undertaking is to be provided by the Authorized Signature Member of the Joint Venture)

The Bidder is required to submit this document On-line ONLY

To
The Chief Engineer (P&P),
Uttar Gujarat Vij Company Ltd.,
Regd. & Corporate Office,
Visnagar road,
MEHSANA-384001, (Gujarat)

Sub: Undertaking for GST towards Request for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode

Ref: NIT No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42

Dear Sir,

In connection with the above subject, I / We confirm the following:

(Please select (Tick mark) out of the following)

☐

(1) I/We have the GSTIN Number which is as under:-

GSTIN Number of the Bidder is _____

☐

(2) I/We do not possess the GSTIN number at present, Therefore, by this undertaking that I/We assure you that I/We shall produce the GSTIN Number at the time of signing of PPA. I/We understood that if I/we failed to produce the GSTIN number at the time of Signing of PPA, our Order is shall be cancelled, PPA can not be executed and PBG will be forfeited.

(Signature & Seal of Authorized Signatory for which POA

attached)Name of Authorized Signatory:

Designation:Date:

Place:

FORM- 5- Positive Net-worth Certificate of Bidder

(On Letterhead of CA for the bidder (Bidder/ Lead Member/ Other Member) for which the below details are provided. In Case of JV the following format is to be provided by Each Member of the Joint Venture separately).

The Bidder is required to upload **scanned copy in on-line Mode.**

Financial Qualification Certificate for Positive Net worth

In Response to NIT No:	UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42
------------------------	--

TO WHOMSOEVER IT MAY CONCERN

We have verified the books of accounts and related record of M/s. _____ situated at _____ Address _____ of the factory/firm> _____

and on verification of the records, we hereby certify that **Net-worth** of this mentioned entity/firm as on **31-03-2022*** / **31-12-2022*** is **POSITIVE**.

(* Keep one date and strike out the other date)

(Signature & Seal of Authorized Signatory for which POA attached)

Name of Authorized Signatory:

Designation:

Date:

Place:

Note:

1. In addition to above certificate from Chartered Accountant, Bidder is required to submit firm's annual audited Balance sheet and Profit & Loss statement for last years.
2. In case of JV, the form shall also be signed by respective entity's authorized signatory along with Authorized Signatory for which POA is attached.

(Signature & Seal of Practicing Chartered Account)

Certifying Chartered Accountant:

Name of Firm:

UDIN No:

Date:

Place:

Form-6 Power of Attorney in favour of Authorized Signatory

(In Case of Bidder is Single Entity)

{On Non-Judicial Stamp Paper of Rs. 300/- attested by Notary Public/ First Class Magistrate}

The Bidder is required to upload scanned copy of the Power of Attorney in the Format as per the applicable Law.

Form-7 : Power of Attorney in favour of Authorized Signatory (In Case Bidder is Joint Venture)

{On Non-Judicial Stamp Paper of Rs. 300/- attested by Notary Public/ First Class Magistrate}
The Bidder is required to upload scanned copy of this document duly filled and signed with company Seal

KNOW ALL MEN BY THESE PRESENTS THAT WE, the Partners whose details are given hereunder

..... have formed a Joint Venture under the laws of and having our Registered Office(s) / Head Office(s) at (hereinafter called the 'Joint Venture' which expression shall unless repugnant to the context or meaning thereof, include its successors, administrators and assigns) acting through M/s

..... being the Partner in-charge do hereby constitute, nominate and appoint M/s.....

a Company incorporated under the laws of and having its Registered/Head Office at as our duly constituted lawful Attorney (hereinafter called "Attorney" or "Authorised Representative" or "Partner In-charge") to exercise all or any of the powers for and on behalf of the Joint Venture in regard to "Bid Specification". **Request for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode, under NIT No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42, for which bids have been invited by Uttar Gujarat Vij Company Limited("UGVCL") undertake the following acts:**

- i. To submit proposal and participate in the aforesaid Bid Specification of UGVCL on behalf of the "Joint Venture".
- ii. To negotiate with UGVCL the terms and conditions for award of the Contract pursuant to the aforesaid Bid and to sign the Contract with the UGVCL for and on behalf of the "Joint Venture".
- iii. To do any other act or submit any document related to the above.
- iv. To receive, accept and execute the Contract for and on behalf of the "Joint Venture".

It is clearly understood that the Partner In-charge (Lead Partner) shall ensure performance of the Contract(s) and if one or more Partner fail to perform their respective portions of the Contract(s), the same shall be deemed to be a default by all the Partners.

It is expressly understood that this Power of Attorney shall remain valid binding and irrevocable till completion of the period to complete all the Scope of Work awarded under the terms of Bid Specification/ Contract.

The Joint Venture hereby agrees and undertakes to ratify and confirm all the whatsoever the said Attorney/Authorised Representatives/Partner in-charge quotes in the bid and negotiates with UGVCL and signs the Contract with UGVCL and/or proposes to act on

behalf of the Joint Venture by virtue of this Power of Attorney and the same shall bind the Joint Venture as if done by itself.

IN WITNESS THEREOF the Partners Constituting the Joint Venture as aforesaid have executed these presents on this day of..... under the Common Seal(s) of their Companies.

For and on behalf of the
Partners of Joint Venture

.....
.....
.....

The Common Seal of the above Partners of the Joint Venture:

The Common Seal has been affixed there unto in the presence of:

WITNESS

1. Signature.....

Name

Designation

Occupation

2. Signature.....

Name

Designation

Occupation

Note:

1. For the purpose of executing the Agreement, the non-judicial stamp papers of appropriate value shall be purchased in the name of Joint Venture.
2. The Agreement shall be signed on all the pages by the authorised representatives of each of the partners and shall invariably be witnessed.

Form-8 Undertaking by the Joint Venture Partners (In Case Bidder is Joint Venture)*{On Non-Judicial Stamp Paper of Rs. 300/- attested by Notary Public/ First Class Magistrate}****The Bidder is required to upload scanned copy of this document duly filled and signed with company Seal***

THIS JOINT DEED OF UNDERTAKING executed on this day of Two Thousand and by M/s a company incorporated under the laws of and having its Registered Office at (hereinafter called the "Party No.1" which expression shall include its successors, executors and permitted assigns) and M/s a company incorporated under the laws of and having its Registered Office at (hereinafter called the "Party No.2" which expression shall include its successors, executors and permitted assigns) for the purpose of making a bid and entering into a contract [hereinafter called the "Contract" {in case of award}] against the "Bid Specification". **Request for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode, under NIT No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42, the bids for which have been invited by Uttar Gujarat Vij Company Limited("UGVCL")** WHEREAS the Party No.1 and Party No.2 have entered into an Agreement dated.....

AND WHEREAS UGVCL has invited bids as per the above mentioned Bid **for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode. under NIT No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42**

AND WHEREAS SECTION - E:(1.1.1) forming part of the RfS document, inter-alia stipulates that an Undertaking of upto two qualified entities as partners in a Joint Venture, meeting the requirements of Eligibility & Qualification Criteria SECTION - E; as applicable may bid, provided, the Joint Venture fulfils all other requirements under SECTION - E: and in such a case, the Bid Formats shall be signed wherever applicable and as required by RfS document either by the Authorized Signatory (appointed by a Power of Attorney executed by all partners of Joint Venture) and/or all the partners so as to legally bind all the Partners of the Joint Venture, who will be jointly and severally liable to perform the Contract and all obligations hereunder.

The above clause further states that this Undertaking shall be attached to the bid and the Performance bank guarantee will be as per the format enclosed with the RfS document without any restrictions or liability for either party.

AND WHEREAS the bid is being submitted to UGVCL vide Bid No..... (Reference No: of Bid submitted by Bidder) dated by Party No.1 based on this Undertaking between all the parties; under these presents and the bid in accordance with the requirements of RfS document, has been signed by all the parties.

NOW THIS UNDERTAKING WITNESSETH AS UNDER:

In consideration of the above premises and agreements all the parties of this Deed of Undertaking do hereby declare and undertake:

1. In requirement of the award of the Contract by UGVCL to the Joint Venture Partners, we, the Parties do hereby undertake that M/s the **Party No.1**, shall act as Lead Partner and further declare and confirm that we the parties to the Joint Venture shall jointly and severally be bound onto UGVCL for the successful performance of the Contract and shall be fully responsible for successful completion and performance of Scope of Work as provided in Contract in accordance with the terms and conditions specified in the Contract.
2. In case of any breach or default of the said Contract by any of the parties to the Joint Venture, the party(s) do hereby undertake to be fully responsible for the successful performance of the Contract and to carry out all the obligations and responsibilities under the Contract in accordance with the requirements of the Contract.
3. Further, if UGVCL suffers any loss or damage on account of any breach in the Contract or any shortfall in the performance of the equipment in meeting the performances guaranteed as per the specification in terms of the Contract, the Party(s) of these presents undertake to promptly make good such loss or damages caused to UGVCL, on its demand without any demur. It shall not be necessary or obligatory for UGVCL to proceed against Lead Partner to these presents before proceeding against or dealing with the other Party(s), UGVCL can proceed against any of the parties who shall be jointly and severally liable for the performance and all other liabilities/obligations under the Contract to UGVCL.
4. The financial liability of the Parties of this Deed of Undertaking to the UGVCL, as applicable, with respect to any of the claims arising out of the performance or non-performance of the obligations set forth in this Deed of Undertaking, read in conjunction with the relevant conditions of the Contract shall, however not be limited in any way so as to restrict or limit the liabilities or obligations of any of the Parties of this Deed of Undertaking.
5. It is expressly understood and agreed between the Parties to this Undertaking that the responsibilities and obligations of each of the Parties shall be as delineated in Appendix – *(to be suitably appended by the JV Partners along with this Undertaking in its bid)* to this Deed of Undertaking. It is further undertaken by the parties that the above sharing of responsibilities and obligations shall not in any way be a limitation of joint and several responsibilities of the Parties under the Contract.
6. It is also understood that this Undertaking is provided for the purposes of undertaking joint and several liabilities of the partners to the Joint Venture for submission of the bid and performance of the Contract and that this Undertaking shall not be deemed to give rise to any additional liabilities or obligations, in any

RfS document for feeder level Solarization under PM-KUSUM-Component-C in UGVCL.

manner or any law, on any of the Parties to this Undertaking or on the Joint Venture, other than the express provisions of the Contract.

7. This Undertaking shall be construed and interpreted in accordance with the provisions of the Contract.
8. In case of an award of a Contract, we the parties to this Deed of Undertaking do hereby agree that we shall be jointly and severally responsible for furnishing a Contract Performance bank guarantee from a bank in favour of UGVCL in the currency/currencies of the Contract.
9. It is further agreed that this Deed of Undertaking shall be irrevocable and shall form an integral part of the bid and shall continue to be enforceable till UGVCL discharges the same or upon the completion of the Contract in accordance with its provisions, whichever is earlier. It shall be effective from the date first mentioned above for all purposes and intents.

IN WITNESS WHEREOF, the Parties to this Deed of Undertaking have through their authorized representatives executed these presents and affixed Common Seals of their companies, on the day, month and year first mentioned above.

Common Seal of
has been affixed in my/ our
presence pursuant to Board of
Director's Resolution dated
.....

For Lead Partner (Party No.-1)
For and on behalf of M/s
.....

Name
Designation
Signature

(Signature of the
authorized
representative)

WITNESS:

I.
II.

Common Seal of
has been affixed in my/ our
presence pursuant to Board of
Director's Resolution dated
.....

For Party No.-2
For and on behalf of
M/s.....

Name
Designation
Signature

(Signature of the
authorized
representative)

WITNESS:

I.
II.

Note:

1. For the purpose of executing the Joint Deed of Undertaking, the non-judicial stamp papers of appropriate value shall be purchased in the name of Joint Venture.
2. The Undertaking shall be signed on all the pages by the authorized representatives of each of the partners and shall invariably be witnessed.
3. Attach the Appendix.....as mentioned in the Clause 5 of this Deed of Undertaking.

FROM-9 EMD Bank Guarantee Format

(To be physically submitted by bidder on non-judicial stamp paper of Rs. 300/- and scanned copy is to be submitted in 'on-line' on the bidding platform)

For RFS No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42. Plant No: _____

WHEREAS M/s. _____ (name & address of the Firm) having their registered office at _____ (address of the firms Registered Office) (hereinafter called the 'RFS Documenter') wish to participate in the RFS Document No. _____ for _____ of (Supply / Erection / Supply & Erection Work) (Name of the material / equipment / Work) for _____ Uttar Gujarat Vij Company Ltd and WHEREAS a Bank Guarantee for (hereinafter called the "Beneficiary") Rs. _____ (amount of EMD) valid till _____ (mention here date of validity of this Guarantee which will be **6 (SIX)** months from the schedule date of opening of the RFS Document. **be submitted by the RFS Documenter along with the RFS Document.**

We, _____ (name of the Bank and address of the Branch giving the Bank Guarantee) having our Registered Office at _____ (address of Bank's Registered Office) hereby give this Bank Guarantee No. _____ dated _____ and hereby agree unequivocally and unconditionally to pay immediately on demand in writing from the Uttar Gujarat Vij Company Ltd or any Officer authorized by it in this behalf any amount not exceeding Rs. _____ (amount of E.M.D.), (Rupees _____ (in words) to the said Uttar Gujarat Vij Company Ltd on behalf of the RFS Documenter.

We _____ (name of the Bank) also agree that withdrawal of the RFS Document or part thereof by the RFS Documenter within its validity or Non-submission of Security Deposit by the RFS Documenter within one month from the date RFS Document or a part thereof has been accepted by the Uttar Gujarat Vij Company Ltd would constitute a default on the part of the RFS Documenter and that this Bank Guarantee is liable to be invoked and encashed within its validity by the Beneficiary in case of any occurrence of a default on the part of the RFS Documenter and that the encashed amount is liable to be forfeited by the Beneficiary.

This agreement shall be valid and binding on this Bank up to and inclusive of _____ (mention here the date of validity of Guarantee) and shall not be terminable by notice or by Guarantor change in the constitution of the Bank or the firm of RFS Documenter Or by any reason whatsoever and our liability hereunder shall not be impaired or discharged by any extension of time or variations or alternations made, given, conceded with or without our knowledge or consent by or between the RFS Documenter and the UGVCL.

"Notwithstanding anything contrary contained in any law for the time being in force or banking practice, this Guarantee shall not be assignable, transferable by the beneficiary (i.e. UGVCL/GUVNL 's Subsidiaries). Notice or invocation by any person such as assignee, transferee or agent of beneficiary shall not be entertained by the Bank. Any invocation of the Guarantee can be made only by the beneficiary directly."

NOTWITHSTANDING anything contained hereinbefore, our liability under this guarantee is restricted to Rs. _____ (Amt. of E.M.D.) (Rupees _____) (in words). Our Guarantee shall remain in force till _____ (Date of validity of the Guarantee). Unless demands or claims under this Bank Guarantee are made to us in writing on or before _____ (***Date of validity of the Guarantee***), all rights of Beneficiary under this Bank Guarantee shall be forfeited and we shall be released and discharged from all liabilities there under:

Place:

Date:

Please Mention here Complete Postal Signature of the Bank's Address of the Bank with
Branch Code,
Authorized Signatory
Telephone and Fax Nos.
Official Round Seal.

Note: The Banks shall be the Banks recognized / notified by the Finance Department, Government of Gujarat (GoG) from time to time.

Form-10: Performance Bank Guarantee Format*(On Non judicial Stamp of worth of Rs.300/-)*

Bank Guarantee No.

Date.....

Contract No.....

Contract for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode. under NIT No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42

To
**The Chief Engineer (P&P),
 Uttar Gujarat Vij Company Ltd.,
 Regd. & Corporate Office,
 Visnagar road,
 MEHSANA-384001, (Gujarat)**

Dear Sir,

We refer to the Letter of Award ("LOA") <Insert LOA No:>, issued on <Insert Date of issue of LOA by UGVCL > by Uttar Gujarat Vij Company Limited (hereinafter referred to as

"UGVCL"), having its Registered Office at Visnagar Road, MEHSANA- 384001 (Gujarat), to M/s (Name of SPG)....., having its Principal

place of business at (Address of Contractor) and Registered Office at (Registered address of Contractor) ("SPG")

concerning **"purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV CHORIWAD Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode. under NIT No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42 on RESCO model, and the LOA having been accepted by the SPG vide <.....Insert Letter No....>, resulting in Letter of Award to be issued vide <.....Insert Work order No....> dated**

By this letter we, the undersigned, (insert name & address of the issuing bank) , a

Bank (which expression shall include its successors, administrators, executors and assigns) organized under the laws of and having its Registered/Head Office at

..... (insert address of registered office of the bank) do hereby irrevocably

guarantee payment to UGVCL up to Rs. _____
 (_____ rupees only) until 2 months (i.e. sixty
 (60) days) beyond the 9 months from the date of signing of Power Purchase
 Agreement (PPA) between SPG and UGVCL i.e., upto and inclusive of
 (dd/mm/yy).

We undertake to make payment under this Letter of Guarantee upon receipt by us
 of your first written demand signed by UGVCL duly authorized officer or the
 authorized officer of **UGVCL** declaring the SPG to be in default under the Contract
 and without civil or argument any sum or sums within the above named limits,
 without your need to prove or show grounds or reasons for your demand and
 without the right of the SPG to dispute or questionsuch demand.

Our liability under this Letter of Guarantee shall be to pay to UGVCL whichever is
 the lesser of the sum so requested or the amount then guaranteed hereunder in
 respect of any demand duly made hereunder prior to expiry of the Letter of
 Guarantee, without being entitled to inquire whether or not this payment is
 lawfully demanded.

**This letter of Guarantee shall remain in full force and shall be valid from the
 date of issue until 2 months (i.e. sixty (60) days) beyond scheduled commercial
 operation date (SCOD). It shall be responsibility of selected bidder to get the
 PBG extended, if required, such that it is valid till 2 months after date of
 commissioning of project.**

Except for the documents herein specified, no other documents or other action
 shall be required, notwithstanding any applicable law or regulation.

Our liability under this Letter of Guarantee shall become null and void
 immediately upon its expiry, whether it is returned or not, and no claim may be
 made hereunder after such expiryor after the aggregate of the sums paid by us to
 UGVCL shall equal the sums guaranteed hereunder, whichever is the earlier.

All notices to be given under shall be given by registered (airmail) posts to the
 addressee at the address herein set out or as otherwise advised by and between
 the parties hereto.

All disputes arising under the said Guarantee between the Bank and UGVCL or
 between the SPG and UGVCL pertaining to the Guarantee shall be subject to the
 jurisdiction of courts onlyat Mehsana in Gujarat alone.

We hereby agree that any part of the Contract may be amended, renewed,
 extended, modified, compromised, released or discharged by mutual agreement
 between you and the SPG, and this security may be exchanged or surrendered
 without in any way impairing or affecting our liabilities hereunder without notices
 to us and without the necessity for any additional endorsement, consent or
 guarantee by us, provided, however, that the sum guaranteed shall not be
 increased or decreased.

No action, event or condition which by any applicable law shall operate to
 discharge us from liability hereunder shall have any effect and we hereby waive
 any right we may have to apply such law so that in all respects our liability
 hereunder shall be irrevocable and, except as stated herein, unconditional in all
 respects.

For and on behalf of the Bank

[Signature of the authorised signatory(ies)]

Signature_____ Name_____ Designation____

Contact Number(s): Tel._____ Mobile_____ Fax Number_____
email _____

Common Seal of the Bank _____

Witness:

Signature_____

Name_____

Address_____


Contact Number(s): Tel._____ Mobile_____ email _____

Note:

1. For the purpose of executing the Bank Guarantee, the non-judicial stamp papers of appropriate value shall be purchased in the name of Bank who issues the 'Bank Guarantee'.
2. The Bank Guarantee shall be signed on all the pages by the Bank Authorities indicating their POA nos. and shall invariably be witnessed.
3. The Bank Guarantee shall be in accordance with the proforma as provided. However, in case the issuing bank insists for additional paragraph for limitation of liability, the following may be added at the end of the proforma of the Bank Guarantee *[i.e., end paragraph of the Bank Guarantee preceding the signature(s) of the issuing authority(ies) of the Bank Guarantee]*

ANNEXURE-1**Metering infrastructure Philosophy and Remote Monitoring System****A. Metering infrastructure Philosophy**

1. Metering and grid connectivity of the projects would be the responsibility of the SPG in accordance with the prevailing guidelines / practices of UGVCL and / or CEA. UGVCL may facilitate in the process; however, the entire responsibility & cost lies only with the SPG.
2. Meters and metering equipment (CT-PT sets) specifications shall be complied with CEA metering regulations and shall be tested as per provision of GERC order / directives and as per IS 14697 at CPRI or at any NABL accredited / distribution licensee lab before installation at site at the cost of SPG and should be properly sealed in the presence of designated authority from UGVCL at the time of installation.
3. The solar power generator shall install Metering infrastructure and Remote Monitoring System as per the philosophy explained in this Annexure.
4. SPG to install 3 ABT meters (main, check and standby) with RMS connectivity and 2 CT-PT sets (one for main & check meter and another for standby meter) indicated in below layout: -:

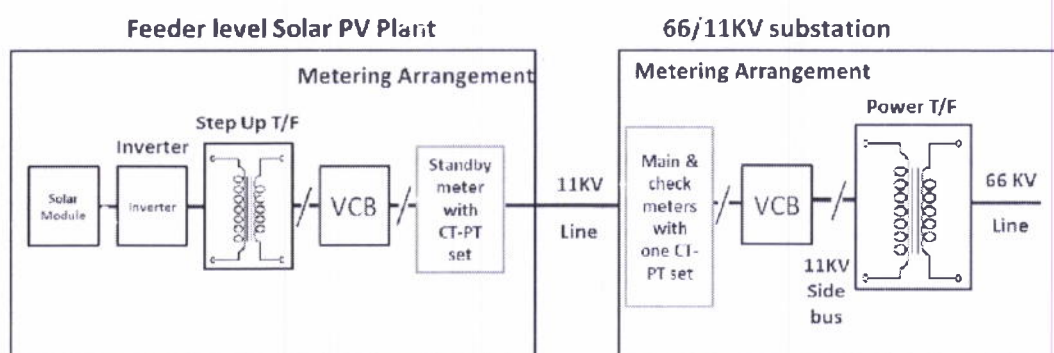


(Indicative Diagram: Metering Arrangement Lay out)

5. Installation and timely replacement of meters (main, check and standby) as required to directly measure energy supplied by the Solar Power Plants shall be the responsibility of selected bidder.
6. The cost of all required meters at Substation end (main, check, standby meter) at substation end along with Meter and associated CT-PT sets and RMS at Solar plant site shall be borne by the SPG.

B. Remote Monitoring System (RMS)

1. SPG shall also be responsible for installation of IoT Devices-RMS Set for Remote Monitoring system connectivity of Inverters, String combiner box, Energy Meters at Solar plant, Substation with State SEDM Portal www.pmkusum.guvnl.com
2. As per the MNRE guidelines for feeder level Solarization under Component C of PM-KUSUM scheme, it is mandatory for DISCOMs to monitor solar power generation and performance of the solar power plant through online system on State-Portal www.pmkusum.guvnl.com. The online data will be integrated with central monitoring portal of MNRE which will extract data from the State portals for monitoring of the scheme.
3. In line with MNRE model guidelines for State Level SEDM Software Development issued in July 2020, Gujarat DISCOMs have developed State Level Solar Energy Data Management (SEDM) platform to integrate & monitor the performance of all systems installed under Component A, B & C (individual as well as feeder level Solarization) of PM-KUSUM scheme.
4. Also, as per the Specifications for Remote Monitoring System for Component A & C of the scheme, issued by MNRE on 15 Jul 2020, **the SPG under this RfS shall be required to install required remote monitoring systems for solar power plant to integrate with State SEDM platform directly** which in turn will have interface with National Level Solar Energy Data Management Platform of MNRE.
5. As part of National and State SEDM platform, various modules will be provided such as Consumer Management, Scheme Progress Management, Asset Management, Live Asset Monitoring, Performance Analysis, Complaint and Ticket Management, Device Integration/SCADA Platform, Alarm/Events/Notification, Meter Data Acquisition (MDAS) / Meter Data Management (MDM), Archiving and Historian, Report Manager, Mobile application, SIA officer and EPC, Enterprise level user and role management.
6. MNRE and DISCOMs will develop and host the of National and State Level SEDM platform which is excluded from the scope of the SPG but SPG needs to operate and do various data entries related to application processing, asset and workflow mgmt.

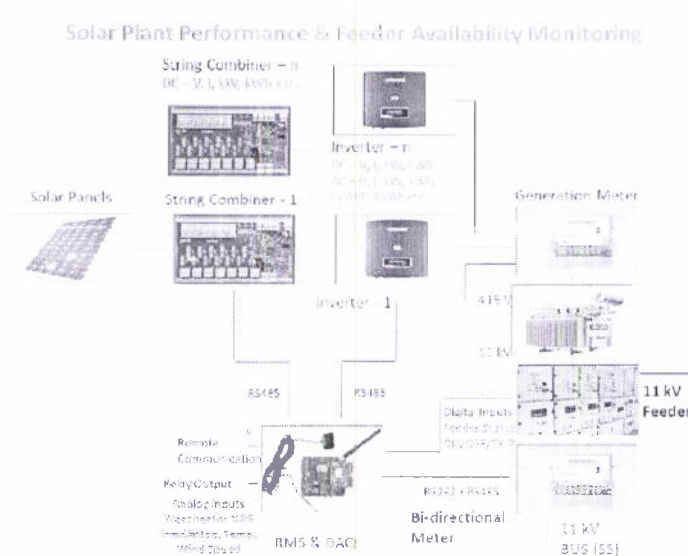

6. As shown in above diagram SPG need to provide a remote monitoring system for:
- (a) **Solar Power Plant Remote Monitoring system:** To capture electrical parameters from multiple devices such as ABT Meter, Inverters, String Combiner boxes or String inverters including meters at Sub-station level. Remote monitoring system will capture important Electrical and Status parameters such as AC/DC voltage, control, power, energy as well as monitoring of Breaker etc and will transmit data to State Level Solar Energy data management (SEDM) platform.
 - (b) **Communication Connectivity for Solar Plant RMS:**
 - i. Field Device Connectivity: RMS will connect to Inverter, String combiner boxes or string inverters using RS485 MODBUS communication protocol as well as meters using RS232 DLMSP protocol. Both protocols are widely used by equipment manufacturers.
 - ii. Remote Connectivity: RMS will connect to State Level SEDM Server using 2G/3G/4G or any other suitable cellular communication.
 - iii. Local Connectivity: Ethernet/Bluetooth/Wi-Fi connectivity to configure parameter, notifications, communication intervals, set points, operation mode configuration or to download locally stored data.
7. It is the responsibility of SPG to provide SIM card/Wi-fi connectivity, bear recurring communication charges and maintain communication connectivity of more than 96% and data availability of 99% for the 25 years (unless extended by both the parties on mutual agreement) of operation & maintenance of solar power plant and its associated 11kV line. Failing bills of the Generator may not be processed.
8. Details of Communication Modes, Communication Protocols, Security and Message formats and equipment wise parameter details are enclosed as "Communication Architecture between RMS and State Level Server" is described as below write-up :-

Communication Architecture between RMS and State Level Server



**RMS Communication and
Security Architecture-
PMKUSUM SEDM Platform**

Date: 14/07/2020

Contents

RMSCommunication & SecurityArchitecture.....	2
1. Security Architecture	2
2. RMSRegistration	3
3. MQTTTopicStructure	3
4. CommunicationModes.....	4
5. CommunicationProtocols.....	4
6. MQTTMessageStructure	5

RMS Communication & Security Architecture

1. SecurityArchitecture(withreferencetoEESLTenderAnnexure8–clause4.d)
2. RMSRegistration (withreferencetoEESLTenderAnnexure8–clause4.d)
3. MQTTTopicStructure(withreferencetoEESLTenderAnnexure8– clause4.b,4.c)
4. MQTT MessageStructure(withreferencetoEESLTenderAnnexure8–clause4.e,4.f)
5. Annexure:JSONFormatswithparameterkeywords,samplevaluesanddescription
 - a. Annexure:PumpController
 - b. Annexure:EnergyMeter
 - c. Annexure:Inverter
 - d. Annexure:StringCombinerBox(SJB)
 - e. Annexure:Heartbeat
 - f. Annexure:DAQ

1. SecurityArchitecture

This section highlights the communication security architecture between RMS/DCU and StateSWPS IoT Platform. With this security, architecture, third parties are unable to intercept or “sniff” the encrypted data. This stops ISPs, employers, local network administrators and cybercriminals from being able to perform “packet sniffing” to access what the traffic contains. It also protects against man in the middle (MitM) attacks. This implements Private TLS/SSL VPN to ensure highest level of security.

In addition to this, use of OTP in every message exchange shall help restrict spammers and Bots. Such OTP based mechanism will provide transaction level security which is required for remote operations.



2. RMSRegistration

This section details how individual RMS/DCU shall be registered and communicate securely with State SWPS IoT Platform.

- Every supplier/vendor must Register all unique IMEI (International Mobile Equipment Identity) of RMS/DCU with State SWPS
- State SWPS will generate individual client certificate for RMS/DCU against unique IMEI registered and share with supplier/vendor through secured web API interface.
- Every supplier/vendor shall be able to access web API with unique credentials shared with them.
- Web API shall return individual client certificate, Device Broker url and "info" topic.
- After installation of client certificate relevant to IMEI of RMS/DCU, RMS/DCU will connect to Device Broker and get authenticated using client certificate and further shall be able to receive additional configuration details such as FTP credential, Message Topic structure etc. after subscribing to default topic.
- After client certificate expiry, RMS will connect to FTP using available credentials and download the renewed certificate

3. MQTT Topic Structure

This section defines the different topic structure for communication between RMS/DCU and State SWPS through Device Broker.

RMS/DCU will publish and subscribe to their respective topics only, authorization of topics shall be done against unique credentials.

Application Version	Solution	IMEI	Message Type	Publish/Subscribe
IIOT-1	Standalone solar pump	{IMEI}	Info	Subscribe
	Grid connected solar pump		OTP	Subscribe
	Solar MW		Heartbeat	Publish
	On grid rooftop		Data	Publish
	Off grid rooftop		On demand	Subscribe
			Config	Subscribe

Sample Topic structure for Stand-alone Solar Pump shall be: **IIOT-1/Standalonesolarpump/{IMEI}/info**

Multiple sub-topics will be formed for communication between RMS/DCU and State SWPS IoT Platform

- **Info:** Default Topic To exchange RMS/DCU configuration details
- **OTP:** To exchange OTP at every interval of 15/30/60 minutes
- **Heartbeat:** To update RMS/DCU health indicators at frequent configurable intervals.
- **Data:** To exchange data related to RMS/DCU Monitoring parameters in "push mode"
 - Push data Periodically
 - Push data on Event/Notification
 - History Missing Data Push Mode: History data will be identified against "index"

- **OnDemand:** To exchange data between RMS/DCU and Server in “**Command onDemand**” Mode
 - Each “OnDemand” message will have two transactions: Commands, Response.
 - OnDemand command and response will be tracked against a common “MSGID”.
 - OnDemand message can be used to read and write with two command types
 - Command: “**Read**” - In json received from server replace each key with value from RMS/DCU and send the updated json back to server.
 - Command: “**Write**” - After executing the command based on key-value pair received in json, send the updated json back to server on successful execution.
 - Note: handshaking parameters such as msgid, etc. have to be sent back to server as is, without modification
- **Config:** To update configurable parameters of Device, which is similar to OnDemand but will be used only for configurable parameters of Device, this implements “**Configuration over the air**”
 - Command: “**Read**” - In json received from server replace each key with value from RMS/DCU and send the updated json back to server.
 - Command: “**Write**” - After executing the command based on key-value pair received in json, send the updated json back to server on successful execution.
 - Note: handshaking parameters such as msgid, etc. have to be sent back to server as is, without modification

4. Communication Modes

- **Push on Periodic Interval:** In this mode deployed RMS shall transmit data of Multiple devices and sensors on different configurable time intervals such as Inverter or pump controller data at every 5 minutes, Energy Meter data at every 15 minutes, String Combiner Box data at every 10 minutes
- **Push on Event:** RMS shall detect various configurable alarm or event conditions such as Pump On/Off Status, Inverter On/Off Status, Low Water Flow Rate, Fault or Trip status etc. and it shall transmit data immediately to the server
- **OnDemand Read:** In this mode, User will send command to RMS to get data as and when required and RMS will send the required data to server immediately
- **OnDemand Write:** In case of Remote Operations, Farmer/Consumers shall send OnDemand Write Command to the RMS and RMS will send back the acknowledgement with change in parameters after operation is completed
- **Configuration read/write:** Using this mode, user will be able to read and change configurable parameters remotely such as updating periodic interval, alarm limits, server parameters etc.

5. Communication Protocols

- **Field Device Communication:** RMS to Field Devices communication such as Inverter, Pump Controller, Drive, String Combiner box, MFT/MFM, Data Acquisition System shall be established using **MODBUS RTU** protocol supported by all leading manufacturers globally

- **EnergyMeterCommunication:** RMS to Energy Meter communications such as BiDirectional (Revenue) Meter, Solar Generation (Audit) Meter shall be established using **DLMS/Modbus protocol** supported by all leading Meter Manufacturers in India
- **RMS to Server Communication - Industrial IoT MQTT Protocol:** RMS to Server Communications shall be established using MQTT protocol which is well accepted IoT protocol across the globe and supported by all leading IT as well as OT companies for Smart Grid, Smart RE and Smart City Applications

6. MQTT Message Structure

This section details message structure exchanged between RMS/DCU and State SWPS IoT Platform through Device Broker

keyword	Description	Sample Value
IMEI	Unique Identification of RMS/DCU – required to ensure registered source of data	863287049443888
VD	Virtual device/group – required for grouping parameters based on update interval/subsystems such as inverter/pump controller/meter/string combiner box etc.	2
MSGID	Message Transaction Id - required for "On demand"/"Config" message type , request/response/acknowledgement/feedback	123456789
COMMAND	Read/Write - Applicable only in case of "On demand"/"Config" message type	Read
TIMESTAMP	RTC timestamp of RMS/DCU against all parameters of vd/group (YYYY-MM-DD HH:mm:ss)	2019-08-20 20:15:08
STINTERVAL	Periodic interval at which RMS shall store and transmit data to server. (in minutes)	15
DATE	Local storage date – required as a reference to fetch data from local storage (YYYY-MM-DD)	2020-06-15
INDEX	Local storage index – required as a reference to fetch data from local storage	5
MAXINDEX	Local storage maximum index of local storage date – required to calculate missing index	96
LOAD	Local storage retrieval command & status	0
POTP	Previous One Time Password	12345678
COTP	Current One Time Password, State SWPS Broker will update OTP at interval of 30/60 minutes	12345678
Parameter-1 Parameter-2 Parameter-3 Parameter-1 Parameter-n	Equipment wise Keywords for multiple Parameters.	

Communication with Annexure

Annexure-1(Revision-B PumpController

MessageName	:PeriodicPushPumpController(1)
MessageFormat	:JSON
MessageType	:Data
Message Command	:NotApplicableforDataperiodicPush
FlowMessage response	:RMS->StateSWPSIoTPlatform
FlowMessageMedium	:GPRS

CommandMessage

NotApplicable

ResponseMessage

ResponseMessage																
Message	Description	Unit														
{																
"VD":1	VirtualDeviceIndex/Group	-														
"TIMESTAMP":"2020-05-18 17:58:00",	RTCTimestampofRMS/DCUagaininstall parametersof vd/group	-														
"MAXINDEX":96	maximumindexoflocalstoragedate	-														
"INDEX":7,	referenceof localstorage	-														
"LOAD":0,	Localstorageretrievalcommand&status	-														
"STINTERVAL":15,	PeriodicintervalatwhichRMSshallstoreand transmitdata toserver.(inminutes)	-														
"MSGID": "",	Message Transaction Id - required for"Ondemand"/"Config" message type,request/response/acknowledgement/feedback	-														
"DATE":200518,	localstoragedate	YYMMDD														
"IMEI":"1234561234561234",	IMEI No. ofFirstSimtobe consideredalwaysforuniqueidentityofDCU	-														
"ASN_11":"34123450",	<table><tr><td colspan="2">PumpControllerSerialNo.</td></tr><tr><td>RMS</td><td>0</td></tr><tr><td>DAQ</td><td>1-9</td></tr><tr><td>PumpController</td><td>11-19</td></tr><tr><td>Meter</td><td>21-29</td></tr><tr><td>Inverter</td><td>31-39</td></tr><tr><td>StringCombinerBox</td><td>41-49</td></tr></table>	PumpControllerSerialNo.		RMS	0	DAQ	1-9	PumpController	11-19	Meter	21-29	Inverter	31-39	StringCombinerBox	41-49	-
PumpControllerSerialNo.																
RMS	0															
DAQ	1-9															
PumpController	11-19															
Meter	21-29															
Inverter	31-39															
StringCombinerBox	41-49															
"POTP":"341234",	PreviousOneTime Password	-														
"COTP":"341234",	CurrentOneTime Password	-														

"PMAXFREQ1": "50.00",	MaximumFrequency	Hz
-----------------------	------------------	----

"PFREQLSP1": "50.00",		LowerLimitFrequency	Hz
"PFREQHSP1": "50.00",		Upper LimitFrequency	Hz
"PCNTRMODE1": "1",		SolarPumpControllerControlModeStatus	-
0	VariableFrequencyControl Mode		
1	CVTModeforSolar		
2	MPPTmodeforSolar		
"PRUNST1": "2",		SolarPumpControllerRunStatus	-
0	Stop		
1	Running		
2	Sleep		
3	Low SpeedProtection		
4	DryRunProtection		
5	Over CurrentProtection		
6	MinimumPowerProtection		
"PREFFREQ1": "50.00",		SolarPumpControllerReference Frequency	Hz
"POPFREQ1": "50.00",		SolarPumpControllerOutput Frequency	Hz
"POPI1": "20.00",		OutputCurrent	A
"POPV1": "230.00",		OutputVoltage	V
"POPKW1": "45.00",		OutputActivePower	KW
"PDC1V1": "550.00",		DCInputVoltage	DCV
"PDC1I1": "50.00",		DC Current	DCI
"PDCVOC1": "650.00",		DCOpenCircuitVoltage	DCV
"PDKWH1": "35.00",		TodayGeneratedEnergy	KWH
"PTOTKWH1": "120.00",		CumulativeGeneratedEnergy	KWH
"POPFLW1": "2.00",		FlowSpeed	LPM
"POPDWD1": "120.00",		DailyWaterDischarge	Litres
"POPTOTWD1": "220.00",		TotalWaterDischarge	Litres
"PMAXDCV1": "750.00",		MaxDCVoltage	DCV
"PMAXDCI1": "40.00",		MaxDCCurrent	DCI
"PMAKKW1": "650.00",		MaxOutputActivePower	DCKW
"PMAKFLW1": "650.00",		MaxFlowSpeed	LPM
"PDHR1": "8.00",		PumpDayRunHours	Hrs
"PTOTHR1": "8.00",		PumpCumulativeRunHours	Hrs
}			

Reaction	
NotApplicable	

CommunicationFormatAnnexure

Annexure-2 EnergyMeter

MessageName	:PeriodicPushMeter(1)
Message	:JSON
FormatMessage	:Data
Type	:NotApplicableforDataperiodicPush
Message Command	:RMS->StateSWPSIoTPlatform
FlowMessage response	:GPRS

CommandMessage

NotApplicable	
---------------	--

ResponseMessage

Message	Description
{	
"VD":2	VirtualDeviceIndex/Group
"TIMESTAMP":"2020-05-18 17:58:00",	RTCtimestampofRMS/DCUagaininstall parametersof vd/group
"MAXINDEX":96	maximumindexoflocalstoragedate
"INDEX":7,	referenceof localstorage
"LOAD":0,	Localstorageretrievalcommand&status
"STINTERVAL":15,	PeriodicintervalatwhichRMSshallstoreand transmitdatatoserver.(inminutes)
"MSGID": "",	Message Transaction Id - required for"Cmdemand"/"Config"messagetype
	' request/response/acknowledgement/feedback
"DATE":200518,	localstoragedate

"IMEI": "1234561234561234",	IMEI No. of First Sim to be considered always for unique identity of DCU												
"ASN_21": 12345678,	Asset Serial Number												
	<table> <tr> <td>RMS</td><td>0</td></tr> <tr> <td>DAQ</td><td>1-9</td></tr> <tr> <td>Pump Controller</td><td>11-19</td></tr> <tr> <td>Meter</td><td>21-29</td></tr> <tr> <td>Inverter</td><td>31-39</td></tr> <tr> <td>String Combiner Box</td><td>41-49</td></tr> </table>	RMS	0	DAQ	1-9	Pump Controller	11-19	Meter	21-29	Inverter	31-39	String Combiner Box	41-49
RMS	0												
DAQ	1-9												
Pump Controller	11-19												
Meter	21-29												
Inverter	31-39												
String Combiner Box	41-49												
"MTDET1": 30012302,	Meter Detail												
"POTP": "34123450",	Previous One Time Password												
"COTP": "34123450",	Current One Time Password												
"MTBLDATE1": 18,	Billing Date for meter 1												
"DATE1": 180606,	Present date for meter 1												
"TIME1": 105400,	Present time for meter 1												
"IR1": 20.58,	R Phase Current in Amps												
"IY1": 20.65,	Y Phase Current in Amps												
"IB1": 20.12,	B Phase Current in Amps												
"VRN1": 240.12,	R Phase to Neutral Voltage in Volts												
"VYN1": 242.13,	Y Phase to Neutral Voltage in Volts												
"VBN1": 243.55,	B Phase to Neutral Voltage in Volts												
"VRY1": 420.18,	Phase to Phase Voltage (R-Y) in Volts												
"VYB1": 419.38,	Phase to Phase Voltage (Y-B) in Volts												
"VBR1": 421.5,	Phase to Phase Voltage (B-R) in Volts												
"PFR1": 0.98,	R Phase Power Factor												
"PFY1": 0.97,	Y Phase Power Factor												
"PFB1": 0.96,	B Phase Power Factor												
"FRQ1": 50.05,	Grid Frequency												
"POWR1": 42.578,	R Phase Active Power in KW												
"POWY1": 42.156,	Y Phase Active Power in KW												
"POWB1": 42.354,	B Phase Active Power in KW												
"POW1": 42.185,	Total Active Power in KW												
"RPOWR1": 22.123,	R Phase Reactive Power in KVAR												
"RPOWY1": 20.110,	Y Phase Reactive Power in KVAR												
"RPOWB1": 22.310,	B Phase Reactive Power in KVAR												
"RPOW1": 65.610,	Total Reactive Power in KVAR												
"APOWR1": 55.610,	R Phase Apparent Power in KVA												
"APOWY1": 52.910,	Y Phase Apparent Power in KVA												
"APOWB1": 53.911,	B Phase Apparent Power in KVA												
"APOW1": 14.198,	Total Apparent Power in KVA												
"KWHNET1": 98561.4,	Cumulative Net Energy in KWH												
"KWHIMP1": 98561.4,	Cumulative Import Energy in KWH												
"KWHEXP1": 98561.2,	Cumulative Export Energy in KWH												
"KVAHNET1": 99100.3,	Cumulative Net Energy in KVAH												
"KVAHIMP1": 99105.1,	Cumulative Import Energy in KWH												
"KVAHEXP1": 98999.1,	Cumulative Export Energy in KWH												
"MDKWIMP1": 100.3,	Rising Demand (Import) in KW												
"MDKWEXP1": 98.6,	Rising Demand (Export) in KW												

"POFF1":1020,	GridPowerFailureinMinutes
"TC1":100,	TotalTamperCounts
"PF1":0.99,	AveragePF
"LBKWHNET1":98561,	LastBillingCycleNetEnergyinKWH
"LBKWHIMP1":98561,	LastBillingCycleImportEnergy inKWH
"LBKWHEXP1":98561,	LastBillingCycleExportEnergy in KWH
"PMDKVAIMP1":22.50,	PresentMDKVAImport
"PMDKVAEXP1":0.00,	PresentMDKVAImport
"LBMDKWIMP1":7.07,	LastBillingMDKWImport
"LBMDKWEXP1":0.00,	LastBillingMDKWExport
"LBMDKVAIMP1":7.07,	LastBillingMDKVAImport
"LBMDKVAEXP1":0.00,	LastBillingMDKVAExport
"MDRSTC1":4	MDResetCount
}	

Reaction	
NotApplicable	

CommunicationFormatAnnexure

Annexure –3 Inverter

MessageName	:InverterPeriodicPush(INVERTER-1)
Message	:JSON
FormatMessage	:Data
Type	:NotApplicableforDataperiodicPush
Message Command	:RMS->StateSWPSIoTPlatform
FlowMessage response	:GPRS

CommandMessage

NotApplicable

ResponseMessage

Message	Description
{	
"VD":5	VirtualDeviceIndex/Group
"TIMESTAMP":"2020-05-1817:58:00",	RTC timestamp of RMS/DCU against allparametersofvd/group
"MAXINDEX":96	maximumindexoflocalstorage date
"INDEX":7,	referenceof localstorage
"LOAD":0,	Localstorageretrievalcommand&status
"STINTERVAL":15,	PeriodicintervalatwhichRMSshallstoreand transmitdatatoserver.(inminutes)
"MSGID": "",	Message Transaction Id - required for"Ondemand"/"Config"messagetype
"DATE":200518,	request/response/acknowledgement/feedback localstorage date
"IMEI":"1234561234561234",	IMEI No. ofFirstSimtobe consideredalwaysforuniqueidentityofDCU
"ASN_31":"34123450",	InverterSerialNo.

	RMS	0
	DAQ	1-9
	PumpController	11-19
	Meter	21-29
	Inverter	31-39
	StringCombinerBox	41-49
"POTP": "34123450",	PreviousOneTime Password	
"COTP": "34123450",	CurrentOneTime Password	
"IST1": 1,	InverterStatus	
"IFREQ1": 40,	Frequency	
"IPF1": 0.8,	PowerFactor	
"IDC1V1": 500,	DC-1Voltage	
"IDC1I1": 200,	DC-1Current	
"IDC1KW1": 200,	DC-1 Power	
"IDC2V1": 243.55,	DC-2Voltage	
"IDC2I1": 420.18,	DC-2Current	
"IDC2KW1": 200,	DC-2 Power	
"IDC3V1": 419.38,	DC-3Voltage	
"IDC3I1": 421.8,	DC-3Current	
"IDC3KW1": 200,	DC-3 Power	
"IDC4V1": 0.98,	DC-4Voltage	
"IDC4I1": 0.97,	DC-4Current	
"IDC4KW1": 200,	DC-4 Power	
"IRPHV1": 0.96,	Rphase voltage	
"IRPHI1": 50.05,	Rphasecurrent	
"IRPHKW1": 50.05,	RphaseActivePower	
"IYPHV1": 42.578,	Yphase voltage	
"IYPHI1": 42.156,	Yphasecurrent	
"IYPHKW1": 50.05,	YphaseActivePower	
"IBPHV1": 42.354,	Bphase voltage	
"IBPHI1": 42.185,	Bphasecurrent	
"IBPHKW1": 50.05,	BphaseActivePower	
"IKW1": 22.123,	ActivePower	
"ITKWH1": 20.110,	TodayGeneratedEnergy	
"ITON1": 22.310,	TodayOnTime ofInverter	
"ILKWH1": 65.610,	LifetimeGeneratedEnergy	
"ILON1": 55.610,	Lifetimerunninghours	
"ITEMP1": 52.910,	InverterTemperature	
"IFT11": 53.911,	Fault-1	
"IFT21": 14.198,	Fault-2	
"IFT31": 98561.4,	Fault-3	
"IFT41": 98561.4,	Fault-4	
"IFT51": 98561.2,	Fault-5	
"IKVA1": 99100.3,	Apparentpower	
"IKVAR1": 99105.1	Reactivepower	
}		

Reaction	
NotApplicable	

CommunicationFormatAnnexure

Annexure- 4StringComblnerBox	
MessageName	:PeriodicPushStringComblnerBox
Message	:JSON
FormatMessage	:Data
Type	:NotApplicableforDataperiodicPush
Message Command	:RMS->StateSWPSIoTPlatform
FlowMessage response	:GPRS

CommandMessage	
NotApplicable	

ResponseMessage					
Message	Description				
{					
"VD":9	VirtualDeviceIndex/Group				
"TIMESTAMP":"2020-05-1817:58:00",	RTC timestamp of RMS/DCU against allparametersofvd/group				
"MAXINDEX":96	maximumindexoflocalstoragedate				
"INDEX":7,	referenceof localstorage				
"LOAD":0,	Localstorageretrievalcommand&status				
"STINTERVAL":15,	Periodic interval at which RMS shall store andtransmitdatatoserver.(inminutes)				
"MSGID": "",	MessageTransactionId-requiredfor "Ondemand"/"Config" message type,request/response/acknowledgement/feedback				
"DATE":200518,	localstoragedate				
"IMEI":"1234561234561234",	IMEI No.ofFirstSimtobeconsideredalwaysfor uniqueidentityof DCU				
"ASN_41":"34123450",	SJBSerialno <table border="1"> <tr> <td>RMS</td><td>0</td></tr> <tr> <td>DAQ</td><td>1-9</td></tr> </table>	RMS	0	DAQ	1-9
RMS	0				
DAQ	1-9				

	PumpController	11-19	
	Meter	21-29	
	Inverter	31-39	
	StringCombinerBox	41-49	
"POTP":"34123450",	PreviousOneTime Password		
"COTP":"34123450",	CurrentOneTime Password		
"SI11":"3.00",	SJB1,Channel1Current		
"SI21":"5.00",	SJB1,Channel2Current		
"SI31":"5.00",	SJB1,Channel3Current		
"SI41":"5.00",	SJB1,Channel4Current		
"SI51":"5.00",	SJB1,Channel5Current		
"SI61":"5.00",	SJB1,Channel6Current		
"SI71":"5.00",	SJB1,Channel7Current		
"SI81":"5.00",	SJB1,Channel8Current		
"SI91":"5.00",	SJB1,Channel9Current		
"SI101":"5.00",	SJB1,Channel10Current		
"SI111":"5.00",	SJB1,Channel11Current		
"SI121":"5.00",	SJB1,Channel12Current		
"SI131":"5.00",	SJB1,Channel13Current		
"SI141":"5.00",	SJB1,Channel14Current		
"SI151":"5.00",	SJB1,Channel15Current		
"SI161":"5.00",	SJB1,Channel16Current		
"SI171":"5.00",	SJB1,Channel17Current		
"SI181":"5.00",	SJB1,Channel18Current		
"SI191":"5.00",	SJB1,Channel19Current		
"SI201":"5.00",	SJB1,Channel20Current		
"SI211":"5.00",	SJB1,Channel21Current		
"SI221":"5.00",	SJB1,Channel22Current		
"SI231":"5.00",	SJB1,Channel23Current		
"SI241":"5.00",	SJB1,Channel24Current		
"SDCV1":"635.00",	SJB1,DCVoltage		
"SDCTOT11":"40.00",	SJB1,TotalDC Current		
"SDCTOTKW1":"28.00",	SJB1,TotalDC Power		
"SDI11":"1.00",	SJB1,DigitalInput1		
"SDI21":"1.00",	SJB1,DigitalInput2		
"ST11":"1.00",	SJB1,Temperature1		
"ST21":"1.00",	SJB1,Temperature2		
"ST31":"1.00"	SJB1,Temperature3		
}			

Reaction	
NotApplicable	

CommunicationFormatAnnexure

Annexure-5RMS

MessageName	:RMS
MessageFormat	:JSON
MessageType	:Heartbeat
Message Command	:NotApplicable
FlowMessage response	:RMS->StateSWPSIoTPlatform
FlowMessageMedium	:GPRS

CommandMessage

NotApplicable

ResponseMessage

Message	Description
{	
"VD":0	VirtualDeviceIndex/Group
"TIMESTAMP":"2020-05-18 17:58:00",	RTTimestampofRMS/DCUagaininstall parametersof vd/group
"MAXINDEX":96	maximumindexoflocalstoragedate
"INDEX":7,	referenceof localstorage
"LOAD":0,	Localstorageretrievalcommand&status
"STINTERVAL":15,	Periodicintervalat which RMS shallstoreand transmitdatatoserver.(inminutes)
"MSGID":"","	Message Transaction Id - required for"Ondemand"/"Config"messagetype
"DATE":200518,	request/response/acknowledgement/feedback localstoragedate
"IMEI":"1234561234561234",	IMEI No. ofFirstSimtobe consideredalwaysfor uniqueidentityof DCU
"POTP":"341234",	PreviousOneTime Password
"COTP":"341234",	CurrentOneTime Password
"GSM":1,	DeviceconnectedtoGSMnetwork
"SIM":1,	SIMdetected (1-detected)
"NET":1,	Devicein Network(1-innetwork)
"GPRS":"1",	GPRSconnected (1-connected)

"RSSI":22,	SignalStrength
"SD":1,	SDcarddetected(1 -detected)
"ONLINE":1,	DeviceOnline (1-Online)
"GPS":1,	GPSModuleStatus(1-ON,0-OFF)
"GPSLOC":1,	GPSLocationLocked
"RF":1,	RFModuleStatus(1-ON,0-OFF)
"RTCDATE":180918,	RTCDate
"RTCTIME":175800,	RTCTime
"TEMP":45.5,	DeviceTemperature
"LAT":19.06,	Latitudefromgps
"LONG":72.8777,	Longitudefromgps
"SIMSLOT":1,	SimSlot(CurrentSimSlot:1or2)
"SIMCHNGCNT":10,	TotalSim SlotChange Count
"FLASH":1,	Device FlashStatus1:Detected0>Error
"BATTST":0,	BatteryInputStatus:1if onbattery powerelse0
"VBATT":5.0,	BatteryVoltage
"PST":1	PowerSupply(1-Mains,2-Battery)
}	

Reaction	
NotApplicable	

CommunicationFormatAnnexure

Annexure-6DAQSystem

MessageName	:PeriodicPushDAQSystem
MessageFormat	:JSON
MessageType	:Data
Message Command	:NotApplicableforDataperiodicPush
FlowMessage response	:RMS->StateSWPSIoTPlatform
FlowMessageMedium	:GPRS

CommandMessage

NotApplicable

ResponseMessage

Message	Description
{	
"VD":12	VirtualDeviceIndex/Group
"TIMESTAMP":"2020-05-18 17:58:00",	RTTimestampofRMS/DCUagaininstall parametersofvd/group
"MAXINDEX":96	maximumindexoflocalstoragedate
"INDEX":7,	referenceof localstorage
"LOAD":0,	Localstorageretrievalcommand&status
"STINTERVAL":15,	PeriodicintervalatwhichRMSshallstoreand transmitdatatoserver.(inminutes)
"MSGID": "",	Message Transaction Id - required for"Ondemand"/"Config"messagetype
"DATE":200518,	request/response/acknowledgement/feedback localstoragedate
"IMEI":"1234561234561234",	IMEI No. ofFirstSimtobe consideredalwaysfor uniqueidentityofDCU
"POTP":"34123450",	PreviousOneTime Password
"COTP":"34123450",	CurrentOneTime Password
"AI1":45.5,	AnalogInput-1
"AI2":45.5,	AnalogInput-2
"AI3":45.5,	AnalogInput-3
"AI4":45.5,	AnalogInput-4

"DI11":1,	DigitalInput-1
"DI21":0,	DigitalInput-2
"DI31":1,	DigitalInput-3
"DI41":0,	DigitalInput-4
"DO11":1,	DigitalOutput-1
"DO21":1,	DigitalOutput-2
"DO31":1,	DigitalOutput-3
"DO41":1	DigitalOutput-4
}	

Reaction	
NotApplicable	

Annexure-7

MessageName :OnDemandRead/WriteParameter/Keyword
 Message :JSON
 FormatMessage :Config
 Type :CloudServer->RMS
 MessageCommandFlow :RMS->Cloud Server
 Message Response :GPRS

CommandMessage	
Message	Description
{	
"timestamp":"2018-09-1817:58:00",	
"type":"config",	
"cmd":"write",	To write config
"msgid":"130",	Server Auto Generated
"APN1":"www"	APN Value for sim1
"USR1":"string"	sim1 username
"PASS1":"string"	sim1 password
"APN2":"Internet"	APN Value for sim2
"USR2":"string"	Sim2 username
"PASS2":"string"	Sim2 password
"RESTART":1	To restart DCU, 1: Execute command
"UPDATEINTERVAL":15	Enter update interval in mins.
"HEARTINTERVAL":5	Heartbeat update interval in mins
"URTCDATE":200622	DCURTCDate(YYMMDD) Update
"URTCTIME":220312	DCURTCTime(HH:MM:SS) Update-24 hour format
"UPDATERTC":1	Update RTC, 1: Execute command, 0: Successful execution
"GSMSYNC":1	RTC auto GSM synchronization, 1: to execute command
"DO1":1	Pump Remote ON/OFF Operation(1-ON, 0-OFF)
"AI1ZERO":1	Engineering Zero Value (4 mAdc) for AI1 E.G. 0(LPM)
"AI1SPAN":100	Engineering Span Value (20 mAdc) for AI1 E.G. 5000(LPM)
"AI2ZERO":1	Engineering Zero Value (4 mAdc) for AI2

"AI2SPAN":100	EngineeringSpanValue(20mA dc)forAI2
"AI3ZERO":1	EngineeringZeroValue(4mA dc)forAI3
"AI3SPAN":100	EngineeringSpanValue(20mA dc)forAI3
"AI4ZERO":1	EngineeringZeroValue(4mA dc)forAI4
"AI4SPAN":100	EngineeringSpanValue(20mA dc)forAI4
"URL":"rms1.kusumiiot.co"	URLofBrokerServer
"PORT":8883	PortofBrokerServer
"CID":"d:860906045525646\$standalonesolarpump\$27"	UniqueClientidofdevice
"USERNAME":"860906045525646\$standalonesolarpump\$27"	Usernamefordevice authentication
"PASSWORD":"9e0baa73"	Passwordfordevice authentication
"FTPURL":"rms1.kusumiiot.co"	URLforFTP
"FTPUSER":"866191037709301"	UsernameforFTP
"FTPPASS":"908552f"	PasswordforFTP
"FTPPORT":22	PortforFTP
"FTPDOWN":1	DownloadCertificatesfromftp1 :Toexecutecommand, 0: Command is successfullyexecuted
}	

ResponseMessage	
Message	Description
{	
"timestamp":"2018-09-1817:58:00",	
"type":"config",	
"cmd":"write",	Towriteconfig
"msgid":"130",	ServerAutoGenerated
"APN1":"www"	APNValueforsim1
"USR1":"string"	sim1username
"PASS1":"string"	sim1password
"APN2":"Internet"	APNValueforsim2
"USR2":"string"	Sim2username
"PASS2":"string"	Sim2password
"RESTART":1	TorestartDCU,1:Execute command
"UPDATEINTERVAL":15	Enterupdateintervalinmins.
"HEARTINTERVAL":5	HeartbeatUpdateIntervalin mins

"URTCDATE":200622	DCURTCDate(YYMMDD) Update
"URTCTIME":220312	DCURTCTime(HH:MM:SS) Update-24 hourformat
"UPDATERTC":1	Update RTC, 1: Executecommand,0 :Successful execution
"GSMSPYNC":1	RTCAutoGSMsynchronization, 1:toexecutecommand
"DO1":1	PumpRemoteON/OFF Operation(1-ON,0-OFF)
"AI1ZERO":1	Engineering Zero Value (4 mAdc)forAI1 E.G.0(LPM)
"AI1SPAN":100	EngineeringSpanValue(20mAd c)forAI1 E.G.5000(LPM)
"AI2ZERO":1	EngineeringZeroValue(4mA dc)forAI2
"AI2SPAN":100	EngineeringSpanValue(20mA dc)forAI2
"AI3ZERO":1	EngineeringZeroValue(4mA dc)forAI3
"AI3SPAN":100	EngineeringSpanValue(20mA dc)forAI3
"AI4ZERO":1	EngineeringZeroValue(4mA dc)forAI4
"AI4SPAN":100	EngineeringSpanValue(20mA dc)forAI4
"URL": "rms1.kusumiiot.co"	URLofBrokerServer
"PORT":8883	PortofBrokerServer
"CID": "d:860906045525646\$standalonesolarpump\$27"	UniqueClientidofdevice
"USERNAME": "860906045525646\$standalonesolarpump\$27"	Usernamefordevice authentication
"PASSWORD": "9e0baa73"	Passwordfordevice authentication
"FTPUURL": "rms1.kusumiiot.co"	UrlforFTP
"FTPUSER": "866191037709301"	UsernameforFTP
"FTPPASS": "908552f"	PasswordforFTP
"FTPPOINT":22	PortforFTP
"FTPDOWN":1	DownloadCertificatesfromftp1 :Toexecutecommand, 0: Command is successfullyexecuted
}	

CommandMessage	
Command- B.Incase,ifsomekeyincommandareinvalid	
Message	Description
{	
"timestamp":"2018-09-1817:58:00",	
"type":"config",	
"cmd":"write",	to write config
"msgid":"130",	server autogenerated
"APNN1":2	send value "2"
"USR1":"xyz"	send value "xyz"
}	

ResponseMessage	
Message	Description
{	
"timestamp":"2018-09-1817:58:00",	
"type":"config",	
"cmd":"write",	to write config
"msgid":"130",	server autogenerated
"APNN1":0	invalid key, value will be returned '0'
"USR1":"xyz"	actual value received
}	

Reaction	
NotApplicable	

ANNEXURE-3

List of Solar Power plant with details 11 KV feeders Covered, Notified Plant Capacity, Annual Energy requirement, EMD & PBG

Sr. No.	Circle	Division	Sub division	Name of Sub Station 66KV/11KV	Name of Solar Plant (Bid plant Number)	Name of Ag Feeders covered under Sub ststion	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Total Consumption up to 7.5 HP Eligible for CFA (KWH)	Solar Plant capacity considering eligible CFA (Considering 19% CUF) up to 7.5 HP (MW)	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)
1	HIMATNAGAR	BHILODA	CHORIVAD	66KV CHORIWAD SS	UG-FLS-SS-1	GORAL,BHANPUR,DHOLIYA, KOTHAN,PRUTHVIPURA, KADIADRA,CHORIWAD, VADIAVIR, LAXMANPURA	9	2170	18015191	10.824	10.5

UTTAR GUJARAT VIJ COMPANY LIMITED

REQUEST FOR SELECTION (RfS) OF SPG
FOR

**PURCHASE OF SOLAR POWER THROUGH COMPETITIVE BIDDING
PROCESS [FOLLOWED BY REVERSE E-AUCTION]**

FOR

**SOLARIZATION OF VARIOUS 11KV FEEDERS OF 66/11 KV AMIRGADH
SUBSTATION IN UGVCL**

UNDER
RESCO MODE OF
PM-KUSUM COMPONENT-C
FEEDER LEVEL SOLARIZATION SCHEME

Issued by:
The Chief Engineer (P&P)
Uttar Gujarat Vij Company Ltd.,
CIN: U40102GJ2003SGC042906,
Regd. & Corporate Office, Visnagar road,
MEHSANA-384001, GUJARAT-INDIA
Web: www.ugvcl.com, Email: cepp@ugvcl.com

Disclaimer:

1. Though adequate care has been taken while preparing this RfS document, the Bidders shall satisfy themselves that the document is complete in all respects. Intimation of any discrepancy shall be given to this office immediately. If no intimation is received from any Bidder within fifteen (15) days from the date of notification of RfS/ Issue of the RfS documents, it shall be considered that the RfS document is complete in all respects and has been received by the Bidder.
2. Uttar Gujarat Vij Company Limited (UGVCL) reserves the right to modify, amend or supplement this RfS document and the draft PPA including selection process and evaluation criteria, if deemed necessary by it or the same is required under Law. Such change shall be posted on Bidding Portal.
3. While this RfS has been prepared in good faith, neither UGVCL nor their employees or advisors make any representation or warranty, express or implied, or accept any responsibility or liability, whatsoever, in respect of any statements or omissions herein, or the accuracy, completeness or reliability of information, and shall incur no liability under any law, statute, rules or regulations as to the accuracy, reliability or completeness of this RfS, even if any loss or damage is caused by any act or omission on their part.
4. This RfS is not an agreement and is neither an offer nor invitation to the prospective bidders or any other person. The purpose of this RfS is to set the terms for the selection process and to provide Bidders with information that may be useful to them in preparation and submission of their Bids.
5. The bidder shall bear all its costs associated with or relating to the preparation and submission of its bid, including but not limited to preparation, copying, postage, delivery fees or any other costs incurred in connection with or relating to its bid. All such costs and expenses will remain with the bidder and the authority shall not be liable in any manner whatsoever for the same or for any other costs or other expenses incurred by a bidder in preparation of submission of the bid, regardless of the conduct or the outcome of the bidding process.
6. UGVCL reserves the right to annul the bid process and/or reject any or all of the Bids submitted in response to this RfS document at any stage without assigning any reasons whatsoever. In such cases UGVCL will refund the EMD, if any, and cannot be subjected to any liability whatsoever due to such rejection/cancelation.
7. This RfS is invited from SPG under Component –C of MNRE, Government of India's PM-KUSUM Scheme for Solarization Agricultural feeders of selected 66/11 KV Sub-station and the availability of CFA is subject fulfillment of terms & conditions of the scheme, disbursement of CFA by MNRE to the State of Gujarat and MNRE's evaluation of data for various projects under this Tender. UGVCL and GUVNL shall not be responsible for non-receipt / part receipt of CFA or delay in disbursement of CFA to any project of any feeder, if reasons for such non-receipt / part receipt or delay in disbursement of CFA is attributable to the SPG entity. In such a case, UGVCL /GUVNL shall not be liable to pay /compensate any difference of CFA on account of less amount of CFA received from MNRE.

Notice Inviting RfS**No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-62 DT: 15.03.2023**

As authorized by the Gujarat Urja Vikas Nigam Ltd. (GUVNL) being State Implementing Agency (SIA) for Component-C of PM-KUSUM Scheme in the Gujarat State, the Chief Engineer (P&P)-UGVCL **invites this Request for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV AMIRGADH Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode.**

The setting up of Solar Power Generator (SPG) under this RfP shall involve Design, survey, supply, installation, testing, commissioning, operation & maintenance for 25 years from Commercial Operation Date, grid connectivity through erection of 11kV line to connect the plant with concerned 66 / 11 KV Substation, installation & operation of RMS of Solar power plant through RESCO model for Solarization of 11kV feeders of 66/11 KV AMIRGADH substation in UGVCL under PM-KUSUM scheme – Component C -feeder level Solarization (FLS).

The RfS documents may be down loaded from web site <https://ugvcl.nprocure.com> (For view, download and on line submission) and UGVCL's website www.ugvcl.com (for view download only) (To view the PDF file please use "Acrobat Reader" software which can be downloaded from "Adobe "website.)

RfS bid offer is required to be submitted by **online mode only in electronic form on website <https://ugvcl.nprocure.com>** (i.e. under preliminary, technical and price offer stage of online). **The copy of necessary documents as specifically mentioned in RfS is/are required to be submitted in physical form also at following address, within 5 days from the date of submission through online mode, to:-**

**The Chief Engineer (P&P),
Uttar Gujarat Vij Company Ltd.,
Regd. & Corporate Office,
Visnagar road,
MEHSANA-384001,GUJARAT-INDIA**

RfS document for feeder level Solarization under PM-KUSUM-Component-C in UGVCL

RfS Schedule: -

1	NIT /RfS No.	UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-62
2	NIT Issue Date	15.03.2023
3	Bidding portal	https://ugvcl.nprocure.com
4	Document description	RfS Document for purchase of power through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV AMIRGADH Sub-station in the supply area of UGVCL. Which involves Design, Survey, Supply, installation, testing , commissioning ,Operation & maintenance for 25 years from Commercial Operation date (COD) of grid connected substation level Solar power plant , erection and maintenance of its associated 11 KV Line to evacuate power to the substation with Remote Monitoring System (RMS) as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.
5	Tender/RfS Document fee	Rs. 10000+ Rs. 1800/- (GST @18%)= Rs. 11800/- (Eleven Thousand Eight hundred only) Payment of Tender fee can be accepted by RTGS/NEFT. In case of payment through DD/Banker's Cheque the scanned copy of original documents shall have to be uploaded with the bid on- line and original copy of the same will have to be submitted, at the office of the Chief Engineer (P&P), UGVCL Mehsana, within 5 days from the scheduled date of the on-line bid opening (Tender Fee EMD stage).
6	EMD	Payment of Earnest Money deposit (EMD) can be accepted by RTGS/NEFT. In case of payment through DD/Banker's Cheque/Pay Order /Bank Guarantee, the scanned copy of original documents shall have to be uploaded with the bid on- line and original copy of the same will have to be submitted, at the office of the Chief Engineer (P&P), UGVCL Mehsana, within 5 days from the scheduled date of on-line bid opening. (Tender Fee EMD stage). The EMD of Rs. 1 lakhs / MW as per offered capacity .
7	Pre-bid meeting	Date and timing: 28.03.2023 at 11:30 Hrs Venue: Conference Hall, UGVCL, Corporate Office, Visanagar Road, Mehsana (The Agency who wants to attend the pre-bid meeting is requested to intimate us at least one day in advance prior to pre-offer meeting by e-mail only on following e-mail IDs

RfS document for feeder level Solarization under PM-KUSUM-Component-C in UGVCL

		sesolar@ugvcl.com cepp@ugvcl.com
8	Last Date & Time of submission of On- line bid in electronic form (Tender Fee, EMD, Technical & Financial Tariff offer. (This is mandatory)	Date: 05.04.2023, Time:-18:00 Hrs
9	Date of opening of Tender Fee, EMD on-line	Date: 06.04.2023, Time:-11:00 Hrs
10	Submission of original copy of DD/ Banker's Cheque/Pay Order /Bank Guarantee	Within 5 days from the scheduled date of on-line bid opening of Tender Fee & EMD stage. (On working days, During office hours)
11	Date of opening of Technical offer on-line (If possible)	Date: 15.04.2023, Time:-11:00 Hrs
12	Tentative Date of on – line opening of financial "Tariff bid" (Price bid) (If possible)	Date: 18.04.2023, Time:-11:00 Hrs
13	Reverse e-auction	Date of Reverse e-auction will be displayed on e-reverse bidding portal and it will be conveyed through e-mail to the eligible bidders. . The bidders shall require to create e auction user id on https://e-auction.nprocure.com/ The bidder shall require to mention their e-auction user id in the on-line submission of technical bid. This is mandatory.
Note: Bidders shall ensure that they have verified the scanned copies of the documents uploaded by them and documents shall open properly without any error. It shall be sole responsibility of the bidder that the uploaded documents (in PDF form) remain legible and should not be password protected.		

UGVCL GSTIN No: 24AAACU6551F1Z1

- Every bidder has to inform their GSTIN No. at the time of payment of applicable fees

Care to be taken for submission of bid:

AS PER THE NOTICE OF THE INVITATION OF RfS DOCUMENT (NEWS PAPER ADVERTISEMENT), THE BID IS INVITED BY **e-tender (ON – LINE) SYSTEM**, FOR WHICH FOLLOWING CONDITIONS ARE MANDATORY.

[A] ALL REQUIRED DOCUMENTS ARE TO BE SUBMITTED IN ONLINE MODE ONLY EXCEPT DOCUMENTS REQUIRED AGAINST PAYMENT OF TENDER FEE & EARNEST MONEY DEPOSIT (EMD), Bank Guarantee etc. as specifically mentioned in this tender documents.

[B] The documents mentioned in RfS Document are required ***to be uploaded in technical stage of online bid submission***. In case of not uploading of required document in online offer or uploading of wrong document, the bid may not be considered for technical evaluation. However, the Bidder have to furnish all required documents physically and it will be the responsibility of the bidder to submit the same within specified timeline.

[C] Bidders are requested to submit price – offer (financial bid) through on-line mode (e-RfS electronic form) only and not to submit the price offer in physical form. This is mandatory. If price offer is submitted in physical form, the bid/RfS offer will be summarily rejected.

[D] It is mandatory for all the bidders to confirm and agree all the terms and condition of bid including the condition to submit the bid only through on-line mode, the RfS documents, draft Power Purchase Agreement and RMS Communication and Security Architecture- PM KUSUM SEDM Platform attached herewith as a part of the whole tender. By confirming this, bidder will also confirm all the amendments thereafter issued time to time and will be automatically binding to the bidder.

[E] UGVCL at its sole discretion may ask additional clarification or information or documents from the bidder who is found to be eligible in pre-qualification criteria.

Note:- Bidder should be familiar with websites <https://ugvcl.nprocure.com> & www.ugvcl.com, <https://e-auction.nprocure.com/> for information regarding revision/corrigendum/Amendment in RfS Document till due date of online submission and thereafter. No separate / individual communications shall be sent in this regard and no public notice shall be issued in newspaper.

Any technical query, information and clarifications that may be required pertaining to this RfP should be referred to: **The Chief Engineer(P&P), Uttar Gujarat Vij Company Ltd., Regd. & Corporate Office, Visnagar Road, MEHSANA-384001, (Gujarat)**

E-Mail:- cepp@ugvcl.com; with a copy to sesolar@ugvcl.com

UGVCL reserves the right to reject any OR all RfS Documents/offers without assigning any reasons thereof.

**For and on behalf of UGVCL
Chief Engineer (P&P)**

ANNEXURE-3										
List of Solar Power plant with details 11 KV feeders Covered, Notified Plant Capacity, Annual Energy requirement, EMD & PBG										
Circle	Division	Sub division	Name of Sub Station 66KV/11KV	Name of Solar Plant (Bid plant Number)	Name of Ag Feeders covered under Sub ststion	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Total Consumption up to 7.5 HP Eligible for CFA (KWH)	Solar Plant capacity considering eligible CFA (Considering 19% CUF) up to 7.5 HP (MW)	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)
PALANPUR	PALANPUR-2	IQBALGADH	66KV AMIRGADH SS	UG-FLS-SS-21	DAMA,GADHADA,KALEDI, KHUNIYA	4	938	6124030	3.679	3.5

UTTAR GUJARAT VIJ COMPANY LIMITED

REQUEST FOR SELECTION (RfS) OF SPG
FOR

**PURCHASE OF SOLAR POWER THROUGH COMPETITIVE BIDDING
PROCESS [FOLLOWED BY REVERSE E-AUCTION]**

FOR

**SOLARIZATION OF VARIOUS 11KV FEEDERS OF 66/11 KV PANCHADA
SUBSTATION IN UGVCL**

UNDER
RESCO MODE OF
**PM-KUSUM COMPONENT-C
FEEDER LEVEL SOLARIZATION SCHEME**

Issued by:
The Chief Engineer (P&P)
Uttar Gujarat Vij Company Ltd.,
CIN: U40102GJ2003SGC042906,
Regd. & Corporate Office, Visnagar road,
MEHSANA-384001, GUJARAT-INDIA
Web: www.ugvcl.com, Email: cepp@ugvcl.com

Disclaimer:

1. Though adequate care has been taken while preparing this RfS document, the Bidders shall satisfy themselves that the document is complete in all respects. Intimation of any discrepancy shall be given to this office immediately. If no intimation is received from any Bidder within fifteen (15) days from the date of notification of RfS/ Issue of the RfS documents, it shall be considered that the RfS document is complete in all respects and has been received by the Bidder.
2. Uttar Gujarat Vij Company Limited (UGVCL) reserves the right to modify, amend or supplement this RfS document and the draft PPA including selection process and evaluation criteria, if deemed necessary by it or the same is required under Law. Such change shall be posted on Bidding Portal.
3. While this RfS has been prepared in good faith, neither UGVCL nor their employees or advisors make any representation or warranty, express or implied, or accept any responsibility or liability, whatsoever, in respect of any statements or omissions herein, or the accuracy, completeness or reliability of information, and shall incur no liability under any law, statute, rules or regulations as to the accuracy, reliability or completeness of this RfS, even if any loss or damage is caused by any act or omission on their part.
4. This RfS is not an agreement and is neither an offer nor invitation to the prospective bidders or any other person. The purpose of this RfS is to set the terms for the selection process and to provide Bidders with information that may be useful to them in preparation and submission of their Bids.
5. The bidder shall bear all its costs associated with or relating to the preparation and submission of its bid, including but not limited to preparation, copying, postage, delivery fees or any other costs incurred in connection with or relating to its bid. All such costs and expenses will remain with the bidder and the authority shall not be liable in any manner whatsoever for the same or for any other costs or other expenses incurred by a bidder in preparation of submission of the bid, regardless of the conduct or the outcome of the bidding process.
6. UGVCL reserves the right to annul the bid process and/or reject any or all of the Bids submitted in response to this RfS document at any stage without assigning any reasons whatsoever. In such cases UGVCL will refund the EMD, if any, and cannot be subjected to any liability whatsoever due to such rejection/cancellation.
7. This RfS is invited from SPG under Component –C of MNRE, Government of India's PM-KUSUM Scheme for Solarization Agricultural feeders of selected 66/11 KV Sub-station and the availability of CFA is subject fulfillment of terms & conditions of the scheme, disbursement of CFA by MNRE to the State of Gujarat and MNRE's evaluation of data for various projects under this Tender. UGVCL and GUVNL shall not be responsible for non-receipt / part receipt of CFA or delay in disbursement of CFA to any project of any feeder, if reasons for such non-receipt / part receipt or delay in disbursement of CFA is attributable to the SPG entity. In such a case, UGVCL /GUVNL shall not be liable to pay /compensate any difference of CFA on account of less amount of CFA received from MNRE.

Notice Inviting RfS**No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-71 DT: 17.03.2023**

As authorized by the Gujarat Urja Vikas Nigam Ltd. (GUVNL) being State Implementing Agency (SIA) for Component-C of PM-KUSUM Scheme in the Gujarat State, the Chief Engineer (P&P)-UGVCL **invites this Request for Selection of SPG through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV PANCHADA Sub-station in the supply area of UGVCL under PM-KUSUM Scheme Feeder level Solarization through RESCO Mode.**

The setting up of Solar Power Generator (SPG) under this RfP shall involve Design, survey, supply, installation, testing, commissioning, operation & maintenance for 25 years from Commercial Operation Date, grid connectivity through erection of 11kV line to connect the plant with concerned 66 / 11 KV Substation, installation & operation of RMS of Solar power plant through RESCO model for Solarization of 11kV feeders of 66/11 KV PANCHADA substation in UGVCL under PM-KUSUM scheme – Component C -feeder level Solarization (FLS).

The RfS documents may be down loaded from web site <https://ugvcl.nprocure.com> (For view, download and on line submission) and UGVCL's website www.ugvcl.com (for view download only.) (To view the PDF file please use "Acrobat Reader" software which can be downloaded from "Adobe "website.)

RfS bid offer is required to be submitted by **online mode only in electronic form on website <https://ugvcl.nprocure.com>** (i.e. under preliminary, technical and price offer stage of online). **The copy of necessary documents as specifically mentioned in RfS is/are required to be submitted in physical form also at following address, within 5 days from the date of submission through online mode, to:-**

**The Chief Engineer (P&P),
Uttar Gujarat Viji Company Ltd.,
Regd. & Corporate Office,
Visnagar road,
MEHSANA-384001, GUJARAT-INDIA**

RfS document for feeder level Solarization under PM-KUSUM-Component-C in UGVCL

RfS Schedule: -

1	NIT /RfS No.	UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-71
2	NIT Issue Date	17.03.2023
3	Bidding portal	https://ugvcl.nprocure.com
4	Document description	RfS Document for purchase of power through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV PANCHADA Sub-station in the supply area of UGVCL. Which involves Design, Survey, Supply, installation, testing , commissioning ,Operation & maintenance for 25 years from Commercial Operation date (COD) of grid connected substation level Solar power plant , erection and maintenance of its associated 11 KV Line to evacuate power to the substation with Remote Monitoring System (RMS) as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.
5	Tender/Rfs Document fee	Rs. 10000+ Rs. 1800/- (GST @18%)= Rs. 11800/- (Eleven Thousand Eight hundred only) Payment of Tender fee can be accepted by RTGS/NEFT. In case of payment through DD/Banker's Cheque the scanned copy of original documents shall have to be uploaded with the bid on- line and original copy of the same will have to be submitted, at the office of the Chief Engineer (P&P), UGVCL Mehsana, within 5 days from the scheduled date of the on-line bid opening (Tender Fee EMD stage).
6	EMD	Payment of Earnest Money deposit (EMD) can be accepted by RTGS/NEFT. In case of payment through DD/Banker's Cheque/Pay Order /Bank Guarantee, the scanned copy of original documents shall have to be uploaded with the bid on- line and original copy of the same will have to be submitted, at the office of the Chief Engineer (P&P), UGVCL Mehsana, within 5 days from the scheduled date of on-line bid opening. (Tender Fee EMD stage). The EMD of Rs. 1 lakhs / MW as per offered capacity .
7	Pre-bid meeting	Date and timing: 28.03.2023 at 11:30 Hrs Venue: Conference Hall, UGVCL, Corporate Office, Visanagar Road, Mehsana (The Agency who wants to attend the pre-bid meeting is requested to intimate us at least one day in advance prior to pre-offer meeting by e-mail only on following e-mail IDs

		sesolar@ugvcl.com cepp@ugvcl.com
8	Last Date & Time of submission of On- line bid in electronic form (Tender Fee, EMD, Technical & Financial Tariff offer. (This is mandatory)	Date: 10.04.2023, Time:-18:00 Hrs
9	Date of opening of Tender Fee, EMD on-line	Date: 11.04.2023, Time:-11:00 Hrs
10	Submission of original copy of DD/ Banker's Cheque/Pay Order /Bank Guarantee	Within 5 days from the scheduled date of on-line bid opening of Tender Fee & EMD stage. (On working days, During office hours)
11	Date of opening of Technical offer on-line (If possible)	Date: 18.04.2023, Time:-11:00 Hrs
12	Tentative Date of on – line opening of financial "Tariff bid" (Price bid) (If possible)	Date: 20.04.2023, Time:-11:00 Hrs
13	Reverse e-auction	Date of Reverse e-auction will be displayed on e-reverse bidding portal and it will be conveyed through e-mail to the eligible bidders. . The bidders shall require to create e auction user id on https://e-auction.nprocure.com/ The bidder shall require to mention their e-auction user id in the on-line submission of technical bid. This is mandatory.
Note: Bidders shall ensure that they have verified the scanned copies of the documents uploaded by them and documents shall open properly without any error. It shall be sole responsibility of the bidder that the uploaded documents (in PDF form) remain legible and should not be password protected.		

UGVCL GSTIN No: 24AAACU6551F1ZI

- Every bidder has to inform their GSTIN No. at the time of payment of applicable fees

Care to be taken for submission of bid:

AS PER THE NOTICE OF THE INVITATION OF RfS DOCUMENT (NEWS PAPER ADVERTISEMENT), THE BID IS INVITED BY e-tender (ON – LINE) SYSTEM, FOR WHICH FOLLOWING CONDITIONS ARE MANDATORY.

[A] ALL REQUIRED DOCUMENTES ARE TO BE SUBMITTED IN ONLINE MODE ONLY EXCEPT DOCUMENTS REQUIRED AGAINST PAYMENT OF TENDER FEE & EARNEST MONEY DEPOSIT (EMD), Bank Guarantee etc. as specifically mentioned in this tender documents.

[B] The documents mentioned in RfS Document are required **to be uploaded in technical stage of online bid submission**. In case of not uploading of required document in online offer or uploading of wrong document, the bid may not be considered for technical evaluation. However, the Bidder have to furnish all required documents physically and it will be the responsibility of the bidder to submit the same within specified timeline.

[C] Bidders are requested to submit price – offer (financial bid) through on-line mode (e-RfS electronic form) only and not to submit the price offer in physical form. This is mandatory. If price offer is submitted in physical form, the bid/RfS offer will be summarily rejected.

[D] It is mandatory for all the bidders to confirm and agree all the terms and condition of bid including the condition to submit the bid only through on-line mode, the RfS documents, draft Power Purchase Agreement and RMS Communication and Security Architecture- PM KUSUM SEDM Platform attached herewith as a part of the whole tender. By confirming this, bidder will also confirm all the amendments thereafter issued time to time and will be automatically binding to the bidder.

[E] UGVCL at its sole discretion may ask additional clarification or information or documents from the bidder who is found to be eligible in pre-qualification criteria.

Note:- Bidder should be familiar with websites <https://ugvcl.nprocure.com> & www.ugvcl.com, <https://e-auction.nprocure.com/> for information regarding revision/corrigendum/Amendment in RfS Document till due date of online submission and thereafter. No separate / individual communications shall be sent in this regard and no public notice shall be issued in newspaper.

Any technical query, information and clarifications that may be required pertaining to this RfP should be referred to: **The Chief Engineer(P&P), Uttar Gujarat Vij Company Ltd., Regd. & Corporate Office, Visnagar Road, MEHSANA-384001, (Gujarat)**

E-Mail:- cepp@ugvcl.com; with a copy to sesolar@ugvcl.com

UGVCL reserves the right to reject any OR all RfS Documents/offers without assigning any reasons thereof.

**For and on behalf of UGVCL
Chief Engineer (P&P)**

ANNEXURE-3**List of Solar Power plant with details 11 KV feeders Covered, Notified Plant Capacity, Annual Energy requirement, EMD & PBG**

Circle	Division	Sub division	Name of Sub Station 66KV/11KV	Name of Solar Plant (Bid plant Number)	Name of Ag Feeders covered under Sub ststion	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Total Consumption up to 7.5 HP Eligible for CFA (KWH)	Solar Plant capacity considering eligible CFA (Considering 19% CUF) up to 7.5 HP (MW)	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)
PALANPUR	PALANPUR-2	VADGAM, JALOTRA	66KV PANCHADA SS	UG-FLS-SS-30	KARSHANPURA,MEJARPURA, CHELANA,GURUDEV,SHERPURA, CHITRODA	6	493	5500543	3.305	3.0

ANNEXURE-3

List of Substation wise Solar Power plants with details 11 KV feeders Covered, Notified Plant Capacity, Annual Energy requirement, EMD & PBG

Sr. No.	Tender No.	Circle	Division	Sub division	Name of Sub Station 66KV/11KV	Name of Solar Plant (Bid plant Number)	Name of Ag Feeders covered under Sub station	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Total Consumption up to 7.5 HP Eligible for CFA (KWH)	Solar Plant capacity considering eligible CFA (Considering 19% CUF) up to 7.5 HP (MW)	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)
1	TN-42	HIMATNAGAR	BHILODA	CHORIVAD	66KV CHORIWAD SS	UG-FLS-SS-1	GORAL,BHANPUR,DHOLIYA,KOTHAN,PRUTHVIPURA,KADIADRA,CHORIWAD,VADIIVIR,LAXMANPURA	9	2170	18015191	10.824	10.5
2	TN-43	PALANPUR	PALANPUR-2	JALOTRA,MALAN	66KV JALOTRA SS	UG-FLS-SS-2	MOTIPURA,VASAN,MANKA,THUR,VANSOL,BHATVADI,MOTETA,KAMALPUR,VASAI,MUMANVAS,DHANALI,ATHIDRA	12	1500	13582832	8.161	8.0
3	TN-44	MEHSANA	VISNAGAR	SATLASANA,KHERALU-1	66KV HOTALPUR SS	UG-FLS-SS-3	CHITRODIPURA,RAMPUR,RADHUPURA,CHHELPURA,DHARAVANIYA,KUDVA,AMARPURA	7	1562	13968952	8.393	8.0
4	TN-45	PALANPUR	PALANPUR-2	IQBALGADH	66KV IQBALGADH SS	UG-FLS-SS-4	JETHI,IBALGADH,BANTAVADA,AMIRGADH,DHOLIYA,DABHELA	6	955	13074083	7.855	7.5
5	TN-46	HIMATNAGAR	MODASA	MODASA RURAL	66KV MEDHASAN SS	UG-FLS-SS-5	RAJENDRANAGAR,DHOLIYA,ADPODRA,SAJAPUR,GADHA,MEDHASAN,RAMPUR,LALPUR	8	2229	12899886	7.750	7.5
6	TN-47	PALANPUR	PALANPUR-2	DANTA	66KV DANTA SS	UG-FLS-SS-6	NAVAVAS,VELVADA,PUNJPUR,GORAD,PETHAPUF,DIVDI,RASULPURA	7	1785	11728601	7.047	7.0
7	TN-48	PALANPUR,MEHSANA	PALANPUR-2,VISNAGAR	VADGAM,KHERALU-2	66KV KODRAM SS	UG-FLS-SS-7	RANCHHODPURA,THALVADA,CHAMUNDA,CHANSOL,DALWANA,DULAN,A,VITHODA,SEDHNI,NAVINAGRI,IBALPURA,PANDVA	11	916	12062562	7.247	7.0
8	TN-49	HIMATNAGAR	IDAR	IDAR RURAL	66KV CHITRODA SS	UG-FLS-SS-8	UMIYA,POSHINA,MOTAKOTDA,DEVASAN,GHANTI,DHARAPUR,CHITRODA	7	1215	11082244	6.658	6.5
9	TN-50	HIMATNAGAR	HIMATNAGAR	HIMATNAGAR RURAL,RANASAN	66KV HMT-2 SS	UG-FLS-SS-9	DESASAN (A),MANORPUR (A),PURAL,AKODRA,KANKROL,VIRAWADA,BERANA	7	1661	10644589	6.395	6.0
10	TN-51	Mehsana	Visnagar	Kheralu-1, Vадnagar	66KV KHANPUR SS	UG-FLS-SS-10	SHOBHASAN,VAGHADI,KARSANPURA,KHANPUR,MADHASNA,KHATASN,A,SAGTHALA,UNDANI,CHADA	9	1523	8737960	5.250	5.0
11	TN-52	MEHSANA	VISNAGAR	SATLASANA,KHERALU-1	66KV VARETHA SS	UG-FLS-SS-11	RINCHHADA,CHIKANA,DALISANA,KANEDIA,NIZAMPUR,JORAPURA,SHIVAM,KESHARPURA,GALALPUR,NALU,VARETHA	11	1352	8299992	4.987	4.5
12	TN-53	HIMATNAGAR	IDAR	BHILODA-1	66KV VASAI SS	UG-FLS-SS-12	BEDASAN,SHABRI,SURYNAGAR,TAKHATGADH,MUDETI (V),VASAI,MUNAI	7	1019	7528376	4.523	4.5
13	TN-54	HIMATNAGAR	IDAR	DESHOTAR,JADAR	66KV SUNDARPUR SS	UG-FLS-SS-13	MADHAVA,MANPURA,PATALIYA	3	1037	7333209	4.406	4.0
14	TN-55	PALANPUR	PALANPUR-2	JALOTRA,DANTA	66KV MORIYA SS	UG-FLS-SS-14	VIKAS,SARITA,KISAN,PAVAN,HARIGADH	5	938	7110228	4.272	4.0

ANNEXURE-3

List of Substation wise Solar Power plants with details 11 KV feeders Covered, Notified Plant Capacity, Annual Energy requirement, EMD & PBG

Sr. No.	Tender No.	Circle	Division	Sub division	Name of Sub Station 66KV/11KV	Name of Solar Plant (Bid plant Number)	Name of Ag Feeders covered under Sub station	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Total Consumption up to 7.5 HP Eligible for CFA (KWH)	Solar Plant capacity considering eligible CFA (Considering 19% CUF) up to 7.5 HP (MW)	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)
15	TN-56	PALANPUR	PALANPUR-2, PALANPUR-1	IQBALGADH, PALANPUR RURAL, DANTI WADA	66KV HEBATPUR SS	UG-FLS-SS-15	KHEMANA, MALANA, ANTROLI, MALP URIYA	4	698	7256664	4.360	4.0
16	TN-57	PALANPUR	PALANPUR-1	DANTIWADA	66KV JEGOL SS	UG-FLS-SS-16	DHANERI, MALIVAS, DERI, GANGUDA RA	4	910	6761605	4.062	4.0
17	TN-58	HIMATNAGAR	HIMATNAGAR	PRANTU, SALA L	66KV PRANTU SS	UG-FLS-SS-17	BALISANA, VADAVASA, GALTESHWA R, SALAL, KESHARPURA, RASLOD, POG LU, SONASAN, VADRAD, AMRAPUR, JESINGPURA, ZINZVA, PALLACHAR, PILU DARA	14	841	6929484	4.163	4.0
18	TN-59	HIMATNAGAR	MODASA	MEGHRAJ-2	66KV RELLAWADA SS	UG-FLS-SS-18	SHANGAL, PANCHAL, SHANTIPURA, ISARI	4	1594	6903331	4.148	4.0
19	TN-60	HIMATNAGAR	TALOD	CHOILA	66KV VASNIREL SS	UG-FLS-SS-19	VANTA, CHHAPARIYA, SHANGAL	3	1265	6971452	4.189	4.0
20	TN-61	HIMATNAGAR	MODASA	TINTOI	66KV TINTOI SS	UG-FLS-SS-20	KUDOL, ADHERA	2	818	7357616	4.421	4.0
21	TN-62	PALANPUR	PALANPUR-2	IQBALGADH	66KV AMIRGADH SS	UG-FLS-SS-21	DAMA, GADHADA, KALEDI, KHUNIYA	4	938	6124030	3.679	3.5
22	TN-63	PALANPUR	PALANPUR-2	DANTA	66KV GANGAVA SS	UG-FLS-SS-22	ABHAPURA, VADUSAN, BHEMAL	3	896	6199697	3.725	3.5
23	TN-64	PALANPUR	PALANPUR-2	IQBALGADH	66KV JUNI SAROTRI SS	UG-FLS-SS-23	MOHANPURA KAMPA, ARNIVADA, MAHADEV, BOR DER, BALUNDR, VAGHORIYA	6	896	6392356	3.841	3.5
24	TN-65	PALANPUR	PALANPUR-2	JALOTRA, MALAN	66KV VASAN SS	UG-FLS-SS-24	GOPALPURA, TALEPURA, SABARADA, NALASAR, NALASAR, AKASH, KUDARA T, DHANDHA	8	588	5638407	3.669	3.5
25	TN-66	HIMATNAGAR	IDAR	KHEDBRAHMA, VADALI	66KV TANDALIYA SS	UG-FLS-SS-25	JADISEBAL, KAKARBORA, KARUNDA, SILWAD	4	1146	6609262	3.971	3.5
26	TN-67	SABARMATI	GANDHINAGAR RURAL, TALOD	RAKHIAL, TALOD-2, CHOILA	66KV UNTARADA SS	UG-FLS-SS-26	ZALAVAD, LAXMIPURA, GHADHVAL, GAMANPURA, LAHERIPURA, MANEKPUR, DIPESWARI	7	941	6134177	3.686	3.5
27	TN-68	PALANPUR	PALANPUR-2	DANTA	66KV GORAD SS	UG-FLS-SS-27	KANTIVAS, DALPURA, RANGPUR, SANDHOSI	4	1081	5496395	3.302	3.0
28	TN-69	PALANPUR	PALANPUR-2	DANTA, JALOTRA	66KV MOTASADA SS	UG-FLS-SS-28	GURUVADA, MOTASADA, ANDHARIYA, BAMANIYA	4	665	5101881	3.065	3.0
29	TN-70	PALANPUR	PALANPUR-2, PALANPUR-1	MALAN, PALANPUR HIGHWAY, PALANPUR RURAL	66KV PALANPUR-2 SS	UG-FLS-SS-29	VASADA, PALANPUR (KASBA) AG, AMBETHA, LAXMANPURA, SANGARA	5	649	5805543	3.488	3.0
30	TN-71	PALANPUR	PALANPUR-2	VADGAM, JALOTRA	66KV PANCHADA SS	UG-FLS-SS-30	KARSHANPURA, MEJARPURA, CHELANA, GURUDEV, SHERPURA, CHITRODA	6	493	5500543	3.305	3.0
31	TN-72	MEHSANA	VISNAGAR	SATLASANA	66KV SATLASANA SS	UG-FLS-SS-31	TARANGA, KAJIPURA, DAVOL, MALAPURA, RANPUR, VAGHAR, SUDASANA, BHATVAS, MUMANVAS, UMARI	10	1720	5442168	3.270	3.0

ANNEXURE-3

List of Substation wise Solar Power plants with details 11 KV feeders Covered, Notified Plant Capacity, Annual Energy requirement, EMD & PBG

Sr. No.	Tender No.	Circle	Division	Sub division	Name of Sub Station 66KV/11KV	Name of Solar Plant (Bid plant Number)	Name of Ag Feeders covered under Sub station	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Total Consumption up to 7.5 HP Eligible for CFA (KWH)	Solar Plant capacity considering eligible CFA (Considering 19% CUF) up to 7.5 HP (MW)	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)
32	TN-73	HIMATNAGAR	BHILODA	SHAMLAJI	66KV PALLA SS	UG-FLS-SS-32	BHAVANPUR(JAMBUDI),KHERADI, RAYPUR(JASHAVANTPURA()),DHAND HASAN,PALLA	5	1727	5726757	3.441	3.0
33	TN-74	HIMATNAGAR	HIMATNAGAR, TALOD	RANASAN, TALOD-2	66KV PUNSARI SS	UG-FLS-SS-33	NAVANAGAR, JASHANPUR, AJMELPURA, ANTROLI, AMRAPUR, LALPUR	6	1115	5383222	3.234	3.0
34	TN-75	PALANPUR	DEESA-2, PALANPUR-1	PANTHAWAD A, DANTIWAD A	66KV GANGUWADA SS	UG-FLS-SS-34	VAIDHNATH, JEET, BHILADA, HARIYA VADA	4	621	4319063	2.595	2.5
35	TN-76	MEHSANA	VISNAGAR	KHERALU-1, KHERALU-2	66KV KHERALU SS	UG-FLS-SS-35	MOTI HIRVANI, MANDROPUR, NANDALI, CHOTIYA, DABHODA, SAMOJA, MALEK PUR, MAHIYAL, NORTOL, THANGANA, GHORISANA, SUNDHIA	12	1510	4376288	2.629	2.5
36	TN-77	MEHSANA	VISNAGAR	SATLASANA	66KV SUDASANA SS	UG-FLS-SS-36	AMBOLA, UMRECHA, KHARI, BAPUNAGAR, TAKHATPURA, MOTI BHALU	6	1161	4925912	2.960	2.5
37	TN-78	HIMATNAGAR	BHILODA	BHILODA-1	66KV KISANGADH SS	UG-FLS-SS-37	PANCHGAMDA, ZANZAR, WAGHESH VARI, MALEKPUR, KISHANGADH	5	893	4628496	2.781	2.5
38	TN-79	HIMATNAGAR	MODASA	TINTOI, MEGH RAJ-2	66KV SHANGAL SS	UG-FLS-SS-38	HATHIPURA, MATH, RAMJI	3	836	4534110	2.724	2.5
39	TN-80	PALANPUR	PALANPUR-1	PALANPUR RURAL, CHAND ISAR	66KV RAJPUR SS	UG-FLS-SS-39	NILKANTH, PAKHANVA, VEER, LUNAV A, UTTAMPURA	5	406	3351015	2.013	2.0
40	TN-81	PALANPUR	PALANPUR-1	DANTIWADA	66KV DANTIWADA SS	UG-FLS-SS-40	BHAKHAR, JAY CHEHAR, VAGHROL, BHUTEDI, GANES HPURA, RAMSIDA, LATIYA, BHAKODA R, SIKARIYA, RAJKOT	10	505	3677970	2.210	2.0
41	TN-82	PALANPUR	PALANPUR-2	MALAN	66KV VIRAMPUR SS	UG-FLS-SS-41	GAVARA, HADMANA, KANPURA	3	743	3838146	2.306	2.0
42	TN-83	HIMATNAGAR	HIMATNAGAR	SALAL	66KV AMODARA SS	UG-FLS-SS-42	ARSODA, NANANPUR, FATEHPUR, AMODARA, VAGHROTA, GOKUL, AMB AWADA, MEMADPUR	8	487	3630186	2.181	2.0
43	TN-84	HIMATNAGAR	IDAR	DESHOTAR, IDAR TOWN	66KV SURPUR SS	UG-FLS-SS-43	BARVAV, SABALWAD	2	501	4100822	2.464	2.0
44	TN-85	PALANPUR	PALANPUR-2	DANTA	66KV SOLSANDA SS	UG-FLS-SS-44	SEKDA, JORAPURA, MOTIPURA	3	650	3078949	1.850	1.5
45	TN-86	PALANPUR	PALANPUR-2	MALAN, AMBAJI	66KV BHAYALA SS	UG-FLS-SS-45	KHAPRA, PADALIYA	2	440	2813957	1.691	1.5
46	TN-87	PALANPUR	DEESA-2, DEESA-1	THARAD-1, WAV	66KV DEL SS	UG-FLS-SS-46	VANDAN, RAMDEV, RAMNAGAR, DEV PURA, BAPAS, BALI, CANAL, JANDLA, TIRANGA	9	717	2831205	1.701	1.5
47	TN-88	PALANPUR	PALANPUR-2	JALOTRA	66KV SUKHPURA SS	UG-FLS-SS-47	BHARAT, SHAKTI, SURAJ, SUKH, KABIR	5	324	2843274	1.708	1.5
48	TN-89	PALANPUR	DEESA-2	THARAD-2, THARAD-1	66KV RAMPURA SS	UG-FLS-SS-48	KASVI, AJAVADA, AMBADESHWAR, BHAPI, RAJKOT	5	1933	2785321	1.673	1.5

ANNEXURE-3

List of Substation wise Solar Power plants with details 11 KV feeders Covered, Notified Plant Capacity, Annual Energy requirement, EMD & PBG

Sr. No.	Tender No.	Circle	Division	Sub division	Name of Sub Station 66KV/11KV	Name of Solar Plant (Bid plant Number)	Name of Ag Feeders covered under Sub station	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Total Consumption up to 7.5 HP Eligible for CFA (KWH)	Solar Plant capacity considering eligible CFA (Considering 19% CUF) up to 7.5 HP (MW)	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)
49	TN-90	MEHSANA	VISNAGAR	SATLASANA	66KV DHAROI SS	UG-FLS-SS-49	KHODAMALI,VAVADI	2	359	2537760	1.525	1.5
50	TN-91	HIMATNAGAR	TALOD	DHANSURA	220KV DHANSURA SS	UG-FLS-SS-50	BARNOLI,DOLPUR,BAPUPURA,SINOL,HIRAPUR,SIKKA	6	924	2973369	1.786	1.5
51	TN-92	HIMATNAGAR	HIMATNAGAR	SALAL	66KV DALPUR SS	UG-FLS-SS-51	MADHA,VAJAPUR,SAMPAD,MORWAD	4	431	3146726	1.891	1.5
52	TN-93	HIMATNAGAR	HIMATNAGAR	HIMATNAGAR RURAL	66KV GADHODA SS	UG-FLS-SS-52	GADHODA,ZATKOR,HADIYOL	3	357	2591172	1.557	1.5
53	TN-94	HIMATNAGAR	HIMATNAGAR	HIMATNAGAR RURAL,SALAL	66KV HAJIPUR SS	UG-FLS-SS-53	JITOD,NADARI,HAJIPUR,PIPLODI,KATWAD,SEJIPUR,DALPUR,SONGADH	8	313	2851613	1.713	1.5
54	TN-95	HIMATNAGAR	TALOD	TALOD-2	66KV HARSOL SS	UG-FLS-SS-54	DADARDA,DOLJI,JAVANPURA,TAJPUR	4	854	3167475	1.903	1.5
55	TN-96	HIMATNAGAR	MODASA	MEGHRAJ-1	66KV KHERAI SS	UG-FLS-SS-55	ADHODIYA,ROYANIYA,BHEMAPUR	3	1247	2983496	1.793	1.5
56	TN-97	HIMATNAGAR	BHILODA	SHAMLAJI	66KV LAXMANPUARA SS	UG-FLS-SS-56	RAMELA,VAGHPUR,DEHGAMDA,KUNDOL	4	1064	2976304	1.788	1.5
57	TN-98	HIMATNAGAR	IDAR	IDAR RURAL,JADAR	66KV NETRAMALI SS	UG-FLS-SS-57	SHRI GANESH,HASANPURA,NEW NETRAMLI	3	320	2720147	1.634	1.5
58	TN-99	HIMATNAGAR	HIMATNAGAR	SALAL,RANASAN	66KV NIKODA SS	UG-FLS-SS-58	NIKODA,CHHADARADA,CHANDRAPURA KAMPA,VILASPURA KAMPA,HARIPURA	5	584	3202155	1.924	1.5
59	TN-100	HIMATNAGAR	HIMATNAGAR	MEHTAPURA, HIMATNAGAR RURAL	66KV NURPURA SS	UG-FLS-SS-59	VAKTAPUR,KAPODA,DOLGADH	3	490	2969146	1.784	1.5
60	TN-101	HIMATNAGAR	TALOD	TALOD-1	66KV UJEDIYA SS	UG-FLS-SS-60	KHEROL,KARMIPURA,SALATPUR,BORIYA	4	920	3313782	1.991	1.5
61	TN-102	SABARMATI	BAVLA,BOPAL	BAVLA-1,BAVLA INDUSTRIAL	66KV BAVLA SS	UG-FLS-SS-61	BADARKHAR,NANODRA,VISALPUR,RASAM,RAJODA	5	547	3236148	1.944	1.5
62	TN-103	SABARMATI	BAVLA,SABARMATI	SANAND-2,VIRAMGAR RURAL,BAVLA-1	66KV ZAMP SS	UG-FLS-SS-62	RETHAL,MOTIKISHOL,SHIKHAR,METAL,KAVLA,DEVADTHAL	6	295	3130253	1.881	1.5
63	TN-104	SABARMATI	BAVLA	DHANDHUKA	132KV DANDHUKA SS	UG-FLS-SS-63	BALAHANUMAN,JALIYA,PADANA	3	1249	2607586	1.567	1.5
Total								357	60524	373945142	224.955	208.5

Pre-Bid Meeting for Tender No. UGVCL/Project/Solar/PM-KUSUM-C-FLS/ TN-42 to TN-104 (63 nos. of Tenders) "Request for Selection of Solar Power Generators for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of PM-KUSUM Component-C Feeder level Solarization Scheme of MNRE, covering 63 Substations with aggregate Solar plant capacity of 208.5 MW

Date:- 28.03.2023

Time: 11.30 A.M

Place :- Conference Hall, UGVCL Corporate Office

Sr No.	Name of Agency	Name	Designation	Mobile No.	E-mail Id	Signature
1	GWE Infra	Kirti N. Shah	Owner	93777 80999	kinrisha111@gmail.com	
2	Shrisai Ele.	Chirag Prajapati	Project Manager	8487013107	sooftop@shrisaielec.co.in	
3	Shrisai Electrical	Sanjay J. Thakor	Project Engineer	9265778123	sooftop@shrisaielec.co.in	
4	Aratao Solar Pvt Ltd	Bhurat Mali	Project Manager	9687055273	bhurat@arataosolar.co	
5	KAI ZEN NOW	Yogesh Purohit	Owner	9978985558	KaiZennowahd@gmail.com	
6	PATEL KALPESH KUMAR RAMCHA DARG	PATEL KALPESH KUMAR RAMCHA DARG	Owner's representative	9979210757	rkpatel2026@yahoo.co.in	
7	SK BUILD CON	Sayid Khan K. Sheikh	Owner	9879892693	Sayidkhanskekh@gmail.com	
8	AES - Solar HARSH PATEL	HARSH PATEL	DIRECTOR	6160833896	info.aes.solar@gmail.com	
9	AES - Solar DHARU SHAH	DHARU SHAH	DIRECTOR	6350165126	info.aes.solar@gmail.com	
10	Wagoo Akash Patel	Akash Patel	Manager	9321962094	akashpatel@wagoo.com	
11	Aadmanimbhansolus Pvt Ltd	Pratik Patel	Manager	9712005896	Pratik@Aadmanimbhansolus.com	
12	Ruxon Solar Pvt Ltd	Komal Patel	Manager	9726583767	komal@ruxonsolar.co	
13	Accurate Trade Link	Jaydeep Patel	Manager	9924444586	Jaydeep.accuratetrade link@gmail.com	
14	HEER solar	Prateek Dikar	Project Head	8347057790		
15	HEER solar	Clinton Kadd	Project Manager	9427063359	prateek.dikar63@gmail.com	

Date:- 28.03.2023

Place :- Conference Hall, UGVCL Corporate Office

Time: 11.30 A.M

Sr No.	Name of Agency	Name	Designation	Mobile No.	E-mail Id	Signature
16	Chaitanya Energy	Chaitanya Patel	Spd Head	7600059071	gxeenergy2014@gmail.com	[Signature]
17	G.K.E	Chirag Bhandari	Project	7600059072		[Signature]
18	S.K. Deshi	Shirish Deshi	Project	8460468660	Shirish.Deshi.1735@gmail.com	[Signature]
19	S.K. Pooch	Shirish Pooch	MD	9723070267	517poochsvip@gmail.com	[Signature]
20	Fusion Technology	Pooch Patel	Partner	8200697007	fusiontech025@gmail.com	[Signature]
21	Savajipal	Dharmendra Patel	Owner	9687059904	5b.savajipalbrothers@gmail.com	[Signature]
22	EFarm International Pvt Ltd	Parvez Singh	Director	7129309277	Parvez@farminternational.com	[Signature]
23	Zodiac Energy Ltd	Rajdeep Upadhyay	Asst. Manager Project	9099913383	tendatazodiacenergy.com	[Signature]
24	Zebson Solar Power Solution	Pooch Patel	Partner	9738616848	Zebson solar@gmail.com	[Signature]
25	Photonics	Narinder Patel	Partner	9427364330	narinderphotonics@gmail.com	[Signature]
26	Photonics	Apurva Bhandari	Sales Head	9034060722	Bhandari@photonics.com	[Signature]
27	H.B. Solar Energy Pvt Ltd	Bhavesn K. Patel	Owner	9825422613	bhavesn603@gmail.com	[Signature]
28	Soline Solar Pvt Ltd	Bhavesn Patel	Director	9898552424	info@soline.in	[Signature]
29	Beech Industries	B.K. Shah	Owner	9824590800	beechindustries@gmail.com	[Signature]
30	Kosol Energy	Parag Nyaas	Director	9825207677	Parag@nyaas.com	[Signature]
31	Vinaya Solutions	Indrajit Rathod	Owner	8320754781	info@vinaya.solutions.in	[Signature]
32	Vee Spot	Vijayesh Sharma	Owner	98254982	Vee@vspot.com	[Signature]
33	BASP Ent Pvt	Rathan Patel	Owner	9099912130	baspenterprise@gmail.com	[Signature]

Date:- 28.03.2023

Time: 11.30 A.M

Place :- Conference Hall, UGVCL Corporate Office

Sr No.	Name of Agency	Name	Designation	Mobile No.	E-mail Id	Signature
34	Topsyn Energy Ltd.	Panchal Pooresh	Sr. Executive	7096446055	tender@topsynenergy.com	P.N.Pam
35						
36						
37						
38						
39						
40						
41						
42						
43						
44						
45						
46						
47						
48						
49						
50						
51						

	Gujarat Urja Vikas Nigam Limited		
	Sardar Patel Vidyut Bhavan, Race Course, Vadodara: 390 007		
	CIN U40109GJ2004SGC045195	An ISO 9001:2015 Certified Company Phone: 0265-2311797, Fax No. 0265-2327483	
No : GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/ 1114			Date : 22-06-2023

To,
The Chief Engineer (P&P)
Uttar Gujarat Vij Co. Ltd.
Corporate Office,
Mahesana.

Sub:- Proposal to give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding followed by e-Reverse Auction for purchase of Power for Solarization of various 11kv Agricultural feeders emanating from selected Sub-stations in the supply area of UGVCL as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.


Ref:- Y.O.L. No. CORMHSUG/0439/05/2023 dtd. 01-06-2023

With reference to your proposal vide letter dated 01-06-2023 in above subject matter, it is to state that same was placed before the GUVNL Board in Board meeting dated 06-06-2023.

In above regard, the Board discussed and decided as under;

- 1) UGVCL shall issue Letter of Intent (LoI) to those bidders who have quoted tariff up to Rs.3.00 per unit within 3 days and seek the acknowledgement for the same as per Bid documents.
- 2) Thereafter, UGVCL shall seek consent of all other bidders who have qualified under bucket filling mechanism as per bid documents and quoted tariff in excess of Rs. 3.00 per unit to agree for tariff of Rs. 3.00 per unit. Based on consents, UGVCL may issue LoI to theses bidders and seek acknowledgement for the same.
- 3) UGVCL shall immediately take above actions and inform the same to GUVNL along with quantum of power for which LoI are issued.

This is for further appropriate actions after observing all the formalities.


 (S S Modi)
 Chief Engineer (Tech)

CFWCs to:-

- The Managing Director, GUVNL, Vadodara.
- The Director (Tech/Fin.), GUVNL, Vadodara
- The Managing Director, UGVCL, Vadodara.

Copy to:-

- The GM (Comm./RE), GUVNL, Vadodara.
- The Company Secretary, GUVNL, Vadodara.

	Gujarat Urja Vikas Nigam Limited		
	Sardar Patel Vidyut Bhavan, Race Course, Vadodara: 390 007		
	CIN U40109GJ2004SGC045195	An ISO 9001:2015 Certified Company Phone: 0265 2331797 Fax No. 0265-2327483	
No : GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/ 1369			Date : 11-08-2023

To,
The Chief Engineer (P&P)
Uttar Gujarat Vij Co. Ltd.
Corporate Office,
Mahesana.

Sub:- Proposal to give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding followed by e-Reverse Auction for purchase of Power for Solarization of various 11kv Agricultural feeders emanating from selected Sub-stations in the supply area of UGVCL as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.

Ref:- 1. Your Letter No. UGVCL/R&C/Solarcell/PM-KUSUM-C/FLS/983 dated 26.07.2023
2. Your Letter No. UGVCL/R&C/Solarcell/PM-KUSUM-C/FLS/1019 dated 01.08.2023

With reference to your proposal vide letters dated 26.07.2023 and 01.08.2023, the Competent Authority has approved to take appropriate actions for this tender as per this office letter No. GUVNL/PM-KUSUM-C/FLS/1114 dated 22.06.2023 after observing all the formalities, please


 (S S Modi)
 Chief Engineer (Tech)

CFWCs to:-

- The Managing Director, GUVNL, Vadodara.
- The Director (Tech/Fin.), GUVNL, Vadodara
- The Managing Director, UGVCL, Vadodara.

	Gujarat Urja Vikas Nigam Limited			262
	Sardar Patel Vidyut Bhavan, Race Course, Vadodara: 390 007			
	CIN: U40109GJ2004SGC045195	An ISO 9001:2015 Certified Company Phone: 0265-2311797, Fax No. 0265-2327483		
No : GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/1454				Date : 31-08-2023

By e-Sarkar & E-mail

To,
The I/C Chief Engineer (P&P)
Uttar Gujarat Vij Co. Ltd.
Corporate Office,
Mehsana.

Sub:- Proposal to give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding followed by e-Reverse Auction for purchase of Power for Solarization of various 11 KV Agriculture feeders emanating from selected Sub-stations in the supply area of UGVCL as per the PM-KUSUM Scheme Component-C Feeder Level Solarization through RESCO model.

Ref:- (1) Y.O.L. No. UGVCL/R&C/ Solar Cell/PM-KUSUM-C/FLS/1116 dtd. 25-08-2023
(2) T.O.L. No. GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/1369 dtd. 11-08-2023
(3) T.O.L. No. GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/1246 dtd. 15-07-2023
(4) T.O.L. No. GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/1114 dtd. 22-06-2023

In continuation to your letter no. 1116 dated 25-08-2023, it is requested to refer this office letters mentioned under reference at Sr. No. (2) to (4), tender terms and MNRE Guidelines for further appropriate actions after observing all the formalities.


 31/8/23

(S S Modi)
Chief Engineer (Tech)

CFWCs to:-

- The Director (Tech), GUVNL, Vadodara

	Gujarat Urja Vikas Nigam Limited (An ISO 9001:2015 Certified Company) <i>Sardar Patel Vidyut Bhavan Race Course,</i> <i>Vadodara-390007</i> (CIN U40109GJ2004SGC045195)	
cetech.guvnl@gebmail.com	Tele (Di): (0265) 2340205	Date: 21/02/2023
No. GUVNL/Tech/SolarCell/PM-KUSUM-C/FLS/37/		

By E-Mail

To,
The Chief Engineer (Project)
 Paschim Gujarat Vij Company Ltd.,
 Corporate Office,
Rajkot

Sub: Ratification of RfS documents for PM KUSUM-C Feeder Level Solarization
Ref: 1) PGVCL's letter No. PGVCL/DSM/KUSUM-C/FLS/138 dated 13-01-23
 2) Meeting held at GTPS, Gandhinagar dated 20-01-23
 3) Commerce Dept. GUVNL e-mail to PGVCL dated 30-01-23 & 04-02-23
 4) PGVCL's e-mail dated 09-02-23

PGVCL vide letter dated 13-01-23 has submitted modified RfP documents for PM KUSUM Component-C Feeder level Solarisation and requested to ratify, so as to invite bids for FLS.

A meeting in this regard was held at GTPS Gandhinagar on 20-01-23 with officials of GUVNL & PGVCL.

Subsequently, PGVCL vide e-mail dated 09-02-23 has submitted modified draft tender of PM KUSUM Component-C Feeder level Solarization and requested to ratify for publishing at DISCOMs level.

In above regard, it is to inform that Competent Authority of GUVNL has ratified the same.

Moreover, DISCOMs shall ensure that MNRE Guidelines is followed scrupulously.

This is for your information and also requested to convey the same to other DISCOMs from your end under intimation to this office for uniform implementation, please.


 (S S Modi)

Addl. Chief Engineer (Tech)

Cfwcs to:-

The Managing Director, GUVNL
 The Director (Tech/ Fin.), GUVNL
 The Managing Director, DGVCL/ MGVCL/ PGVCL/ UGVCL

	Gujarat Urja Vikas Nigam Limited (An ISO 9001:2015 Company) CIN U40109GJ2004SGC045195 Registered and Corporate Office: Sardar Patel Vidyut Bhavan Race Course, Vadodara-390007		
	cetech.guvnl@gebmail.com sesolar.guvnl@gebmail.com	web site: www.guvnl.com	

No. GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/455

Date: 02-02-2023

By E-mail

To,
 The Chief Engineer (P&P)
 Uttar Gujarat Vij Co. Ltd.
 Corporate Office,
 Mehsana

Sub:- To give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding against various small scale Solar plants of covered under the Component-C Feeder Level Solarization of PM-KUSUM Scheme.

Ref:- Y.O.L. No. UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/73 dtd. 19-01-2023

In continuation to your letter No. 73 dated 19-01-2023, it is requested to refer this office letter No. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/58 dtd. 06-01-2023 and take appropriate actions accordingly after observing all the formalities, please.



(S S Modi)

Additional Chief Engineer (Tech)

Copy fwcs to:-

- The Director (Tech), GUVNL, Vadodara

	Gujarat Urja Vikas Nigam Limited (An ISO 9001:2015 Company) CIN U40109GJ2004SGC045195 Registered and Corporate Office: Sardar Patel Vidyut Bhavan Race Course, Vadodra-390007		
	cetech.guvnl@gebmail.com sesolar.guvnl@gebmail.com	web site: www.guvnl.com	

No. GUVNL/Tech/ Solar Cell/PM-KUSUM-C/FLS/ 58

Date: 06-01-2023

By E-mail

To,
 The Managing Director
 DGVCL/MGVCL/PGVCL/UGVCL
 Corporate Office,
 Surat/Vadodara/Rajkot /Mehsana

Sub:- Filing tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding against various small scale Solar plants covered under Component-C- Feeder level Solarization of PM-KUSUM Scheme.

Ref:- (1) PGVCL letter No. PGVCL/Project/DSM/PM-KUSUM-C/FLS/TN-03/2598 dtd. 01-10-2022
 (2) UGVCL letter No. UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/1415 dtd. 21-10-2022
 (3) MGVCCL letter No. MGVCCL/RA&C/DSM/PM-KUSUM-C/FLS/TN-1/1427 dtd. 18-11-2022
 (4) PGVCL letter No. PGVCL/DSM/KUSUM-C/FLS/3211 dtd. 23-12-2022
 (5) PGVCL letter No. PGVCL/DSM/KUSUM-C/FLS/65 dtd. 05-01-2023

With reference to DISCOMs' submission regarding to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding against various small scale Solar plants covered under Component-C- Feeder level Solarization of PM-KUSUM Scheme, it is to state that same was put up before the Competent Authority of GUVNL.

In above regard, the qualification requirement & criteria stipulated in PGVCL's RfP documents for PM-KUSUM, Component C for feeder level solarization has been reviewed. The qualification criteria and observation/ comments against the same as approved by the Competent Authority of GUVNL are as under:

(1) Technical qualification requirement & criteria:

- (a) Bidder shall have experience of execution of supply, installation and commissioning of grid connected solar power plants with cumulative capacity of 500 KWp considering capacity of individual solar plants of 03 kWp or more, during last five years with any govt. or private organization in India.

Observation / comments:

As regard to above provision of RfP documents, it is to state that the experience criteria for installation of solar plant seems to be restrictive in nature. Even GUVNL's bid for MW scale project are not having such requirement. Therefore, the same may not be kept to increase the bidder participation.

- (b) The Bidder should have Electrical contractor license in Gujarat. In case of non-availability of the same at the time of bid submission, the contractor should submit a valid electrical contractor license issued by Govt. of Gujarat within 1 month of award of contract. The bidder should submit an undertaking in this regard along with the bid. Or submit a copy of contract executed for electrical work with a contractor having a valid license.

Observation / comments:

The bidder is possessing Electrical Contractor License or not, has no bearing on the execution / performance of the solar project as the bidder can avail the services of licensed electrical contractor as per their requirement. Further, the person shall have minimum technical qualification to eligible for getting electrical contractor license. Therefore, this requirement may be removed as many bidders who want to participate in the bid may not have minimum technical qualification to get the electrical license and may want to avail services from third party contractor if become successful bidder.

(2) Financial qualification criteria:

- (a) The Bidder should have positive net worth for each of the last three Financial Years (FY:19-20, FY:20-21 & FY:21-22). In case of JV, at least one member must fulfil this requirement.
- (b) To ascertain that the Bidder has sufficient means to manage the fund requirements for the Project, the Bidder shall be required to have Minimum Average Annual Turnover during LAST 3 financial years (FY2019-20, FY 2020-21, FY2021-22) not be less than amount in Rs. mentioned against each separate individual Solar Plant in Annexure K20 for which the bidder wants to bid. (If audited annual accounts for FY 2021-22 are not available, provide accounts for FY 2020-21, FY 2019-20 and 2018-19)

Observation / comments:

In regard to above provisions regarding minimum turnover requirement of Rs. 1.05 Crs per MW, it is to state that certain entities who want to participate in bid may not have requisite turnover specifically in respect of Start-up entities but may have adequate net worth to fund the project.

Further, GUVNL's bid for MW solar projects provides for net worth requirement only to ascertain financial capabilities of bidder to execute the project.

Therefore, in order to attract more participation in the bid, it is suggested to provide that the bidder shall meet either (i) turnover requirement of Rs. 1.05 Crs / MW or (ii) Net worth requirement of Rs. 0.80 Cr / MW in line GUVNL's RfP and

proportionate net worth requirement for part capacity, as minimum qualifying criteria.

(3) Other conditions of RfP documents:

- (a) The SPG shall ensure submission of the "In-Principle" land documents including documents such as Agreements to Sell, Banakhat etc. within 90 days from the date of issuance of work order after which PPA shall be signed by PGVCL with the SPG. Further, the SPG shall submit the final land documents within the period of 4 months after the date of signing of PPA for the entire required land duly registered by appropriate revenue authority.

Observation / comments:

The land documents may be sought at the time of commissioning of the project instead of providing limited time period.

- (b) The bidder is required to submit make and other details of Solar PV module, Inverter, meter, circuit breaker, conductor/cable and other material before signing of PPA.

Observation / comments:

These details related to plants & machineries may not be available at the time of signing of PPA. If required, such details may be sought at the time of commissioning of project instead of seeking the details upfront.

DISCOMs are requested for carrying out necessary modification in RfP documents and properly publicise the scheme for more competition.

In view of above, it is requested to instruct concerned officer for further appropriate actions after observing all the formalities, please.

Thanking you.

Yours faithfully,



(S S Modi)

Additional Chief Engineer (Tech)

Copy fwcs to:-

- The Managing Director, GUVNL, Vadodara
- The Director (Tech/A&F), GUVNL, Vadodara
- The General Manager (Comm./RE&IPP), GUVNL, Vadodara

	Gujarat Urja Vikas Nigam Limited (An ISO 9001:2008 Company) CIN U40109GJ2004SGC045195 Registered and Corporate Office: Sardar Patel Vidyut Bhavan Race Course, Vadodara-390007		
	Email: cetech.guvnl@gmail.com	web site: www.guvnl.com	

No. GUVNL/Tech/Solar-Cell/ PM-KUSUM-C/FLS/1693

Date: 21/06/2022

To
 The Managing Director,
 DGVCL/MGVCL/PGVCL/UGVCL
 Corporate Office,
 Surat/Vadodara/Rajkot/Mehsana

Sub: Revision in allocation of Quantity and inviting Request for Selection (RfS) of Solar Power Generator (SPG) for Feeder Level Solarization Component-C of PM-KUSUM Scheme.

- Ref:1. MNRE's OM No. 32/645/2017-SPV DIVISION, Date: 04-12-2020
 2. MNRE's sanction vide no-32/54/2018- SPV DIVISION Date:17-03-2021
 3. EPD, GoG letter to MNRE no-REN/11/2021/552/B1 Date:13-01-2022
 4. EPD, GoG letter to GUVNL no-SLR/11/2016/2284/B1 Date:07-04-2022
 5. MNRE's sanction vide no-32/54/2018- SPV DIVISION Date:18-05-2022
 6. GUVNL's letter to all DISCOM no-GUVNL/Tech/Solar-Cell/PM-KUSUM-C/FLS/1500 Date:01-06-2022

Respected Sir,

In continuation with the GUVNL's letter dated 01-06-2022 to all DISCOMs for inviting RfS under Component-C (FLS). It is to inform you that MNRE vide email dated:24-05-2022 informed all SIAs regarding initiating the tendering process for the balance quantity as under:-

"Proposal for extension and expansion of the PM-KUSUM Scheme has been submitted for approval of the Ministry of Finance and the remaining quantities, which could not be allocated in this round, would be allocated once MoF's approval is received. In the meantime, SIAs anticipating fresh/ additional allocations can undertake activities such as identification of sub-station/feeders/beneficiaries; preparation of tender documents; filing of tariff petition with the respective State regulator, if required; initiate the tendering process; etc. However, the Letter of Award shall be given only after getting the firm allocation from the Ministry."

Sr. No.	State	Feeder Level Solarization (Nos)	Balance Demand pending for approval (Nos.)
2	Gujarat	39832	260668

During the PRM held under the chairmanship of MD, GUVNL with MDs and CEs of all DISCOMs on 15-06-2022, it was discussed and decided to invite Request for Selection

(RfS) under Component-C of FLS for total demanded quantity : 3,00,000 nos. of agriculture pumps.

Considering the status of existing Ag. consumers having load of up to 7.5HP, the quantity to be distributed among all DISCOMs in proportionate to the total connections of up to 7.5 HP is proposed as under:-

DISCOM	Total Ag. Connections	Total Ag. Connections Up to 7.5 HP	Earlier Allocation to DISCOM (Agriculture Pumps)	Proposed Fresh Allocation to DISCOM (Agriculture Pumps)	Total Allocation to DISCOM (Agriculture Pumps) For inviting RFS
DGVCL	206102	164232	465	39035	39500
MGVCL	202749	133882	1855	30345	32200
PGVCL	1085119	758895	30820	151680	182500
UGVCL	413981	190410	6692	39108	45800
Total	1907951	1247419	39832	260168	300000

Here, it is apt to mention that the tariff to be discovered for the Solar plants will be different for different capacity of Solar plants at different locations.

Further, MNRE is providing CFA for agriculture connections pumps of capacity up to 7.5 HP only. Hence, DISCOMs are requested to select feeders having at least 90% agriculture connections up to 7.5 HP firstly. In case of 90% criteria is not met, DISCOMs may select feeders in down grade manner gradually. i.e. first 89%, 88 %up to 80 %.

In view of the above, GUVNL being an SIA, hereby authorize all DISCOMs to invite the RfS to select SPG as per the tender to be modified by PGVCL for the Feeder level Solarization under Component-C of PM-KUSUM Scheme, in consultation with GUVNL.

DISCOM are requested, after selection of SPG / parties the discovered tariff may be consulted with GUVNL and subsequently before signing agreement, tariff needs to be adopted by GERC.

Concerned officers may please be directed to take necessary action in this matter by observing MNRE's guideline dated: 04-12-2020 and amendments thereof.

This is submitted with the approval of MD, GUVNL.


Thanking you,

Yours Faithfully,

18/01/2021
Addl. Chief Engineer (Tech)

CFWC:-

1. The Director(Tech) – GUVNL, Vadodara
2. GM (Commerce / IPP)

	Gujarat Urja Vikas Nigam Limited (An ISO 9001:2015 Company) CIN U40109GJ2004SGC045195 Registered and Corporate Office: Sardar Patel Vidyut Bhavan Race Course, Vadodara-390007	 
cetech.guvnl@gebmail.com	www.guvnl.com	Tele (Di) : (0265) 2340205 PBX : (0265) 2310582 to 86

No. GUVNL/Tech/Solar Cell/PM-KUSUM-B/૨૫૫૭

Date: 29/12/2022

To,
 Managing Director,
 DGVCL/MGVCL/PGVCL/UGVCL,
 Corporate Office,
 Surat/Vadodara/Rajkot/Mehasana

Sub:- Inviting Request for Selection (RfS) of Solar Power Generator (SPG) for feeder level solarization under Component-C of PM KUSUM Scheme.

Ref.:- (1) GUVNL letter no. GUVNL/Tech/solarCell/PM-KUSUM-C/FLS/1693 dtd:21.06.2022
 (2) MGVCCL letter no. MGVCCL/RA&C/DSM/PMKUSUM-C/FLS/1325 dtd:03.11.2022

Respected Sir,

GUVNL vide letter no. 1693 dtd:21.06.2022 has informed all DISCOMs for inviting Request for Selection (RfS) of Solar Power Generator (SPG) for feeder level solarization under Component-C of PM KUSUM Scheme considering selection of feeders having at least 90% agriculture connection up to 7.5 HP firstly. In case of 90% criteria is not met, DISCOMs may select feeders in down grade manner gradually i.e. firstly 89%, 88%.... up to 80%.

Now, from the submission of MGVCCL vide letter no.1325 dtd:03.11.2022, they had selected feeders having 7.5 HP connections between 60% to 80% in down grade manner gradually i.e. 79%, 78%.... up to 60% for Request for Selection (RfS) of Solar Power Generator (SPG) for feeder level solarization under Component-C of PM KUSUM Scheme.

In view of submission of MGVCCL regarding feeder selection criteria, as approved by the Competent Authority of GUVNL, the above criteria mentioned in GUVNL's letter no.1693 dtd:21.06.2022 for selection of feeders has been removed with a view to increase solar capacity.

However, DISCOMs shall have to adhere to the MNRE guidelines and amendments issued from time to time for feeder level solarization under Component-C of PM KUSUM Scheme, please.

This is for further appropriate action after observing all the formalities, please.

Thanking you,

Yours Faithfully,

(S S Modi)

Additional Chief Engineer (Tech)

Copy fwcs to:

- The Director (Tech), GUVNL, Vadodara



Gujarat Urja Vikas Nigam Limited

(An ISO 9001:2008 Company) CIN U40109GJ2004SGC045195
Registered and Corporate Office: Sardar Patel Vidyut Bhawan Race Course,
Vadodara-390007

Email: guvnl@guvnl.com

web site: www.guvnl.com

Tel: (0) 2338164
PRX: 02338162 to 86
FAX: 02338164

No. GUVNL/Tech/Solar-Cell/PM-KUSUM/FLS/378

Date: 8/02/2022

To,
The Managing Director,
PGVCL, UGVCL
Corporate Office,
Rajkot, Mehsana

Sub: Inviting Request for Selection (RfS) from Solar Power Generator (SPG) for Feeder Level Solarisation under the Component-C of PM-KUSUM Scheme under RESCO mode.

Ref: 1. GUVNL letter no- GUVNL/Tech/Solar-cell/PMKUSUM-C-FLS/3307 Dt:04-12-2021
2. PGVCL Tender no- PGVCL/Project/DSM/PM-KUSUM-C-FLS/ TN-1 Dt:14-12-2021
3. UGVCL Tender no UGVCL/Project/SOLAR CELL/PM-KUSUM C-FLS/ TN-1 DT:14-12-2021

Sir,

PGVCL and UGVCL had published tenders for Feeder Level Solarisation under Component-C of PM-KUSUM Scheme for 4 nos. of Solar Plants in each DSICOM having various capacities from 125 KW to 439 KW.

It is noticed that, **no bid is received** even after extending due dates of submission of bids **3 times**, against the tenders.

As per MNRE's guideline, single power plant for multiple feeders emanating from same substation can be installed as per following conditions:-

*"Feeder level solar power plant may be installed to cater to the requirement of power for a **single feeder or for multiple agriculture feeders emanating from a distribution sub-station (DSS)** to feed power at 11 kV or at the higher voltage level side of the DSS depending upon on factors like availability of land, technical feasibility, etc., and there is no cap of the capacity of solar power plant for feeder level solarisation."*

Considering above, it is requested to invite a bid for a single power plant for one substation having solar plant capacity nearly 1 MW comprising of multiple agriculture feeders in the same substation considering about minimum 90% Ag. consumers up to 7.5 H.P. in the substation as per the scheme's guideline. The data of the feeders should be shared to GUVNL for upward submission to MNRE.

This being a Pilot Project having extreme importance, concerned Officer may please be instructed to take necessary actions to invite the RfS for feeder level Solarization immediately.

poopute
(P. M. Patel) 08/02/2022
Chief Engineer (Tech)

CFWC:-

1. The MD -GUVNL, Vadodara
2. The Director(Tech) - GUVNL

ઉત્તર ગુજરાત વીજ કંપની લિમિટેડ
૨૭, અને કોર્પોરેટ ડાયરી:
વિસનગરરોડ,
મેહસાના-૩૮૪૦૦૧ (ઉ.ગુ.)
CIN
U40102GJ2003SGC042906
Phone: (02762) 222080-81
Fax: 223574



UTTAR GUJARAT VIJ
COMPANY LIMITED
Regd. & Corporate Office:
Visnagar Road,
Mehsana- 384 001 (N.G.)
Web site: www.ugvcl.com
e-mail: corporate@ugvcl.com

UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/983

Date: 26/07/23

To,

The Chief Engineer (Tech)

Gujarat Urja Vikas Nigam Limited (GUVNL)

Sardar Patel Vidhyut Bhavan, Race Corse,

Vadodara-39007.

Subject: Proposal to give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding followed by e-Reverse Auction for purchase of Power for Solarization of various 11kv Agricultural feeders emanating from selected Sub-stations in the supply area of UGVCL as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.

- Ref. :-**
1. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM-C/FLS/1500
Dtd.01.06.2022
 2. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM/1693 Dtd.21.06.2022
 3. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-3,TN-4 & TN-5
Dtd.27&28.06.2022
 4. UGVCL Tender No :- UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-6 to TN-41
Dtd.15,16 & 17.09.2022 (36 nos. Tenders)
 5. UGVCL Letters to give consent to file tariff petition : 40 Solar Plants.
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/1415 Dtd.21.10.2022 (13 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/73 Dtd.19.01.2023 (24 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/222 Dtd.02.03.2023 (03 Plants)
 6. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/58 Dtd.06.01.2023.
 7. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/155 Dtd.02.02.2023.
 8. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/528 Dtd.06.03.2023.
 9. GUVNL/Tech/Solar Cell/KUSUM-C/FLS/371 Dtd.21.02.2023.
 10. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104
Dtd.15,16 & 17.03.2023 (63 nos. Tenders).
 11. UGVCL proposal for 44 nos. Tenders : CORMHSUG/0439/05/2023 Dtd.01.06.2023.
 12. GUVNL/Tech/Solar cell/PM-KUSUM-C/FLS/1114 Dtd.22.06.2023.
 13. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1246 Dtd.15.07.2023

Dear Sir,

With reference to the UGVCL's previous proposals in reference no 11, UGVCL had send proposal to give consent to file petition for 44 nos. of Tenders/Sub-stations with 169.5 MW capacity & 46337 nos. of consumers for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of PM- KUSUM Component-C Feeder level Solarization Scheme of MNRE, out of 63 Substations with aggregate Solar plant capacity of 208.5 MW.

As on date 17.07.2023 total 51 nos. of Tenders Price Bids Opened, status are as under :

Sr No.	Particular	Nos. of Tenders	Nos. of Ag Consumers	Nos. of Feeders	Nos. of Sub-Station	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)	Offered Solar Plant Capacity by Bidders (MW)
1	Total	63	60524	357	63	208.5	186.5
2	Scrap	11	7230	42	11	20.0	
3	Under Technical Scrutiny	1	1523	9	1	5	5.0
4	Price Bids Opened	51	51771	306	51	183.5	181.5
5	Already sent for approval	44	46337	265	44	171.0	169.5
6	Pending for approval	7	5434	41	7	12.5	12.00

11 nos. of Tenders / sub-stations are scrap due to no any bids received after 14 times extended time limit.

Out of 07 nos. of pending approval which price bids opened after 01.06.2023:

Tariff Received in N-Procure price bid for 06 nos. of Tenders in which Single Bids are received: Rs. 3.50/Kwh to Rs.4.55/Kwh.

Tariff Received by Reverse e-Auction for 01 nos. of Tenders in which more than One Bids (02 Bids) are received: Rs. 4.00/Kwh & Rs. 4.01/Kwh.

Validity of Price Bid : 01 Tender-09.09.2023, 01 Tender : 15.09.2023, 02 Tenders : 29.09.2023 & 03 Tenders-13.10.2023.

Details for 07 nos. of Tenders which Price Bids Opened are as under :

Table-A

Sr. No.	Tender No.	No. of Ag Feeders	No. of Connections	Notified Solar Plant capacity in MW	Technical Bid Opened Date	Price Bid Opened Date	Reverse e-Auction Date	Nos. of Bids	Total Offered Capacity for SS by Bidders	Online Tariff Received (Rs./KWH)	After Reverse Auction Tariff Received (Rs./KWH)
1	TN-76	12	1510	2.5	12.05.23	15.06.23	17.06.23	2	2.0	L1:4.02, L2:4.19	RL1 : 4.00 (1 MW), RL2 :4.01 (1 MW)
2	TN-78	5	893	2.5	01.06.23	15.06.23		1	2.5	4.55	
3	TN-94	8	313	1.5	01.06.23	01.07.23		1	1.5	3.75	
4	TN-95	4	854	1.5	15.06.23	11.07.23		1	1.5	3.50	

5	TN-98	3	320	1.5	18.05.23	03.06.23		1	1.5	4.50	
6	TN-103	6	295	1.5	15.06.23	01.07.23		1	1.5	3.50	
7	TN-104	3	1249	1.5	15.06.23	11.07.23		1	1.5	3.50	

Bidder wise propose solar plant capacity are as under :

Table-B

Sr. No.	Tender No.	Bidder Name	Name of Sub Station 66KV/11KV	Notified Solar Plant Capacity (MW)	Offered Solar Plant Capacity by Bidder (MW)	Propose Capacity to be Allot (MW)	Lowest Tariff Received (Rs./KWH)
1	TN-98	Sharadkumar Keshubhai Desai	66KV KHERALU SS	2.5	1.0	1.0	4.00
		Desai Ramilaben Sharadkumar			1.0	1.0	4.01
2	TN-78	M/s Platinum Agro Industries	66KV KISANGADH SS	2.5	2.5	2.5	4.55
3	TN-98	M/s JSR Renewable Consultants	66KV NETRAMALI SS	1.5	1.5	1.5	4.50
4	TN-94	M/s VIJAPURA IMPEX LLP, JV Partner : M/s Photonics Watertech Pvt Ltd.	66KV HAJIPUR SS	1.5	1.5	1.5	3.75
5	TN-103	Kamleshkumar Babulal Shah	66KV ZAMP SS	1.5	1.5	1.5	3.50
6	TN-95	M/s R K CORP	66KV HARSOL SS	1.5	1.5	1.5	3.50
7	TN-104	M/s R K CORP	132KV DANDHUKA SS	1.5	1.5	1.5	3.50

In all 07 nos. Tenders price bids opened after 01.06.2023 having tariff more than Rs. 3.00 per unit.

• Proposal: -

In view of the above substantial exercise carried out by UGVCL, it is requested to :-

a. Give approval to ask consent/LoI to agree Rs. 3.00 per unit as per GUVNL Letter No. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1114 Dtd. 22.06.2023.

b. If the notified capacity not get full through RL1 Bidder, in that case to make the bucket full of notified Capacity through next bidder RL2 bidder with matching of RL1 bidder tariff.

In this regard, it is requested to move the matter at appropriate level for further directives please.

This is for your kind information please.

Signed by: ENGINEER
GHANSHYAMSHAI HARGOVINDRAI
Location: Mehsana
Organization: Unit, Uttar Gujarat Vidyut Company Ltd.
Date: 26-Jul-2023 (01:12 PM)

Chief Engineer (P&P)

UGVCL, R&C, Mehsana

Copy f.w.c.s. to:

EA to M.D. Sir, UGVCL, Corporate office, Mehsana

Copy to :

1. The A.C.E. (Commerce), R&C office, UGVCL
2. The S.E., UGVCL, Circle office, Himmatnagar / Mehsana / Palanpur / Sabarmati

ઉત્તર ગુજરાત વીજ કંપની લિમિટેડ
રજી. અને કોર્પોરેટ ઓફિસ:
વિસ્નગર રોડ,
મેહસાના-૩૮૪૦૦૧ (ઉ.ગ.)
CIN
U40102GJ2003SGC042906
Phone: (02762) 222080-81
Fax: 223574



UTTAR GUJARAT VIJ
COMPANY LIMITED
Regd. & Corporate Office:
Visnagar Road,
Mehsana- 384 001 (N.G.)
Web site: www.ugvcl.com
e-mail: corporate@ugvcl.com

UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/

To,

The Chief Engineer (Tech)

Gujarat Urja Vikas Nigam Limited (GUVNL)

Sardar Patel Vidhyut Bhavan, Race Corse,

Vadodara-39007.

Subject: Proposal to give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding followed by e-Reverse Auction for purchase of Power for Solarization of various 11kv Agricultural feeders emanating from selected Sub-stations in the supply area of UGVCL as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.

- Ref. :-**
1. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM-C/FLS/1500
Dtd.01.06.2022
 2. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM/1693 Dtd.21.06.2022
 3. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-3,TN-4 & TN-5
Dtd.27&28.06.2022
 4. UGVCL Tender No :- UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-6 to TN-41
Dtd.15,16 & 17.09.2022 (36 nos. Tenders)
 5. UGVCL Letters to give consent to file tariff petition : 40 Solar Plants.
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/1415 Dtd.21.10.2022 (13 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/73 Dtd.19.01.2023 (24 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/222 Dtd.02.03.2023 (03 Plants)
 6. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/58 Dtd.06.01.2023.
 7. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/155 Dtd.02.02.2023.
 8. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/528 Dtd.06.03.2023.
 9. GUVNL/Tech/Solar Cell/KUSUM-C/FLS/371 Dtd.21.02.2023.
 10. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104
Dtd.15,16 & 17.03.2023 (63 nos. Tenders).

Dear Sir,

With reference to the UGVCL's previous proposals in reference no 5 and subsequent communications from GUVNL for preparation of modified tender document to make it simpler and subsequent ratification by GUVNL vide letter in reference no 9, UGVCL has published the modified RFP vide reference no 10 for inviting Request for Selection of Solar Power Generators for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of PM- KUSUM Component-C Feeder level Solarization Scheme of MNRE, covering 63 Substations with aggregate Solar plant capacity of 208.5 MW as under :

New Tenders Invited by UGVCL as per Modified Terms						Tender Invite Date	Tender No.
Sr No.	Nos. of Plants / Tenders	Consumers	Feeders	S/S	MW		
1	21	26926	144	21	117.5	15-03-2023	TN-42 to TN-62
2	8	6862	41	8	26.5	16-03-2023	TN-63 to TN-70
3	34	26736	172	34	64.5	17-03-2023	TN-71 to TN-104
Total	63	60524	357	63	208.5		

As on date 30.05.2023 total 44 nos. of Tenders Price Bids Opened, status as under :

Sr No.	Particular	Nos. of Tenders	Nos. of Ag Consumers	Nos. of Feeders	Nos. of Sub-Station	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)	Offered Solar Plant Capacity by Bidders (MW)
1	Total	63	60524	357	63	208.5	182.0
2	Under Bid Submission	14	9628	55	14	24.5	
3	Under PQC	2	1206	13	2	4.0	4.0
4	Under Technical Scrutiny	3	3353	24	3	9	8.5
5	Price Bids Opened	44	46337	265	44	171.0	169.5

Step taken for wider Publicity: -

- For wider publicity of the tender, UGVCL published the Advertisement in various newspapers : Divya Bhaskar, Indian Express & Financial Express all India edition as per the circular of Director(Tech)-GUVNL dated 25-1-23 considering the estimated cost above 100 Cr.
- mailed the advertisement to 726 Solar Roof Top EPC Developers.
- mailed the advertisement to 13 bidders who participated in the previous tender Notice TN 03 to TN-41.
- mailed the advertisement to the Empanelled Agencies of SKY-7, PM KUSUM-B-9 and PM KUSUM C(ILS)-5.

Tariff Received in N-Procure price bid for 22 nos. of Tenders in which Single Bids are received: Rs. 3.19/Kwh to Rs.4.48/Kwh.

Tariff Received by Reverse e-Auction for 22 nos. of Tenders in which more than One Bids are received: Rs. 2.75/Kwh to Rs.3.93/Kwh.

Validity of Price Bid : 01 Tender-27.08.2023, 02 Tenders : 01.09.2023, 25 tenders : 02.09.2023 & 16 Tenders-09.09.2023.

Details for 44 nos. of Tenders which Price Bids Opened are as under :

Table-A

Sr. No.	Tender No.	No. of Ag Feeders	No. of Connections	Notified Solar Plant capacity in MW	Technical Bid Opened Date	Price Bid Opened Date	Reverse e-Auction Date	Nos. of Bids	Total Offered Capacity for SS by Bidders	Online Tariff Received (Rs./KWH)	After Reverse Auction Tariff Received (Rs./KWH)
1	TN-42	9	2170	10.5	05.05.23	23.05.23	24.05.23	3	10.5	L1:3.19, L2:3.83, L3:5.95	3.19
2	TN-43	12	1500	8.0	05.05.23	09.05.23		1	8.0	3.25	
3	TN-44	7	1562	8.0	05.05.23	29.05.23	30.05.23	4	8.0	L1:3.25, L2:3.83, L3(2):3.96	RL-1 : 3.18 (4 MW), RL-2 :3.19 (Rest 4 MW)
4	TN-45	6	955	7.5	05.05.23	09.05.23		1	7.5	3.25	
5	TN-46	8	2229	7.5	05.05.23	29.05.23	30.05.23	4	7.5	L1:3.20, L2(2):3.96	3.20
6	TN-47	7	1785	7.0	05.05.23	09.05.23		1	7.0	3.35	
7	TN-48	11	916	7.0	05.05.23	18.05.23	20.05.23	3	7.0	L1:3.19, L2:3.75, L3:4.35	3.19
8	TN-49	7	1215	6.5	05.05.23	09.05.23		1	6.5	3.19	
9	TN-50	7	1661	6.0	05.05.23	09.05.23		1	6.0	3.25	
10	TN-52	11	1352	4.5	04.05.23	24.05.23	25.05.23	6	4.5	L1:2.99, L2:3.83, L3:3.95, L4:3.97, L5:4.19, L6:4.50	RL-1 : 2.95 (3 MW), RL-2 :2.96 (Rest 1.5 MW)
11	TN-53	7	1019	4.5	05.05.23	09.05.23		1	4.0	3.20	
12	TN-54	3	1037	4.0	05.05.23	09.05.23		1	4.0	3.20	
13	TN-55	5	938	4.0	05.05.23	18.05.23	20.05.23	2	4.0	L1:3.25, L2:4.35	3.25
14	TN-56	4	698	4.0	05.05.23	09.05.23		1	4.0	3.29	
15	TN-57	4	910	4.0	05.05.23	18.05.23	20.05.23	3	4.0	L1:3.25, L2:3.83, L3:4.35	3.25
16	TN-58	14	841	4.0	05.05.23	09.05.23		1	4.0	3.50	
17	TN-59	4	1594	4.0	05.05.23	11.05.23	16.05.23	2	4.0	L1 : 3.25, L2:3.96	3.25
18	TN-60	3	1265	4.0	05.05.23	09.05.23		1	4.0	3.25	
19	TN-61	2	818	4.0	05.05.23	11.05.23	16.05.23	2	4.0	L1 : 3.25, L2:3.83	3.25
20	TN-62	4	938	3.5	05.05.23	18.05.23		1	3.5	3.40	
21	TN-63	3	896	3.5	05.05.23	18.05.23	20.05.23	2	3.5	L1:3.40, L2:3.83	3.40
22	TN-64	6	896	3.5	05.05.23	09.05.23		1	3.5	3.30	
23	TN-65	8	588	3.5	05.05.23	18.05.23	20.05.23	2	3.5	L1:3.50, L2:4.44	3.50
24	TN-66	4	1146	3.5	05.05.23	11.05.23	16.05.23	2	3.5	L1: 3.40, L2:3.83	RL-1 : 3.34
25	TN-67	7	941	3.5	05.05.23	24.05.23	25.05.23	2	3.5	L1:3.50, L2:5.00	3.50
26	TN-68	4	1081	3.0	29.04.23	10.05.23	11.05.23	6	3.0	L1: 3.50, L2:3.70, L3 : 3.83, L4 (03) : 6.72	RL-1 : 3.39
27	TN-69	4	665	3.0	05.05.23	18.05.23		1	3.0	3.40	
28	TN-71	6	493	3.0	12.05.23	23.05.23	24.05.23	6	3.0	L1:3.30, L2:4.52 L3:4.54, L4:4.85 L5:4.99, L6:5.30	3.29
29	TN-72	10	1720	3.0	12.05.23	16.05.23		1	3.0	3.30	

30	TN-73	5	1727	3.0	12.05.23	16.05.23	17.05.23	3	3.0	L1:3.40, L2:3.83, L3:3.96	RL-1 : 3.39 (2 MW), L2 : 3.40 (Rest 1 MW)
31	TN-74	6	1115	3.0	12.05.23	16.05.23		1	3.0	3.40	
32	TN-75	4	621	2.5	12.05.23	23.05.23	24.05.23	2	2.5	L1:3.80, L2:4.46	3.80
33	TN-77	6	1161	2.5	04.05.23	23.05.23	25.05.23	4	2.5	L1:3.45, L2:3.65 L3 (02): 3.80	3.44
34	TN-81	10	505	2.0	12.05.23	16.05.23		1	2.0	3.83	
35	TN-83	8	487	2.0	12.05.23	16.05.23		1	1.0	3.75	
36	TN-84	2	501	2.0	12.05.23	23.05.23	24.05.23	2	2.0	L1:3.86, L2:4.50	RL-1 : 3.85 (1 MW), L2 : 4.50 (Rest 1 MW)
37	TN-87	9	717	1.5	12.05.23	23.05.23	24.05.23	2	1.5	L1:3.95, L2:4.52	3.93
38	TN-88	5	324	1.5	12.05.23	23.05.23		1	1.5	4.48	
Sr. No.	Tender No.	No. of Ag Feeders	No. of Connections	Notified Solar Plant capacity in MW	Technical Bid Opened Date	Price Bid Opened Date	Reverse e-Auction Date	Nos. of Bids	Total Offered Capacity for SS by Bidders	Online Tariff Received (Rs./KWH)	After Reverse Auction Tariff Received (Rs./KWH)
39	TN-89	5	1933	1.5	12.05.23	23.05.23	24.05.23	3	1.5	L1:3.80, L2:3.95, L3:4.49	3.63
40	TN-90	2	359	1.5	12.05.23	23.05.23		1	1.5	4.37	
41	TN-97	4	1064	1.5	12.05.23	23.05.23		1	1.5	3.95	
42	TN-99	5	584	1.5	12.05.23	16.05.23		1	1.5	3.83	
43	TN-100	3	490	1.5	12.05.23	16.05.23	17.05.23	2	1.5	L1:3.00, L2:4.30	RL-1 : 2.75 (1 MW), L2 : 4.30 (Rest 0.5 MW)
44	TN-101	4	920	1.5	12.05.23	16.05.23		1	1.5	3.83	

Bidder wise propose solar plant capacity are as under :

Table-B

Sr. No.	Tender No.	Bidder Name	Name of Sub Station 66KV/11KV	Notified Solar Plant Capacity (MW)	Offered Solar Plant Capacity by Bidder (MW)	Propose Capacity to be Allot (MW)	Lowest Tariff Received (Rs./KWH)
1	TN-42	M/s MKC Infrastructure Ltd.	66KV CHORIWAD SS	10.5	10.5	10.5	3.19
2	TN-43	M/s MKC Infrastructure Ltd.	66KV JALOTRA SS	8.0	8.0	8.0	3.25
3	TN-44	M/s TIRUPATI COTTON INDUSTRIES	66KV KOTRALPUR SS	8.0	4.0	4.0	3.18
		M/s VENKATESH COTTON COMPANY			4.0	4.0	3.19
4	TN-45	M/s MKC Infrastructure Ltd.	66KV IQBALGADH SS	7.5	7.5	7.5	3.25
5	TN-46	M/s MKC Infrastructure Ltd.	66KV MEDHASAN SS	7.5	7.5	7.5	3.20
6	TN-47	M/s MKC Infrastructure Ltd.	66KV DANTA SS	7.0	7.0	7.0	3.35
7	TN-48	M/s MKC Infrastructure Ltd.	66KV KODRAM SS	7.0	7.0	7.0	3.19
		M/s MKC	66KV CHITRA				

8	TN-49	Infrastructure Ltd.	66KV CHITRODA SS	6.5	6.5	6.5	3.19
9	TN-50	M/s MKC Infrastructure Ltd.	66KV HMT-2 SS	6.0	6.0	6.0	3.25
10	TN-52	M/s S.K.Bulldcon	66KV VARETHA SS	4.5	3.0	3.0	2.95
		M/s Harkesh Solar			4.0	1.5	2.96
11	TN-53	M/s MKC Infrastructure Ltd.	66KV VASAI SS	4.5	4.0	4.0	3.20
12	TN-54	M/s MKC Infrastructure Ltd.	66KV SUNDARPUR SS	4.0	4.0	4.0	3.20
13	TN-55	M/s MKC Infrastructure Ltd.	66KV MORIYA SS	4.0	4.0	4.0	3.25
14	TN-56	M/s MKC Infrastructure Ltd.	66KV HEBATPUR SS	4.0	4.0	4.0	3.29
15	TN-57	M/s MKC Infrastructure Ltd.	66KV JEGOL SS	4.0	4.0	4.0	3.25
16	TN-58	M/s MKC Infrastructure Ltd.	66KV PRANTIJ SS	4.0	4.0	4.0	3.50
17	TN-59	M/s MKC Infrastructure Ltd.	66KV RELWADA SS	4.0	4.0	4.0	3.25
18	TN-60	M/s MKC Infrastructure Ltd.	66KV VASNIREL SS	4.0	4.0	4.0	3.25
19	TN-61	M/s MKC Infrastructure Ltd.	66KV TINTOI SS	4.0	4.0	4.0	3.25
20	TN-62	M/s HEXATRON INDUSTRIES LIMITED	66KV AMIRGADH SS	3.5	3.5	3.5	3.40
21	TN-63	M/s HEXATRON INDUSTRIES LIMITED	66KV GANGAVA SS	3.5	3.5	3.5	3.40
22	TN-64	M/s MKC Infrastructure Ltd.	66KV JUNI SAROTRI SS	3.5	3.5	3.5	3.30
23	TN-65	M/s MKC Infrastructure Ltd.	66KV VASAN SS	3.5	3.5	3.5	3.50
24	TN-66	M/s MKC Infrastructure Ltd.	66KV TANDALIYA SS	3.5	3.5	3.5	3.34
25	TN-67	M/s MKC Infrastructure Ltd.	66KV UNTARADA SS	3.5	3.5	3.5	3.50
26	TN-68	Manisha Sunil Shah	66KV GORAD SS	3.0	3.0	3.0	3.39
27	TN-69	M/s HEXATRON INDUSTRIES LIMITED	66KV MOTASADA SS	3.0	3.0	3.0	3.40
28	TN-71	Ganeshbhai Parthibhai Chaudhary	66KV PANCHADA SS	3.0	3.0	3.0	3.29
29	TN-72	M/s MKC Infrastructure Ltd.	66KV SATLASANA SS	3.0	3.0	3.0	3.30
30	TN-73	M/s SKP Bearing Industries Limited.	66KV PALLA SS	3.0	2.0	2.0	3.39
		M/s MKC Infrastructure Ltd.			3.0	1.0	3.40
31	TN-74	M/s MKC Infrastructure Ltd.	66KV PUNSARI SS	3.0	3.0	3.0	3.40
32	TN-75	M/s CEPCO Industries Pvt. Ltd.	66KV GANGUWADA SS	2.5	2.5	2.5	3.80
33	TN-77	M/s CEPCO Industries Pvt. Ltd.	66KV SUDASANA SS	2.5	2.5	2.5	3.44
34	TN-81	M/s Zodiac Energy Limited	66KV DANTIWADA SS	2.0	2.0	2.0	3.83
35	TN-83	Ahmadabbas Taherali Khanusiya	66KV AMODARA SS	2.0	1.0	1.0	3.75
36	TN-84	M/s Goldensol Producer company Limited	66KV SURPUR SS	2.0	1.0	1.0	3.85
37	TN-87	M/s Avtar Solar Private Limited	66KV DEL SS	1.5	1.5	1.5	3.93
38	TN-88	M/s GPC Infrastructure Limited	66KV SUKHPURA SS	1.5	1.5	1.5	4.48

39	TN-89	M/s Avtar Solar Private Limited	66KV RAMPURA SS	1.5	1.5	1.5	3.63
40	TN-90	M/s NUGLADE PRIVATE LIMITED	66KV DHAROI SS	1.5	1.5	1.5	4.37
41	TN-97	M/s Sukoon Energy LLP.	66KV LAXMANPUARA SS	1.5	1.5	1.5	3.95
42	TN-99	M/s Zodiac Energy Limited	66KV NIKODA SS	1.5	1.5	1.5	3.83
43	TN-100	M/s Deesha Civil Engineering Design	66KV NURPURA SS	1.5	1.0	1.0	2.75
		M/s Gurukrupa Granite			1.5	0.5	4.30
44	TN-101	M/s Zodiac Energy Limited	66KV UJEDIYA SS	1.5	1.5	1.5	3.83

• Previous tender's offers:-

Nos. of Substations	Nos. of Solar Power Plants	Nos. of Feeders	Nos. of consumers	Estimated Plant Size (MW)
33	40	117	37748	95.818

Against the previous proposals submitted to GUVNL vide reference no.5, out of 40 plants (95.818 MW), there are still 39 Nos plants (94.578 MW), where price bids were received in respect of earlier tenders and validity of the price bid is yet not expired. The lowest tariff received among these plants is Rs. 3.19 per unit and highest tariff is Rs. 4.90 per unit.

In Tender No. TN-37, technical bid opened on dtd. 17.01.2023 hence validity of offer remains valid till dtd. 17.05.2023.UGVCL had asked to bidder for extend the validity for further 90 days vide e-mail dtd. 04.05.2023 but M/s GRE Electronics Pvt. Ltd had refused offer vide letter dtd.06.05.2023. Details of solar plant is as under :

Bidder Name	Tender No.	Name of Sub Station 66KV/11KV	Name of Solar Plant	Solar Plant capacity (MW)	Tariff After Negotiation (Rs./Kwh)
M/s GRE Electronics Pvt. Ltd	TN-37	66KV HINGATHIYA SS	UG-FLS-46	1.240	3.29

Validity of Price Bid of previous Solar Plants : 23 Plants-20.06.2023, 13 Plants- 05.07.2023,01 Plant-01.07.2023, 01 Plant-15.08.2023 & 01 Plants-29.08.2023 (Total : 39 nos. of Solar Plants).

Summary of all price bids received in respect of all PM KUSUM-C FLS tenders floated so far is as under:

Particulars	Phase-I		Phase-II		Total		Nos. of Consumers
	Nos.	MW	Nos.	MW	Nos.	MW	
Price bids Opened	40	95.818	44	169.5	84	265.318	84085
Extended validity of Price Bid not submitted	1	1.240	..	..	1	1.240	704
Net Pending Price bids Opened as on 26.05.2023	39	94.578	44	169.5	83	264.078	83381
Rates: Above 2.75 up to 3.00	0		2	6.0	2	6.000	1842
Rates: Above 3.00 up to 3.25	4	8.449	15	89.0	19	97.449	23741
Rates: Above 3.25 up to 3.50	6	16.115	16	56.5	22	72.615	24067

Rates: Above 3.50 up to 4.00	25	60.486	9	15.0	34	75.486	29676
Rates: Above 4.00 up to 4.50	1	3.378	2	3.0	3	6.378	1726
Rates: Above 4.50 up to 4.90	3	6.149			3	6.149	2329
Plant Rates: up to 3.50	10	24.564	33	151.5	43	176.064	49650
Plant Rates: Above up to 3.50	29	70.014	11	18.0	40	88.014	33731
Price Bid Valid up to	20.06.2023 to 29.08.2023		27.08.2023 to 09.09.2023				

- District wise price bids received for 44 nos. of Solar Power Plants as under :

Particulars	ARVALLI		BANASKANTHA		MEHSANA		SABARKANTHA		Total	
	Nos.	MW	Nos.	MW	Nos.	MW	Nos.	MW	Nos.	MW
Rates: Above 2.75 up to 3.00	0	0.0	0	0.0	1	4.5	1	1.5	2	6.0
Rates: Above 3.00 up to 3.25	5	23.5	5	30.5	1	8.0	4	27.0	15	89.0
Rates: Above 3.25 up to 3.50	1	3.0	9	34.0	2	5.5	4	14.0	16	56.5
Rates: Above 3.50 up to 4.00	1	1.5	4	7.5	0	0.0	4	6.0	9	15.0
Rates: Above 4.00 up to 4.50	0	0.0	1	1.5	1	1.5	0	0.0	2	3.0
Total	7	28.0	19	73.5	5	19.5	13	48.5	44	169.5

- District wise price bids received for Old 39 nos. of Solar Power Plants as under :

Particulars	ARVALLI		Sabarkantha		Total	
	No.	MW	No.	MW	No.	MW
Rates: Above 3.00 up to 3.25	4	8.45	0	0.00	4	8.45
Rates: Above 3.25 up to 3.50	5	12.57	1	3.54	6	16.11
Rates: Above 3.50 up to 4.00	19	48.35	6	12.14	25	60.49
Rates: Above 4.00 up to 4.50			1	3.38	1	3.38
Rates: Above 4.50 up to 4.90	3	6.15	0	0.00	3	6.15
Total	31	75.52	8	19.06	39	94.58

- **Proposal: -**

In view of the above substantial exercise carried out by UGVCL, it is requested to :-

a. Give consent to file tariff petition before Hon'ble GERC for adoption of the tariff discovered.

b. If the notified capacity not get full through RL1 Bidder, in that case to make the bucket full of notified Capacity through next bidder RL2 bidders, it is proposed to approve for offering the RL1 price for match by the RL2 Bidders.

c. Please advise us for the counter offer of unit purchase rate which can be given to the following bidders to agree or to constitute a committee comprising of Senior Official of GUVNL to carry out negotiation.

In this regard, it is requested to move the matter at appropriate level for further directives please.

This is for your kind information please.

eSign
Signed by: ENGINEER
GHANSHYAMBHAI HARGOVINDBHAI
Location: Mehsana
Organization Unit: Uttar Gujarat Vv
Company Ltd
Date: 31-May-2023 (06:09 PM)

Chief Engineer (P&P)

UGVCL, R&C, Mehsana

Copy f.w.c.s. to:

EA to M.D. Sir, UGVCL, Corporate office, Mehsana

Copy to :

1. The A.C.E. (Commerce), R&C office, UGVCL
2. The S.E., UGVCL, Circle office, Himmatnagar / Mehsana / Palanpur / Sabarmati

ઉત્તર ગુજરાત વિજ સુધી (ઉ.ગ.) રજી. અને સુધી સુધી: ઉ.ગ.વિજ. રજી. નં. 384/001 (ઉ.ગ.) CIN U40102GJ2003SGC042906 Phone: (02762) 222080-81 Fax: 223574		UTTAR GUJARAT VIJ COMPANY LIMITED Regd. & Corporate Office: Visnagar Road, Mehsana- 384 001 (N.G.) Web site: www.ugvcl.com e-mail: corporate@ugvcl.com
---	---	--

UGVCL/R&C Solar Cell/PM-KUSUM-C/FLS/ 1019

Date : 01/08/2023

To,

The Chief Engineer (Tech)

Gujarat Urja Vikas Nigam Limited (GUVNL)

Sardar Patel Vidhyut Bhavan, Race Corse,

Vadodara-39007.

Subject: Proposal to give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding followed by e-Reverse Auction for purchase of Power for Solarization of various 11kv Agricultural feeders emanating from selected Sub-stations in the supply area of UGVCL as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.

- Ref. :-**
1. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM-C/FLS/1500 Dtd.01.06.2022
 2. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM/1693 Dtd.21.06.2022
 3. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-3,TN-4 & TN-5 Dtd.27&28.06.2022
 4. UGVCL Tender No :- UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-6 to TN-41 Dtd.15,16 & 17.09.2022 (36 nos. Tenders)
 5. UGVCL Letters to give consent to file tariff petition : 40 Solar Plants.
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/1415 Dtd.21.10.2022 (13 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/73 Dtd.19.01.2023 (24 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/222 Dtd.02.03.2023 (03 Plants)
 6. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/58 Dtd.06.01.2023.
 7. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/155 Dtd.02.02.2023.
 8. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/528 Dtd.06.03.2023.
 9. GUVNL/Tech/Solar Cell/KUSUM-C/FLS/371 Dtd.21.02.2023.
 10. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-42 to TN-104 Dtd.15,16 & 17.03.2023 (63 nos. Tenders).
 11. UGVCL proposal for 44 nos. Tenders : CORMHSUG/0439/05/2023 Dtd.01.06.2023.
 12. GUVNL/Tech/Solar cell/PM-KUSUM-C/FLS/1114 Dtd.22.06.2023.
 13. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1246 Dtd.15.07.2023
 14. UGVCL proposal for 07 nos. Tenders : UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/983 Dtd.26.07.2023.

Dear Sir,

With reference to the UGVCL's previous proposals in reference no 11, UGVCL had send proposal to give consent to file petition for **44 nos.** of Tenders/Sub-stations with 169.5 MW capacity & 46337 nos. of consumers for Purchase of Solar Power through 'On-line' competitive bidding process

Signature valid

Signed by: Shri B G PRANAMI
 Additional Chief Engineer
 Date: 2023.08.01 16:34:59
 +05:30

File No: CORMHSUG/PMKUSUMCFLS/e-file/430/2023/4102/Solar
 Approved By: Shri B G PRANAMI(ACE,Project and Renewable,COR)

Open the document in Adobe Acrobat DC to verify the E-sign



(followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of PM- KUSUM Component-C Feeder level Solarization Scheme of MNRE, out of 63 Substations with aggregate Solar plant capacity of 208.5 MW.

Vide reference no 14, UGVCL had send proposal to give consent to file petition for 07 nos. of Tenders/Sub-stations with 12 MW capacity & 5434 nos. of consumers for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RESCO mode of PM- KUSUM Component-C Feeder level Solarization Scheme of MNRE.

As on date 31.07.2023 total 52 nos. of Tenders Price Bids Opened, status are as under :

Sr No.	Particular	Nos. of Tenders	Nos. of Ag Consumers	Nos. of Feeders	Nos. of Sub-Station	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)	Offered Solar Plant Capacity by Bidders (MW)
1	Total	63	60524	357	63	208.5	186.5
2	Scarp	11	7230	42	11	20.0	
4	Price Bids Opened	52	53294	315	52	188.5	186.5
5	Already sent for approval 01.06.2023	44	46537	265	44	171.0	169.5
6	Already sent for approval 26.07.2023	7	5434	41	7	12.5	12.0
7	Pending for approval	1	1523	09	1	5.0	5.0

01 nos. of pending approval which price bids opened on dtd.28.07.2023 & reverse e-Auction on dtd.31.07.2023.

Out of 07 nos. of Bids 01 nos. of bids rejected during Technical Scrutiny.

Tariff Received in online N-Procure website for 01 nos. of Tenders in which 06 nos. of bidders Price Bids opened are received: Rs. 2.99/Kwh to Rs. 4.50/Kwh.

Tariff Received by Reverse e-Auction on dtd.31.07.2023 for 01 nos. of Tenders in which 06 nos. of bids Price Bids opened are received: Rs. 2.98/Kwh to Rs. 4.50/Kwh.

Validity of Price Bid : 01 Tender-01.09.2023.

Details for 01 nos. of Tender which Price Bids Opened are as under :

Table-A

Sr. No.	Tender No.	No. of Ag Feeders	No. of Connections	Notified Solar Plant capacity in MW	Technical Bid Opened Date	Price Bid Opened Date	Reverse e-Auction Date	Nos. of Bids	Nos. of Bids which Price Bids Opened	Total Offered Capacity for SS by Bidders	Online Tariff Received (Rs./KWH)	After Reverse Auction Tariff Received (Rs./KWH)
---------	------------	-------------------	--------------------	-------------------------------------	---------------------------	-----------------------	------------------------	--------------	--------------------------------------	--	----------------------------------	---

Signature valid

Signed by: Shri B G PRANAMI
Additional Chief Engineer
Date: 2023/07/31 16:34:59
+05:30

File No: CORMHSUG/PMKUSUMCFLS/e-file-430/2023/4102/Solar
Approved By: Shri B G PRANAMI(ACE, Project and Renewable, COR)

Open the document in Adobe Acrobat DC to verify the E-sign



1	TN-51	09	1253	5.0	04.05.23	28.07.23	31.07.23	07	06	5.0	L1:2.99, L2 (2) :3.69, L3:3.83, L4 (2) : 4.50	RL1 : 2.98 (1 MW), RL2 :2.99 (4 MW)
---	-------	----	------	-----	----------	----------	----------	----	----	-----	--	--

Bidder wise propose solar plant capacity are as under :

Table-B

Sr. No.	Tender No.	Bidder Name	Name of Sub Station 66KV/11KV	Notified Solar Plant Capacity (MW)	Offered Solar Plant Capacity by Bidder (MW)	Propose Capacity to be Allot (MW)	Online Tariff Received during Price Bid (Rs./Kwh)	Tariff Received Through e-Reverse Auction (Rs./KWH)
1	TN-51	M/s MECHATRONIK TECHNOLOGIES PRIVATE LIMITED	66KV KHANPUR SS	5.0	1.0	1.0	3.69	2.98
2		M/s MKC Infrastructure Ltd.			4.0	4.0	2.99	..
3		M/s QORX Energy			1.0	..	3.69	..
4		M/s Zodiac Energy Limited			5.0	..	3.83	..
5		Modi Divyesh Rakeshbhai			1.0	..	4.50	..
6		Vishal Mukeshkumar Modi			1.0	..	4.50	..

• **Proposal: -**

In view of the above substantial exercise carried out by UGVCL, it is requested to :-

- Give approval to issue LoI to bidder whose tariff received up to Rs. 3.00 per unit i.e Rs.2.98 per unit as per GUVNL Letter No. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1114 Dtd. 22.06.2023.
- As the notified capacity not get full through RL1 Bidder, so to make the bucket full of notified Capacity through next bidder RL2 bidder with matching of RL1 bidder tariff i.e. Rs.2.98 per unit.

In this regard, it is requested to move the matter at appropriate level for further directives please.

This is for your kind information please.

I/c Chief Engineer (P&P)
UGVCL, R&C, Mehsana

Signature valid

Signed by: Shri B G PRANAMI
Additional Chief Engineer
Date: 2023/08/01 16:34:59
+05:30

File No: CORMHSUG/PMKUSUMCFLS e-file/430/2023/4102/Solar
Approved By: Shri B G PRANAMI(ACE, Project and Renewable, COR)

Open the document in Adobe Acrobat DC to verify the E-sign



Copy f.w.c.s. to:

EA to M.D. Sir, UGVCL, Corporate office, Mehsana

Copy to :

1. The A.C.E. (Commerce), R&C office, UGVCL
2. The S.E., UGVCL, Circle office, Mehsana

Signature valid

Signed by: Shri B G PRANAMI
Additional Chief Engineer
Date: 2023-08-01 16:34:59
+05:30

File No: CORMHSUG/PMKUSUMCFLS/e-file/430/2023/4102/Solar
Approved By: Shri B G PRANAMI(ACE,Project and Renewable,CORP)
Open the document in Adobe Acrobat DC to verify the E-sign





Save Energy for Benefit of Self and Nation

UGVCL



Uttar Gujarat Vij Company Limited

CIN: U46102GJ2003SGC042906
(A subsidiary of Gujarat Urja Vikas Nigam Limited)

UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/ 1116

Date: 25/08/2023

To,

The Chief Engineer (Tech)

Gujarat Urja Vikas Nigam Limited (GUVNL)

Sardar Patel Vidhyut Bhavan, Race Course,

Vadodara-39007.

Subject: Proposal to give consent to file tariff petition before the Hon'ble GERC for adoption of the Tariff discovered through the competitive bidding followed by e-Reverse Auction for purchase of Power for Solarization of various 11kv Agricultural feeders emanating from selected Sub-stations in the supply area of UGVCL as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model.

- Ref. :-**
1. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM-C/FLS/1500 Dtd.01.06.2022
 2. GUVNL Letter No: GUVNL/Tech/Solar-Cell/PM-KUSUM/1693 Dtd.21.06.2022
 3. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-3,TN-4 & TN-5 Dtd.27&28.06.2022
 4. UGVCL Tender No :- UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-6 to TN-41 Dtd.15.16 & 17.09.2022 (36 nos. Tenders)
 5. UGVCL Letters to give consent to file tariff petition : 40 Solar Plants.
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/1415 Dtd.21.10.2022 (13 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/73 Dtd.19.01.2023 (24 Plants)
UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/222 Dtd.02.03.2023 (03 Plants)
 6. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/58 Dtd.06.01.2023.
 7. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/155 Dtd.02.02.2023.
 8. GUVNL/Tech/Solar Cell/PMKUSUM-C/FLS/528 Dtd.06.03.2023.
 9. GUVNL/Tech/Solar Cell/KUSUM-C/FLS/371 Dtd.21.02.2023.
 10. UGVCL Tender No. UGVCL/Project/Solar/PM-KUSUM-C/FLS TN-42 to TN-104 Dtd.15.16 & 17.03.2023 (63 nos. Tenders).
 11. UGVCL proposal for 44 nos. Tenders : CORMHSUG/0439/05/2023 Dtd.01.06.2023.
 12. GUVNL/Tech/Solar cell PM-KUSUM-C/FLS/1114 Dtd.22.06.2023.
 13. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1246 Dtd.15.07.2023
 14. UGVCL proposal for 07 nos. Tenders : UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/983 Dtd.26.07.2023.
 15. UGVCL proposal for 01 nos. Tenders : UGVCL/R&C/Solar Cell/PM-KUSUM-C/FLS/1019 Dtd.01.08.2023.
 16. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1369 Dtd.11.08.2023

Regd. & Corporate Office: Visnagar Road, MEHSANA – 384 001 (North Gujarat)

Telephone: (02762) 222080-81

Fax: (02762) 223574


Website: www.ugvcl.com

e-mail: cepp@ugvcl.com



Save Energy for Benefit of Self and Nation

UGVCL



Uttar Gujarat Vij Company Limited

CIN: UG45102920003SGC042905
(A subsidiary of Gujarat Urja Vikas Nigam Limited)

Dear Sir,

With reference to the UGVCL's previous proposals in reference no.11, UGVCL had send proposal to give consent to file petition for 44 nos. of New Tenders/Sub-stations with 169.5 MW capacity & 46337 nos. of consumers & 39 nos. of Old Tenders/Sub-stations with 94.577 MW for Purchase of Solar Power through 'On-line' competitive bidding process (followed by reverse e-auction) for Solarization of various 11 KV Agricultural feeders of selected 66 / 11 KV Sub-stations in supply area of UGVCL under RFSCO mode of PM- KUSUM Component-C Feeder level Solarization Scheme of MNRE, out of 63 Substations with aggregate Solar plant capacity of 208.5 MW.

In Submitted Old 39 nos. of Tenders, 02 nos. of Tenders bid validity not extended by the bidders of 3.398 MW.

Price bids opened after 01.06.2023 for 08 nos. of Tenders which proposal to give consent to agree tariff up to Rs.3.00 submitted for approval vide reference letter no.14 & 15 for 6957 nos. of consumers with 17 MW capacity.

As on date 24.08.2023 total 52 nos. of Tenders Price Bids Opened, status are as under :

Sr No.	Particular	Nos. of Tenders	Nos. of Ag Consumers	Nos. of Feeders	Nos. of Sub-Station	Notified Solar Plant capacity in MW (in multiple of 0.5 MW)	Offered Solar Plant Capacity by Bidders (MW)
1	Total	63	60524	357	63	208.5	186.5
2	Scarp	11	7230	42	11	20.0	
3	Price Bids Opened	52	53294	315	52	188.5	186.5
4	Submitted for approval 01.06.2023	44	46337	265	44	171.0	169.5
5	Submitted for approval 26.07.2023	7	5434	41	7	12.5	12.0
6	Submitted for approval 01.08.2023	1	1523	09	1	5.0	5.0

Regd. & Corporate Office: Vishnagar Road, MEHSANA – 384 001 (North Gujarat)
Telephone: (02762) 222080-81 Fax: (02762) 223574
Website: www.ugvcl.com e-mail: cepp@ugvcl.com



Save Energy for Benefit of Self and Nation

UGVCL

Uttar Gujarat Vij Company Limited

CUU-1146102GJ2003SGC042906
(A subsidiary of Gujarat Uja Vikas Nigam Limited)

After receiving approval vide reference letter no. 12 for New 44 nos. tenders, vide reference letter no.13 for Old Tenders, vide reference letter no.16 for 08 nos. tenders, UGVCL initiated process as per directives. Status of Tenders after approval as under :

Particular	Price Bid Open	Lol / Consent letter issued		Unconditional Acceptance Received		
	MW	No. of Bidders	MW	No. of Bidders	MW	Approx. Consumers
Tariff received up to Rs.3.00 per unit	5.5	3	5.5	2	4	1228
Tariff received above Rs.3.00 per unit	164	46	164	23	85.5	25676
Total of New Tenders (44 Nos.)	169.5	49	169.5	25	89.5	26904
Tariff received up to Rs.3.00 per unit	5.0	2	5.0	1	1.0	304
Tariff received above Rs.3.00 per unit	12.0	8	12.0	6	8.0	3926
Total of New Tenders (08 Nos.)	17.0	10	17	7	9.0	4230
Tariff received up to Rs.3.00 per unit	10.5	5	10.5	3	5.0	1532
Tariff received above Rs.3.00 per unit	176.0	54	176.0	29	93.5	29602
Total of New Tenders (52 Nos.)	186.5	59	186.5	32	98.5	31134
Old Tenders 37 Nos. Above Rs.3.00	91.179	37	91.179	20	48.376	19656
Grand Total	277.679	96	277.679	52	146.876	50790

In New Tenders : Lol/Consent issued to 05 Bidders which tariff received up to Rs.3.00 per unit (in case of RL2 to match RL1 tariff) & for 54 bidders whose tariff received above Rs.3.00 per unit; Consent/LOI asked to bidders to agree tariff of Rs.3.00 per unit.

Summary of Bidder wise for New Tenders are as under :

Sr No.	Name of Bidder	Nos. of Tenders (Solar Plants)	Notified Solar Plant Capacity (MW)	Offered Capacity by Bidder (MW)	Propose to be Allotted (MW)	Tariff offered by Bidder	Consent of Agree for Tariff up to Rs.3.00	Nos.	MW	Lol Issued	Lol Acceptance Received
1	M/s MKC Infrastructure Ltd	23	116.5	116	116	Rs. 3.19 / Kwh to Rs.3.50 / Kwh	YES	10	49.5	YES	YES
2	M/s HEXATRON INDUSTRIES LIMITED	3	10	10	10	Rs. 3.40 / Kwh	YES	1	3.5	YES	YES
3	M/s Zodiac Energy Limited	3	5	5	5	Rs. 3.83 / Kwh	YES	3	5	YES	YES
4	Manisha Sunil Shah	1	3	3	3	Rs. 3.39 / Kwh	YES	1	3	YES	YES
5	Ahmadabbas Taherali Khanushya	1	2	1	1	Rs. 3.75 / Kwh	NO				
6	Ganeshbhai Parthibhai Chaudhary	1	3	3	3	Rs. 3.29 / Kwh	NO				
7	M/s Avtar Solar Private Limited	2	3	3	3	Rs. 3.63 / Kwh & Rs.3.93 / Kwh	YES (01-1.5 MW)	1	1.5	YES	YES

Regd. & Corporate Office: Visnagar Road, MEHSANA – 384 001 (North Gujarat)

Telephone: (02762) 222080-81

Website: www.ugvcl.com

Fax: (02762) 223574

e-mail: cepp@ugvcl.com



Save Energy, Save Cost of Self and Nation

UGVCL



Uttar Gujarat Vij Company Limited

CIN - U40100-GJ-2003SGC042906
(A subsidiary of Gujarat State Power Corporation Limited)

8	M/s CEPSCO Industries Pvt. Ltd	2	5	5	5	Rs. 3.44 / Kwh & Rs. 3.80 / Kwh	YES	2	5	YES	YES
9	M/s NUGLADE PRIVATE LIMITED	1	1.5	1.5	1.5	Rs. 4.37 / Kwh	NO				
10	M/s Sukoon Energy LLP.	1	1.5	1.5	1.5	Rs. 3.95 / Kwh	NO				
11	M/s GPC Infrastructure Limited	1	1.5	1.5	1.5	Rs. 3.45 / Kwh	NO				
12	M/s Deesha Civil Engineering Design	1	1.5	1	1	Rs. 2.75 / Kwh		1	1	YES	YES
13	M/s Gurukrupa Granite	1	1.5	1.5	0.5	Rs. 1.39 / Kwh	NO	Consent asked to Agree RL1 Tariff of Rs. 2.75/ Kwh & Capacity : 0.5 MW			
14	M/s SKP Bearing Industries Limited	1	3	2	2	Rs. 3.39 / Kwh	YES	1	2	YES	YES
	M/s MKC Infrastructure Ltd., ANJAR			3	1	Rs. 3.40 / Kwh	No				
15	M/s S.K. Buildcon	1	4.5	3	3	Rs. 2.95 / Kwh		1	3	YES	YES
16	M/s Hatkesh Solar	1	4.5	4	1.5	Rs. 2.96 / Kwh	No	Consent asked to Agree RL1 Tariff of Rs. 2.95/ Kwh & Capacity : 1.5 MW			
17	M/s Goldensoil Producer company Limited	1	2	1	1	Rs. 3.85 / Kwh	YES	1	1	YES	YES
18	Hiteshkumar Amichandbhai Pate	1	2	1	1	Rs. 4.50 / Kwh	NO				
	M/s TIRUPATI COTTON INDUSTRIE	1	8	4	4	Rs. 3.18 / Kwh	YES	1	4	YES	YES
20	M/s VENKATESH COTTON COMPAN	1	8	4	4	Rs. 3.19 / Kwh	YES	1	4	YES	YES
21	Sharadkumar Keshubhai Desai, Kheralu	1	2.5	1	1	Rs. 4.00 / Kwh		1	1	YES	YES
22	Desai Ramilaben Sharadkumar, Kheralu	1	2.5	1	1	Rs. 4.01 / Kwh		1	1	YES	YES
23	M/s Platinum Agro Industries, Narpura (Himmatnagar)	1	2.5	2.5	2.5	Rs. 4.55 / Kwh				YES	NO
24	M/s JSR Renewable Consultants, Ahmedabad	1	1.5	1.5	1.5	Rs. 4.50 / Kwh		1	1.5	YES	YES
25	M/s VIJAPURA IMPEX LLP, Himmatnagar JV Partner : M/s Photonics Watertech Pvt Ltd.	1	1.5	1.5	1.5	Rs. 9.75 / Kwh				YES	NO
26	Kamleshkumar Babulal Shah, Ahmedabad	1	1.5	1.5	1.5	Rs. 3.50 / Kwh		1	1.5	YES	YES
27	M/s R K CORP, Ahmedabad	2	3	3	3	Rs. 3.50 / Kwh		2	3	YES	YES
28	M/s MECHATRONIK TECHNOLOGIES PRIVATE LIMITED, Ahmedabad	1	5	1	3	Rs. 2.98 / KWH		1	1	YES	YES
29	M/s MKC Infrastructure Ltd., ANJAR (Kachchh)	1	5	4	4	Rs. 2.99 / KWH	Not Submitted within time	LOI issued to Agree RL1 Tariff of Rs. 2.98/ Kwh & Capacity : 4 MW			
Total		52	188.5		185.5	Minimum: Rs. 2.75 Maximum : Rs. 4.50		32	98.5		

Regd. & Corporate Office: Visnagar Road, MEHSANA – 384 001 (North Gujarat)

Telephone: (02762) 222080-81

Fax: (02762) 223574

Website: www.ugvcl.com

e-mail: cepp@ugvcl.com



Save Energy for Benefit of Self and Nation

UGVCL



Uttar Gujarat Vij Company Limited

CIN - U40102GJ200035UC042908
(A subsidiary of Gujarat Uja Vikas Nigam Limited)

In Old Tenders : LoI issued to 37 Bidders whose tariff received above Rs.3.00 to submit unconditionally acceptance of tariff of Rs.3.00 with submission of PBG of Rs.5.00/- Lacs per MW as per tender terms & conditions.

Summary of Bidder wise for Old Tenders are as under:

Sr No.	Name of Agency	Nos. of Solar Plants	Sum of Solar Plant Capacity (MW)	LOI Issued	LOI Acceptance Received as (YES / NO)	Nos.	MW	PBG Submitted
1	AVI Appliances	1	3.541	YES	NO			
2	M/s GWE Infra Projects Private Limited	9	21.095	YES	YES	5	11.143	YES
3	M/s Krushnam Infra Private Limited	1	1.633	YES	NO			
4	M/s Omega Electricals	1	3.703	YES	YES	1	3.703	YES
5	M/s Pioneer Security Solutions Pvt. Ltd	5	11.972	YES	YES	5	11.972	YES
6	M/s Topsun Energy Ltd	3	9.971	YES	NO			
7	M/s Trom Industries Limited	2	3.932	YES	NO			
8	M/s U R Energy (India) Pvt. Ltd	2	5.596	YES	NO			
9	M/s Zodiac Energy Limited	13	29.136	YES	YES	9	21.558	Under Process
Grand Total		37	91.179			20	48.376	

Annexure A, B, C & D attached herewith for Individual Tender wise Status.

As per GUVNL letter reference no. 12, point no.3 "UGVCL shall immediately take above actions and inform the same to GUVNL along with quantum of power for which LoI are issued" Hence, UGVCL submitting the proposal for unconditionally acceptance received from 52 nos. of bidders & 146.876 MW capacity.

> Proposal: -

In view of the above substantial exercise carried out by UGVCL, it is requested to :-

- Give approval to file tariff petition before the Hon'ble GERC for 52 nos. of Bidders whose unconditional acceptance received for issued LoI or it is suggested to file common tariff petition for all DISCOM as already Tariff is fixed up to Rs.3.00 per unit and no any separate petition time delay to all DISCOMs and also to avoid file petition to Hon'ble GERC for next tenders in future.

Regd. & Corporate Office: Visnagar Road, MEHSANA – 384 001 (North Gujarat)
Telephone: (02762) 222080-81 Fax: (02762) 223574
Website: www.ugvcl.com e-mail: cepp@ugvcl.com



Save Energy for Benefit of Self and Nation.

UGVCL



Uttar Gujarat Vij Company Limited

CIN - U40102GJ1995BGG0001405
(A subsidiary of Gujarat State Power Corporation Limited)

b. Give approval to refund/release EMD for rest 87 nos. of bidders who had not submitted consent (44 Bidders) to agree tariff up to Rs.3.00 per unit or L2,L3...L6 bidders in which UGVCL had not asked the consents (43 Bidders).

c. Provide the common draft petition document for further process.

In this regard, it is requested to move the matter at appropriate level for further directives please.

This is for your kind information please.

Sign
Signed by: BHAGUBHAI
GANESHBHAI PRANAMI
Location: Mehsana
Organization Unit: Uttar Gujarat Vij
Company Ltd.
Date: 25-Aug-2023 (11:14 AM)

Ue Chief Engineer (P&P)
UGVCL, R&C, Mehsana

Copy f.w.c.s. to:

EA to M.D. Sir, UGVCL, Corporate office, Mehsana

Copy to :

1. The A.C.E. (Commerce), R&C office, UGVCL

2. The S.E., UGVCL, Circle office, Mehsana/Sabarmati/Palanpur/Himmatnagar.

Regd. & Corporate Office: Visnagar Road, MEHSANA – 384 001 (North Gujarat)

Telephone: (02762) 222080-81

Website: www.ugvcl.com

Fax: (02762) 223574

e-mail: cepp@ugvcl.com

ANX- A- UGVCL- PM-KUSUM-FLS-C-TN-42 to TN-104 (52-Tender wise status)

Sr. No.	Tender No.	Sunstation name	Plant No (UG-FLS-SS)	Count of bids per S/s	Max of Notified Capacity of SS	Sum of Offered capacity in MW	Bucket full capacity	Mini. Offered rate after reverse auction	Nos. of Bidders Consent Asked up to Rs.3.00	Consent Asked MW	Consent Received Nos.	Consent Received MW	LOI Issued Nos.	LOI Issued MW	LOI Acceptance Received No.	LOI Acceptance Received MW	Nos. of Consumers	Proportionate Consumers whose LOI Accepted
1	TN-42	66KV CHORIWAD SS	UG-FLS-SS-1	3	10.5	10.5	10.5	3.19	1	10.5	1	10.5	1	10.5	1	10.5	2170	2170
2	TN-43	66KV JALOTRA SS	UG-FLS-SS-2	1	8	8	8	3.25	1	8							1500	0
3	TN-44	66KV HOTALPUR SS	UG-FLS-SS-3	4	8	8	8	3.18	2	8	2	8.0	2	8.0	2	8.0	1562	1562
4	TN-45	66KV IQBALGADH SS	UG-FLS-SS-4	1	7.5	7.5	7.5	3.25	1	7.5							955	0
5	TN-46	66KV MEDHASAN SS	UG-FLS-SS-5	3	7.5	7.5	7.5	3.2	1	7.5	1	7.5	1	7.5	1	7.5	2229	2229
6	TN-47	66KV DANTA SS	UG-FLS-SS-6	1	7	7	7	3.35	1	7							1785	0
7	TN-48	66KV KODRAM SS	UG-FLS-SS-7	3	7	7	7	3.19	1	7	1	7.0	1	7.0	1	7.0	916	916
8	TN-49	66KV CHITRODA SS	UG-FLS-SS-8	1	6.5	6.5	6.5	3.19	1	6.5							1215	0
9	TN-50	66KV HMT-2 SS	UG-FLS-SS-9	1	6	6	6	3.25	1	6	1	6.0	1	6.0	1	6.0	1661	1661
10	TN-52	66KV VARETHA SS	UG-FLS-SS-11	6	4.5	4.5	4.5	2.95	1	1.5			1	3.0	1	3.0	1352	901
11	TN-53	66KV VASAI SS	UG-FLS-SS-12	1	4.5	4	4	3.2	1	4							1019	0
12	TN-54	66KV SUNDARPUR SS	UG-FLS-SS-13	1	4	4	4	3.2	1	4	1	4.0	1	4.0	1	4.0	1037	1037
13	TN-55	66KV MORIYA SS	UG-FLS-SS-14	2	4	4	4	3.25	1	4							938	0
14	TN-56	66KV HEBATPUR SS	UG-FLS-SS-15	1	4	4	4	3.29	1	4							698	0
15	TN-57	66KV JEGOL SS	UG-FLS-SS-16	3	4	4	4	3.25	1	4							910	0
16	TN-58	66KV PRANTII SS	UG-FLS-SS-17	1	4	4	4	3.5	1	4							841	0
17	TN-59	66KV RELLAWADA SS	UG-FLS-SS-18	2	4	4	4	3.25	1	4	1	4.0	1	4.0	1	4.0	1594	1594
18	TN-60	66KV VASNIREL SS	UG-FLS-SS-19	1	4	4	4	3.25	1	4	1	4.0	1	4.0	1	4.0	1265	1265
19	TN-61	66KV TINTOI SS	UG-FLS-SS-20	2	4	4	4	3.25	1	4							818	0
20	TN-62	66KV AMIRGADH SS	UG-FLS-SS-21	1	3.5	3.5	3.5	3.4	1	3.5	1	3.5	1	3.5	1	3.5	938	938
21	TN-63	66KV GANGAVA SS	UG-FLS-SS-22	2	3.5	3.5	3.5	3.4	1	3.5							896	0
22	TN-64	66KV JUNI SAROTRI SS	UG-FLS-SS-23	1	3.5	3.5	3.5	3.3	1	3.5	1	3.5	1	3.5	1	3.5	896	896
23	TN-65	66KV VASAN SS	UG-FLS-SS-24	2	3.5	3.5	3.5	3.5	1	3.5							588	0
24	TN-66	66KV TANDALIYA SS	UG-FLS-SS-25	2	3.5	3.5	3.5	3.34	1	3.5	1	3.5	1	3.5	1	3.5	1146	1146
25	TN-67	66KV UNTARADA SS	UG-FLS-SS-26	2	3.5	3.5	3.5	3.5	1	3.5	1	3.5	1	3.5	1	3.5	941	941
26	TN-68	66KV GORAD SS	UG-FLS-SS-27	6	3	3	3	3.39	1	3	1	3.0	1	3.0	1	3.0	1081	1081
27	TN-69	66KV MOTASADA SS	UG-FLS-SS-28	1	3	3	3	3.4	1	3							665	0
28	TN-71	66KV PANCHADA SS	UG-FLS-SS-30	6	3	3	3	3.29	1	3							493	0
29	TN-72	66KV SATLASANA SS	UG-FLS-SS-31	1	3	3	3	3.3	1	3							1720	0
30	TN-73	66KV PALLA SS	UG-FLS-SS-32	3	3	3	3	3.39	2	3	1	2.0	1	2.0	1	2.0	1727	1151
31	TN-74	66KV PUNSARI SS	UG-FLS-SS-33	1	3	3	3	3.4	1	3	1	3.0	1	3.0	1	3.0	1115	1115
32	TN-75	66KV GANGUWADA SS	UG-FLS-SS-34	2	2.5	2.5	2.5	3.8	1	2.5	1	2.5	1	2.5	1	2.5	621	621
33	TN-77	66KV SUDASANA SS	UG-FLS-SS-36	4	2.5	2.5	2.5	3.44	1	2.5	1	2.5	1	2.5	1	2.5	1161	1161
34	TN-81	66KV DANTIWADA SS	UG-FLS-SS-40	1	2	2	2	3.83	1	2	1	2.0	1	2.0	1	2.0	505	505

ANX- A- UGVCL- PM-KUSUM-FLS-C-TN-42 to TN-104 (52-Tender wise status)																		
Sr. No.	Tender No.	Sunstation name	Plant No (UG-FLS-SS)	Count of bids per S/s	Max of Notified Capacity of SS	Sum of Offered capacity in MW	Bucket full capacity	Mini. Offered rate after reverse auction	Nos. of Bidders Consent Asked up to Rs.3.00	Consent Asked MW	Consent Received Nos.	Consent Received MW	LOI Issued Nos.	LOI Issued MW	LOI Acceptance Received No.	LOI Acceptanc e Received MW	Nos. of Consumers	Proportionat e Consumers whose LOI Accepted
35	TN-83	66KV AMODARA SS	UG-FLS-SS-42	1	2	1	1	3.75	1	1							487	0
36	TN-84	66KV SURPUR SS	UG-FLS-SS-43	2	2	2	2	3.85	2	2	1	1.0	1	1.0	1	1.0	501	251
37	TN-87	66KV DEL SS	UG-FLS-SS-46	2	1.5	1.5	1.5	3.93	1	1.5							717	0
38	TN-88	66KV SUKHPURA SS	UG-FLS-SS-47	1	1.5	1.5	1.5	4.48	1	1.5							324	0
39	TN-89	66KV RAMPURA SS	UG-FLS-SS-48	3	1.5	1.5	1.5	3.63	1	1.5	1	1.5	1	1.5	1	1.5	1933	1933
40	TN-90	66KV DHAROI SS	UG-FLS-SS-49	1	1.5	1.5	1.5	4.37	1	1.5							359	0
41	TN-97	66KV LAXMANPUARA SS	UG-FLS-SS-56	1	1.5	1.5	1.5	3.95	1	1.5							1064	0
42	TN-99	66KV NIKODA SS	UG-FLS-SS-58	1	1.5	1.5	1.5	3.83	1	1.5	1	1.5	1	1.5	1	1.5	584	584
43	TN-100	66KV NURPURA SS	UG-FLS-SS-59	2	1.5	1.5	1.5	2.75	1	0.5			1	1.0	1	1.0	490	327
44	TN-101	66KV UJEDIYA SS	UG-FLS-SS-60	1	1.5	1.5	1.5	3.83	1	1.5	1	1.5	1	1.5	1	1.5	920	920
45	TN-76	66KV KHERALU SS	UG-FLS-SS-35	2	2.5	2.0	2	4.00					2	2	2	2	1510	1208
46	TN-78	66KV KISANGADH SS	UG-FLS-SS-37	1	2.5	2.5	2.5	4.55					1	2.5			893	0
47	TN-98	66KV NETRAMALI SS	UG-FLS-SS-57	1	1.5	1.5	1.5	4.50					1	1.5	1	1.5	320	320
48	TN-94	66KV HAJIPUR SS	UG-FLS-SS-53	1	1.5	1.5	1.5	3.75					1	1.5			313	0
49	TN-103	66KV ZAMP SS	UG-FLS-SS-62	1	1.5	1.5	1.5	3.50					1	1.5	1	1.5	295	295
50	TN-95	66KV HARSOL SS	UG-FLS-SS-54	1	1.5	1.5	1.5	3.50					1	1.5	1	1.5	854	854
51	TN-104	132KV DANDHUKA SS	UG-FLS-SS-63	1	1.5	1.5	1.5	3.50					1	1.5	1	1.5	1249	1249
52	TN-51	66KV KHANPUR SS	UG-FLS-SS-10	7	5	5	5	2.98					2	5	1	1	1523	305
		Grand Total		103	188.5	186.5	186.5	2.75	47	165.5	23	85.5	35	106.5	32	98.5	53294	31134

Annexure-B : 24 Plants where more than 1 bid is received and taken in to E-REVERSE AUCTION

296

Sr No	Tender No.	Plant No	Name of Plant/ SS	Bidder Name	Notified Capacity of SS in MW	Offered capacity in MW	Min Rate	Propose MW Allocation	Letter for Consent Of Rs.	Consent Recived as (YES/NO)	LOI Issued (YES/NO)	LoI Confirmati on received as (Yes/No)	Bucket Full YES/NO
1	TN-42	UG-FLS-SS-1	66KV CHORIWAD SS	M/s MKC Infrastructure Ltd.	10.5	10.5	3.19	10.5	3.00	YES	YES	YES	YES
2	TN-42	UG-FLS-SS-1	66KV CHORIWAD SS	M/s Zodiac Energy Limited	10.5	10.5	3.83						YES
3	TN-42	UG-FLS-SS-1	66KV CHORIWAD SS	M/s XITIZ TECHNOMECH LLP	10.5	2.5	5.95						YES
4	TN-44	UG-FLS-SS-3	66KV HOTALPUR SS	M/s TIRUPATI COTTON INDUSTRIES	8.0	4.0	3.18	4	3.00	YES	YES	YES	YES
5	TN-44	UG-FLS-SS-3	66KV HOTALPUR SS	M/s VENKATESH COTTON COMPANY	8.0	4.0	3.19	4	3.00	YES	YES	YES	YES
6	TN-44	UG-FLS-SS-3	66KV HOTALPUR SS	M/s MKC Infrastructure Ltd.	8.0	8.0	3.20						YES
7	TN-44	UG-FLS-SS-3	66KV HOTALPUR SS	M/s Zodiac Energy Limited	8.0	8.0	3.83						YES
8	TN-46	UG-FLS-SS-5	66KV MEDHASAN SS	M/s MKC Infrastructure Ltd.	7.5	7.5	3.20	7.5	3.00	YES	YES	YES	YES
9	TN-46	UG-FLS-SS-5	66KV MEDHASAN SS	M/s TIRUPATI COTTON INDUSTRIES	7.5	4.0	3.96						YES
10	TN-46	UG-FLS-SS-5	66KV MEDHASAN SS	M/s VINKATESH COTTON COMPANY	7.5	4.0	3.96						YES
11	TN-48	UG-FLS-SS-7	66KV KODRAM SS	M/s MKC Infrastructure Ltd.	7.0	7.0	3.19	7	3.00	YES	YES	YES	YES
12	TN-48	UG-FLS-SS-7	66KV KODRAM SS	M/s EFARM INTERNATIONAL PRIVATE LIMITED	7.0	2.0	3.75						YES
13	TN-48	UG-FLS-SS-7	66KV KODRAM SS	M/s GPC Infrastructure Limited	7.0	4.0	4.35						YES
14	TN-52	UG-FLS-SS-11	66KV VARETHA SS	M/s S.K.Buildcon	4.5	3.0	2.95	3			YES	YES	NO
15	TN-52	UG-FLS-SS-11	66KV VARETHA SS	M/s Hatkesh Solar	4.5	4.0	2.96	1.5	2.95	NO			NO
16	TN-52	UG-FLS-SS-11	66KV VARETHA SS	M/s MKC Infrastructure Ltd.	4.5	4.0	2.99						NO
17	TN-52	UG-FLS-SS-11	66KV VARETHA SS	M/s Zodiac Energy Limited	4.5	4.5	3.83						NO
18	TN-52	UG-FLS-SS-11	66KV VARETHA SS	M/s Avatar Solar Private Limited	4.5	2.0	3.95						NO
19	TN-52	UG-FLS-SS-11	66KV VARETHA SS	Harsh Nathubhai Chaudhari	4.5	4.0	4.19						NO

Annexure-B : 24 Plants where more than 1 bid is received and taken in to E-REVERSE AUCTION													297
Sr No	Tender No.	Plant No	Name of Plant/ SS	Bidder Name	Notified Capacity of SS in MW	Offered capacity in MW	Min Rate	Propose MW Allocation	Letter for Consent Of Rs.	Consent Recived as (YES/NO)	LOI Issued (YES/NO)	LoI Confirmation received as (Yes/No)	Bucket Full YES/NO
20	TN-55	UG-FLS-SS-14	66KV MORIYA SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.25	4	3.00	Not Submitted within time 14.07.23			NO
21	TN-55	UG-FLS-SS-14	66KV MORIYA SS	M/s GPC Infrastructure Limited	4.0	4.0	4.35						NO
22	TN-57	UG-FLS-SS-16	66KV JEGOL SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.25	4	3.00	Not Submitted within time 14.07.23			NO
23	TN-57	UG-FLS-SS-16	66KV JEGOL SS	M/s Zodiac Energy Limited	4.0	4.0	3.83						NO
24	TN-57	UG-FLS-SS-16	66KV JEGOL SS	M/s GPC Infrastructure Limited	4.0	4.0	4.35						NO
25	TN-59	UG-FLS-SS-18	66KV RELAWADA SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.25	4	3.00	YES	YES	YES	YES
26	TN-59	UG-FLS-SS-18	66KV RELAWADA SS	M/s SKP Bearing Industries Limited	4.0	2.0	3.96						YES
27	TN-61	UG-FLS-SS-20	66KV TINTOI SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.25	4	3.00	Not Submitted within time 14.07.23			NO
28	TN-61	UG-FLS-SS-20	66KV TINTOI SS	M/s Zodiac Energy Limited	4.0	4.0	3.83						NO
29	TN-63	UG-FLS-SS-22	66KV GANGAVA SS	M/s HEXATRON INDUSTRIES LIMITED	3.5	3.5	3.40	3.5	3.00	Not Submitted within time 14.07.23			NO
30	TN-63	UG-FLS-SS-22	66KV GANGAVA SS	M/s Zodiac Energy Limited	3.5	3.5	3.83						NO
31	TN-65	UG-FLS-SS-24	66KV VASAN SS	M/s MKC Infrastructure Ltd.	3.5	3.5	3.50	3.5	3.00	Not Submitted within time 14.07.23			NO
32	TN-65	UG-FLS-SS-24	66KV VASAN SS	M/s GPC Infrastructure Limited	3.5	3.5	4.44						NO
33	TN-66	UG-FLS-SS-25	66KV TANDALIYA SS	M/s MKC Infrastructure Ltd.	3.5	3.5	3.34	3.5	3.00	YES	YES	YES	YES
34	TN-66	UG-FLS-SS-25	66KV TANDALIYA SS	M/s Zodiac Energy Limited	3.5	3.5	3.35						YES
35	TN-67	UG-FLS-SS-26	66KV UNTARADA SS	M/s MKC Infrastructure Ltd.	3.5	3.5	3.50	3.5	3.00	YES	YES	YES	YES
36	TN-67	UG-FLS-SS-26	66KV UNTARADA SS	M/s Ganesh Energy	3.5	2.0	5.00						YES

Annexure-B : 24 Plants where more than 1 bid is received and taken in to E-REVERSE AUCTION

298

Sr No	Tender No.	Plant No	Name of Plant/ SS	Bidder Name	Notified Capacity of SS in MW	Offered capacity in MW	Min Rate	Propose MW Allocation	Letter for Consent Of Rs.	Consent Received as (YES/NO)	LOI Issued (YES/NO)	LoI Confirmation received as (Yes/No)	Bucket Full YES/NO
37	TN-68	UG-FLS-SS-27	66KV GORAD SS	Manisha Sunil Shah	3.0	3.0	3.39	3	3.00	YES	YES	YES	YES
38	TN-68	UG-FLS-SS-27	66KV GORAD SS	M/s S. Poddar International (India) Pvt. Ltd.	3.0	1.0	3.40						YES
39	TN-68	UG-FLS-SS-27	66KV GORAD SS	M/s MKC Infrastructure Ltd.	3.0	3.0	3.42						YES
40	TN-68	UG-FLS-SS-27	66KV GORAD SS	Pankaj Prakash Choudhary	3.0	1.0	3.44						YES
41	TN-68	UG-FLS-SS-27	66KV GORAD SS	M/s Divine Techno Solar India LLP	3.0	1.0	3.48						YES
42	TN-68	UG-FLS-SS-27	66KV GORAD SS	M/s Zodiac Energy Limited	3.0	3.0	3.83						YES
43	TN-71	UG-FLS-SS-30	66KV PANCHADA SS	Ganeshbhai Parthibhai Chaudhary	3.0	3.0	3.29	3	3.00	NO			NO
44	TN-71	UG-FLS-SS-30	66KV PANCHADA SS	M/s Hexatron Industries limited	3.0	3.0	3.30						NO
45	TN-71	UG-FLS-SS-30	66KV PANCHADA SS	Vipul Daljibhai Chaudhary	3.0	3.0	4.34						NO
46	TN-71	UG-FLS-SS-30	66KV PANCHADA SS	Haresh Dhohjibhai Chaudhary	3.0	3.0	4.85						NO
47	TN-71	UG-FLS-SS-30	66KV PANCHADA SS	Mehul Hirabhai Chaudhary	3.0	3.0	4.99						NO
48	TN-71	UG-FLS-SS-30	66KV PANCHADA SS	Bhagwanbhai Bhikhabhai Karen	3.0	3.0	5.30						NO
49	TN-73	UG-FLS-SS-32	66KV PALLA SS	M/s SKP Bearing Industries Limited.	3.0	2.0	3.39	2	3.00	YES	YES	YES	NO
50	TN-73	UG-FLS-SS-32	66KV PALLA SS	M/s MKC Infrastructure Ltd.	3.0	3.0	3.40	1	3.00	Not Submitted within time 14.07.23			NO
51	TN-73	UG-FLS-SS-32	66KV PALLA SS	M/s Zodiac Energy Limited	3.0	3.0	3.83						NO
52	TN-75	UG-FLS-SS-34	66KV GANGUWADA SS	M/s CEPCO Industries Pvt. Ltd.	2.5	2.5	3.80	2.5	3.00	YES	YES		YES
53	TN-75	UG-FLS-SS-34	66KV GANGUWADA SS	M/s GPC Infrastructure Limited	2.5	2.5	4.46						YES
54	TN-77	UG-FLS-SS-36	66KV SUDASANA SS	M/s CEPCO Industries Pvt. Ltd.	2.5	2.5	3.44	2.5	3.00	YES	YES		YES
55	TN-77	UG-FLS-SS-36	66KV SUDASANA SS	Deep Shaileshkumar Shah	2.5	2.5	3.45						YES

Annexure-B : 24 Plants where more than 1 bid is received and taken in to E-REVERSE AUCTION													299
Sr No	Tender No.	Plant No	Name of Plant/ SS	Bidder Name	Notified Capacity of SS in MW	Offered capacity in MW	Min Rate	Propose MW Allocation	Letter for Consent Of Rs.	Consent Recived as (YES/NO)	LOI Issued (YES/NO)	LoI Confirmation received as (Yes/No)	Bucket Full YES/NO
56	TN-77	UG-FLS-SS-36	66KV SUDASANA SS	Laxmikumari Virendrasinh Parmar	2.5	1.0	3.65						YES
57	TN-77	UG-FLS-SS-36	66KV SUDASANA SS	M/s Topsun Energy Ltd.	2.5	1.5	3.80						YES
58	TN-84	UG-FLS-SS-43	66KV SURPUR SS	M/s Goldensol Producer company Limited	2.0	1.0	3.85	1	3.00	YES	YES	YES	NO
59	TN-84	UG-FLS-SS-43	66KV SURPUR SS	Hiteshkumar Amichandbhai Patel	2.0	1.0	4.50	1	3.00	NO			NO
60	TN-87	UG-FLS-SS-46	66KV DEL SS	M/s Avatar Solar Private Limited	1.5	1.5	3.93	1.5	3.00	NO			NO
61	TN-87	UG-FLS-SS-46	66KV DEL SS	M/s GPC Infrastructure Limited	1.5	1.5	4.52						NO
62	TN-89	UG-FLS-SS-48	66KV RAMPURA SS	M/s Avatar Solar Private Limited	1.5	1.5	3.53	1.5	3.00	YES	YES	YES	YES
63	TN-89	UG-FLS-SS-48	66KV RAMPURA SS	M/s CEPCO Industries Pvt. Ltd.	1.5	1.5	3.64						YES
64	TN-89	UG-FLS-SS-48	66KV RAMPURA SS	M/s GPC Infrastructure Limited	1.5	1.5	4.49						YES
65	TN-100	UG-FLS-SS-59	66KV NURPURA SS	M/s Deesha Civil Engineering Design	1.5	1.0	2.75	1			YES	YES	NO
66	TN-100	UG-FLS-SS-59	66KV NURPURA SS	M/s Gurukrupa Granite	1.5	1.5	4.30	0.5	2.75	NO			NO
67	TN-76	UG-FLS-SS-35	66KV KHERALU SS	Sharadkumar Keshubhai Desai	2.5	1.0	4.00	1			YES	YES	NO
68	TN-76	UG-FLS-SS-35	66KV KHERALU SS	Desai Ramiaben Sharadkumar	2.5	1.0	4.01	1			YES	YES	NO

Annexure-B : 24 Plants where more than 1 bid is received and taken in to E-REVERSE AUCTION												300	
Sr No	Tender No.	Plant No	Name of Plant/ SS	Bidder Name	Notified Capacity of SS in MW	Offered capacity in MW	Min Rate	Propose MW Allocation	Letter for Consent Of Rs.	Consent Recived as (YES/NO)	LOI Issued (YES/NO)	LoI Confirmation received as (Yes/No)	Bucket Full YES/NO
69	TN-51	UG-FLS-SS-10	66KV KHANPUR SS	M/s MECHATRONIK TECHNOLOGIES PRIVATE LIMITED	5.0	1.0	2.98	1	2.98		YES	YES	NO
70	TN-51	UG-FLS-SS-10	66KV KHANPUR SS	M/s MKC Infrastructure Ltd.	5.0	4.0	2.99	4	2.98		YES	Not Submitted within time	NO
71	TN-51	UG-FLS-SS-10	66KV KHANPUR SS	M/s QORX Energy	5.0	1.0	3.69						NO
72	TN-51	UG-FLS-SS-10	66KV KHANPUR SS	M/s Zodiac Energy Limited	5.0	5.0	3.83						NO
73	TN-51	UG-FLS-SS-10	66KV KHANPUR SS	Modi Divyesh Rakeshbhai	5.0	1.0	4.50						NO
74	TN-51	UG-FLS-SS-10	66KV KHANPUR SS	Vishal Mukeshkumar Modi	5.0	1.0	4.50						NO

Annexure-C : 28 Plants where single bid is received against each individual plant												301
Sr No	Tender No.	Plant No	Name of Plant/ SS	Bidder Name	Notified Capacity of SS in MW	Offered capacity in MW	Offered Rate	Propose Capacity Allocation (MW)	Letter for Consent Of Rs.	Consent Recived as (YES/NO)	LOI Issued (YES/NO)	LOI Confirmation
1	TN-43	UG-FLS-SS-2	66KV JALOTRA SS	M/s MKC Infrastructure Ltd.	8.0	8.0	3.25	8.0	3.00	Not Submitted within time 14.07.23		
2	TN-45	UG-FLS-SS-4	66KV IQBALGADH SS	M/s MKC Infrastructure Ltd.	7.5	7.5	3.25	7.5	3.00	Not Submitted within time 14.07.23		
3	TN-47	UG-FLS-SS-6	66KV DANTA SS	M/s MKC Infrastructure Ltd.	7.0	7.0	3.35	7.0	3.00	Not Submitted within time 14.07.23		
4	TN-49	UG-FLS-SS-8	66KV CHITRODA SS	M/s MKC Infrastructure Ltd.	6.5	6.5	3.19	6.5	3.00	Not Submitted within time 14.07.23		
5	TN-50	UG-FLS-SS-9	66KV HMT-2 SS	M/s MKC Infrastructure Ltd.	6.0	6.0	3.25	6.0	3.00	YES	YES	YES
6	TN-53	UG-FLS-SS-12	66KV VASAI SS	M/s MKC Infrastructure Ltd.	4.5	4.0	3.20	4.0	3.00	Not Submitted within time 14.07.23		
7	TN-54	UG-FLS-SS-13	66KV SUNDARPUR SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.20	4.0	3.00	YES	YES	YES
8	TN-56	UG-FLS-SS-15	66KV HEBATPUR SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.29	4.0	3.00	Not Submitted within time 14.07.23		
9	TN-58	UG-FLS-SS-17	66KV PRANTIJ SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.50	4.0	3.00	Not Submitted within time 14.07.23		
10	TN-60	UG-FLS-SS-19	66KV VASNIREL SS	M/s MKC Infrastructure Ltd.	4.0	4.0	3.25	4.0	3.00	YES	YES	YES
11	TN-62	UG-FLS-SS-21	66KV AMIRGADH SS	M/s HEXATRON INDUSTRIES LIMITED	3.5	3.5	3.40	3.5	3.00	YES	YES	YES
12	TN-64	UG-FLS-SS-23	66KV JUNI SAROTRI SS	M/s MKC Infrastructure Ltd.	3.5	3.5	3.30	3.5	3.00	YES	YES	YES
13	TN-69	UG-FLS-SS-28	66KV MOTASADA SS	M/s HEXATRON INDUSTRIES LIMITED	3.0	3.0	3.40	3.0	3.00	Not Submitted within time 14.07.23		
14	TN-72	UG-FLS-SS-31	66KV SATLASANA SS	M/s MKC Infrastructure Ltd.	3.0	3.0	3.30	3.0	3.00	Not Submitted within time 14.07.23		
15	TN-74	UG-FLS-SS-33	66KV PUNSARI SS	M/s MKC Infrastructure Ltd.	3.0	3.0	3.40	3.0	3.00	YES	YES	YES
16	TN-81	UG-FLS-SS-40	66KV DANTIWADA SS	M/s Zodiac Energy Limited	2.0	2.0	3.83	2.0	3.00	YES	YES	YES
17	TN-83	UG-FLS-SS-42	66KV AMODARA SS	Ahmadabbas Taherali Khanusiya	2.0	1.0	3.75	1.0	3.00	No		
18	TN-88	UG-FLS-SS-47	66KV SUKHPURA SS	M/s GPC Infrastructure Limited	1.5	1.5	4.48	1.5	3.00	No		
19	TN-90	UG-FLS-SS-49	66KV DHAROI SS	M/s NUGLADE PRIVATE LIMITED	1.5	1.5	4.37	1.5	3.00	NO		
20	TN-97	UG-FLS-SS-56	66KV LAXMANPUARA SS	M/s Sukoon Energy LLP.	1.5	1.5	3.95	1.5	3.00	No		
21	TN-99	UG-FLS-SS-58	66KV NIKODA SS	M/s Zodiac Energy Limited	1.5	1.5	3.83	1.5	3.00	YES	YES	YES

Sr No	Tender No.	Plant No	Name of Plant/ SS	Bidder Name	Notified Capacity of SS in MW	Offered capacity in MW	Offered Rate	Propose Capacity Allocation (MW)	Letter for Consent Of Rs.	Consent Recived as (YES/NO)	302 LOI Issued (YES/NO)	LOI Confirmation
22	TN-101	UG-FLS-SS-60	66KV UJEDIYA SS	M/s Zodiac Energy Limited	1.5	1.5	3.83	1.5	3.00	YES	YES	YES
23	TN-78	UG-FLS-SS-37	66KV KISANGADH SS	M/s Platinum Agro Industries	2.5	2.5	4.55	2.5	3.00		YES	NO
24	TN-98	UG-FLS-SS-57	66KV NETRAMALI SS	M/s ISR Renewable Consultants	1.5	1.5	4.50	1.5	3.00		YES	YES
25	TN-94	UG-FLS-SS-53	66KV HAJIPUR SS	M/s VIJAPURA IMPEX LLP, JV Partener : M/s Photonics Watertech Pvt Ltd	1.5	1.5	3.75	1.5	3.00		YES	NO
26	TN-103	UG-FLS-SS-62	66KV ZAMP SS	Kamleshkumar Babulal Shah	1.5	1.5	3.50	1.5	3.00		YES	YES
27	TN-95	UG-FLS-SS-54	66KV HARSOL SS	M/s R K CORP	1.5	1.5	3.50	1.5	3.00		YES	YES
28	TN-104	UG-FLS-SS-63	132KV DANDHUKA SS	M/s R K CORP	1.5	1.5	3.50	1.5	3.00		YES	YES

PAN NO. BQMPS6174E

Subject to Kheralu Jurisdiction

SAJIDKHAN K. SHAIKH

Mo. : 98798 92693

99240 56592

Email: sajidkhanskkn@gmail.com

MSME - UDYAN GJ-14 0017751

DHWDN-1/AB/Dy Act/Regi/1438

Govt. of Gujarat Approved Contractor



GST.NO. 24BQMPS6174E1ZI
ISO 9001 2015

All Kind of Civil work, Petrpleum, Complex, Hotel, Society & Development

Ambaji Highway Road, Yogeshwar Complex, Vrundavan Char Rasta, KHERALU, Di.: Mehesana

REF.No.

Dt. _____

To,
Solar Cell,
Uttar Gujarat Vij Company Limited.
Mehsana

Date: 01/07/2023

Sub.: Tariff confirmation for 3 MWp Solar plant Under PM-KUSUM scheme at Varethha Substation.

With reference letter no.: UGVCL/SOLAR CELL/PM KUSUM C/FLS/LOI/802 Dated on 28/06/2023.

Respected Sir,

We S K Buildcon participated in tender of PM KUSUM and as per the received LOI we are agree and accept for given tariff rate.

So, We requesting to you that please do further process.

Your Faithfully

[Signature]
S K Buildcon

S K BUILDCON

Ambaji Highway Road

Yogeshwar complex

Vrundavan char Rasta

Kheralu Dist. Mahesana

Pin :- 384325

સુવર્ણ વીજ કંપની લિમિટેડ
સુવર્ણ હોટેલ સરોવર
વિસામગરોડ,
મેહસાણા-384305 (ગુ.)
CIN
U40102GJ2003SGC042906
Phone: (02752) 222080-81
Fax: 223574

UTTAR GUJARAT VIJ
COMPANY LIMITED
Regional & Corporate Office
Sanaga Road,
Mehsana-384305 (Guj)
Website: www.ugvcl.com
Email: corporate@ugvcl.com

UGVCL/Solar Cell/PM KUSUM C/FLS/Lol/ 802

Date: 28/06/23

Through RPAD & Email

Letter of Intent (Lol)

To,

M/s S.K.Buildcon

E-Mail : sajidkhanskekh@gmail.com

2nd floor, 13/51, Yogeshwar Complex,

Nr. Gayatri Petrol Pump, Ambaji Highway Road,

Vrundavan Char Rasta, Kheralu,

Dist. Mehsana-384325

Sub.: Letter of Intent of Design, Survey, Supply, Installation, testing, commissioning, Operation & maintenance for 25 years from Commercial Operation date (COD) of grid connected substation level Solar power plant, erection and maintenance of its associated 11 KV Line to evacuate power to the substation with Remote Monitoring System (RMS) as per the PM-KUSUM Scheme Component-C-Feeder Level Solarization through RESCO model for solar power plant having capacity of 3.0 MW, for Solarization of 11 KV Agricultural feeders emanating from 66/11 KV VARETHA Sub-station in the supply area of UGVCL.

Ref.: 1. RFS No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-52 DT: 15.03.2023

2. Your offer submitted by on line in n-procure website.

3. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1114 Dtd.22.06.2023

Dear Sir/Madam,

This has reference to above RFS, your offer and further correspondences. UGVCL intends to empanel you as a solar power generator (SPG) for design, survey, supply, installation, testing, commissioning and operation & maintenance of grid connected feeder level solar power plant having capacity of 3.0 MW, its associated 11kv line and RMS of solar power plant for 25 years. RESCO Model as per specification, terms and conditions of above reference RFS, at the following approved rates mentioned here under:

Sr. No.	Solar PV Plant Capacity(MW) Name of S/S Name of Sdn	Levelized tariff for 25 years including applicable taxes including GST, duties etc. (Rs. Per kwh) All inclusive Tariff up to 2 decimal places Rs.
1	Solar PV Plant Capacity (3.0 MW) Name of S/S : 66KV VARETHA SS Name of Sdn : KHERALU-1	2.95

If you are interested in above offer, in that case please send your acceptance of above rates by

Signature valid

Signed by: Shri G H ENGINEER
Chief Engineer
Date: 2023/06/28 14:34:00
+05:30

File No: CORMHSUG/PMKUSUMCFLS/e-file/430/2023/3000/Solar

Approved By: Shri G H ENGINEER(Chief Engineer, Technical, CORM)

Open the document in Adobe Acrobat DC to verify the E-sign



within 7 days by replying our e-mail on your letter pad.

Conditional acceptance will not be accepted. No further communication will be entertained in this matter. If the acceptance will not be received by above date & time, it will be presumed that you are not interested to pursue your offer and accordingly further actions will be taken up without entering in to any correspondences in the matter. Please note that no further correspondences in the matter will be entertained thereafter.

This is without any prejudice to the UGVCL's rights in terms on RFS. However, this is also without any commitment on the part of UGVCL at this stage.

Kindly acknowledge the receipt of this Letter of Intent.

Thanking you,

For and on behalf of UGVCL,

**Chief Engineer (P&P)
Corporate Office, UGVCL
Mehsana**

Copy to:

- The Chief Engineer (Tech), GUVNL, Sardar Patel Vidhyut Bhavan, Race Course,

... for your kind information please.

- EA to M.D. Sir, UGVCL, Corporate office, Mehiana.
- Superintending Engineer, UGVCL, Circle Office, Mehiana.

Signature valid

Signed by: Shri G H ENGINEER
Chief Engineer
Date: 2023/06/14:34:00
+05:30

File No: CORMHSUG/PMKUSUMCFLS/e-file/430/2023/3000/Solar

Approved By: Shri G H ENGINEER(Chief Engineer, Technical, CORM)

Open the document in Adobe Acrobat DC to verify the E-sign



હેમાંગ મનોજભાઈ પોંડે,
હાટકેશ સોલર
હેમાંગ મનોજભાઈ પોંડે,
ડ. જસિત કુબેકસ, ૩૨૦ મટેલ સોસાયટી,
ગુલબાઈ ટેકરા,
એવિસબ્રિજ, અમદાવાદ-૩૮૦ ૦૦૬
તારીખ:-૦૩/૦૪/૨૦૨૩

પ્રતિ,
મુખ્ય ઇજનેર (પી એન્ડ પી),
ઉત્તર ગુજરાત વિજ કંપની લિ.
કોર્પોરેટ ઓફિસ,
મહેસાણા.

વિષય:- UGVCL/PROJECT/SOLAR/PM-KUSUM-C/FLS/TN-52, Date : 15/03/2023 ના પ્રોજેક્ટ હેઠળ કરેલ એપ્લિકેશન માંથી બહાર નીકળવા અંગેની અરજી.

માનનીય સાહેબ શ્રી,
સવિનય જાણવાનું કે અમોએ UGVCL/PROJECT/SOLAR/PM-KUSUM-C/FLS/TN-52, Date : 15/03/2023 અંતર્ગત અરજી કરેલ તેની વિગત નીચે પ્રમાણે છે.

Sr.No.	Bid No. (Plant Number) UG-SS- FLS-	Name Of Sub station	Notified Plant Capacityas per Annexure-3	Offered plant Capacityby the bidder (MW)	Mode of Payment (Online/ DD/BG)	EMD Amount in Rs. (Rs 1Lakhs /MW basis)	BG/DD/ On line mode payment Number	Date	Date upto which, BG is valid.
1	UGVCL/Project/Solar/PM-KUSUM-C- FLS/TN-52 Date-15/03/2023	66/11KV Varetha S/S	4.5 MW	4.0 MW	Online	4,00,000/-	UTR No. RNSB 20230411100 0119880 Date- 11/04/2023	11/04/2023	NA

વધુ માં હું આ યોજના માંથી નીકળી જવા માંગુ છું, તો તે માટે EMD ની રકમ મને રીફંડ મારા જણાવેલા બેંક ખાતા માં જમા આપવા વિનંતી.
મારા બેંક ખાતાની વિગત નીચે પ્રમાણે છે.

Name Of Account Holder	HATKESH SOLAR	Name OF Bank	RAJKOT NAGARI SAHAKARI BANK LTD.
Account Number	048003800004170	Name of Branch	NAVRANGPURA,
Bank IFSC Code	RNSB0000001	Address of Bank	MITHAKHALI SIX ROAD, NAVRANGPURA, AHMEDABAD-380-009

વધુ માં જાણવાનું કે UGVCL/PROJECT/SOLAR/PM-KUSUM-C/FLS/TN-52 ની આ યોજના માં કોઈપણ જાતની હક્કદાવો રહેશે નહિ, જેની ખાતરી બદલ સહી કરી આપું છું.
આભાર સહ..

For, HATKESH SOLAR
HM G. Modadra
PARTNER

અરજદાર ની સહી

બિડાણ:
એપ્લિકેશન, પૈસા ભર્યાની અસલ પાવતી તથા અરજદારના ખાતા ની કન્સલ ચેક

જાહેરાત બીજા કક્ષાના કાર્યો
સા.નં. 50/2023-સર્વિસ
વિભાગ: 22/2
સા.નં. 50/2023-સર્વિસ (સ.સ.)
CIN
U40102GJ2003SGC042906
Phone: (02762) 222080-81
Fax: 223574



308
UTTAR G
COMPANY
Bapt &
Vareg
Mandap
Web Site
e-mail con

UGVCL/R&C/Solar Cell/ PM KUSUM C/FLS/ 788

Date 27/06/23

To,

M/s Hatkesh Solar

5, Jasmit Duplex,

22/2 Patel Society, Gulbai Tekra,

Ahmedabad-6, Pin.380006

E-mail : hatkeshsolar2020@gmail.com

Subject: Submit consent to agree for RL1 tariff of Rs.2.95 per unit with allocation (balance) capacity of 1.5 MW against your offered tariff.

Ref. :- 1. Tender no. UGVCL/Project/Solar/PM-KUSUM-C/FLS/TN-52

2. Your offer submitted by on line in n-procure website.

3. GUVNL/Tech/Solar Cell/PM-KUSUM-C/FLS/1114 Dtd.22.06.2023

This office has received your offer against the above reference tenders inquiry for "Request for Selection (RfS) of Solar Power Generator (SPG) for Design, survey, supply, installation, testing, commissioning, operation & maintenance for 25 years (unless extended by both the parties on mutual agreement) from COD of grid connected Feeder level solar power plant, its associated 11kV line to connect the plant with concerned substation and RMS of solar power plant through RESCO model for solarization of 11kv feeders of associated 66/11kV VARETHA substation in UGVCL under PM-KUSUM scheme - Component C -Feeder Level Solarization (FLS)."

Your offered rate submitted by on line in n-procure website are as under :

Sr No	Tender No.	Plant No	Name of Plant/ SS	Notified Capacity of SS in MW	Offered capacity in MW	Offered Tariff (Rs./Kwh)	Propose Capacity Allocation (MW)
1	TN-52	UG-FLS-SS-11	66KV VARETHA SS	4.5	4.0	2.96	1.5

As per Tender clause : 7.3.2 In case of the last selected bidder, if the balance project capacity is less than the notified project capacity mentioned by such bidder, then the balance capacity shall be awarded to the bidder till the total notified capacity.

As per Tender clause : 8.1.4. In case of non-satisfactory achievement of tariff from single bidder, the Competent Committee may choose to make a written counter offer to the single bidder : **UGVCL offer RL1 tariff of Rs.2.95 per unit as counter offer with allocation (balance) capacity of 1.5 MW.**

If you are agree, Kindly submit consent to agree for tariff of Rs.2.95 per unit & capacity allocation : 1.5

Signature valid

Signed by: Shri B G PRANAMI
Additional Chief Engineer
Date: 2023-06-27 12:14:46
+05:30

File No: CORMHSUG/PMKUSUMCFLS/e-file/430/2023/3056/Solar

Approved By: Shri B G PRANAMI(ACE, Project and Renewable, COR)

Open the document in Adobe Acrobat DC to verify the E-sign



MW as above on your letter pad within 05 working days for Tender No. UGVCL/Proj,309Solar/KUSUM-CFLS/ITN-52.

On failure to submit consent within timeline, it will be presumed that you are not willing to peruse your offer any further and your offer will be disqualified without any further correspondence.

This is being informed to you as a matter of courtesy only and without prejudice to the UGVCL's rights in terms of tender.

This is for your kind information please.

Addl. Chief Engineer (P&Re)

UGVCL, R&C, Mehsana

Copy to:

- The Chief Engineer (Tech), GUVNL, Sardar Patel Vidhyut Bhavan, race Corse,
... for your kind information please.
- EA to M.D. Sir, UGVCL, Corporate office, Mehsana.
- The Chief Engineer (P&P), UGVCL, Corporate office, Mehsana

Signature valid

Signed by: Shri B. PRANAMI
Additional Chief Engineer
Date: 2023/02/12 12:14:48
+05:30

File No: CORMHSUG/309KUSUMCFLS/e-file/430/2023/3056/Solar

Approved By: Shri B. PRANAMI(ACE, Project and Renewable, COR)

Open the document in Adobe Acrobat DC to verify the E-sign



Bid Details Report

Bidders[Attached:11 Logged-In:8 Active:

Auction Detail [Auction Id: 67962, Auctioneer: UGVCL, Division: SOLAR CELL]

Auction Id:	67962	Auction Type:	Reverse Auction	UOM:	Solar
Reference No:	e-auction/23-24			Auction Code:	S239-67962
Description:	Request for Selection of Solar Power Generators for Purchase of Solar Power through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders of various 66/11 KV Sub-station in the supply area of UGVCL under RESCO mode of PM-KUSUM Component-C Feeder level Solarization Scheme of MNRE			Base Currency:	Rupees
Start Time:	25/05/2023 12:00	End Time:	25/05/2023 12:30		

Bid Detail

Sr No	Item Name	Description	O.P.	Best Bid	Offered By	Total Bids
1	TN-52/UG-FLS-SS-11	66KV VARETHA SS	2.99000	2.95000	s.k. buildcon, sajdkhan shekh, kheralu (sajdkhanskekh) (9879892693) (sajdkhanskekh@gmail.com)	3
		Sr No	Bidder Name	Bid Date	Bid Rate	
		1	sajdkhan shekh (sajdkhanskekh)	25/05/2023 12:16:26	2.95000	
		2	Hemang(hatkesh)	25/05/2023 12:11:46	2.96000	
		3	sajdkhan shekh (sajdkhanskekh)	25/05/2023 12:02:07	2.97000	
2	TN-67/UG-FLS-SS-26	66KV UNTARADA SS	3.50000	0.00000		0
		Sr No	Bidder Name	Bid Date	Bid Rate	
3	TN-77/UG-FLS-SS-36	66KV SUDASANA SS	3.45000	3.44000	HARSHA ENGINEERS INTERNATIONAL LIMITED, FALGUN, AHMEDABAD (munjalhrangwala) (9662471344) (yash.bhavsar@harsha-abakus.com)	1
		Sr No	Bidder Name	Bid Date	Bid Rate	
		1	FALGUN (munjalhrangwala)	25/05/2023 12:15:06	3.44000	



Dashboard



Edit Profile



Archived Data



Logout



Good Morning J. R. Chaudhary! [Solar Cell - Mehsana]

Easy Links : **GoodsWise Report****Current Tender Details**

IFB / Tender Notice No : UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-52

Tender ID: 581259

Name of Work : Request for Selection of Solar Power Generators for Purchase of Solar Power through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders of 66/11 KV VARETHA Sub-station in the supply area of UGVCL under RESCO mode of PM-KUSUM Component-C Feeder level Solarization Scheme of MNRE.

ECV (INR): 0

Last Date & Time For Submission of Bid: 19/04/2023 18:00:00

Type Of Tender: open

Tender Item Details

Sr. No. : 1

Name Of Circle : MEHSANA

Name of Sub- SATLASANA,KHERALU-1

Divisions :

Name of Sub- 66KV VARETHA SS
Station :Name of Plant- UG-FLS-SS-11
number :Name of AG RINCHHADA,CHIKANA,DALISANA,KANEDIA,NIZAMPUR,JORAPURA ,SHIVAM,KESHARPURA,GALALPUR,NALU,VARETHA
feeders :

Notified Solar plant capacity for the Substation (MW) : 4.5

Qualified Suppliers List

Sr.NO.	Company Name	Order Preference Parties	Evaluated Ranking	Supplier User Name	Fixed Tariff for the Capacity cost as in Form-3 for 25 Years, Inclusive applicable taxes(Incl.GST),duties,etc. (Rs. Per KWH)	Quoted Price	Equated Price
1	MKC Infrastructure Ltd.	NO	L1	mkinfrastructureltd	2.99	2.99	2.99
2	ZODIAC ENERGY LIMITED	NO	L2	zodiaceenergy2	3.83	3.83	3.83
3	AVATAR SOLAR PRIVATE LIMITED	NO	L3	Solar_123	3.95	3.95	3.95

4	S.K.BUILDCON	NO	L4	skbuildcon	3.97	3.97	3.97
	Harsh						
5	Nathubhai	NO	L5	Harsh1234	4.19	4.19	4.19
	Chaudhari						
6	HATKESH	NO	L6	hatkesh	4.50	4.50	4.50
	SOLAR						

Note: < Equated Price difference of each Selected Supplier reduced + Formula. Formula= Equated Price = Quoted Price of Order Preference Parties / Loading Factor >

[Previous](#)[Export To Excel](#)**Committee Members**

First Name

User Name

J. R. Chaudhari

ugvdsoljrc

[Tenders Under Creation](#) | [Create New Tender](#) | [Approve Tender](#) | [My Procurements](#) | [Edit Tender](#) | [Approve Corrigendum](#) | [Pre Bid Meeting](#) |
[Create Offline Tender](#) | [Create New Form](#) | [Tender BackUp](#) | [Bid Evaluation](#) | [Bid Evaluation Reports](#) | [Assign Tender Activities](#) | [Upload Documents](#) | [Tender Summary](#) | [Registered Suppliers](#) | [Add Limited Suppliers](#) |

Server Time : 24/05/2023 11:21:15

RIS document for feeder level Solarization under PM-KUSUM Component-F in GVT

Form-3 Summary of Sub-Station wise capacity bidded and EMD detail

In Response to RTI No:	UGVCL/Project/Solar/PM-KUSUM-C/RTI/14
------------------------	---------------------------------------

Name of bidder: S.K. Bulokom

Name of JV Partners, if bid is submitted through JV :- NA

Name of Bidder's contact Person: Sridharan Sathya

Bidder's contact Person mobile No: 9879892693

Email ID of Bidder: Sridharan.sathya@gmail.com

GST No of Bidder: 24BQMP56174E121

Please mention details as under in respect of all plants for which, bidder have submitted his bids.

Sr.	Bid	Name of	Notified	Offered	Mode of	EMD	BG/DD/	Date	upto	whic	h, BG	is	valid.
N.	No.	Sub	Plant	Capacity	Capacity	Payment	Amount	On line	mode	payment	Number		
o.	(Plant	Numb	er)	UG-	SS-	FLS-							
1	11	66 kv	4.5	3.0	On line	300000000	1123799440	21MAR-2023					
2		VAREHA											
3													

(Signature & Seal of Authorized Signatory for which POA

attached)

Name of Authorized Signatory: Sridharan K. Sathya

Designati

Proprietor

on: Date:

31/03/2023

Place:

12, KLEHOLY

Sign & Seal of SPG

FOR, S. K. BULOKOM

Proprietor

Name of Bidder: Harkesh Solai

Name of JV Partners, if bid is submitted through JV - NA (Sole bidder)

Name of bidder's contact Person:- Hemang Ghobadra

Bidder's contact Person mobile No: 9824054008

Email ID of Bidder: hatkesnsolar2020@gmail.com

GST No of Bidder: NA

Please mention details as under in respect of all plants for which, bidder have submitted his bids.

Sr. No.	Bid No.	(PlantNumb ofsub fled plant of	Noti	Name	station	Pla	Capacity	by the	Cap	bidder	(MW)	as per Ann	exu	re-3
1	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS	UG-SS-FLS
1	UGVCL/Project/66/1KV	4.5	4.0 MW	Online	4,00,000/-	RNSB	2023041110	00119880	11/04/2023	11/04/2023	NA	11/04/2023	NA	11/04/2023

(Signature & Seal of Authorized Signatory for which POA attached)

Name of Authorized Signatory: Hemang Chhabra

Designation: Partner

Date:

Place:

Sign & Seal of SPG



**Bid Status****Current Tender Details**

Tender Notice No. UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-52

Tender ID 581259

Name of Work

Request for Selection of Solar Power Generators for Purchase of Solar Power through "On-line" mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders of 66/11 KV VARETHA Sub-station in the supply area of UGVCL under RESCO mode of PM-KUSUM Component-C Feeder level Solarization Scheme of MNRE.

ECy (INR) 0


Last Date & Time For Submission of Bid: 19/4/2023 13:00

Type Of Tender open

Bid Status**No of Bids = 6**

Powered By: C1India Private Limited

Server Time : 05/08/2023 13:13:03



Save Energy for Benefit of Self and Nation

UGVCL



Uttar Gujarat Vij Company Limited

CIN - U40102GJ2003SGC042906
(A subsidiary of Gujarat Urja Vikas Nigam Limited)

AMENDMENT No:-2

Tender No: UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-52

"Request for Selection of Solar Power Generators for Purchase of Solar Power through 'On-line' mode for purchase of power from solar power projects through competitive bidding process (followed by reverse e-auction) for Solarization of 11 KV Agricultural feeders of 66/11 KV VARETHA Sub-station in the supply area of UGVCL under RESCO mode of PM-KUSUM Component-C Feeder level Solarization Scheme of MNRE."

At this stage, the time limit of this tender is extended as under:

EXTENSION IN DUE DATE OF SUBMISSION

Sr.No	Description	
1	Tender No :	UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-52
2	Last Date & Time of submission of On-line bid in electronic form (Tender Fee, EMD, Technical & Financial Tariff offer. (This is mandatory)	Date: 12.04.2023 up to 18.00 Hrs is extended up to Dtd.19.04.2023 Up to 18.00 Hrs
3	Date of opening of Tender Fee, EMD on-line	Date: 13.04.2023 at 11.00 Hrs is extended up to Dtd.20.04.2023 at 11.00 Hrs
4	Submission of original copy of DD/ Banker's Cheque/Pay Order /Bank Guarantee	Within 5 days from the scheduled date of on-line bid opening of Tender Fee & EMD stage. (On working days, During office hours)
5	Date of opening of Technical Bid online (if possible)	Date: 20.04.2023 at 11.00 Hrs is extended up to Dtd. 27.04.2023 at 11.00 Hrs
6	Tentative Date of on - line opening of financial "Tariff bid" (Price bid) (If possible)	Date: 24.04.2023 at 11.00 Hrs is extended up to Dtd.29.04.2023 at 11.00 Hrs

Other contents of tender notice, terms and condition, Specification of above tender remains unchanged. Please submit this amendment in technical bid duly signed.

Chief Engineer (P&P)
UGVCL: Mehsana

Date: _____ Signature & Seal of the Tenderer _____

Regd. & Corporate Office: Visnagar Road, MEHSANA – 384 001 (North Gujarat)
Telephone: (02762) 222080-81 Fax: (02762) 223574
Website: www.ugvcl.com e-mail: aceproject@ugvcl.com

(On Non-Judicial Stamp Paper of Rs. 300/- attested by Notary Public/ First Class Magistrate)

DRAFT POWER PURCHASE AGREEMENT (PPA)

for

Procurement of ____MWp

Solar Power on Long Term basisfor

Feeder level Solarization –under

PM-KUSUMComponent-Cof the Scheme for

Solarization of 11 KV Agricultural Feeder(s) of ____66/11 KV

**Substation, ____sub-division, ____Division, ____Circle
of UGVCL**

Between

<nameofSolarPowerGenerator(SPG)>

and

UTTAR GUJARAT VIJ COMPANY LIMITED

[/ /2023]

This Power Purchase Agreement is made on the _____ day of _____ of 20 at _____.

Between

.....<name of SPG>....., selected as Solar Power Generator for implementation of Solar Power Project with associated 11kV evacuation line under **Pradhan Mantri Kisan Urja Suraksha evam Utthan Mahabhiyan (PM KUSUM) Scheme, Component C (feeder level solarization)**, having registered office at<Address of SPG>..... (hereinafter referred to as "**Solar Power Generator or SPG**", which expressions shall, unless repugnant to the context or meaning thereof, be deemed to include its successors and permitted assigns) as a Party of the **First Part**;

And

UTTAR GUJARAT VIJ COMPANY LIMITED' a company incorporated under the Companies Act 1956, having its registered office at, _____ (hereinafter referred to as 'UGVCL' " which expression shall, unless repugnant to the context or meaning thereof, be deemed to include its successors and assignees) as a Party of the **Second Part**;

The SPG and UGVCL are individually referred to as 'Party' and collectively referred to as 'Parties'.

WHEREAS:

- A. The Ministry of New and Renewable Energy [MNRE] has notified a guidelines for feeder level solarization under Component C of PM KUSUM Scheme on 04th Dec 2020.
- B. UGVCL initiated process for selection of Solar Power Generator (s) (SPG) to set solar power plant for notified solar capacity through RESCO mode and procurement of power generated from the solar power plant as per the terms and conditions contained in the RfS No: _____ DT: _____
- C. The SPG has been selected for installation of solar power project which includes work of design, survey, supply, installation, testing, commissioning and operation & maintenance of grid connected _____ MW solar power plant, its associated 11kV evacuation line to connect the plant with concerned substation and RMS of solar power plant for Solarization of 11kV feeder(s) of 66/11kV _____ substation under _____ subdivision, _____ Division, _____ Circle of UGVCL.
- D. UGVCL has issued the Letter of Award/Work Order No. _____ dated _____ in Favour of<name of SPG> as per the terms and conditions contained in the RfS.
- E. The SPG has furnished the Project Security Amount of Rs. _____ (_____ rupees only) in the form of Bank Guarantee in favour of UGVCL, _____.
- F. The SPG has fulfilled the terms and conditions for signing of this Power Purchase Agreement as a definitive agreement for establishing the

Solar Power Project of ___MWp under Feeder level solarization –Component-C of PM-KUSUM Scheme for Agricultural feeder(s) of _____ 66/11kV substation, _____ subdivision, _____ division, _____ circle of UGVCL under _____ district and sale of electricity by the SPG to UGVCL at delivery point at 66/11kV _____ substation.

- G. Hon'ble GERC vide order dated _____ in petition no. _____ has adopted the tariff discovered in the competitive bidding process conducted vide RfS dated _____ wherein the SPG has emerged as a successful bidder and allocated the Solar Power project of ___ MWp under the bucket filling mode as per the terms of RfP.
- H. The parties have agreed to execute this Power Purchase Agreement in terms of the RfS and the Letter of Award in regard to the work of Design, survey, supply, installation, testing, commissioning, operation & maintenance for 25 years (unless extended by both the parties on mutual agreement) from COD of grid connected **Feeder level** solar power plant having capacity of _____ MWp, its associated 11kV line to connect the plant with concerned substation and RMS of solar power plant through RESCO model for solarization of Agricultural 11kV feeders of associated _____ 66/11kV substation in UGVCL under PM-KUSUM scheme – Component C (feeder level solarization)

Now therefore, in consideration of the premises and mutual agreements, covenants and conditions set forth herein, it is hereby agreed by and between the Parties as follows:

ARTICLE 1: DEFINITIONS AND INTERPRETATION

1.1 Definitions

The terms used in this Agreement, unless as defined below or repugnant to the context, shall have the same meaning as assigned to them by the Electricity

Act, 2003 and the rules or regulations framed thereunder, including those issued/framed by the Appropriate Commission (as defined hereunder), as amended or re-enacted from time to time.

ALMM	Approved List of Models and Manufacturers of Solar Photovoltaic Modules issued by Ministry of New and Renewable Energy, Government of India time to time.
"Agreement" or "Power Purchase Agreement" or "PPA"	shall mean this Power Purchase Agreement including its recitals and Schedules, amended or modified from time to time in accordance with the terms hereof;
"Appropriate Commission"	Appropriate Commission or "GERC" shall mean the Gujarat Electricity Regulatory Commission (GERC)
"Bill Dispute Notice"	shall mean the notice issued by a Party raising a Dispute regarding a Monthly Bill or a Supplementary Bill issued by the other Party;

“Base rate of Late Payment Surcharge”	shall mean the marginal cost of funds based lending rate for one year of the State Bank of India, as applicable on the 1st April of the financial year in which the period lies, plus five percent and in the absence of marginal cost of funds based lending rate, any other arrangement that substitutes it, which the Central Government may, by notification, in the Official Gazette, specify. Provided that if the period of default lies in two or more financial years, the base rate of Late Payment Surcharge shall be calculated separately for the periods falling in different years.
“BusinessDay”	shall mean with respect to SPG and DISCOM, a day other than Sunday or a statutory holiday, on which the banks remain open for business in the State;
“Capacity Utilisation Factor” or “CUF”	CUF in a Year shall mean the ratio of the net output energy injected at delivery point of the SPV Power Plant in a Year versus installed Project capacity $\times 365 \times 24$ (i.e. $CUF = \frac{\text{Cumulative Project output in kWh}}{(\text{installed Project capacity in kW} \times 24 \times 365)}$) The annual CUF will be calculated every year from 1st April of the year (COD for first year) to 31 st March next year.
“CFA”	Shall mean the Central finance Assistance to be provided by the Ministry of New and Renewable Energy Government of India under the Pradhan Mantri Urja Suraksha evam Utthaan Mahabhiyaan (PM-KUSUM) scheme as per the Guidelines for Implementation of Feeder Level Solarisation under Component-C of PM-KUSUM Scheme issued on date 4-12-2020 with subsequent amendment/s, if any.
“Change in Law”	shall have the meaning ascribed thereto in Article 12 of this Agreement;
“Commercial Operation Date (COD)”	shall mean the date certified by the DISCOM's committee upon successful commissioning (as per provisions of this Agreement) of the project when all equipment's as per rated capacity have been installed and energy has flown into the grid.
“Competent Court of Law”	shall mean the Supreme Court of India or Gujarat High Court, or any tribunal or any similar judicial or quasi-judicial body that has jurisdiction in relation to issues relating to the Project.
“Consents, Clearances and Permits”	shall mean all authorizations, licenses, approvals, registrations, permits, waivers, privileges, acknowledgements, agreements, or concessions required to be obtained from or provided by any concerned authority for the purpose of setting up of the generation facilities and/or supply of power;

"Consultation Period"	shall mean the period of ninety (90) days or such other longer period as the Parties may agree, commencing from the date of issuance of a SPG Preliminary Default Notice or DISCOM Preliminary Default Notice as provided in Article 13 of this Agreement, for consultation between the Parties to mitigate the consequence of the relevant event having regard to all the circumstances;
"Contract Year"	shall mean the period beginning from the Effective Date and ending on the immediately succeeding March 31 and thereafter each period of 12 months beginning on April 1 and ending on March 31 provided that: 1) in the financial year in which the COD occurs, the Contract Year shall end on the date immediately before the COD and a new Contract Year shall commence once again from the COD and end on the immediately succeeding March 31, and thereafter each period of twelve (12) months commencing on April 1 and ending on March 31, and 2) provided further that the last Contract Year of this Agreement shall end on the last day of the Term of this Agreement or on termination of this agreement whichever is earlier.
"Contracted Capacity"	shall mean <u> MWpAC </u> contracted with DISCOM for supply by the SPG to DISCOM at the Delivery Point which shall be the maximum injection limit at delivery point in any 15 minute time block during the entire term of the PPA.
"Delivery Point"	Delivery Point shall mean the point at the voltage level of 11kV of the 66/11kV Sub-station i.e. 11kV side of 66/11kV <u> </u> substation under this PPA. Metering shall be done at this interconnection point where the power is injected into the 66/11kV Sub-station. For interconnection with grid and metering, the SPG shall abide by the relevant and applicable regulations, Grid Code notified by the State Commission and Central Electricity Authority (Installation and Operation of Meters) Regulations, 2006 as amended and revised from time to time, or orders passed thereunder by the Appropriate Commission or CEA. All charges and losses related to Transmission of power from project up to Delivery Point shall be borne by the SPG without any reimbursement thereof.
"Dispute"	shall mean any dispute or difference of any kind between DISCOM and the SPG, in connection with or arising out of this Agreement including but not limited to any issue on the interpretation and scope of the terms of this Agreement as provided in Article 16 of this Agreement;

DISCOM	Shall mean the Electricity Distribution Company. The DISCOM in this PPA is UGVCL.
"DueDate"	Due Date shall mean the thirtieth (30 th) day after aMonthly Bill (including all the relevant documents) or aSupplementary Bill is received in hard copy and dulyacknowledged by UGVCL or, if such day is not a BusinessDay, the immediately succeeding Business Day, by whichdatesuchMonthlyBilloraSupplementaryBillispayable by UGVCL.
"ElectricityAct,2003"	shallmeantheElectricityAct,2003andincludeany modifications,amendmentsandsubstitutionfromtimetotime;
"EffectiveDate"	shallhavethemeaningascribedtheretoinArticle2.1of thisAgreement;
"ElectricityLaws"	shall mean the Electricity Act, 2003 and the rules andregulations made there under from time to time alongwith amendments thereto and replacements thereof andanyotherLawpertainingtoelectricityincluding regulationsframedbytheAppropriateCommission;
"EventofDefault"	shallmeantheeventsasdefinedinArticle13ofthis Agreement;
"ExpiryDate"	Shall mean the date occurring twenty-five (25) years fromthe Commercial Operation Date provided that the supplyof power shall be limited for a period of 25 years from theCOD (unless extended by both the parties on mutualagreement);
"Financing Agreements"	shall mean the agreements pursuant to which the SPG hassought financing for the Power Project including the loanagreements, security documents, for the Power Projectincludingtheloanagreements,securitydocuments,notes,indentures, security agreements, letters of credit andother documents, as may be amended, modified, orreplacedfromtimetotime,butwithoutinanyway increasingtheliabilitiesof UGVCL;
"ForceMajeure"or "Force MajeureEvent"	shall have the meaning ascribed thereto in Article 11 ofthisAgreement;

"Indian Governmental Instrumentality"	shall mean the Government of India, Governments of state of Gujarat and any ministry, department, board, authority, agency, corporation, commission under the direct or indirect control of Government of India or the above state Government or both, any political subdivision of any of them including any court or Appropriate Commission or tribunal or judicial or quasi-judicial body in India
"Insurances"	shall mean the insurance cover to be obtained and maintained by the SPG in accordance with Article 8 of this Agreement;
"Interconnection Facilities"	shall mean the facilities on SPG's side of the Delivery Point for scheduling, transmitting and metering the electrical output in accordance with this Agreement and which shall include, without limitation, all other transmission lines and associated equipment, transformers, relay and switching equipment and protective devices, safety equipment and RTU, Data Transfer and Acquisition facilities for transmitting data subject to Article 7, the Metering System required for supply of power as per the terms of this Agreement;
"Invoice" or "Bill"	shall mean either a Monthly Bill / Supplementary Bill or a Monthly Invoice/ Supplementary Invoice raised by any of the Parties;
"Joint Meter Reading" or "JMR":	Shall mean the monthly joint meter reading statement which shall be jointly signed by SPG and UGVCL representative
"Late Payment Surcharge"	shall have the meaning ascribed thereto in Article 10.1.7 of this Agreement;
"Law"	shall mean in relation to this Agreement, all laws including Electricity Laws in force in India and any statute, ordinance, regulation, notification or code, rule, or any interpretation of any of them by an Indian Governmental Instrumentality and having force of law and shall further include without limitation all applicable rules, regulations, orders, notifications by an Indian Governmental Instrumentality pursuant to or under any of them and shall include without limitation all rules, regulations, decisions and orders of the GERC;
"Letter of Credit" or "LC"	shall have the meaning ascribed thereto in Article 10.1.10 of this Agreement;
"Letter of Award" or "LoA"	shall mean work order issued by UGVCL to the SPG for the project;
MNRE"	shall mean the Ministry of New and Renewable Energy, Government of India;

"Month"	shall mean a period of thirty (30) days from (and excluding) the date of the event, where applicable, else a calendar month;
"Party" and "Parties"	shall have the meaning ascribed thereto in the recital to this Agreement;
"Payment Security Mechanism"	shall have the meaning ascribed thereto in Article 10.1.10 of this Agreement
"PM-KUSUM"	Pradhan Mantri Urja Suraksha evam Utthaan Mahabhiyaan- A scheme notified by the Ministry of New and Renewable Energy Government of India with Guidelines for Implementation of Feeder Level Solarisation under Component-C of PM-KUSUM Scheme issued on date 4-12-2020.
"Power Project" or "Project"	shall mean the Solar Power generation facility of Contracted Capacity having a separate control system, metering and separate points of injection into the grid at Delivery point. The Project shall include all units and auxiliaries such as water supply, treatment or water storage facilities, bay(s) for transmission system in the switchyard, dedicated electrical line upto the Delivery Point and all the other assets, buildings/structures, equipment, plant and machinery, facilities and related assets required for the efficient and economic operation of the power generation facility, whether completed or at any stage of development and construction or intended to be developed and constructed for the purpose of supply of power as per this Agreement;
"Preliminary Default Notice"	shall have the meaning ascribed thereto in Article 13 of this Agreement;
"Project Capacity"	shall mean the maximum AC capacity of the Project at the point of injection for which the Power Purchase Agreement has been signed.

"Prudent Utility Practices"	shall mean the practices, methods and standards that are generally accepted internationally from time to time by electric utilities for the purpose of ensuring the safe, efficient and economic design, construction, commissioning, operation and maintenance of power generation equipment and which practices, methods and standards shall be adjusted as necessary to take account of: a. operation and maintenance guidelines recommended by the manufacturers of the plant and equipment to be incorporated in the Power Project b. the requirements of Indian Law; and the physical conditions at the site of the Power Project
"Rebate"	shall have the same meaning as ascribed thereto in Article 10.1.9 of this Agreement;
"RESCO"	shall mean Renewable Energy Service Company i.e. an energy service company that develops, installs, finances, operates and owns the solar power project and supplies power generated from the Project to the UGVCL.
"Rupees", "Rs.",	shall mean Indian rupees, the lawful currency of India;
"Scheduled Commissioning Date" or "SCD" of the Project	Shall mean date that is nine (9) Months from the Date of execution of this PPA between _UGVCL
SPG	Shall mean Solar Power Generator who has signed this agreement upon issue of Letter of Award by UGVCL
"Tariff"	Shall have the same meaning as provided for in Article 9 of this Agreement;
"Tariff Payment"	shall mean the payments to be made under Monthly Bills as referred to in Article 10 and the relevant Supplementary Bills;
"Termination Notice"	shall mean the notice given by either Parties for termination of this Agreement in accordance with Article 13 of this Agreement;
"Term of Agreement"	shall have the meaning ascribed thereto in Article 2 of this Agreement;

1.2 INTERPRETATION

Save where the contrary is indicated, any reference in this Agreement to:

- i) "Agreement" shall be construed as including a reference to its Schedules, Appendices
- ii) An "Article", a "Recital", a "Schedule" and a "paragraph clause" shall be construed as a reference to an Article, a Recital, a Schedule and a paragraph/clause

spectively of this Agreement;

- iii) A "*crore*" means a reference to ten million (10,000,000) and a "*lakh*" means a reference to one tenth of a million (1,00,000).
- iv) An "*encumbrance*" shall be construed as a reference to a mortgage, charge, pledge, lien or other encumbrance securing any obligation of any person or any other type of preferential arrangement (including, without limitation, title transfer and retention arrangements) having a similar effect;
- v) "*Indebtedness*" shall be construed so as to include any obligation (whether incurred as principal or surety) for the payment or repayment of money, whether present or future, actual or contingent;
- vi) A "*person*" shall be construed as a reference to any person, firm, company, corporation, society, trust, government, state or agency of a state or any association or partnership (whether or not having separate legal personality) of two or more of the above and a person shall be construed as including a reference to its successors, permitted transferees and permitted assigns in accordance with their respective interests;
- vii) "*Rupee*", "*Rupees*" and "*Rs.*" shall denote Indian Rupees, the lawful currency of India;
- viii) The "*winding-up*", "*dissolution*", "*insolvency*", or "*reorganization*" of a company or corporation shall be construed so as to include any equivalent or analogous proceedings under the Law of the jurisdiction in which such company or corporation is incorporated or any jurisdiction in which such company or corporation carries on business including the seeking of liquidation, winding-up, reorganization, dissolution, arrangement, protection or relief of debtors;
- ix) Words importing the singular shall include the plural and vice versa;
- x) This Agreement itself or any other agreement or document shall be construed as a reference to this or to such other agreement or document as it may have been, or may from time to time be, amended, varied, novated, replaced or supplemented;
- xi) A Law shall be construed as a reference to such Law including its amendments or re-enactments from time to time;
- xii) A time of day shall, save as otherwise provided in any agreement or document be construed as a reference to Indian Standard Time;
- xiii) Different parts of this Agreement are to be taken as mutually explanatory and supplementary to each other and if there is any inconsistency between or among the parts of this Agreement, they shall be interpreted in a harmonious manner so as to give effect to each part;
- xiv) The tables of contents and any headings or sub-headings in this Agreement have been inserted for ease of reference only and shall not affect

he interpretation of this Agreement.

- xv) The words "*hereof*" or "*herein*", if and when used in this Agreement shall mean a reference to this Agreement.
- xvi) The terms "*including*" or "*including without limitation*" shall mean that any list of examples following such term shall in no way restrict or limit the generality of the word or provision in respect of which such examples are provided.

ARTICLE 2: TERM OF AGREEMENT

2.1 *Effective Date*

- 2.1.1 This Agreement shall come into effect from the date of its execution by all the parties and such date shall be referred to as the Effective Date.

2.2 *Term of Agreement*

- 2.2.1 Subject to Article 2.3 and 2.4 of this Agreement, this Agreement shall be valid for a term from the Effective Date until the Expiry Date. This Agreement may be extended for a further period at least one hundred eighty (180) days prior to the Expiry Date, on mutually agreed terms and conditions.
- 2.2.2 The SPG is free to operate their plants beyond the Expiry Date if other conditions like land lease/Right to Use of Land (as applicable), permits, approvals and clearances etc. allow. In such case unless otherwise agreed by UGVCL, UGVCL shall not be obligated to procure power beyond the Expiry Date.

2.3 *Early Termination*

- 2.3.1 This Agreement shall terminate before the Expiry Date if either UGVCL or SPG terminates the Agreement, pursuant to Article 13 of this Agreement.

2.4 *Survival*

- 2.4.1 The expiry or termination of this Agreement shall not affect any accrued rights, obligations and liabilities of the Parties under this Agreement, including the right to receive penalty as per the terms of this Agreement, nor shall it affect the survival of any continuing obligations for which this Agreement provides, either expressly or by necessary implication, which are to survive after the Expiry Date or termination including those under Article 11 (Force Majeure), Article 13 (Events of Default and Termination), Article 14 (Liability and Indemnification), Article 16 (Governing Law and Dispute Resolution), Article 17 (Miscellaneous Provisions), and other Articles and Schedules of this Agreement which expressly or by their nature survive the Term or termination of this Agreement shall continue and survive any expiry or termination of this Agreement.

2.5 *Performance Bank Guarantee (PBG)*

- 2.5.1. The Performance Bank Guarantee furnished under this Agreement shall be for guaranteeing the successful commissioning of the Project for power up to the Contracted Capacity within the times specified

in this Agreement.

- 2.5.2. The failure on the part of the SPG to furnish and maintain the Performance Bank Guarantee shall be a material breach of the term of this Agreement on the part of the SPG.
- 2.5.3. The PBG shall be initially valid from the date of issue until 2 months (i.e. sixty (60) days) beyond the 9 months from the date of signing of Power Purchase Agreement (PPA).
- 2.5.4. The PBG will be returned to the SPG after successful commissioning of Solar power plant, after taking into account any penalties due to delay in commissioning as per terms and conditions of RfS.
- 2.5.5. **CFA up to 100% of the total eligible CFA will be released to the RESCO developer through UGVCL on successful operation and performance of solar plant for two months after the commissioning with at least one month CUF as per minimum CUF agreed in PPA, as per MNRE's sanction for the CFA, subject to release of the same by MNRE-GOI**

ARTICLE 3: CONDITIONS SUBSEQUENT

- 3.1 The SPG agrees and undertakes to secure Project Financing Arrangements for its Project and should provide necessary documents to UGVCL in this regard within six months from the date of issue of Work order by UGVCL for the project.
- 3.2 The SPG shall identify the project land preferably within the distance of Five KM radius of the respective 66/11 KV Sub-station, get ownership of land or its lease rights and make necessary arrangement including ROW, clearances etc for the electrical line between 66/11 KV sub-station and the solar power plant. The SPG shall submit the final land documents before Commercial Operation Date of the project.

ARTICLE 4: CONSTRUCTION & DEVELOPMENT OF THE PROJECT

4.1 SPG's Obligations

- 4.1.1 The SPG undertakes to be responsible, at SPG's own cost and risk, for:
 - a) The SPG shall be solely responsible and make arrangements for infrastructure for development of the Project and for Connectivity with the 66/11 KV sub-station for confirming the evacuation of power by the Scheduled Commissioning date or COD, whichever is earlier, and all clearances related thereto;
 - b) obtaining all Consents, Clearances and Permits as required and maintaining all documents;
 - c) Designing, constructing, erecting, commissioning, completing and testing the Power Project including then RMS in accordance with the applicable Law, the Grid Code, the terms and conditions of this Agreement and Prudent Utility Practices;

- d) the commencement of supply of power up to the Contracted Capacity to UGVCL not later than the Scheduled Commissioning Date and continuance of the supply of power throughout the term of the Agreement at the agreed CUF;
- e) Connecting the Power Project switchyard with the Interconnection Facilities at the Delivery Point. The SPG shall make adequate arrangements to connect the Power Project switchyard with the Interconnection Facilities at Interconnection / Metering / Delivery Point. SPG will be responsible for laying of dedicated 11KV line from Solar Power Plant to sub-station, construction of bay and related switchgear & metering equipment at sub-station where the plant is connected to the grid and metering is done. SPG will be responsible to set up Remote Metering Systems as per Article 7.2 of this agreement;
- f) owning the Power Project throughout the Term of Agreement free and clear of encumbrances, except those expressly permitted under Article 15;
- g) fulfilling all obligations undertaken by the SPG under this Agreement.
- h) The SPG shall be responsible for directly coordinating and dealing with UGVCL, SLDC and GETCO and other authorities in all respects in regard to declaration of availability, scheduling and dispatch of Power and due compliance with deviation and settlement mechanism and the applicable Grid code/State Regulations.
- i) The SPG shall be required to follow the applicable rules regarding project registration with the State Nodal Agency GEDA in line with the provisions of the applicable policies/regulations of the State of Gujarat. It shall be the responsibility of the SPG to remain updated about the applicable charges payable to UGVCL, SLDC, GETCO, GEDA or any other authority under the respective rules, regulations, policies, framework.
- j) The technology adopted by SPG shall be in accordance with MNRE's Approved Models and Manufacturers of Solar PV Modules having PV Module from ALMM only.

However, as per recent amendment by MNRE vide Office Memorandum No. : 283/16/2023-GRID SOLAR, Dtd.10.03.2023 (Requirements for Compulsory Registration) Order, 2019 it is to consider that ALMM order is held in abeyance for one financial year, i.e. FY 2023-24. Thus Projects commissioned by 31.03.2024 will be exempted from the requirement of procuring Solar PV modules from ALMM.

However, Order/clarifications issued by MNRE in this regard from time to time will be applicable.

- k) All the mandatory standards issued by MNRE and / or BIS regarding project equipments and material shall be followed.
- l) The SPG shall be responsible for all payments on account of any taxes, cesses, duties or levies imposed by the GoG or its competent statutory

authority on the land, equipment, material or works of the Project or on the Electricity generated or consumed by the Project or by itself or on the income or assets owned by it. All expenses including wheeling / transmission charges and losses, UI / DSM Charges applicable as per GERC / CERC Regulations, upto Delivery Point shall be paid by the SPG without any reimbursement by UGVCL.

- m) To procure start up power required for the plant from UGVCL.
- n) The SPG shall ensure that he shall not sell power to any other buyer except the UGVCL during the tenure of this PPA. At any point of time during the tenure of PPA, if it is found that the SPG has sold the solar power produce from the contracted solar plant strict legal action will be taken against the SPG, including stop deal or black list from Participation in future tender of MNRE in Gujarat and the SPG shall require to refund the proportionate CFA granted for the project by MNRE to UGVCL.

For the recovery of the proportionate CFA, the CFA granted by MNRE for the project will be divided by 25 years to arrive at per year CFA. If any event of sell of power is found at a particular time, the amount to be recovered from the SPG shall be the remaining period of PPA after the event date multiply by per year CFA.

The recovery of the proportionate CFA will be made through the payments of invoices or through remedies taken in accordance with applicable laws. In case of any liquidation of assets of the solar power plants prior to completion of PPA period the first charge shall be towards recovery of the proportionate CFA granted to the project by MNRE.

4.2 Purchase and sale of Contracted Capacity

- 4.2.1 Subject to the terms and conditions of this Agreement, the SPG undertakes to sell to UGVCL and UGVCL undertakes to pay Tariff for all the energy supplied at the Delivery Point corresponding to the Contracted Capacity.

4.3 Right to Contracted Capacity & Energy

- 4.3.1 UGVCL, in any Contract Year shall not be obliged to purchase any additional energy from the SPG beyond the contract capacity. If for any Contract Year except for the first year of operation, it is found that the SPG has not been able to generate and supply minimum energy of _____ KWH (Units) (corresponding to 19% minimum CUF) for _____ Feeder/substation level Solar plant during the term of the agreement except force majeure conditions as defined in the Article -11 of the _____ PPA. **Then non-compliance by SPG shall make the SPG liable to pay the compensation.** UGVCL shall not be obliged to purchase energy in excess of maximum CUF of 30% during any contract year. If UGVCL decides to purchase the excess energy beyond CUF of 30%, the payments for such excess energy shall be made at 75% of the PPA tariff. For the first year of operation, the above limits shall

be considered on pro-rata basis. The lower limit will, however be relaxable by UGVCL to the extent of grid non-availability attributable of UGVCL / GETCO.

- 4.3.2 This compensation (as mentioned in above para 4.3.1) shall be applied to the amount of shortfall in generation during the Contract Year. The amount of such penalty would ensure that the UGVCL is offset for all potential costs associated with low generation and supply of power under the PPA. **The compensation payable to UGVCL by the SPG shall be at 25% (twenty-five percent) of PPA tariff on the shortfall in energy.** This compensation shall not be applicable in events of Force Majeure identified under PPA.

- 4.3.3 At any point of time block, the peak of capacity shall not reach higher than the contracted capacity at the point where power is injected in the grid. The SPG shall forego the excess generation and reduce the output to the contract capacity and shall be required to pay the penalty/charges, **25% of Tariff rate + applicable taxes** in case of failure to do so. The SPG shall install adequate protection equipment at the interconnection point to avoid excess energy feeding into the grid and failure to do so shall entitle DISCOM to not pay for the additional energy over and above the contracted capacity.

4.4 *Extension of Time*

- 4.4.1 In the event that the SPG is prevented from performing its obligations under Article 4.1 by the Scheduled Commissioning Date due to:

- (a) any UGVCL Event of Default; or
- (b) Force Majeure Events affecting UGVCL, or
- (c) Force Majeure Events affecting the SPG,

the Scheduled Commissioning Date and the Expiry Date shall be deferred, subject to Article 4.4.4, for a reasonable period but not less than 'day for day' basis, to permit the SPG or DISCOM through the use of due diligence, to overcome the effects of the Force Majeure Events affecting the SPG or UGVCL, or till such time such Event of Default is rectified by UGVCL if delay is attributable to UGVCL.

- 4.4.2 If the Parties have not agreed, within thirty (30) days after the affected Party's performance has ceased to exist by the relevant circumstance on the time period by which the Scheduled Commissioning Date or the Expiry Date should be deferred, any Party may raise the Dispute to be resolved in accordance with Article 16.

- 4.4.3 As a result of such extension, the newly determined Scheduled Commissioning Date and newly determined Expiry Date shall be deemed to be the Scheduled Commissioning Date and the Expiry Date for the purposes of this Agreement.

- 4.4.4 Notwithstanding anything to the contrary contained in this Agreement, any extension of the Scheduled Commissioning Date arising due to any reason envisaged in this Agreement shall not be allowed beyond the date pursuant to Article 4.5.2.

- 4.4.5 Delay in commissioning of the project beyond the scheduled commissioning date

or reasons other than those specified in Article 4.4.1 shall be an event of default on part of the SPG and shall be subject to the consequences specified in the Article 4.5.

4.5 Liquidated Damages not amounting to penalty for delay in Commissioning

4.5.1 If the SPG is unable to commission the Project by the Scheduled Commissioning Date other than for the reasons specified in Article 4.4.1, the SPG shall pay to UGVCL, damages for the delay in such commissioning and making the Contracted Capacity available for dispatch by the Scheduled Commissioning Date as per following:

4.5.2 In case any SPG fails to achieve this milestone, UGVCL shall encash the Performance Bank Guarantee (PBG) as liquidated damages (LD) in the following manner:

Delay up to two months: LD equal to the PBG on per day basis. The no. of days

In "month" for the LD calculations shall be considered as 30.

In case the commissioning of the solar power plant is delayed over two months: The complete PBG amount shall be encashed and DISCOM shall have right to terminate the PPA. The decision of MNRE regarding release of CFA shall be binding and to the account of SPG.

In case of delays of plant commissioning due to Force Majeure reasons, the Procurer / UGVCL after having been satisfied with documentary evidences produced by the SPG for the purpose, can extend the time for commissioning date without any financial implications on the SPG.

4.5.3 The SPG further acknowledge that the amount of the liquidated damages fixed is genuine and reasonable pre-estimate of the damages that may be suffered by UGVCL.

4.6 System Specifications and Quality Control

4.6.1 All components used for installation of solar power plants shall confirm to applicable BIS/MNRE specifications and follow quality control guidelines issued by MNRE. It will be mandatory to use domestically manufactured solar modules only.

4.6.2 Erection of 11 KV Line network shall be confirming to relevant standards.

4.7 Third Party Verification

4.7.1 The SPG shall be further required to provide entry to the site of the Power Project free of all encumbrances at all times during the Term of the Agreement to UGVCL and a third party nominated by UGVCL or any Indian Governmental Instrumentality for inspection and verification of the works being carried out by the SPG at the site of the Power Project.

4.7.2 The third party may verify the construction works/operation of the Power Project being carried out by the SPG and if it is found that the construction works/operation of the Power Project is not as per the Prudent Utility Practices, it may seek clarifications from SPG or require the works to be stopped or to comply with the instructions of such third party.

4.8 Breach of Obligations

- 4.8.1 The Parties herein agree that during the subsistence of this Agreement, subject to UGVCL being in compliance of its obligations & undertakings under this Agreement, the SPG would have no right to negotiate or enter into any dialogue with any third party for the sale of Contracted Capacity of power which is the subject matter of this Agreement. It is the specific understanding between the Parties that such bar will apply throughout the entire term of this Agreement.

4.9 Generation compensation for Off-take constraints

- 4.9.1 Generation Compensation in offtake constraints due to Grid Unavailability: During the operation of the plant, UGVCL shall endeavor to ensure 95% of grid availability in a contract year. However, there can be some periods where the Project can generate power but due to temporary transmission unavailability, the power is not evacuated, for reasons not attributable to the SPG. In such cases, subject to the submission of documentary evidences from the competent authority, the generation compensation shall be restricted to the following and there shall be no other claim, directly or indirectly against UGVCL:

Duration of Grid unavailability	Provision for Generation Compensation
Grid unavailability in excess of 5% in a contract year as defined in the PPA (only period from 8 am to 6 pm to be counted):	$\text{Generation Loss} = \left[\left(\text{Average Generation per hour during the Contract Year} \right) \times \left(\text{number of hours of grid unavailability during the Contract Year} \right) \right]$ Where, Average Generation per hour during the Contract Year (kWh) = $\frac{\text{Total generation in the Contract Year (kWh)}}{\text{Total hours of generation in the Contract Year}}$.

The excess generation beyond 19% CUF by the SPG equal to this generation loss shall be procured by UGVCL at the PPA tariff so as to offset this loss in the succeeding 3 (three) Contract Years and no further compensation shall be made by UGVCL to SPG.

- 4.9.2 Offtake constraints due to Backdown: The SPG shall follow the forecasting and scheduling process as per the regulations in this regard by the Appropriate Commission. In the eventuality of backdown, subject to the submission of documentary evidences from the competent authority, the SPG shall be eligible for a minimum generation compensation, from UGVCL, restricted to the following and there shall be no other claim, directly or indirectly against UGVCL.

Duration of Backdown	Provision for Generation Compensation

Hours of Backdown during a monthly billing cycle	Minimum Generation Compensation = 100% of [(Average Generation per hour during the month) X (number of backdown hours during the month)] X PPA tariff Where, Average Generation per hour during the month (kWh) = Total generation in the month (kWh) ÷ Total hours of generation in the month
--	---

The SPG shall not be eligible for any compensation in case the Backdown is on account of events like consideration of grid security or safety of any equipment or personnel or other such conditions. The Generation Compensation shall be paid as part of the energy bill for the successive month after JMR.

ARTICLE 5: SYNCHRONISATION, COMMISSIONING AND COMMERCIAL OPERATION

5.1 Synchronization, Commissioning and Commercial Operation

- 5.1.1 The SPG shall give UGVCL at least thirty (30) days' advanced preliminary written notice and at least fifteen (15) days' advanced final written notice, of the date on which it intends to synchronize the Solar Power Project to the Grid System.
- 5.1.2 Subject to Article 5.1.1, the Power Project may be synchronized by the SPG to the Grid System when it meets all the connection conditions prescribed in applicable Grid Code in effect and otherwise meets all other Indian legal requirements for synchronization to the Grid System.
- 5.1.3 The synchronization equipment and all necessary arrangements/equipment including RTU for scheduling of power generated from the Project and transmission of data to the concerned authority as per applicable regulation shall be installed by the SPG at its generation facility of the Power Project at its own cost. The SPG shall synchronize its system with the Grid System only after the approval of synchronization scheme is granted by the competent authority of the concerned substation/ and checking/verification is made by the concerned authorities of the UGVCL.
- 5.1.4 The SPG shall immediately after each synchronization/tripping of generator, inform the sub-station of the Grid System to which the Power Project is electrically connected in accordance with applicable Grid Code. In addition, the SPG will inject in-firm power to grid from time to time to carry out operational/ functional test prior to commercial operation. For avoidance of doubt, it is clarified that Synchronization /Connectivity of the Project with the grid shall not be considered as Commissioning of the Project.
- 5.1.5 The SPG shall commission the Project within nine (9) Months from the Date

of execution of this PPA. Declaration of COD shall be certified by the commissioning committee.

- 5.1.6 The Parties agree that for the purpose of commencement of the supply of electricity by SPG to UGVCL, liquidated damages for delay etc., the Scheduled Commissioning Date as defined in this Agreement shall be the relevant date.

ARTICLE 6: DISPATCH AND SCHEDULING

6.1 Dispatch and Scheduling

- 6.1.1 The SPG shall be required to schedule its power as per the applicable regulations of GERC / SLDC or any other competent agency and same being recognized by the SLDC or any other competent authority / agency as per applicable regulation / law / direction and maintain compliance to the applicable Codes / Grid Code requirements and directions, if any, as specified by concerned SLDC from time to time. Any deviation from the Schedule will attract the provisions of applicable regulation / guidelines / directions and any financial implication on account of this shall be on the account of the SPG.
- 6.1.2 The SPG shall be responsible for directly coordinating and dealing with the UGVCL, State Load Dispatch Centers, and other authorities in all respects in regard to declaration of availability, scheduling and dispatch of Power and due compliance with deviation and settlement mechanism and the applicable Grid Code Regulations.
- 6.1.3 The SPG shall be responsible for any deviation from scheduling and for any resultant liabilities on account of charges for deviation as per applicable regulations. UI/DSM charges on this account shall be directly paid by the SPG.
- 6.1.4 Auxiliary power consumption will be treated as per the orders of GERC or concerned GERC regulations. The charges for net import of energy by the solar power plant from the grid shall be billed at HTP-III tariff by UGVCL. The SPG shall not undertake any other commercial activity within the project premises except generation of Solar Power under this contract.

ARTICLE 7: METERING, GRID CONNECTIVITY AND REMOTE MONITORING SYSTEM

- 7.1.1. Metering and grid connectivity of the projects would be the responsibility of the SPG in accordance with the prevailing guidelines / practices of UGVCL and / or CEA. UGVCL may facilitate in the process; however, the entire responsibility & cost lies only with the SPG.
- 7.1.2. Meters and metering equipment (CT-PT sets) specifications shall be complied with CEA metering regulations and shall be tested as per provision of GERC order / directives and as per IS 14697 at CPRI or at any NABL accredited / distribution licensee lab before installation at site at the cost of SPG and should be properly sealed in the presence of designated authority from UGVCL at the time of installation.
- 7.1.3. The solar power generator shall install Metering infrastructure and Remote

Monitoring System (RMS) as per the philosophy explained in the **Annexure-1**

ARTICLE 8: INSURANCES**8.1 Insurance**

- 8.1.1 The SPG shall effect and maintain or cause to be effected and maintained, at its own cost and expense, throughout the Term of PPA, Insurances against theft, damage, fire and damage or loss due to natural calamities, Cyclones, earthquake, flood, riots, etc. consistent with **Prudent Utility Practice** and all such risks to keep the Project in good condition and shall take Industrial All Risk insurance policy covering risks against any loss or damage, with such deductibles and with such endorsements and co-insured(s), which the Prudent Utility Practices would ordinarily merit maintenance of and as required under the Financing Agreements, and under the applicable laws.

8.2 Application of Insurance Proceeds

- 8.2.1 In case of the Project not being implemented through Financing Agreement(s), save as expressly provided in this Agreement or the Insurances, the proceeds of any insurance claim made due to loss or damage to the Power Project or any part of the Power Project shall be first applied to reinstatement, replacement or renewal of such loss or damage.

In case of the Project being financed through Financing Agreement(s), save as expressly provided in this Agreement or the Insurances, the proceeds of any insurance claim made due to loss or damage to the Power Project or any part of the Power Project shall be applied as per such Financing Agreements.

- 8.2.2 If a Force Majeure Event under the insurance contract renders the Power Project no longer economically and technically viable and the insurers under the Insurances make payment on a "total loss" or equivalent basis, UGVCL shall have claim on such proceeds of such Insurance limited to outstanding dues of UGVCL against SPG.

8.3 Effect on liability of DISCOM

- 8.3.1 Notwithstanding any liability or obligation that may arise under this Agreement, any loss, damage, liability, payment, obligation or expense which is insured or not or for which the SPG can claim compensation, under any Insurance shall not be charged to or payable by UGVCL. It is for the SPG to ensure that appropriate insurance coverage is taken for payment by the insurer for the entire loss and there is no underinsurance or short adjustment etc.

ARTICLE 9: APPLICABLE TARIFF

- 9.1 The SPG shall be entitled to receive the Tariff of per kWh, fixed for the entire term of 25 years (unless extended by both the parties on mutual agreement), with effect from the COD, for the power sold to UGVCL as reflected in the State Energy Accounts published by SLDC Guajrat.

ARTICLE 10: BILLING AND PAYMENT

10.1.1 *Energy measurement for Monthly billing*

- a) The SPG shall raise the invoice after issuance of State Energy Account by SLDC each month and submit the relevant extracts thereof along with the monthly invoice.
- b) Subsequently, the SPG shall furnish the joint meter reading report (JMR)/Energy Account, duly verified by its authorized representative and concerned Executive Engineer, along with downloaded CMRI data (of all three meters) of 15 minutes time block to The Chief Engineer SLDC, Vadodara, as well as to The Chief Engineer (Proj) UGVCL, Rajkot through courier and/or e-mail along with the Monthly Bill (final energy net of import and export, multiplied by the Rs. per kWh tariff as per PPA and reactive power charges compensation) on the same day (i.e. 1st day of the month).
- c) Provided that:
 - i. if the date of commencement or supply of power falls during the period between the first (1st) day and up to and including the fifteenth (15th) day of a Month, the first Monthly Bill shall be issued for the period until the last day of such Month, or
 - ii. if the date of commencement of supply of power falls after the fifteenth (15th) day of a Month, the first Monthly Bill shall be issued for the period commencing from the Delivery Date until the last day of the immediately following Month.
- d) Provided further that if a Monthly Bill is received on or before the second (2nd) day of a Month, it shall be deemed to have been received on the second (2nd) Business Day of such Month.
- e) Provided further that if a Monthly Bill for the immediately preceding Month is issued after 1st day of the next Month, the Due Date for payment of such Monthly Bill shall be extended accordingly.
- f) The monthly bills shall be raised by SPG only after issuance of State Energy Account by SLDC.

10.1.2 *Inspection and Testing of Meters*

- a) UGVCL and SPG shall jointly inspect and if necessary, recalibrate the metering system on a regular basis but in any event, at least once every year or at a shorter interval at the request of any of the two parties.
- b) Each Meter comprising the metering system shall be sealed by UGVCL, and shall be opened, tested or calibrated in the presence of both the parties.

10.1.3 *Inaccuracy of Meters*

- a) In case the difference between the energy recorded in the main meter and the check meter for any calendar month is within 0.5%, the energy recorded in the main meter shall be taken as final.
- b) However, if the variation exceeds $\pm 0.5\%$, following steps shall be taken:

- i. Both interface meters (Main as well Check) and metering system shall be tested and checked.
- ii. Re-Calibration of both meters at site with reference standard meter of accuracy class higher than the meter under test, if no issues found in step (a) above.
- iii. On carrying out the re-calibration of the main meter, if it is discovered that either the percentage of inaccuracy exceeds $\pm 0.5\%$ or that the main meter is not working, the following procedure in order of priority, which ever is feasible, for arriving at the computation of quantity of energy during the period between the last calibration and the present, shall be followed:
 - On the basis of energy recorded in the check meter if installed and functioned accurately; or
 - By correcting the error, if the percentage of error is ascertainable from calibration, tests or mathematical calculation
- iv. The correction to the quantity of energy injected shall apply to the following periods (hereinafter referred to as the "Correction Period"):
 - To any period of time during which the main meter was known to be malfunctioning or to which the parties mutually agree;
 - If the period during which the main meter was malfunctioning is not known or is not agreed to between the parties, the correction shall be applicable for a period equal to half the time elapsed since the date of the preceding calibration test, provided that under no circumstances shall the Correction Period exceed one month.
- v. If the difference exists even after such checking or testing, then the defective meter(s) shall be replaced with a tested meter.
- vi. In case of conspicuous failures like burning of meter and erratic display of metered parameters and when the error found in testing of meter is beyond the permissible limit of error provided in the relevant standard, the meters shall be immediately replaced with a tested meter.
- vii. In case where both the Main meter and Check meter fail, energy recorded in the Standby meter shall be considered as final and at least one of the meters shall be immediately replaced by a tested meter by the SPG and bear all the cost of meters and meter replacement.

10.1.4 General

- a) From the Commercial Operations Date of the solar power plant, UGVCL shall pay to the Successful SPG the monthly Tariff Payments subject to the adjustments as per provisions of the PPA and submission of following documents:
 - i. Monthly bill (Injection/Schedule at delivery point as certified by SLDC multiplied by the Rs. per kWh tariff as per PPA)
 - ii. Relevant Extracts of State Energy Account.

- b) All Tariff Payments by UGVCL shall be in Indian Rupees.
- c) The SPG shall be required to make arrangements and payments for import of energy (if any) as per applicable regulations.

Reactive power charges or any other charges as per GERC order / regulations shall be payable by SPG as per provisions of PPA.

10.1.5 Delivery and Content of Monthly Bills/Supplementary Bills

- a) The SPG shall issue to UGVCL hard copy of a signed Monthly Bill for the immediately preceding Month based on the State Energy Account along with all relevant documents (payments made by SPG for drawl of power, payment of reactive energy charges, Metering charges or any other charges as per regulations of CERC/GERC shall not be a part of bill raised by SPG to UGVCL)
- b) Each Monthly Bill shall include all charges as per the Agreement for the energy supplied for the relevant Month based on State Energy Account. The Monthly Bill amount shall be the product of the energy as per Energy Accounts and the applicable levelized tariff. Net energy import from the grid shall be billed at HTP-III tariff.

10.1.6 Payment of Monthly Bills

- a) On receipt of JMR/Energy Account along with CMRI data (of both meters) and bill, Superintending Engineer (Regulation) UGVCL shall verify the readings and subsequent share the same along with original bill and other relevant document to UGVCL.

UGVCL shall make payment of the amounts due in Indian Rupees within thirty (30) days from the date of receipt of the Tariff Invoice by the Chief Engineer (Project) UGVCL.

- b) As defined under the PPA, "Due Date of Payment" in respect of a Tariff Invoice means the date, which is 30 (thirty) days from the date of receipt of such invoices by the designated official of the UGVCL. The Tariff Invoice shall include relevant documents.

All payments required to be made under this Agreement shall also include any deduction or set off for:

- i. deductions required by the Law; and
 - ii. Amount claimed by UGVCL, if any, from the SPG, will be adjusted from the monthly energy payment.
 - iii. Charges for net import of energy by the solar plant from the grid shall be as per HTP-III Tariff as per GERC
- a) The SPG shall open a bank account (if not having any bank account) for all Tariff Payments to be made by UGVCL to the SPG and notify UGVCL of the details of such account at least sixty (60) Days before the dispatch of the first Monthly Bill.

10.1.7 Late Payment Surcharge

- (1) For payment of Monthly bill by UGVCL, if paid after Due Date of Payment, a late Payment charge shall be payable by UGVCL to the SPG on the payment outstanding after the due date at the base rate of Late Payment Surcharge applicable for the

period for the first month of default.

(2) The rate of Late Payment Surcharge for the successive months of default shall increase by 0.5 percent for every month of delay provided that the Late Payment Surcharge shall not be more than 3 percent higher than the base rate at any time.

(3) Provided that the rate at which Late Payment Surcharge shall be payable shall not exceed the rate of seven (7) percent in excess of the SBI 1 year Marginal Cost of Funds Based Lending Rate (MCLR) per annum / any replacement thereof by SBI, on the amount of outstanding payment, calculated on a week or part thereof basis viz.

(SBI MCLR rate + 7%)

= _____ per week or part thereof.

52

(4) Provided further that all Payments shall be first adjusted towards Late Payment Surcharge and thereafter, towards monthly charges, starting from the longest overdue bill.

(5) The Late Payment Surcharge shall be claimed by SPG through the supplementary bill.

(6) The Late Payment Surcharge shall be governed as per the provisions of Electricity (Late Payment Surcharge) Rules, 2021 issued by Ministry of Power, Government of India vide notification dated 22.02.2021 and subsequent amendments or replacements thereof issued from time to time.

10.1.8 Rebate

a) For payment of any Bill on or before Due Date, the following Rebate shall be paid by the SPG to UGVCL in the following manner and the SPG shall not raise any objection to the payments made under this article.

i. For payment of Monthly Bill by UGVCL, if paid before Due Date of Payment, a Rebate shall be deducted by UGVCL at the rate of seven (7) percent in excess of the applicable SBI 1 year Marginal Cost of Funds Based Lending Rate (MCLR) per annum / any replacement thereof by SBI, on the amount paid before due date, calculated on a week or part thereof basis viz.

(SBI MCLR rate + 7%)

= _____ per week or part thereof.

52

10.1.9 Payment of Supplementary Bills

a) Either _____ party may raise a ("Supplementary Bill") for payment on account of adjustments required by the Energy Accounts (if any) and such Supplementary Bill shall be paid by the other Party.

b) The Parties shall remit all amounts due under a Supplementary Bill to the Designated Account by the Due Date.

c) The Rebate and Late Payment Surcharge shall be applicable at the same

terms applicable to the Monthly Bill.

10.1.10 Payment Security Mechanism

Letter of Credit (LC):

- a) UGVCL shall provide to the SPG, in respect of payment of its Monthly Bills and/or Supplementary Bills, a monthly unconditional, revolving and irrevocable letter of credit ("Letter of Credit"), opened and maintained which may be drawn upon by the SPG in accordance with the PPA.
- b) Not later than one (1) Month before the start of supply, UGVCL through a scheduled bank open a Letter of Credit in favour of the SPG, to be made operative from a date prior to the Due Date of its first Monthly Bill under this Agreement. The Letter of Credit shall have a term of twelve (12) Months and shall be renewed annually, for an amount equal to:
 - i. for the first Contract Year, equal to the estimated average monthly billing;
 - ii. for each subsequent Contract Year, equal to the average of the monthly billing of the previous Contract Year.
- c) Provided that the SPG shall not draw upon such Letter of Credit prior to the Due Date of the relevant Monthly Bill and/or Supplementary Bill, and shall not make more than one drawal in a Month.
- d) Provided further that if at any time, such Letter of Credit amount falls short of the amount specified above due to any reason whatsoever, UGVCL shall restore such shortfall within fifteen (15) days.
- e) UGVCL shall cause the scheduled bank issuing the Letter of Credit to intimate the SPG, in writing regarding establishing of such irrevocable Letter of Credit.
- f) UGVCL shall ensure that the Letter of Credit shall be renewed not later than its expiry.
- g) All costs relating to opening, maintenance of the Letter of Credit shall be borne by the SPG.
- h) If UGVCL fails to pay undisputed Monthly Bill or Supplementary Bill or a part thereof within and including the Due Date, then, subject to above, the SPG may draw upon the Letter of Credit, and accordingly the bank shall pay without any reference or instructions from UGVCL, an amount equal to such Monthly Bill or Supplementary Bill or part thereof, in accordance with above, by presenting to the scheduled bank issuing the Letter of Credit, the following documents:
 - i. a copy of the Monthly Bill or Supplementary Bill which has remained unpaid to SPG and;
 - ii. a certificate from the SPG to the effect that the bill at item (a) above, or specified part thereof, is in accordance with the Agreement, is not disputed and has remained unpaid beyond the Due Date;

10.1.11 Disputed Bill

- a) If UGVCL does not dispute a Monthly Bill or a Supplementary Bill raised by the SPG withi

thirty (30) days of receiving such Bill shall be taken as conclusive.

- b) If UGVCL disputes the amount payable under a Monthly Bill or a Supplementary Bill, as the case may be, it shall pay undisputed amount of the invoice amount and it shall within fifteen (15) days of receiving such Bill, issue a notice (the "Bill Dispute Notice") to the invoicing Party setting out:
 - i. the details of the disputed amount;
 - ii. its estimate of what the correct amount should be; and
 - iii. all written material in support of its claim.
- c) If the SPG agrees to the claim raised in the Bill Dispute Notice, the SPG shall revise such Bill and present along with the next Monthly Bill. In such a case excess amount shall be refunded along with interest at the same rate as Late Payment Surcharge, which shall be applied from the date on which such excess payment was made by the disputing Party to the invoicing Party and up to and including the date on which such payment has been received as refund.
- d) If the SPG does not agree to the claim raised in the Bill Dispute Notice, it shall, within fifteen (15) days of receiving the Bill Dispute Notice, furnish a notice (Bill Disagreement Notice) to UGVCL (i.e. office of Superintending Engineer (Regulation)), UGVCL) providing:
 - i. reasons for its disagreement;
 - ii. its estimate of what the correct amount should be; and
 - iii. all written material in support of its counterclaim.
- e) Upon receipt of the Bill Disagreement Notice by Superintending Engineer (Regulation), UGVCL, authorized representative(s) or a director of the board of directors/ member of board of the UGVCL and SPG shall meet and make best endeavours to amicably resolve such dispute within fifteen (15) days of receipt of the Bill Disagreement Notice.
- f) If the Parties do not amicably resolve the Dispute within fifteen (15) days of receipt of Bill Disagreement Notice, the matters shall be referred to Dispute Resolution in accordance with Article 16 of PPA.
- g) For the avoidance of doubt, it is clarified that despite a Dispute regarding an invoice, UGVCL shall, without prejudice to its right to Dispute, be under an obligation to make payment of undisputed amount of the invoice amount in the Monthly Bill.

ARTICLE 11: FORCE MAJEURE

11.1 Definitions

11.1.1 In this Article, the following terms shall have the following meanings:

11.2 Affected Party

11.2.1 An Affected Party means DISCOM or the SPG whose performance has been affected by an event of Force Majeure.

11.3 Force Majeure Events

- a) Neither Party shall be responsible or liable for or deemed in breach hereof because of any delay or failure in the performance of its obligations hereunder (except for obligations to pay money due prior to occurrence of Force Majeure events under this Agreement) or failure to meet milestone dates due to any event or circumstance (a "Force Majeure Event") beyond the reasonable control of the Party experiencing such delay or failure, including the occurrence of any of the following:
 - i) acts of God;
 - ii) typhoons, floods, lightning, cyclone, hurricane, drought, famine, epidemic, plague or other natural calamities;
 - iii) acts of war (whether declared or undeclared), invasion or civil unrest;
 - iv) any requirement, action or omission to act pursuant to any judgment or order of any court or judicial authority in India (provided such requirement, action or omission to act is not due to the breach by the SPG or UGVCL of any Law or any of their respective obligations under this Agreement);
 - v) inability despite complying with all legal requirements to obtain, renew or maintain required licenses or Legal Approvals;
 - vi) earthquakes, explosions, accidents, landslides; fire;
 - vii) expropriation and/or compulsory acquisition of the Project in whole or in part by Government Instrumentality;
 - viii) chemical or radioactive contamination or ionizing radiation; or
 - ix) damage to or breakdown of transmission facilities of GETCO/ DISCOMs;
 - x) Exceptionally adverse weather condition which are in excess of the statistical measure of the last hundred (100) years.

11.4 Force Majeure Exclusions

- a) Force Majeure shall not include the following conditions, except to the extent that they are consequences of an event of Force Majeure:
 1. Unavailability, Late Delivery or Change in cost of plants and machineries, equipment, materials, spares parts or consumables for the project;
 2. Delay in performance of any contractor / sub contractor or their agents;
 3. Non performance resulting from normal wear and tear experience in power generation materials and equipment;
 4. Strike or Labour Disturbances at the facilities of affected parties;
 5. Insufficiency of finances or funds or the agreement becoming onerous to perform, and
 6. Non performance caused by, or concerned with, the affected party's
 - I. Negligent and intentional acts, errors or omissions;
 - II. Failure to comply with Indian law or Indian Directive; or

- III. Breach of, or default under this agreement or any Project agreement or Government agreement.
- b) The affected Party shall give notice to other party of any event of Force Majeure as soon as reasonably practicable, but not later than 7 days after the date on which such Party knew or should reasonably have known of the commencement of the event of Force Majeure. If any event of Force Majeure results in a breakdown of communication rendering it not reasonable to give notice within the applicable time limit specified herein, then the party claiming Force Majeure shall give notice as soon as reasonably practicable after reinstatement of communication, but not later than one day after such reinstatement. Such notice shall include full particulars of the event of Force Majeure, its effects on the Party claiming relief and the remedial measures proposed, and the Affected Party shall give the other Party regular (and not less than monthly) reports on the progress of those remedial measures and such other information as the other party may reasonably request about the situation.
 - c) The affected Party shall give notice to the other Party of (1) cessation of relevant event of Force Majeure; and (2) cessation of the effects of such event of Force Majeure on the performance of its rights or obligations under this agreement, as soon as practicable after becoming aware of each of these cessations.
 - d) To the extent not prevented by a Force Majeure event, the affected party shall continue to perform its obligations pursuant to this agreement. The affected party shall use its reasonable efforts to mitigate the effect of any event of Force Majeure as soon as practicable.

11.5 Available Relief for a Force Majeure Event

No Party shall be in breach of its obligations pursuant to this agreement to the extent that the performance of its obligations was prevented, hindered or delayed due to a Force Majeure event. However, adjustment in tariff shall not be allowed on account of Force Majeure event.

For avoidance of doubt, neither Party's obligation to make payments of money due and payable prior to occurrence of Force Majeure events under this Agreement shall be suspended or excused due to the occurrence of a Force Majeure Event in respect of such Party.

ARTICLE 12: CHANGE IN LAW

12.1 Definitions

"Change in Law" shall refer to the occurrence of any of the following events notified after the Bid Deadline.

- a) the enactment, bringing into effect, adoption, promulgation, amendment, modification or repeal, of any statute, decree, ordinance or other law, regulations, notice, circular, code, rule or direction by Governmental Instrumentality or a change in its interpretation by a Competent Court of law, tribunal, government or statutory authority or any of the above regulations, taxes, duties charges, levies etc. that results in any change with respect to any tax or surcharge or cess levied or similar charges by the Competent Government

on the generation of electricity (leviable on the final output in the form of energy) or sale of electricity.

- b) Modification / changes in rates of Goods & Service Tax (GST) between bid deadline date and Schedule Commercial Operation Date which have direct effect on the cost of solar PV modules.

12.2 Relief for Change in Law

- a) In case Change in Law on account of 9.1.1 (a) above results in the SPG's costs directly attributable to the Project being decreased or increased by one percent (1%), of the estimated revenue from the Electricity for the Contract Year for which such adjustment becomes applicable or more, during Operation Period, the Tariff Payment to the SPG shall be appropriately increased or decreased with due approval of GERC.
- b) In case of Change in Law on account of 9.1.1 (b) above, the SPG shall be allowed an increase / decrease in tariff of 1 paise / unit for every increase / decrease of Rs. 2 Lakh per MW in the Project Cost incurred upto the Scheduled Commercial Operation Date upon submission of proof of payment made by the SPG towards GST to the concerned Authority and with due approval of GERC. This increase / decrease in tariff due to this change in cost of solar PV modules shall be limited to actual DC capacity or 150% (One hundred & fifty percent) of contracted AC capacity, whichever is lower.
- c) UGVCL or SPG, as the case may be, shall provide the other Party with a certificate stating that the adjustment in the Tariff Payment is directly as a result of the Change in Law and shall provide supporting documents to substantiate the same and such certificate shall correctly reflect the increase or decrease in costs.
- d) The revised tariff shall be effective from the date of such Change in Law as approved by GERC.

ARTICLE 13: EVENTS OF DEFAULT AND TERMINATION

13.1 SPG Event of Default

13.1.1 The occurrence and/or continuation of any of the following events, unless any such event occurs as a result of a Force Majeure Event or a breach by DISCOM of its obligations under this Agreement, shall constitute an SPG Event of Default:

- (i) the failure to commence supply of power to DISCOM up to the Contract Capacity, by the end of the period specified in Article 4, or failure to continue supply of Contract Capacity to DISCOM after Commercial Operation Date throughout the term of this Agreement, or

if

- the SPG assigns, mortgages or charges or purports to assign, mortgage or charge any of its assets or rights related to the Power Project in contravention of the provisions of this Agreement; or
- the SPG transfers or novates any of its rights and/ or obligations under this agreement, in a manner contrary to the provisions of this Agreement; except where such transfer

- is in pursuance of a Law; and does not affect the ability of the transferee to perform, and such transferee has the financial capability to perform, its obligations under this Agreement or
- is to a transferee who assumes such obligations under this Agreement and the Agreement remains effective with respect to the transferee;

if

- a. the SPG becomes voluntarily or involuntarily the subject of any bankruptcy or insolvency or winding up proceedings and such proceedings remain uncontested for a period of thirty (30) days, or
- b. any winding up or bankruptcy or insolvency order is passed against the SPG, or
- c. the SPG goes into liquidation or dissolution or has a receiver or any similar officer appointed over all or substantially all of its assets or official liquidator is appointed to manage its affairs, pursuant to Law, provided that a dissolution or liquidation of the SPG will not be a SPG Event of Default if such dissolution or liquidation is for the purpose of a merger, consolidation or reorganization and where the resulting company retains creditworthiness similar to the SPG and expressly assumes all obligations of the SPG under this Agreement and is in a position to perform them; or
 - (i) the SPG repudiates this Agreement and does not rectify such breach within a period of thirty (30) days from a notice from DISCOM in this regard; or
 - (ii) except where due to any DISCOM's failure to comply with its material obligations, the SPG is in breach of any of its material obligations pursuant to this Agreement, and such material breach is not rectified by the SPG within thirty (30) days of receipt of first notice in this regard given by DISCOM.
 - (iii) Occurrence of any other event which is specified in this agreement to be a material breach/default of the SPG
 - (iv) except where due to any DISCOM's failure to comply with its material obligations, the SPG is in breach of any of its material obligations pursuant to this Agreement, and such material breach is not rectified by the SPG within thirty (30) days of receipt of first notice in this regard given by DISCOM.
 - (v) Failure on the part of the SPG for a continuous period of ninety (90) days to (i) operate and/or (ii) maintain (in accordance with Prudent Utility Practices), the Project at all times.
 - (vi) Failure on part of the SPG to maintain the minimum shareholding of 51% for a period of one year after Commercial Operation Date of the Project.
 - (vii) Failure to supply power in terms of the PPA
 - (viii) Failure to make any payment required to be made to DISCOM under this agreement within three (3) months after the due date of a valid invoice raised by the DISCOM on the SPG.
 - (ix) SPG fails to make compensation payment to UGVCL towards shortfall in supply for not achieving 19% guaranteed CUF during contract years.

13.2 DISCOM Event of Default

13.2.1 The occurrence and the continuation of any of the following events, unless any

such event occurs as a result of a Force Majeure Event or a breach by the SPG of its obligations under this Agreement, shall constitute the Event of Default on the part of the defaulting DISCOM:

- (i) DISCOM fails to pay (with respect to a Monthly Bill or a Supplementary Bill), subject to Article 11, for a period of ninety (90) days after the Due Date and the SPG is unable to recover the amount outstanding to the SPG through the Letter of Credit,
- (ii) DISCOM repudiates this Agreement and does not rectify such breach even within a period of sixty (60) days from a notice from the SPG in this regard; or
- (iii) If DISCOM becomes voluntarily or involuntarily the subject of proceeding under any bankruptcy or insolvency laws or goes into liquidation or dissolution or has a receiver appointed over it or liquidator is appointed, pursuant to Law, except where such dissolution of DISCOM is for the purpose of a merger, consolidation or reorganization and where the resulting entity has the financial standing to perform its obligations under this Agreement and creditworthiness similar to DISCOM and expressly assumes all obligations under this agreement and is in a position to perform them.

13.3 Procedure for cases of SPG Event of Default

13.3.1 Upon the occurrence and continuation of any SPG Event of Default under Article 13.1, DISCOM shall have the right to deliver to the SPG, with a copy to the representative of the lenders to the SPG with whom the SPG has executed the Financing Agreements, a notice stating its intention to terminate this Agreement (DISCOM Preliminary Default Notice), which shall specify in reasonable detail, the circumstances giving rise to the issue of such notice and calling upon the SPG to remedy the same. Where a "Default Notice" has been issued with respect to an Event of Default, which requires the co-operation of both DISCOM and the SPG to remedy, DISCOM shall render all reasonable co-operation to enable the Event of Default to be remedied without any legal obligations. Upon being in default on account of failure to commission the project within Scheduled Commercial Operation Date, the SPG shall be liable to pay liquidated damages as per Article 4.5 whereas for failure to supply power in terms of Article 4.3, the SPG shall be liable to make payment of compensation as per the said clause. For other cases, the damages shall be as under.

- a. At the expiry of 90 (ninety) days from the delivery of the default notice and unless the Parties have agreed otherwise, or the Event of Default giving rise to the default notice has been remedied, the SPG shall have liability to make payment toward compensation to DISCOM equivalent to three (3) years billing at 19% CUF for its contracted capacity. Also, DISCOM shall have the right to recover the said damages by way of forfeiture of bank guarantee, if any, without prejudice to resorting to any other legal course or remedy.
- b. In addition to the levy of damages as aforesaid, in the event of a default by the SPG, the lenders shall be entitled to exercise their rights to seek substitution of the SPG by a selectee, in accordance with the substitution agreement and in concurrence with DISCOM. However, in the event the lenders are unable to substitute the defaulting SPG within the stipulated period, DISCOM may terminate the PPA and acquire the Project assets for an amount equivalent to 90% of the debt due by issuing a "Termination Notice" /

“Takeover Notice”, failing which, the lenders may exercise their mortgage rights and liquidate the Project assets.

- c. Provided that any substitution under this Agreement can only be made with the condition that the selectee meets the eligibility requirements of Request for Selection (RfS) issued by DISCOM.
- d. The lenders in concurrence with DISCOM, may seek to exercise the right of substitution under by an amendment or novation of the PPA in favour of the selectee. The SPG shall cooperate with DISCOM to carry out such substitution and shall have the duty and obligation to continue to operate the Power Project in accordance with this PPA till such time as the substitution is finalized. In the event of Change in Shareholding/Substitution of Promoters triggered by the Financial Institutions leading to signing of fresh PPA with a New Entity, an amount of Rs. 10 Lakh per Project per Transaction as Facilitation Fee (non-refundable) shall be deposited by the developer-SPG to DISCOM.

13.3.2 During the Consultation Period, the Parties shall continue to perform their respective obligations under this Agreement.

13.4 Procedure for cases of DISCOM Event of Default

- 13.4.1 Upon the occurrence and continuation of any DISCOM Event of Default specified in Article 13.2, the SPG shall have the right to deliver to DISCOM, a SPG Preliminary Default Notice, which notice shall specify in reasonable detail the circumstances giving rise to its issue and calling upon DISCOM to remedy the same.
- 13.4.2 DISCOM with the prior consent of the SPG may novate its part of the PPA to any third party, including its Affiliates within the period of 7 days following the expiry of notice period. In the event the aforesaid novation is not acceptable to the SPG, or if no offer of novation is made by the defaulting Procurer/ DISCOM within the stipulated period of 7 days, then the SPG may terminate the PPA and at its discretion require the defaulting Procurer/ DISCOM to either (i) takeover the Project assets by making a payment of the termination compensation equivalent to the amount of the debt due and 110% (one hundred and ten per cent) of the adjusted equity as detailed below, less insurance cover, if any by issuing a “Termination Notice” / “Takeover Notice”, or, (ii) pay to the SPG, damages, equivalent to 6 (six) months billing at contracted CUF, or balance PPA period whichever is less, of charges for its contracted capacity, with the Project assets being retained by the SPG.
- 13.4.3 In the event of such termination of PPA, any damages or charges payable to GETCO/ DISCOM, for the connectivity of the plant, shall be borne by DISCOM.
- 13.4.4 “Adjusted Equity” means the Equity funded in Indian Rupees and adjusted on the first day of the current month (the “Reference Date”), in the manner set forth below, to reflect the change in its value on account of depreciation and variations in Wholesale Price Index (WPI), and for any Reference Date occurring between the first day of the month of Appointed Date (the date of achievement of Financial Closure) and the Reference Date;
 - i. On or before Commercial Operation Date (COD), the Adjusted Equity shall be a sum equal to the Equity funded in Indian Rupees and expended on the Project, revised to the extent of one half of the variation in WPI occurring between the

first day of the month of Appointed Date and Reference Date;

ii. An amount equal to the Adjusted Equity as on COD shall be deemed to be the base (the "Base Adjusted Equity");

iii. After COD, the Adjusted Equity hereunder shall be a sum equal to the Base Adjusted Equity, reduced by 0.333% (zero point three three three percent) thereof at the commencement of each month following the COD [reduction of 1% (one percent) per quarter of an year] and the amount so arrived at shall be revised to the extent of variation in WPI occurring between the COD and the Reference Date;

For the avoidance of doubt, the Adjusted Equity shall, in the event of termination, be computed as on the Reference Date immediately preceding the Transfer Date; provided that no reduction in the Adjusted Equity shall be made for a period equal to the duration, if any, for which the PPA period is extended, but the revision on account of WPI shall continue to be made.

13.4.5 "Debt Due" means the aggregate of the following sums expressed in Indian Rupees outstanding on the Transfer Date:

i. The principal amount of the debt provided by the Senior Lenders under the Financing Agreements for financing the Total Project Cost (the 'Principal') but excluding any part of the principal that had fallen due for repayment 2 (two) years prior to the Transfer Date;

ii. All accrued interest, financing fees and charges payable under the Financing Agreements on, or in respect of, the debt referred to in sub-clause (i) above until the Transfer Date but excluding: (i) any interest, fees or charges that had fallen due one year prior to the Transfer Date, (ii) any penal interest or charges payable under the Financing Agreements to any Senior Lender, (iii) any pre-payment charges in relation to accelerated repayment of debt except where such charges have arisen due to Utility Default, and (iv) any Subordinated Debt which is included in the Financial Package and disbursed by lenders for financing the Total Project Cost. Provided that if all or any part of the Debt Due is convertible into Equity at the option of Senior Lenders and/or the Concessionaire, it shall for the purposes of this Agreement be deemed not to be Debt Due even if no such conversion has taken place and the principal thereof shall be dealt with as if such conversion had been undertaken. Provided further that the Debt Due, on or after COD, shall in no case exceed 80% (eighty percent) of the Total Project Cost."

13.4.6 During the Consultation Period, the Parties shall continue to perform their respective obligations under this Agreement.

13.4.7 After a period of two hundred ten (210) days following the expiry of the Consultation Period and unless the Parties shall have otherwise agreed to the contrary or DISCOM Event of Default giving rise to the Consultation Period shall have ceased to exist or shall have been remedied, DISCOM under intimation to SPG shall, subject to the prior consent of the SPG, novate its part of the PPA to any third party, including its Affiliates within the stipulated period. In the event the aforesaid novation is not acceptable to the SPG, or if no offer of novation is made by DISCOM within the stipulated period, then the SPG may terminate the PPA and at its discretion require DISCOM to either (i) takeover the Project assets by making

apaymentof the termination compensation equivalent to theamount ofthedebt due and 110% (one hundred and fifty per cent) of the adjusted equity or, (ii) pay tothe SPG, damages, equivalent to 6 (six) months, or balance PPA period whichever isless, of charges for its contracted capacity, with the Project assets being retained bytheSPG.

Providedfurtherthataattheendofthree(3)monthsperiodfromtheperiodmentionedint hisArticle13.4.4,thisAgreementmaybeterminatedbytheSPG.

ARTICLE14:LIABILITYANDINDEMNIFICATION

14.1 Indemnity

14.1.1 **TheSPG's indemnity** -The SPG agrees to defend, indemnify and hold harmless DISCOM, its officers, directors, agents, employees and affiliates (and their respective officers, directors, agents and employees) from and against any and all claims, liabilities, actions, demands, judgments, losses, costs, expenses, suits, actions and damages arising by reason of bodily injury, death or damage to property sustained by third parties that are caused by an act of negligence or the willful misconduct of the SPG, or by an officer, director, sub-contractor, agent or employee of the SPG except to the extent of such injury, death or damage as is attributable to the willful misconduct or negligence of, or breach of this Agreement by, DISCOM, or by an officer, director, sub-contractor, agent or employee of the DISCOM.

14.1.2 **DISCOM's Indemnity** - DISCOM agrees to defend, indemnify and hold harmless the SPG, its officers, directors, agents, employees and affiliates (and their respective officers, directors, agents and employees) from and against any and all claims, liabilities, actions, demands, judgments, losses, costs, expenses, suits, actions and damages arising by reason of bodily injury, death or damage to property sustained by third parties that are caused by an act of negligence or the willful misconduct of DISCOM, or by an officer, director, sub-contractor, agent or employee of DISCOM except to the extent of such injury, death or damage as is attributable to the willful misconduct or negligence of, or breach of this Agreement by, the SPG, or by an officer, director, sub-contractor, agent or employee of the SPG.

ARTICLE15:ASSIGNMENTSANDCHARGES

15.1 Assignments

- 15.1.3 Neither Party shall assign this Agreement nor shall any portion hereof without the prior written consent of the other Party, provided further that any assignee expressly assume the assignor's obligations thereafter arising under this Agreement pursuant to documentation satisfactory to such other Party. However, such assignment shall be permissible only for entire contracted capacity.
- 15.1.3 Provided however, no approval is required from DISCOM for the assignment by the SPG of its rights herein to the Financing Parties and their successors and assigns in connection with any financing or refinancing related to the construction, operation and maintenance of the Project.
- 15.1.3 In furtherance of the foregoing, DISCOM acknowledges that the Financing Documents may provide that upon an event of default by the SPG under the Financing Documents, the

Financing Parties may cause the SPG to assign to a third party the interests, rights and obligations of the SPG thereafter arising under this Agreement. DISCOM further acknowledges that the Financing Parties, may, in addition to the exercise of their rights as set forth in this Section, cause the SPG to sell or lease the Project and cause any new lessee or purchaser of the Project to assume all of the interests, rights and obligations of the SPG thereafter arising under this Agreement.

15.2 Permitted Charges

15.2.1 SPG shall not create or permit to subsist any encumbrance over all or any of its rights and benefits under this Agreement, other than as set forth in Article 15.1

ARTICLE 16: GOVERNING LAW AND DISPUTE RESOLUTION

16.1 Governing Law

16.1.1 This Agreement shall be governed by and construed in accordance with the Electricity Act 2003 and other applicable Laws of India. Any legal proceedings in respect of any matters, claims or disputes under this Agreement shall be under the jurisdiction of Gujarat Electricity Regulatory Commission.

16.2 Dispute Resolution

16.2.1 All disputes or differences between the Parties arising out of or in connection with this Agreement shall be first tried to be settled through mutual negotiation.

16.2.2 The Parties hereto agree to attempt to resolve all disputes arising hereunder promptly, equitably and in good faith.

16.2.3 Each Party shall designate in writing and communicate to the other Party its own representative who shall be authorized to resolve any dispute arising under this Agreement in an equitable manner and, unless otherwise expressly provided herein, to exercise the authority of the Parties hereto to make decisions by mutual agreement.

16.2.4 In the event that such differences or disputes between the Parties are not settled through mutual negotiations within sixty (60) days, after such dispute arises, then it shall be adjudicated by GERC in accordance with the law.

ARTICLE 17: MISCELLANEOUS PROVISIONS

17.1 Amendment

17.1.1 This Agreement shall not be amended, changed, altered, or modified except by a written instrument duly executed by an authorized representative of both Parties. However, DISCOM may consider any amendment or change that the Lenders may require to be made to this Agreement.

17.2 Waiver

17.2.1 Any failure on the part of a Party to exercise, and any delay in exercising, exceeding three years, any right hereunder shall operate as a waiver thereof. No waiver by a Party of any right hereunder with respect to any matter or default arising in connection with this Agreement shall be considered a waiver with respect to any subsequent matter or default.

17.3 Severability

- 17.3.1 The invalidity or unenforceability, for any reason, of any part of this Agreement shall not prejudice or affect the validity or enforceability of the remainder of this Agreement, unless the part held invalid or unenforceable is fundamental to this Agreement.

17.4 Notices

- 17.4.1 Any notice, communication, demand, or request required or authorized by this Agreement shall be in writing and shall be deemed properly given upon date of receipt if delivered by hand or sent by courier, if mailed by registered or certified mail at the time of posting, if sent by fax when dispatched (provided if the sender's transmission report shows the entire fax to have been received by the recipient and only if the transmission was received in legible form), to:

In case of SPG

Name & Designation	
Address	
Email	
Mobile/Whatsapp No.	
Telephone	

In case of DISCOM

Name & Designation	
Address	
Email	
Telephone	

17.5 Language

- 17.5.1 All agreements, correspondence and communications between the Parties relating to this Agreement and all other documentation to be prepared and supplied under the Agreement shall be written in English, and the Agreement shall be construed and interpreted in accordance with English language.
- 17.5.2 If any of the agreements, correspondence, communications or documents are prepared in any language other than English, the English translation of such agreements, correspondence, communications or documents shall prevail in matters of interpretation.

17.6 Restriction of Shareholders'/Owners' Liability

- 17.6.1 Parties expressly agree and acknowledge that none of the shareholders of the Parties hereto shall be liable to the other Parties for any of the contractual obligations of the concerned Party under this Agreement. Further, the financial liabilities of the shareholder/s of each Party to this Agreement, shall be restricted to the extent provided in the Indian Companies Act, 2013.

17.7 Taxes and Duties

- 17.7.1 The SPG shall bear and promptly pay all statutory taxes, duties, levies and cess, assessed/levied on the SPG, contractors or their employees that are required to be

aid by the SPG as per the Law in relation to the execution of the Agreement and for supplying power as per the terms of this Agreement.

- 17.7.2 DISCOM shall be indemnified and held harmless by the SPG against any claim that may be made against DISCOM in relation to the matters set out in Article 17.9.1.
- 17.7.3 DISCOM shall not be liable for any payment of, taxes, duties, levies, cess whatsoever for discharging any obligation of the SPG by DISCOM on behalf of SPG.

17.8 Independent Entity

- 17.8.1 The SPG shall be an independent entity performing its obligations pursuant to the Agreement.
- 17.8.2 Subject to the provisions of the Agreement, the SPG shall be solely responsible for the manner in which its obligations under this Agreement are to be performed. All employees and representatives of the SPG or contractors engaged by the SPG in connection with the performance of the Agreement shall be under the complete control of the SPG and shall not be deemed to be employees, representatives, contractors of DISCOM and nothing contained in the Agreement or in any agreement or contract awarded by the SPG shall be construed to create any contractual relationship between any such employees, representatives or contractors and DISCOM.

17.9 Compliance with Law

- 17.9.1 Despite anything contained in this Agreement but without prejudice to this Article, if any provision of this Agreement shall be in deviation or inconsistent with or repugnant to the provisions contained in the Electricity Act, 2003, or any rules and regulations made there under, such provision of this Agreement shall be deemed to be amended to the extent required to bring it into compliance with the aforesaid relevant provisions as amended from time to time.

17.10 Order of priority in application

- 17.10.1 In case of inconsistencies in the agreements executed between the Parties, applicable Law including rules and regulations framed there under, the order of priority shall be as mentioned below:
 - (i) applicable Law, rules and regulations framed there under,
 - (ii) this Agreement

17.11 Affirmation

- 17.11.1 The SPG and UGVCL, both affirm that;
 - a) neither it nor its respective directors, employees, or agents has paid or undertaken to pay or shall in the future pay any unlawful commission, bribe, pay-off or kick-back; and
 - b) it has not in any other manner paid any sums, whether in Indian currency or foreign currency and whether in India or abroad to the other Party to procure this Agreement, and the SPG and DISCOM hereby undertaken not to engage in any similar acts during the Term of Agreement.

17.12 No consequential or Indirect Losses

- 17.14.1. The liability of the Seller and the Procurers is limited to that explicitly provided in this Agreement.

17.14.2. Provided that notwithstanding anything contained in this Agreement, under no events shall the Procurers or the Seller claim from one another any indirect or consequential losses or damages.

17.13 Breach of Obligations

17.13.1 The Parties acknowledge that a breach of any of the obligations contained herein would result in injuries. The Parties further acknowledge that the amount of the liquidated damages or the method of calculating the liquidated damages specified in this Agreement is a genuine and reasonable pre-estimate of the damages that may be suffered by the non-defaulting party in each case specified under this Agreement.

17.14 Books and Records: The SPG shall maintain books of account relating to the Project in accordance with generally accepted Indian accounting principles.

17.15 Limitation Remedies and Damages: Neither Party shall be liable to the other for any consequential, indirect or special damages to persons or property whether arising in tort, contract or otherwise, by reason of this Agreement or any services performed or undertaken to be performed hereunder.

17.16 Severability: Any provision of this Agreement, which is prohibited or unenforceable in any jurisdiction, shall, as to such jurisdiction, be ineffective to the extent of such prohibition or unenforceability without invalidating the remaining provisions hereof and without affecting the validity, enforceability or legality of such provision in any other jurisdiction.

17.17 Entire Agreement, Appendices: This Agreement constitutes the entire agreement between DISCOM and the SPG, concerning the subject matter hereof. All previous documents, undertakings, and agreements, whether oral, written, or otherwise, between the Parties concerning the subject matter hereof are hereby cancelled and shall be of no further force or effect and shall not affect or modify any of the terms or obligations set forth in this Agreement, except as the same may be made part of this Agreement in accordance with its terms, including the terms of any of the appendices, attachments or exhibits. The appendices, attachments and exhibits are hereby made an integral part of this Agreement and shall be fully binding upon the Parties.

In the event of any inconsistency between the text of the Articles of this Agreement and the appendices, attachments or exhibits hereto or in the event of any inconsistency between the provisions and particulars of one appendix, attachment or exhibit and those of any other appendix, attachment or exhibit DISCOM and the SPG shall consult to resolve the inconsistency.

17.18 Further Acts and Assurances: Each of the Parties after convincing itself agrees to execute and deliver all such further agreements, documents and instruments, and to do and perform all such further acts and things, as shall be necessary or convenient to carry out the provisions of this Agreement and to consummate the transactions contemplated hereby.

IN WITNESS WHEREOF the Parties have caused the Agreement to be executed through their duly authorized representatives as of the date and place set forth above.

Signature

SignaturewithSeal

SolarPowerGenerator
Witness:

Uttar Gujarat Vij Company Ltd.
DISCOM
Witness:

Annexure-G


357

Annex-G : Details of plant wise bidders for which price bid is opened under PM KUSUM Componet-C (FLS) Tender No-TN-42 to TN-104																					
Sr No	Tender No.	Name of Plant (UG-FLS-SS)	Notified Capacity of SS in MW	No. of Ag Feeders	No. of Ag. Connec-tions (up to 7.5HP)	Ranking after E-RA	Bidder Name	Offered capacity in MW	Quoted Rate (Rs./KWH)	Reverse Auction offered rate (Rs./KWH)	L-1 Rate of plant (Rs./KWH)	UGVCL Offer as per Consent Letter			Consent Letter Acceptance by Bidder as	UGVCL Offer as per LoI			LOI Acceptance		Remark
												MW (Bucket)	Rate (Rs./ KWH)	Date of Letter issued		MW (Bucket)	Rate (Rs./ KWH)	Date of LoI	MW	Rate (Rs./ KWH)	
1	TN-42	UG-FLS-SS-1	10.5	9	2170	L1	M/s MKC Infrastructure Ltd.	10.5	3.19	-	3.19	10.5	3.00	27.06.2023	YES	10.5	3.00	18.07.23	10.5	3.00	YES
	TN-42	UG-FLS-SS-1	10.5	9	2170	L2	M/s Zodiac Energy Limited	10.5	3.83	-	3.19										Not Allotted
	TN-42	UG-FLS-SS-1	10.5	9	2170	L3	M/s XITIZ TECHNOMECH LLP	2.5	5.95	-	3.19										Not Allotted
2	TN-43	UG-FLS-SS-2	8.0	12	1500	L1	M/s MKC Infrastructure Ltd.	8.0	3.25	Single	3.25	8.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
3	TN-44	UG-FLS-SS-3	8.0	7	1562	L1	M/s TIRUPATI COTTON INDUSTRIES	4.0	3.96	3.18	3.18	4.0	3.00	27.06.2023	YES	4	3.00	01.07.23	4	3.00	YES
	TN-44	UG-FLS-SS-3	8.0	7	1562	L2	M/s VENKATESH COTTON COMPANY	4.0	3.96	3.19	3.18	4.0	3.00	27.06.2023	YES	4	3.00	01.07.23	4	3.00	YES
	TN-44	UG-FLS-SS-3	8.0	7	1562	L3	M/s MKC Infrastructure Ltd.	8.0	3.25	3.20	3.18										Not Allotted
	TN-44	UG-FLS-SS-3	8.0	7	1562	L4	M/s Zodiac Energy Limited	8.0	3.83	-	3.18										Not Allotted
4	TN-45	UG-FLS-SS-4	7.5	6	955	L1	M/s MKC Infrastructure Ltd.	7.5	3.25	Single	3.25	7.5	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
5	TN-46	UG-FLS-SS-5	7.5	8	2229	L1	M/s MKC Infrastructure Ltd.	7.5	3.20	-	3.20	7.5	3.00	27.06.2023	YES	7.5	3.00	18.07.2023	7.5	3.00	YES
	TN-46	UG-FLS-SS-5	7.5	8	2229	L2	M/s TIRUPATI COTTON INDUSTRIES	4.0	3.96	-	3.20										Not Allotted
	TN-46	UG-FLS-SS-5	7.5	8	2229	L2	M/s VINKATESH COTTON COMPANY	4.0	3.96	-	3.20										Not Allotted
6	TN-47	UG-FLS-SS-6	7.0	7	1785	LI	M/s MKC Infrastructure Ltd.	7.0	3.35	Single	3.35	7.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
7	TN-48	UG-FLS-SS-7	7.0	11	916	L1	M/s MKC Infrastructure Ltd.	7.0	3.19	-	3.19	7.0	3.00	27.06.2023	YES	7	3.00	11.08.2023	7	3.00	YES
	TN-48	UG-FLS-SS-7	7.0	11	916	L2	M/s EFARM INTERNATIONAL PRIVATE LIMITED	2.0	3.75	-	3.19										Not Allotted
	TN-48	UG-FLS-SS-7	7.0	11	916	L3	M/s GPC Infrastructure Limited	4.0	4.35	-	3.19										Not Allotted
8	TN-49	UG-FLS-SS-8	6.5	7	1215	L1	M/s MKC Infrastructure Ltd.	6.5	3.19	Single	3.19	6.5	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
9	TN-50	UG-FLS-SS-9	6.0	7	1661	L1	M/s MKC Infrastructure Ltd.	6.0	3.25	Single	3.25	6.0	3.00	27.06.2023	YES	6	3.00	19.07.2023	6	3.00	YES
10	TN-51	UG-FLS-SS-10	5.0	9	1523	L1	M/s MECHATRONIK TECHNOLOGIES PRIVATE LIMITED	1.0	3.69	2.98	2.98					1	2.98	14.08.2023	1	2.98	YES
	TN-51	UG-FLS-SS-10	5.0	9	1523	L2	M/s MKC Infrastructure Ltd.	4.0	2.99	-	2.98					4	2.98	14.08.2023			Not Accepted
	TN-51	UG-FLS-SS-10	5.0	9	1523	L3	M/s QORX Energy	1.0	3.69	-	2.98										Not Allotted
	TN-51	UG-FLS-SS-10	5.0	9	1523	L4	M/s Zodiac Energy Limited	5.0	3.83	-	2.98										Not Allotted
	TN-51	UG-FLS-SS-10	5.0	9	1523	L5	Modi Divyesh Rakeshbhai	1.0	4.50	-	2.98										Not Allotted
	TN-51	UG-FLS-SS-10	5.0	9	1523	L5	Vishal Mukeshkumar Modi	1.0	4.50	-	2.98										Not Allotted
11	TN-52	UG-FLS-SS-11	4.5	11	1352	L1	M/s S.K. Buildcon	3.0	3.97	2.95	2.95					3	2.95	28.06.2023	3	2.95	YES
	TN-52	UG-FLS-SS-11	4.5	11	1352	L2	M/s Hatkesh Solar	4.0	4.50	2.96	2.95	1.5	2.95	27.06.2023	NO						Not Accepted
	TN-52	UG-FLS-SS-11	4.5	11	1352	L3	M/s MKC Infrastructure Ltd.	4.0	2.99	-	2.95										Not Allotted
	TN-52	UG-FLS-SS-11	4.5	11	1352	L4	M/s Zodiac Energy Limited	4.5	3.83	-	2.95										Not Allotted
	TN-52	UG-FLS-SS-11	4.5	11	1352	L5	M/s Avatar Solar Private Limited	2.0	3.95	-	2.95										Not Allotted
	TN-52	UG-FLS-SS-11	4.5	11	1352	L6	Harsh Nathubhai Chaudhari	4.0	4.19	-	2.95										Not Allotted
12	TN-53	UG-FLS-SS-12	4.5	7	1019	L1	M/s MKC Infrastructure Ltd.	4.0	3.20	Single	3.20	4.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
13	TN-54	UG-FLS-SS-13	4.0	3	1037	L1	M/s MKC Infrastructure Ltd.	4.0	3.20	Single	3.20	4.0	3.00	27.06.2023	YES	4	3.00	18.07.2023	4	3.00	YES
14	TN-55	UG-FLS-SS-14	4.0	5	938	L1	M/s MKC Infrastructure Ltd.	4.0	3.25	-	3.25	4.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
	TN-55	UG-FLS-SS-14	4.0	5	938	L2	M/s GPC Infrastructure Limited	4.0	4.35	-	3.25										Not Allotted
15	TN-56	UG-FLS-SS-15	4.0	4	698	L1	M/s MKC Infrastructure Ltd.	4.0	3.29	Single	3.29	4.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted

Annex-G : Details of plant wise bidders for which price bid is opened under PM KUSUM Componet-C (FLS) Tender No-TN-42 to TN-104																					
Sr No	Tender No.	Name of Plant (UG-FLS-SS)	Notified Capacity of SS in MW	No. of Ag Feeders	No. of Ag. Connectio ns (up to 7.5HP)	Ranking after E-RA	Bidder Name	Offered capacity in MW	Quoted Rate (Rs./KWH)	Reverse Auction offered rate (Rs./KWH)	L-1 Rate of plant (Rs./KWH)	UGVCL Offer as per Consent Letter			Consent Letter Acceptance by Bidder as	UGVCL Offer as per Lol			LOI Acceptance		Remark
												MW (Bucket)	Rate (Rs./ KWH)	Date of Letter issued		MW (Bucket)	Rate (Rs./ KWH)	Date of Lol	MW	Rate (Rs./ KWH)	
16	TN-57	UG-FLS-SS-16	4.0	4	910	L1	M/s MKC Infrastructure Ltd.	4.0	3.25	-	3.25	4.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
	TN-57	UG-FLS-SS-16	4.0	4	910	L2	M/s Zodiac Energy Limited	4.0	3.83	-	3.25										Not Alloted
	TN-57	UG-FLS-SS-16	4.0	4	910	L3	M/s GPC Infrastructure Limited	4.0	4.35	-	3.25										Not Alloted
17	TN-58	UG-FLS-SS-17	4.0	14	841	L1	M/s MKC Infrastructure Ltd.	4.0	3.50	Single	3.50	4.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
18	TN-59	UG-FLS-SS-18	4.0	4	1594	L1	M/s MKC Infrastructure Ltd.	4.0	3.25	-	3.25	4.0	3.00	27.06.2023	YES	4	3.00	18.07.2023	4	3.00	YES
	TN-59	UG-FLS-SS-18	4.0	4	1594	L2	M/s SKP Bearing Industries Limited	2.0	3.96	-	3.25										Not Alloted
19	TN-60	UG-FLS-SS-19	4.0	3	1265	L1	M/s MKC Infrastructure Ltd.	4.0	3.25	Single	3.25	4.0	3.00	27.06.2023	YES	4	3.00	18.07.2023	4	3.00	YES
20	TN-61	UG-FLS-SS-20	4.0	2	818	L1	M/s MKC Infrastructure Ltd.	4.0	3.25	-	3.25	4.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
	TN-61	UG-FLS-SS-20	4.0	2	818	L2	M/s Zodiac Energy Limited	4.0	3.83	-	3.25										Not Alloted
21	TN-62	UG-FLS-SS-21	3.5	4	938	L1	M/s HEXATRON INDUSTRIES LIMITED	3.5	3.40	Single	3.40	3.5	3.00	27.06.2023	YES	3.5	3.00	18.07.2023	3.5	3.00	YES
22	TN-63	UG-FLS-SS-22	3.5	3	896	L1	M/s HEXATRON INDUSTRIES LIMITED	3.5	3.40	-	3.40	3.5	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
	TN-63	UG-FLS-SS-22	3.5	3	896	L2	M/s Zodiac Energy Limited	3.5	3.83	-	3.40										Not Alloted
23	TN-64	UG-FLS-SS-23	3.5	6	896	L1	M/s MKC Infrastructure Ltd.	3.5	3.30	Single	3.30	3.5	3.00	27.06.2023	YES	3.5	3.00	18.07.2023	3.5	3.00	YES
24	TN-65	UG-FLS-SS-24	3.5	8	588	L1	M/s MKC Infrastructure Ltd.	3.5	3.50	-	3.50	3.5	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
	TN-65	UG-FLS-SS-24	3.5	8	588	L2	M/s GPC Infrastructure Limited	3.5	4.44	-	3.50										Not Alloted
25	TN-66	UG-FLS-SS-25	3.5	4	1146	L1	M/s MKC Infrastructure Ltd.	3.5	3.40	3.34	3.34	3.5	3.00	27.06.2023	YES	3.5	3.00	18.07.2023	3.5	3.00	YES
	TN-66	UG-FLS-SS-25	3.5	4	1146	L2	M/s Zodiac Energy Limited	3.5	3.83	3.35	3.34										Not Alloted
26	TN-67	UG-FLS-SS-26	3.5	7	941	L1	M/s MKC Infrastructure Ltd.	3.5	3.50	-	3.50	3.5	3.00	27.06.2023	YES	3.5	3.00	18.07.2023	3.5	3.00	YES
	TN-67	UG-FLS-SS-26	3.5	7	941	L2	M/s Ganesh Energy	2.0	5.00	-	3.50										Not Alloted
27	TN-68	UG-FLS-SS-27	3.0	4	1081	L1	Manisha Sunil Shah	3.0	3.70	3.39	3.39	3.0	3.00	27.06.2023	YES	3	3.00	01.07.2023	3	3.00	YES
	TN-68	UG-FLS-SS-27	3.0	4	1081	L2	M/s S. Poddar International (India) Pvt. Ltd.	1.0	6.72	3.40	3.39										Not Alloted
	TN-68	UG-FLS-SS-27	3.0	4	1081	L3	M/s MKC Infrastructure Ltd.	3.0	3.50	3.42	3.39										Not Alloted
	TN-68	UG-FLS-SS-27	3.0	4	1081	L4	Pankaj Prakash Choudhary	1.0	6.72	3.44	3.39										Not Alloted
	TN-68	UG-FLS-SS-27	3.0	4	1081	L5	M/s Divine Techno Solar India LLP	1.0	6.72	3.48	3.39										Not Alloted
	TN-68	UG-FLS-SS-27	3.0	4	1081	L6	M/s Zodiac Energy Limited	3.0	3.83	-	3.39										Not Alloted
28	TN-69	UG-FLS-SS-28	3.0	4	665	L1	M/s HEXATRON INDUSTRIES LIMITED	3.0	3.40	Single	3.40	3.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted
29	TN-71	UG-FLS-SS-30	3.0	6	493	L1	Ganeshbhai Parthibhai Chaudhary	3.0	4.52	3.29	3.29	3.0	3.00	27.06.2023	NO						Not Accepted
	TN-71	UG-FLS-SS-30	3.0	6	493	L2	M/s Hexatron Industries limited	3.0	3.30	-	3.29										Not Alloted
	TN-71	UG-FLS-SS-30	3.0	6	493	L3	Vipul Daljibhai Chaudhary	3.0	4.54	-	3.29										Not Alloted
	TN-71	UG-FLS-SS-30	3.0	6	493	L4	Haresh Dhohjibhai Chaudhary	3.0	4.85	-	3.29										Not Alloted
	TN-71	UG-FLS-SS-30	3.0	6	493	L5	Mehul Hirabhai Chaudhary	3.0	4.99	-	3.29										Not Alloted
	TN-71	UG-FLS-SS-30	3.0	6	493	L6	Bhagwanbhai Bhikhabhai Karen	3.0	5.30	-	3.29										Not Alloted
30	TN-72	UG-FLS-SS-31	3.0	10	1720	L1	M/s MKC Infrastructure Ltd.	3.0	3.30	Single	3.30	3.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Accepted

Annex.G : Details of plant wise bidders for which price bid is opened under PM KUSUM Componet-C (FLS) Tender No-TN-42 to TN-104

Sr No	Tender No.	Name of Plant (UG-FLS-SS)	Notified Capacity of SS in MW	No. of Ag Feeders	No. of Ag. Connections (up to 7.5HP)	Ranking after E-RA	Bidder Name	Offered capacity in MW	Quoted Rate (Rs./KWH)	Reverse Auction offered rate (Rs./KWH)	L-1 Rate of plant (Rs./KWH)	UGVCL Offer as per Consent Letter			Consent Letter Acceptance by Bidder as	UGVCL Offer as per Lol			LOI Acceptance		Remark
												MW (Bucket)	Rate (Rs./ KWH)	Date of Letter issued		MW (Bucket)	Rate (Rs./ KWH)	Date of Lol	MW	Rate (Rs./ KWH)	
31	TN-73	UG-FLS-SS-32	3.0	5	1727	L1	M/s SKP Bearing Industries Limited.	2.0	3.96	3.39	3.39	2.0	3.00	27.06.2023	YES	2	3.00	01.07.2023	2	3.00	YES
	TN-73	UG-FLS-SS-32	3.0	5	1727	L2	M/s MKC Infrastructure Ltd.	3.0	3.40	-	3.39	1.0	3.00	27.06.2023	Not Submitted within time 14.07.23						Not Alloted
	TN-73	UG-FLS-SS-32	3.0	5	1727	L3	M/s Zodiac Energy Limited	3.0	3.83	-	3.39										Not Alloted
32	TN-74	UG-FLS-SS-33	3.0	6	1115	L1	M/s MKC Infrastructure Ltd.	3.0	3.40	Single	3.40	3.0	3.00	27.06.2023	YES	3	3.00	18.07.2023	3	3.00	YES
33	TN-75	UG-FLS-SS-34	2.5	4	621	L1	M/s CEPCO Industries Pvt. Ltd.	2.5	3.80	-	3.80	2.5	3.00	27.06.2023	YES	2.5	3.00	13.07.2023	2.5	3.00	YES
	TN-75	UG-FLS-SS-34	2.5	4	621	L2	M/s GPC Infrastructure Limited	2.5	4.46	-	3.80										Not Alloted
34	TN-76	UG-FLS-SS-35	2.5	12	1510	L1	Sharadkumar Keshubhai Desai	1.0	4.02	4	4.00					1	3.00	14.08.2023	1	3.00	YES
	TN-76	UG-FLS-SS-35	2.5	12	1510	L2	Desai Ramilaben Sharadkumar	1.0	4.19	4.01	4.00					1	3.00	14.08.2023	1	3.00	YES
35	TN-77	UG-FLS-SS-36	2.5	6	1161	L1	M/s CEPCO Industries Pvt. Ltd.	2.5	3.80	3.44	3.44	2.5	3.00	27.06.2023	YES	2.5	3.00	13.07.2023	2.5	3.00	YES
	TN-77	UG-FLS-SS-36	2.5	6	1161	L2	Deep Shaileshkumar Shah	2.5	3.45	-	3.44										Not Alloted
	TN-77	UG-FLS-SS-36	2.5	6	1161	L3	Laxmikumar Virendrasinh Parmar	1.0	3.65	-	3.44										Not Alloted
	TN-77	UG-FLS-SS-36	2.5	6	1161	L4	M/s Topsun Energy Ltd.	1.5	3.80	-	3.44										Not Alloted
36	TN-78	UG-FLS-SS-37	2.5	5	893	L1	M/s Platinum Agro Industries	2.5	4.55	Single	4.55					2.5	3.00	14.08.2023	2.5	3.00	YES
37	TN-81	UG-FLS-SS-40	2.0	10	505	L1	M/s Zodiac Energy Limited	2.0	3.83	Single	3.83	2.0	3.00	27.06.2023	YES	2	3.00	01.07.2023	2	3.00	YES
38	TN-83	UG-FLS-SS-42	2.0	8	487	L1	Ahmadabbas Taherali Khanusiya	1.0	3.75	Single	3.75	1.0	3.00	27.06.2023	No						Not Accepted
39	TN-84	UG-FLS-SS-43	2.0	2	501	L1	M/s Goldensol Producer company Limited	1.0	3.86	3.85	3.85	1.0	3.00	27.06.2023	YES	1	3.00	13.07.2023	1	3.00	YES
	TN-84	UG-FLS-SS-43	2.0	2	501	L2	Hiteshkumar Amchandbhai Patel	1.0	4.50	-	3.85	1.0	3.00	27.06.2023	NO						Not Accepted
40	TN-87	UG-FLS-SS-46	1.5	9	717	L1	M/s Avatar Solar Private Limited	1.5	3.95	3.93	3.93	1.5	3.00	27.06.2023	NO						Not Accepted
	TN-87	UG-FLS-SS-46	1.5	9	717	L2	M/s GPC Infrastructure Limited	1.5	4.52	-	3.93										Not Alloted
41	TN-88	UG-FLS-SS-47	1.5	5	324	L1	M/s GPC Infrastructure Limited	1.5	4.48	Single	4.48	1.5	3.00	27.06.2023	No						Not Accepted
42	TN-89	UG-FLS-SS-48	1.5	5	1933	L1	M/s Avatar Solar Private Limited	1.5	3.95	3.63	3.63	1.5	3.00	27.06.2023	YES	1.5	3.00	15.07.2023	1.5	3.00	YES
	TN-89	UG-FLS-SS-48	1.5	5	1933	L2	M/s CEPCO Industries Pvt. Ltd.	1.5	3.80	3.64	3.63										Not Alloted
	TN-89	UG-FLS-SS-48	1.5	5	1933	L3	M/s GPC Infrastructure Limited	1.5	4.49	-	3.63										Not Alloted
43	TN-90	UG-FLS-SS-49	1.5	2	359	L1	M/s NUGLADE PRIVATE LIMITED	1.5	4.37	Single	4.37	1.5	3.00	27.06.2023	YES	1.5	3.00	12.09.2023	1.5	3.00	YES
44	TN-94	UG-FLS-SS-53	1.5	8	313	L1	M/s VIJAPURA IMPEX LLP, JV Partener : M/s Photonics Watertech Pvt Ltd.	1.5	3.75	Single	3.75					1.5	3.00	14.08.2023	1.5	3.00	YES
45	TN-95	UG-FLS-SS-54	1.5	4	854	L1	M/s R K CORP	1.5	3.50	Single	3.50					1.5	3.00	14.08.2023	1.5	3.00	YES
46	TN-97	UG-FLS-SS-56	1.5	4	1064	L1	M/s Sukoon Energy LLP, (JV Partener :Photonics Watertech Pvt. Ltd.)	1.5	3.95	Single	3.95	1.5	3.00	27.06.2023	No						Not Accepted
47	TN-98	UG-FLS-SS-57	1.5	3	320	L1	M/s JSR Renewable Consultants	1.5	4.50	Single	4.50					1.5	3.00	14.08.2023	1.5	3.00	YES
48	TN-99	UG-FLS-SS-58	1.5	5	584	L1	M/s Zodiac Energy Limited	1.5	3.83	Single	3.83	1.5	3.00	27.06.2023	YES	1.5	3.00	01.07.2023	1.5	3.00	YES
49	TN-100	UG-FLS-SS-59	1.5	3	490	L1	M/s Deesha Civil Engineering Design	1.0	3.00	2.75	2.75					1	2.75	28.06.2023	1	2.75	YES
	TN-100	UG-FLS-SS-59	1.5	3	490	L1	M/s Gurukrupa Granite	1.5	4.30	-	2.75	0.5	2.75	27.06.2023	YES	0.5	2.75	12.09.2023	0.5	2.75	YES
50	TN-101	UG-FLS-SS-60	1.5	4	920	L1	M/s Zodiac Energy Limited	1.5	3.83	Single	3.83	1.5	3.00	27.06.2023	YES	1.5	3.00	01.07.2023	1.5	3.00	YES
51	TN-103	UG-FLS-SS-62	1.5	6	295	L1	Kamleshkumar Babulal Shah	1.5	3.50	Single	3.50					1.5	3.00	14.08.2023	1.5	3.00	YES
52	TN-104	UG-FLS-SS-63	1.5	3	1249	L1	M/s R K CORP	1.5	3.50	Single	3.50					1.5	3.00	14.08.2023	1.5	3.00	YES



UGVCL

Uttar Gujarat Vij Company Limited

CIN - U40102GJ2003SGC042906
(A subsidiary of Gujarat Urja Vikas Nigam Limited)

No. UGVCL/R&C/Commerce/GERC Cell/ 681,

Date - 06.10.2023

To,
The Secretary
Gujarat Electricity Regulatory Commission,
 6th Floor, GIFT One,
 Road 5C, Zone 5,
Gandhinagar 382 355

Sub: Submission of the affidavit for details of the notice published regarding Filing of the Petition no. 2254 of 2023

Respected Sir,

As directed by Hon'ble Commission, UGVCL has published notice in daily newspapers for above referred petition no. 2254/2023. Two nos of public notices in vernacular (Gujarati) Newspaper namely "SANDESH" & "DIVYA BHASKAR" and one in English Newspaper namely "INDIAN EXPRESS" were published on dated 05.10.2023 and 06.10.2023 respectively for inviting comments/ suggestions/ objections from stakeholders in Petition under Section 63 read with 86(1) (b) and other applicable provisions of the Electricity Act, 2003 for adoption of tariff discovered under tariff based competitive bidding process conducted by UGVCL vide RfS No. UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42 to TN-104 & TN-03 to TN-41 for aggregate 152.876 MW for Solarization of 56 nos. S/S level plants on 11 KV Feeders through RESCO Models in UGVCL for implementation of Feeder Level Solarization under PM KUSUM Component scheme of MNRE, Gol.

Please find enclosed here with the five (5) copies of both the daily news papers in English & Gujarati along with the necessary affidavit. Also, soft copy the Petition is available on UGVCL Website.

Thanking You,

G.E.R.C.
Inward No. 4 6 7 2
Date : - 6 OCT 2023

Se (f)
 Bhi

Yours Faithfully,

I/c Chief Engineer (P&P)
 UGVCL, Mehsana

C. P. 1000	
1000000000	
Date :	

BEFORE THE HONOURABLE GUJARAT ELECTRICITY REGULATORY
COMMISSION AT GANDHINAGAR

Case No. 2254/2023

IN THE MATTER OF	Filing of the Petition under Section 63 read with 86(1) (b) and other applicable provisions of the Electricity Act, 2003 for adoption of tariff discovered under tariff based competitive bidding process conducted by UGVCL vide RfS No. UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42 to TN-104 & TN-03 to TN-41 for aggregate 152.876 MW for Solarization of 56 nos. S/S level plants on 11 KV Feeders through RESCO Models in UGVCL for implementation of Feeder Level Solarization under PM KUSUM Component scheme of MNRE, Gol.
AND	
IN THE MATTER OF	Uttar Gujarat Vij Company Limited, Registered & Corporate Office Visnagar Road, Mehsana-384001 <i>Petitioner</i>



THE APPLICANT ABOVE NAMED RESPECTFULLY SUBMITS

PREAMBLE


Petitioners has filed Petitions under Section 63 read with 86(1) (b) and other applicable provisions of the Electricity Act, 2003 for adoption of tariff discovered under tariff based competitive bidding process conducted by UGVCL vide RfS No. UGVCL/Project/Solar/PM-KUSUM-C-FLS/TN-42 to TN-104 & TN-03 to TN-41 for aggregate 152.876 MW for Solarization of 56 nos. S/S level plants on 11 KV Feeders through RESCO Models in UGVCL for implementation of Feeder Level Solarization under PM KUSUM Component scheme of MNRE, Gol.

Submission

The petitioner most respectfully and humbly submits that the petitioner has published the Public Notice as directed by Hon'ble Commission forinviting comments/suggestions/objections of the stakeholders to the above-mentioned Petitions. The Public Notice have

been published on dated 05.10.2023 & 06.10.2023 in editions of Gujarati News Papers "**SANDESH**" & "**DIVYA BHASKAR**" and English News Paper "**INDIAN EXPRESS**" respectively. The details of the "Notice" published in newspapers having wide circulations in the state are as under:

1	Name of News paper	1. " SANDESH " & " DIVYA BHASKAR " in Gujarati 2. " INDIAN EXPRESS " in English
2	Date of Publication	05.10.2023 & 06.10.2023
3	Centre to obtain copy of Petition	The I/c Chief Engineer (P&P) Uttar Gujarat Vij Company Limited, Registered & Corporate Office Visnagar Road, Mehsana Gujarat-384001.
4	Electronic copy	Available on Web site www.ugvcl.com
5	Last date for Submitting objections/suggestion on affidavit before Secretary, GERC.	16.10.2023



The clipping of the relevant newspapers dated 05.10.2023 & 06.10.2023 are marked as Annexure "A" and submitted herewith for the perusal of the Hon'ble Commission.

Place: Mehsana

Date : 06.10.2023


I/c Chief Engineer (P&P)
UGVCL, Mehsana

Affidavit verifying the reply


SERIAL NO. 2570
 BOOK NO. 01
 PAGE NO. 86
 DATE 6/10/23

I, Mr Bhagubhai Pranami, son of Ganeshbhai Pranami, aged 53 years, working as I/c Chief Engineer (P&P) at R&C Office, UGVCL, Visnagar Road, Mehsana, do solemnly affirm and say as follows:

I am the I/c Chief Engineer (P&P) of Uttar Gujarat Vij Company Limited (UGVCL), the Petitioner in the above matter and I am duly authorized by the said Petitioner to make this affidavit.

The Statements made in the Petition hereinabove are true to my knowledge and belief, which I believe them to be true.

Solemnly affirmed at Mehsana on this 6th day of October' 2023, that the contents of the above affidavit are true to my knowledge & no part of it is false and nothing material has been concealed there from.




 (Petitioner)

Date: 06.10.2023

Place: Mehsana.

Solemnly Affirmed & Signed
 BEFORE ME



Jayeshkumar M. Chaudhary
 NOTARY
 (GOVT. OF INDIA) MEHSANA

6/10/2023



પ્રાથમ થયેલ ટેરિફ અપનાવવા માટે ૩૧ કપ ડોલરના સોલરાઇઝેશન માટે ટેન્ડર પ્રક્રિયા હાથ પરવામાં આવેલ જેમાં

BY PETER VIDAL



TAURUS (Apr 21 - May 21)
 The pressure is on at work and at home, not for the first time, and not for the last. To look at your long-term trends it now seems *clear* that personal change will move faster than professional. And, to that extent, you might well soon decide that it's time to *move* (or).

SAGITTARIUS (Nov 24 - Dec 22)
The time has come to decide where you are going — literally.

GEMINI (May 22 - June 21)
 You seem to be isolated, but that's not bad. After all, it's the world that's out of step, not you. Others may be leaving you behind, but that's their problem, as they rush through life, they'll miss a great many of the opportunities you pick up.

tempted by the prospect of living or working in foreign parts, far from home. Whether this is realistic or not is quite another matter, but you can always work to make

CANCER (June 22 - July 23)
foreign
connections,
overseas contacts,
legal questions and
educational considerations
should now be at least settled,
but not quite. You may like to
wait and see what the next
few days bring before reaching
a final verdict. Perhaps
what seems like a great
idea today will look a little
doubtful tomorrow.

CAPRICORN (Dec 23 - Jan 20)

LEO (July 24 - Aug 23)
Long-term

Y₂₀ It is said that the best business people are born under your sign, in which case the moment of truth has now arrived. According to your long-term cycles, you are now in a phase of private austerity and public extravagance. I think you'll have to exceed your budget before long.

 planetary cycles are now at a critical point, one which will be repeated in exactly two months' time. You may plan ahead in the knowledge that you have no less than six months to establish the pattern of your affairs for a long time to come.

AQUARIUS (Jan 21 - Feb 19)
A whole new world is opening up. Right now you may be too preoccupied by daily concerns, such as cash, or the lack of it, to see what is really happening. It may even be the end of next month before it all becomes blindingly obvious. Until

VIRGO (Aug 24 - Sep 23)
 There are some strong words to be spoken concerning the grain and crop commitments, and there may

PSCS (Feb 20 - Mar 20)
If you are caught up in a web of intrigue, the cause probably lies in your own

will be much point in expecting everyone to agree. But then, why should they? It's good to hear a variety of opinions, and the end results can only be good.

reluctance ever to say "no." One thing you can be sure of now is that you have a chance to improve family relationships. If you regret a past action, take the lead and say you're sorry.

ARE YOU GUYS THAT STARVED FOR ENTERTAINMENT?

Given below are four jumbled words. Solve the puzzles to make proper words and move them to the respective squares below. Select the letters in the shaded squares and jumble them to get the answer for the given clue.

I didn't think I ____ - Anthony Burgess (12)

142 Instructions:
To solve a Sudoku puzzle every digit from 1 to 9 must appear in each of the nine vertical columns, in

8	7		3		1	5
3			6		9	8
	2	4		1	7	
		1	5	8		2
6						4
	9		4	2	8	
		9	1		4	5
4		7		6		3
1	3		4		9	2

SOLUTION SUDOKU 5341

Difficulty Level
1s = Very easy; 2s = Easy;
3s = Medium; 4s = Hard;
5s = Very Hard;
6s = Genius.

SURAT MUNICIPAL CORPORATION
PUBLIC INFRASTRUCTURE CELL
Online Tender Notice No.
I/C/DY/MC/P.C./10/2023-24

Surat E-Tender (Online) Invitation Notice Tender Notice
(Online) No. I/C/DY/MC/P.C./10/2023-24

The tender is a single online

<https://smc.surat.npsc.org> from experienced
Government approved Contractor with following schedule

Name of Department	Public Infrastructure Cell
No of work	06

No. PR.O/379/2023-24
Date: 04-10-2023

I.C. Dy. Municipal Commissioner
Public Infrastructure Cell
Surat Municipal Corporation

SBI
Central Securities Department
(Self-Insured Retention, Non-Admitted, Multiple, AIG)

NOTICE INVITING TENDER

At 4:00 PM, CSDP/2013-24072 (Tender 03/10/2013)
Bids through **Gold Purata** are invited by **State Bank of India**, from interested companies, engaged in printing of multicolored security forms, i.e. Cheques, IDs, etc. and Non-Security Forms, i.e. Letters, for selection to a **Security Printer in Bank**. For details, please visit: **Gold Purata at "https://gem.gov.in"**

Ref No: **CSDP/2013-24072** CERN/2013/030812
Bid Start Date / Time: **03/10/2013 18:00:00 Hrs**
Bid End Date / Time: **20/10/2013 18:00:00 Hrs**
Note: The **Security Printers** who are presently empanelled with the **State Bank of India** are required to apply **ahead** if they are eligible and interested to be selected by the Bank.

Place: **Mumbai** Deputy General Manager

OFFICE OF ADDITIONAL CHIEF ENGINEER, WATER RESOURCES UNIT, LDA/UPR Near Akashvani, Chetana, K. S. Nagar, (Rajasthan) 313001 Phone no. - 4294-2414, 4294-2415, Faxno. - 42942416, 4294-2417 E-Mail - ace@water.res.in		
No. ACE/Chetana/UPR/water-2/2017-24 DATED: 15.08.2017		
M.T. No. 30/2017-24 NHR CODE- WRA254A689		
Tick one box, indicating work status (check those which are NOT the case) (a) ☒ Finalized		
(b) ☐ Not Finalized		Estimated Cost of Work (Rs. in Lacs) Rs. 50.00
(c) ☐ Not Finalized		
(d) ☐ Not Finalized		
(e) ☐ Not Finalized		
(f) ☐ Not Finalized		
(g) ☐ Not Finalized		
(h) ☐ Not Finalized		
(i) ☐ Not Finalized		
(j) ☐ Not Finalized		
(k) ☐ Not Finalized		
(l) ☐ Not Finalized		
(m) ☐ Not Finalized		
(n) ☐ Not Finalized		
(o) ☐ Not Finalized		
(p) ☐ Not Finalized		
(q) ☐ Not Finalized		
(r) ☐ Not Finalized		
(s) ☐ Not Finalized		
(t) ☐ Not Finalized		
(u) ☐ Not Finalized		
(v) ☐ Not Finalized		
(w) ☐ Not Finalized		
(x) ☐ Not Finalized		
(y) ☐ Not Finalized		
(z) ☐ Not Finalized		
(aa) ☐ Not Finalized		
(ab) ☐ Not Finalized		
(ac) ☐ Not Finalized		
(ad) ☐ Not Finalized		
(ae) ☐ Not Finalized		
(af) ☐ Not Finalized		
(ag) ☐ Not Finalized		
(ah) ☐ Not Finalized		
(ai) ☐ Not Finalized		
(aj) ☐ Not Finalized		
(ak) ☐ Not Finalized		
(al) ☐ Not Finalized		
(am) ☐ Not Finalized		
(an) ☐ Not Finalized		
(ao) ☐ Not Finalized		
(ap) ☐ Not Finalized		
(aq) ☐ Not Finalized		
(ar) ☐ Not Finalized		
(as) ☐ Not Finalized		
(at) ☐ Not Finalized		
(au) ☐ Not Finalized		
(av) ☐ Not Finalized		
(aw) ☐ Not Finalized		
(ax) ☐ Not Finalized		
(ay) ☐ Not Finalized		
(az) ☐ Not Finalized		
(ba) ☐ Not Finalized		
(bb) ☐ Not Finalized		
(bc) ☐ Not Finalized		
(bd) ☐ Not Finalized		
(be) ☐ Not Finalized		
(bf) ☐ Not Finalized		
(bg) ☐ Not Finalized		
(bh) ☐ Not Finalized		
(bi) ☐ Not Finalized		
(bj) ☐ Not Finalized		
(bk) ☐ Not Finalized		
(bl) ☐ Not Finalized		
(bm) ☐ Not Finalized		
(bn) ☐ Not Finalized		
(bo) ☐ Not Finalized		
(bp) ☐ Not Finalized		
(bq) ☐ Not Finalized		
(br) ☐ Not Finalized		
(bs) ☐ Not Finalized		
(bt) ☐ Not Finalized		
(bu) ☐ Not Finalized		
(bv) ☐ Not Finalized		
(bw) ☐ Not Finalized		
(bx) ☐ Not Finalized		
(by) ☐ Not Finalized		
(bz) ☐ Not Finalized		
(ca) ☐ Not Finalized		
(cb) ☐ Not Finalized		
(cc) ☐ Not Finalized		
(cd) ☐ Not Finalized		
(ce) ☐ Not Finalized		
(cf) ☐ Not Finalized		
(cg) ☐ Not Finalized		
(ch) ☐ Not Finalized		
(ci) ☐ Not Finalized		
(cj) ☐ Not Finalized		
(ck) ☐ Not Finalized		
(cl) ☐ Not Finalized		
(cm) ☐ Not Finalized		
(cn) ☐ Not Finalized		
(co) ☐ Not Finalized		
(cp) ☐ Not Finalized		
(cq) ☐ Not Finalized		
(cr) ☐ Not Finalized		
(cs) ☐ Not Finalized		
(ct) ☐ Not Finalized		
(cu) ☐ Not Finalized		
(cv) ☐ Not Finalized		
(cw) ☐ Not Finalized		
(cx) ☐ Not Finalized		
(cy) ☐ Not Finalized		
(cz) ☐ Not Finalized		
(da) ☐ Not Finalized		
(db) ☐ Not Finalized		
(dc) ☐ Not Finalized		
(dd) ☐ Not Finalized		
(de) ☐ Not Finalized		
(df) ☐ Not Finalized		
(dg) ☐ Not Finalized		
(dh) ☐ Not Finalized		
(di) ☐ Not Finalized		
(dj) ☐ Not Finalized		
(dk) ☐ Not Finalized		
(dl) ☐ Not Finalized		
(dm) ☐ Not Finalized		

BUJARAT ENERGY TRANSMISSION CORPORATION LIMITED
Transmission Licence (ATC) : 66kv sub Station Compund
Nr Shiv Nethi ST Station Near Surendranagar 363070
Website: www.getecp.com CIN: U46100GJ1995SGC0060
Ph. No.: 02752-223050 Fax No.: 02752-223055
E-Mail: sellmndr@getecp.com

TENDER NOTICE
"Tender Notice Notice No- STC-7/5-2023 to STC-50-23/23 for Mech. Suringdangar, and Hirding of Vehicle,
Erection of 66 KV D/C L/O proposed 55 KV V-Zurud,
Shifting of 66KV DC Dhama-ESP line. Shifting of 66KV DC
Dhama-ESP line. Painting of line loc. Erection of Feoster and
Tha Bay, 220 kv SS Solar rooftop, Replacement of Conductor
Under Surendranagar (TR). Circle are put up on web site
www.getecp.com and www.bjuar.com.
Interested contractors are requested to download last date of
from web site & submit there offers on or before due date of
receipt for detail please visit above websites."

**Supervising Engineer (TR),
Surendranagar**
"Save Electricity & Save Indian"

અમદાવાદ મ્યુનિસિપલ કોર્પોરેશન



(છાત્રી પ્રોજેક્ટ કોર્પોરેશન)
સી-ઈસ્ટવાડ-રેલવે કોલોની નં. ૫૦/૩૦૨-૨૪

Sl. No.	Name of Work	Estimated Tender Cost
૧.	અમદાવાદ, રાજકોટમાં પુલ કાંચલાઈનના	રૂ.
૨.	પાવાર નદી પાસેનાં લેમંગા બ્રિજ પર	૨૧,૨૮,૦૦૦ રૂ.
૩.	રેલવેની પાસે લેમંગા નદીની બીજી કાંચલાઈ	(૭૦ કોસ્ટી ની યાજર)
અમદાવાદ મ્યુનિસિપલ કોર્પોરેશન		
ધોળ સાહેબ ડિપાર્ટમેન્ટ કમપાની તરીકે ઈ-ટેન્ડર લેન્ડિંગ કરવાની પેટર્ની તરીકે		
DETAILS & TENDERS AVAILABLE ON		૦૬-૦૮-૨૦૧૩ ૦૧-૦૯-૨૦૧૩ સુધી અને ૧૮-૦૮-૨૦૧૩ તુરતી www.tenderportal.gujarat.com

Municipal Commissioner (A.M.C.)

[illegible]

SPROCC RAPRA VEDYUT VITARAN NIGAM LIMITED
 Corporate Member Number (CIN) : U41070GJ2006PLC061483
 (WFOVSE) Regd. Office: New Pimpri, Dist. Indapur, Maharashtra
 Jodhpur 342003, PHONE: 0291-2712324, FAX: 0291-2745259

SHORT TERM E-PROCUREMENT TENDER NOTICE

Short term Turnkey-commercial and Price Bids are invited for
 Supply, Design, Supply, Erection, Testing, Commissioning and
 maintenance of yearly Comprehensive Operation & Maintenance of
 110 KV 3211 KV Grid Sub-stations & associated infrastructure
 conforming basis on BOOT model in JVVNL under various circle. "E-
 TENDER-650/UBN No JV22124W/LOC00591"

Details regarding Quantity, Tender cost, Earnest Money, Schedule
 dates for opening of bids are available on our website at
www.sproc.raprajan.gov.in or
www.sproc.raprajan.gov.in in the bidders, in their own interest
 are requested to read very carefully the tender documents before submitting
 any offer through on line at website www.sproc.raprajan.gov.in

NOTE: Interested bidders please note that in future any other notices
 issued by the organization will be posted on our website and e-mail
 addresses and bid submission site for above tender will only be available
 on website www.sproc.raprajan.gov.in sproc.raprajan@gmail.com

www.raprajan.gov.in raprajan@raprajan.gov.in

SUPERINTENDING ENGINEER

KATA POWER & DOLU DISTRIBUTION LIMITED KATA Power and Dolu Government Joint Venture Plot 60/61, 62/63, 64/65, 66/67, 68/69, 70/71, 72/73, 74/75, 76/77, 78/79, 80/81, 82/83, 84/85, 86/87, 88/89, 90/91, 92/93, 94/95, 96/97, 98/99, 100/101, 102/103, 104/105, 106/107, 108/109, 110/111, 112/113, 114/115, 116/117, 118/119, 120/121, 122/123, 124/125, 126/127, 128/129, 130/131, 132/133, 134/135, 136/137, 138/139, 140/141, 142/143, 144/145, 146/147, 148/149, 150/151, 152/153, 154/155, 156/157, 158/159, 160/161, 162/163, 164/165, 166/167, 168/169, 170/171, 172/173, 174/175, 176/177, 178/179, 180/181, 182/183, 184/185, 186/187, 188/189, 190/191, 192/193, 194/195, 196/197, 198/199, 200/201, 202/203, 204/205, 206/207, 208/209, 210/211, 212/213, 214/215, 216/217, 218/219, 220/221, 222/223, 224/225, 226/227, 228/229, 230/231, 232/233, 234/235, 236/237, 238/239, 240/241, 242/243, 244/245, 246/247, 248/249, 250/251, 252/253, 254/255, 256/257, 258/259, 260/261, 262/263, 264/265, 266/267, 268/269, 270/271, 272/273, 274/275, 276/277, 278/279, 280/281, 282/283, 284/285, 286/287, 288/289, 290/291, 292/293, 294/295, 296/297, 298/299, 300/301, 302/303, 304/305, 306/307, 308/309, 310/311, 312/313, 314/315, 316/317, 318/319, 320/321, 322/323, 324/325, 326/327, 328/329, 330/331, 332/333, 334/335, 336/337, 338/339, 340/341, 342/343, 344/345, 346/347, 348/349, 350/351, 352/353, 354/355, 356/357, 358/359, 360/361, 362/363, 364/365, 366/367, 368/369, 370/371, 372/373, 374/375, 376/377, 378/379, 380/381, 382/383, 384/385, 386/387, 388/389, 390/391, 392/393, 394/395, 396/397, 398/399, 400/401, 402/403, 404/405, 406/407, 408/409, 410/411, 412/413, 414/415, 416/417, 418/419, 420/421, 422/423, 424/425, 426/427, 428/429, 430/431, 432/433, 434/435, 436/437, 438/439, 440/441, 442/443, 444/445, 446/447, 448/449, 450/451, 452/453, 454/455, 456/457, 458/459, 460/461, 462/463, 464/465, 466/467, 468/469, 470/471, 472/473, 474/475, 476/477, 478/479, 480/481, 482/483, 484/485, 486/487, 488/489, 490/491, 492/493, 494/495, 496/497, 498/499, 500/501, 502/503, 504/505, 506/507, 508/509, 510/511, 512/513, 514/515, 516/517, 518/519, 520/521, 522/523, 524/525, 526/527, 528/529, 530/531, 532/533, 534/535, 536/537, 538/539, 540/541, 542/543, 544/545, 546/547, 548/549, 550/551, 552/553, 554/555, 556/557, 558/559, 560/561, 562/563, 564/565, 566/567, 568/569, 570/571, 572/573, 574/575, 576/577, 578/579, 580/581, 582/583, 584/585, 586/587, 588/589, 590/591, 592/593, 594/595, 596/597, 598/599, 600/601, 602/603, 604/605, 606/607, 608/609, 610/611, 612/613, 614/615, 616/617, 618/619, 620/621, 622/623, 624/625, 626/627, 628/629, 630/631, 632/633, 634/635, 636/637, 638/639, 640/641, 642/643, 644/645, 646/647, 648/649, 650/651, 652/653, 654/655, 656/657, 658/659, 660/661, 662/663, 664/665, 666/667, 668/669, 670/671, 672/673, 674/675, 676/677, 678/679, 680/681, 682/683, 684/685, 686/687, 688/689, 690/691, 692/693, 694/695, 696/697, 698/699, 700/701, 702/703, 704/705, 706/707, 708/709, 710/711, 712/713, 714/715, 716/717, 718/719, 720/721, 722/723, 724/725, 726/727, 728/729, 730/731, 732/733, 734/735, 736/737, 738/739, 740/741, 742/743, 744/745, 746/747, 748/749, 750/751, 752/753, 754/755, 756/757, 758/759, 760/761, 762/763, 764/765, 766/767, 768/769, 770/771, 772/773, 774/775, 776/777, 778/779, 780/781, 782/783, 784/785, 786/787, 788/789, 790/791, 792/793, 794/795, 796/797, 798/799, 800/801, 802/803, 804/805, 806/807, 808/809, 810/811, 812/813, 814/815, 816/817, 818/819, 820/821, 822/823, 824/825, 826/827, 828/829, 830/831, 832/833, 834/835, 836/837, 838/839, 840/841, 842/843, 844/845, 846/847, 848/849, 850/851, 852/853, 854/855, 856/857, 858/859, 860/861, 862/863, 864/865, 866/867, 868/869, 870/871, 872/873, 874/875, 876/877, 878/879, 880/881, 882/883, 884/885, 886/887, 888/889, 890/891, 892/893, 894/895, 896/897, 898/899, 900/901, 902/903, 904/905, 906/907, 908/909, 910/911, 912/913, 914/915, 916/917, 918/919, 920/921, 922/923, 924/925, 926/927, 928/929, 930/931, 932/933, 934/935, 936/937, 938/939, 940/941, 942/943, 944/945, 946/947, 948/949, 950/951, 952/953, 954/955, 956/957, 958/959, 960/9

Uttar Gujarat Vij Company Limited
CIN: U40102GU3035GC042505
Registered & Corporate Office: Varnagar Road, Mehsana 384001
Toll free No.1912 0191 10001503350. info@ugvij.com

PUBLIC NOTICE

In the matter of Petitions No. 2254/2023 & 2255/2023 filed before Hon'ble Gujarat Electricity Regulatory Commission

UGVCL has filed petition having No. 2254/2023 & 2255/2023 before Hon'ble Gujarat Electricity Regulatory Commission under Section 63 read with 86(1) (b) and other applicable provisions of the Electricity Act, 2003 for adoption of tariff (discussed under tariff based competitive bidding process) conducted by UGVCL vide R/S No. UGVCL/Project/Solar/2023/001 dated 14.06.2023 for 150 MW of solar power in N-41 for aggregate area 152.876 Mtr for Solarization of 56 nos. open plants in UGVCL for implementation of Feeder Level Solarization under PMP KUSUM Component scheme of MNRE. Gd. In this regard, during the course of hearing held on 4th Oct. 2023, Hon'ble Commission has directed Petitioner to give a public notice for soliciting/raising objections/suggestions/comments of the stakeholders.

UGVCL's website www.ugvij.com. The stakeholders are requested to give their suggestions/objections/comments in this matter on an affidavit in five copies addressed to the Secretary, Gujarat Electricity Regulatory Commission, Chofa, GIDC Zone, Road No.3, Zone-5, Gandhinagar - 382 035, Gandhinagar, Mehsana District, Gujarat & Chief Engineer (P&P), Uttar Gujarat Vij Company Limited, Chief Engineer (P&P), Varnagar Road, MEHSANA-384001, GUJARAT-INDIA within 10 days from the date of this public notice.

Dated 05/10/2023
Chief Engineer (P&P), UGVCL

 **GOVERNMENT OF ODISHA,
“e”-PROCUREMENT NOTICE**
WORKS DEPARTMENT
E-mail: cearoads.bbsr@gmail.com
Bid Identification No. CF-DPBR/2023-24

1. The Chief Engineer (DPI & Road), Odisha on behalf of Government of Odisha invites percentage rate bids in double cover system as **ONLINE MODE**, from eligible contractors for Road work as mentioned below:

No. of work	Road work
1. Nature of work	1.25 Nos.
2. Tender Paper cost	Rs.10000.00
3. Class of Contractor	3. A Class/Special Class/Super Class
4. Availability of bid document in the website	From: 10/03 A.M. of 09.10.2023 to 5.30 PM of 26.10.2023
5. Date of opening of Bid	27.10.2023/5.11.00 A.M.

The Bidders have to participate in **ONLINE** bidding only. Further details can be seen from the website: www.bidsupply.odisha.gov.in. Any/and/or Compulsory Cancellation of tender can also be seen in the said website.

Sd/-
Chief Engineer,
(DPI & Road), Odisha
CPRE: 41111/110109/23.24

**OFFICE OF THE CHIEF CONSTRUCTION ENGINEER
RAWRUM WORKS CIRCLE, BERHAMPUD**

☎ 01232 (E-Mail: newsrwb2004@yahoo.com, Tel/Fax: 0860-26424287)
At: Ampatuan, P.O.-Engineering School Near Income
Tax Office, Berhempu-780011

E-Mail/E-Deposit
NATIONAL COMPETITIVE BIDDING THROUGH A Procurement
Bid Identification No. Online Tender/ 62-2023-24/BPR

Identification No	Name of work	No. of Bids	Approx. Estimated Cost (in lakhs)	Classes of Contract	Period of Completion
Online Tender/ 62-2023-24/BPR	Online/ 62-2023-24/BPR Road Construction maintenance under MBOT TRIP as per year 2023-24	05	From Rs. 571.43 to 152.01 Lakhs	A/Cause of contract as provided	09 (Nine) to 15 (Fifteen) Months as provided

Procurement Officer
Bid Identification No. Availability of tender online
for bidding

Online Tender/ 62-2023-24/BPR	From 06/10/2023 To 26/10/2023
03.00 A	3.00 PM

Chief Construction Engineer,
Rawrum Circle, Berhampu

E-UID: MD Services. Cost of Document is to be transferred through Online as per the procurement method used in the GCEN

Tender documents and related documents through online by the website as per the items mentioned in the single online of the UTCA will also take for the matters of its tender.

Further details & clarifications if any can be seen from the website www.tenderindiaa.gov.in

G.S.-Chief Construction Engineer
R.R Circle, Berhampu